



Appendix F

Preliminary Project Specific Water Quality Management Plan,
Redlands West Industrial
Albert A. Webb Associates
January 2022

FOR REVIEW ONLY


Project Specific Water Quality Management Plan

A Template for Projects located within the **Santa Ana Watershed** Region of Riverside County

Project Title: Redlands West Industrial

Development No:

Design Review/Case No: 20-00020

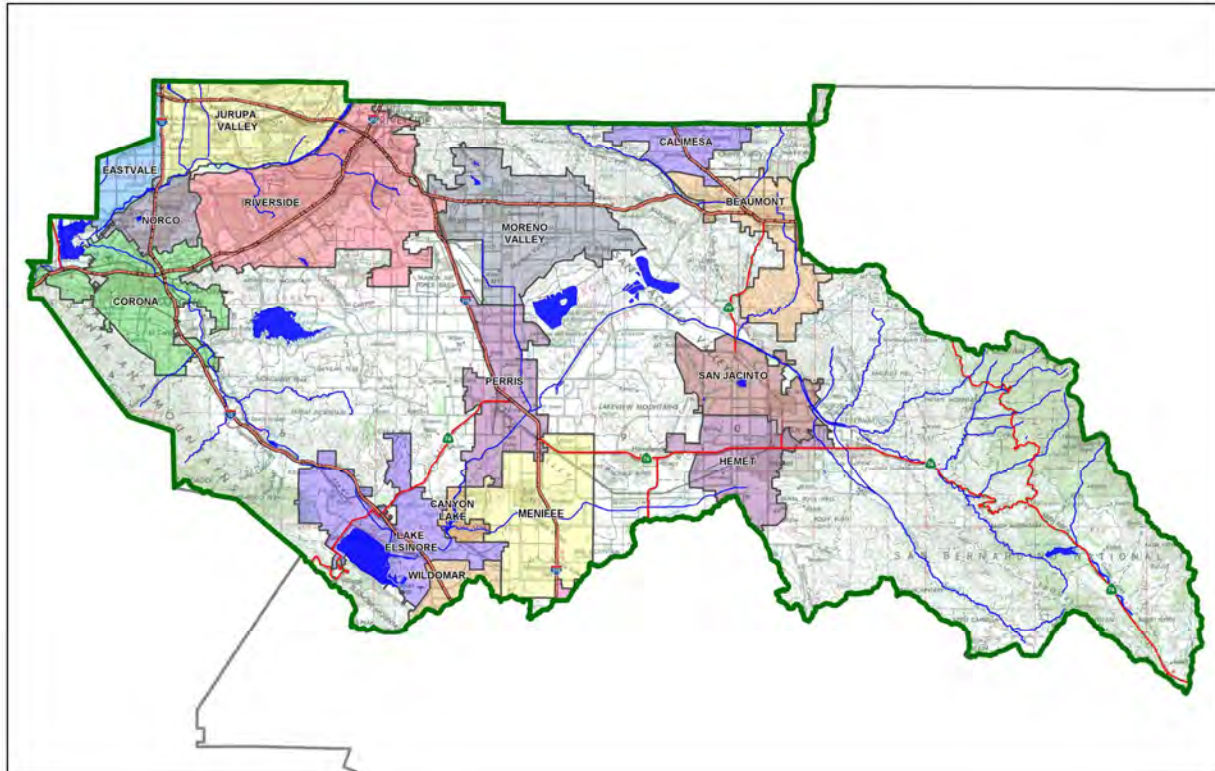

Contact Information:

Prepared for:

Lake Creek Industrial LLC
1302 Brittany Cross Road
Santa Ana, CA 92705
(786) 200 - 9681

Prepared by:

Albert A. Webb Associates
3788 McCray St
Riverside, CA 92506
(951) 686 – 1070
Attn: Teresa (Teri) Gibbs

- Preliminary
- Final


Original Date Prepared: May 2021

Revision Date(s): January 2022

Prepared for Compliance with
Regional Board Order No. R8-2010-0033

A Brief Introduction

This Project-Specific WQMP Template for the **Santa Ana Region** has been prepared to help guide you in documenting compliance for your project. Because this document has been designed to specifically document compliance, you will need to utilize the WQMP Guidance Document as your “how-to” manual to help guide you through this process. Both the Template and Guidance Document go hand-in-hand, and will help facilitate a well prepared Project-Specific WQMP. Below is a flowchart for the layout of this Template that will provide the steps required to document compliance.

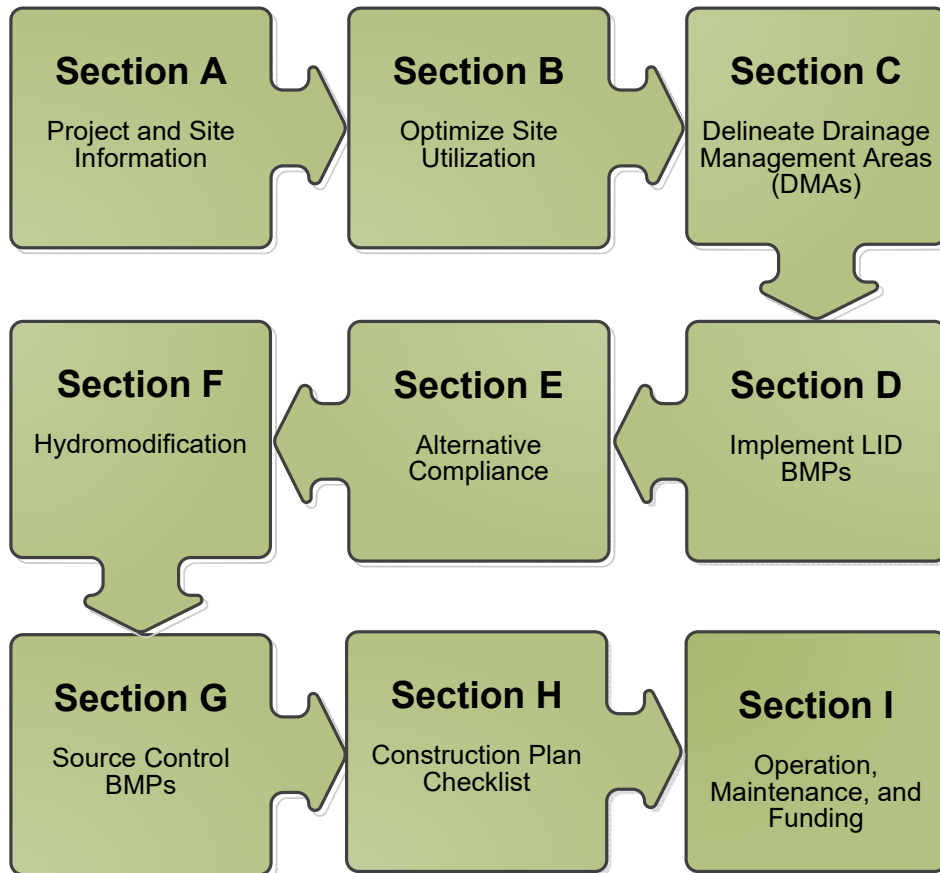


OWNER'S CERTIFICATION

This Project-Specific Water Quality Management Plan (WQMP) has been prepared for Redlands Ave LC, LLC by **Albert A. Webb Associates** for the **Redlands West Industrial** project.

This WQMP is intended to comply with the requirements of **City of Perris** for **Water Quality Ordinance 1194** which includes the requirement for the preparation and implementation of a Project-Specific WQMP.

The undersigned, while owning the property/project described in the preceding paragraph, shall be responsible for the implementation and funding of this WQMP and will ensure that this WQMP is amended as appropriate to reflect up-to-date conditions on the site. In addition, the property owner accepts responsibility for interim operation and maintenance of Stormwater BMPs until such time as this responsibility is formally transferred to a subsequent owner. This WQMP will be reviewed with the facility operator, facility supervisors, employees, tenants, maintenance and service contractors, or any other party (or parties) having responsibility for implementing portions of this WQMP. At least one copy of this WQMP will be maintained at the project site or project office in perpetuity. The undersigned is authorized to certify and to approve implementation of this WQMP. The undersigned is aware that implementation of this WQMP is enforceable under **City of Perris Water Quality Ordinance 1194**.

"I, the undersigned, certify under penalty of law that the provisions of this WQMP have been reviewed and accepted and that the WQMP will be transferred to future successors in interest."



Owner's Signature

Michael Johnson

Owner's Printed Name

01/14/2022

Date

Manager

Owner's Title/Position

See Attached
Certificate

JAN 14 2022
Acknowledgment
Jurat
Copy Certificate

PREPARER'S CERTIFICATION

"The selection, sizing and design of stormwater treatment and other stormwater quality and quantity control measures in this plan meet the requirements of Regional Water Quality Control Board Order No. **R8-2010-0033** and any subsequent amendments thereto."



Preparer's Signature

Teresa Gibbs

Preparer's Printed Name

January 19, 2022

Date

Senior Engineer

Preparer's Title/Position

Preparer's Licensure:



CALIFORNIA ALL-PURPOSE ACKNOWLEDGEMENT

A Notary Public or other officer completing this certificate verifies only the identity of the individual who signed the document to which this certificate is attached, and not the truthfulness, accuracy, or validity of that document.

State of California }

County of Orange

Alka Chowhan-Patel, Notary Public


On 01.14. 2022 before me _____, Notary Public, personally appeared

Michael Graham Johnson

who proved to me on the basis of satisfactory evidence to be the person(s) whose name(s) is/are subscribed to the within instrument and acknowledged to me that he/she/they executed the same in his/her/their authorized capacity(ies), and that by his/her/their signature(s) on the instrument the person(s), or the entity upon behalf of which the person(s) acted, executed the instrument.

I certify under PENALTY OF PERJURY under the laws of State of California that the foregoing paragraph is true and correct.

WITNESS my hand and official seal.

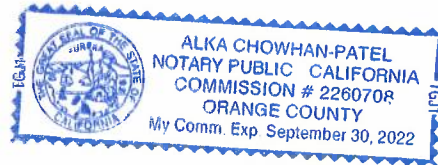

SIGNATURE _____

[Handwritten signature]

PLACE NOTARY SEAL ABOVE

Though the information below is not required by law, it may prove valuable to persons relying on the document and could prevent fraudulent removal and reattachment of this form to another document.

Description of attached document

Title or type of document: Owner's certification

Table of Contents

Section A: Project and Site Information.....	6
Project Description.....	6
A.1 Maps and Site Plans.....	7
A.2 Identify Receiving Waters.....	7
A.3 Additional Permits/Approvals required for the Project:	8
Section B: Optimize Site Utilization (LID Principles)	9
Section C: Delineate Drainage Management Areas (DMAs).....	11
Section D: Implement LID BMPs	13
D.1 Infiltration Applicability	13
D.2 Harvest and Use Assessment.....	14
D.3 Bioretention and Biotreatment Assessment	16
D.4 Feasibility Assessment Summaries	17
D.5 LID BMP Sizing	18
Section E: Alternative Compliance (LID Waiver Program)	21
E.1 Identify Pollutants of Concern	22
E.2 Stormwater Credits	23
E.3 Sizing Criteria.....	23
E.4 Treatment Control BMP Selection	24
Section F: Hydromodification	25
F.1 Hydrologic Conditions of Concern (HCOC) Analysis.....	25
F.2 HCOC Mitigation.....	26
Section G: Source Control BMPs.....	27
Section H: Construction Plan Checklist.....	31
Section I: Operation, Maintenance and Funding.....	32

List of Tables

Table A.1 Identification of Receiving Waters.....	7
Table A.2 Other Applicable Permits.....	8
Table C.1 DMA Classifications.....	11
Table C.2 Type 'A', Self-Treating Areas.....	11
Table C.3 Type 'B', Self-Retaining Areas.....	11
Table C.4 Type 'C', Areas that Drain to Self-Retaining Areas.....	12
Table C.5 Type 'D', Areas Draining to BMPs.....	12
Table D.1 Infiltration Feasibility.....	13
Table D.2 LID Prioritization Summary Matrix.....	17
Table D.3 DCV Calculations for LID BMPs.....	18
Table E.1 Potential Pollutants by Land Use Type.....	22
Table E.2 Water Quality Credits.....	23
Table E.3 Treatment Control BMP Sizing.....	23
Table E.4 Treatment Control BMP Selection.....	24
Table F.1 Hydrologic Conditions of Concern Summary.....	25
Table G.1 Permanent and Operational Source Control Measures.....	27
Table H.1 Construction Plan Cross-reference.....	31

List of Appendices

Appendix 1: Maps and Site Plans.....	33
Appendix 2: Construction Plans.....	34
Appendix 3: Soils Information.....	35
Appendix 4: Historical Site Conditions.....	36
Appendix 5: LID Infeasibility.....	37
Appendix 6: BMP Design Details.....	38
Appendix 7: Hydromodification.....	39
Appendix 8: Source Control.....	40
Appendix 9: O&M.....	41
Appendix 10: Educational Materials.....	42

Section A: Project and Site Information

PROJECT INFORMATION	
Type of Project:	Industrial
Planning Area:	Perris Valley Commercial Center Specific Plan
Community Name:	Perris Valley Commercial Center Specific Plan
Development Name:	Redlands West Industrial DPR 20-00020
PROJECT LOCATION	
Latitude & Longitude (DMS): 33° 49' 36.95"N / 117° 13' 07.97" W	
Project Watershed and Sub-Watershed: Santa Ana Watershed	
APN(s): 300-250-009 - 016	
Map Book and Page No.: Thomas Bros. Map Page 777, Grid H-4	
PROJECT CHARACTERISTICS	
Proposed or Potential Land Use(s)	Light Industrial
Proposed or Potential SIC Code(s)	1541 – General Contractors-Industrial Buildings and Warehouses
Area of Impervious Project Footprint (SF)	759,163 SF
Total Area of <u>proposed</u> Impervious Surfaces within the Project Limits (SF)/or Replacement	759,163 SF
Does the project consist of offsite road improvements?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Does the project propose to construct unpaved roads?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Is the project part of a larger common plan of development (phased project)?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
EXISTING SITE CHARACTERISTICS	
Total area of <u>existing</u> Impervious Surfaces within the project limits (SF)	0 SF
Is the project located within any MSHCP Criteria Cell?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
If so, identify the Cell number:	N/A
Are there any natural hydrologic features on the project site?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Is a Geotechnical Report attached?	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N
If no Geotech. Report, list the NRCS soils type(s) present on the site (A, B, C and/or D)	B & C
What is the Water Quality Design Storm Depth for the project?	0.2 in/hr

Project Description

The Redlands West Industrial project proposes a warehouse/industrial building (approximately 334,040 SF) within the City of Perris on approximately 20.1 acres of currently vacant land. The proposed project cover will be a combination of approximately 334,040 square feet of building, 425,123 square feet of pavement, and 118,146 square feet of landscape. The project is bounded by Redlands Ave to its east, vacant land to its northeast, an existing industrial building to its northwest, an existing residential tract (TR 04417) to its west, and vacant land to its south. The surrounding roads are Rider St to the north and Placentia Ave to the south. The Redlands West project consists of a proposed industrial building along with all associated utilities, drive aisles, parking stalls, walkways, and landscaped areas.

In the existing condition, the project site generally drains from west to east but is quite flat overall (slopes under 1%). Runoff exits the site into natural conditions along Redlands Ave near the eastern boundary of the project site. Larger storm events spill over Redlands Ave and continue to flow eastwards

towards the Perris Valley Storm Drain (PVSD) Channel and ultimately discharges into the San Jacinto River.

For the proposed conditions, runoff is captured through a series of catch basins and inlets located throughout the site. Captured flows are then directed towards proposed treatment devices for water quality requirements. Treated flows are then directed towards proposed underground storage chambers in order to mitigate the peak flow rates exiting the site. The storage chambers proposed are 45-inch tall ADS MC-3500 Stormtech chamber with varying widths of perimeter stone within an approximate footprint of 459'x37' that contribute to the total storage volume, design calculations and drawings can be found in Appendix 6. Mitigated flows are then discharged into the proposed extension of Lateral A-B-10 located along Redlands Ave via a proposed pump (preliminarily sized with a capacity of Q= 5.0 cfs) and a preliminary outlet structure. These mitigated flows are conveyed north towards the existing MDP Line A-B which ultimately discharges into the PVSD Channel.

Due to site constraints, including poor infiltration rates of the existing soil, five (5) Modular Wetland System (MWS) treatment vault is being proposed in tandem with any inlets (or roof drains) in order to treat for water quality requirements. There are multiple MWS treatment vaults being proposed that will vary in size (4'x8', 8'x20', and 8'x24'), to properly convey the flows from each drainage management area. The proposed MWS treatment vaults are classified as biotreatment devices per the WQMP guidelines. All captured onsite runoff will then be directed towards proposed underground storage chambers. Although the project is HCOC exempt, the underground storage chambers ensure that the capacity of MDP Line A-B is not exceeded by the development of the Redlands West project. Details regarding the reallocated capacity of MDP Line A-B can be found in the Technical Memorandum titled "Perris Valley MDP: Line A-B and Line A-C Tributary Watershed Modification" dated February 12, 2020. Mitigation design calculations and drawings can be found in the separate drainage study prepared for P20-00020.

A.1 Maps and Site Plans

When completing your Project-Specific WQMP, include a map of the local vicinity and existing site. In addition, include all grading, drainage, landscape/plant palette and other pertinent construction plans in Appendix 2. At a **minimum**, your WQMP Site Plan should include the following:

- Drainage Management Areas
- Proposed Structural BMPs
- Drainage Path
- Drainage Infrastructure, Inlets, Overflows
- Source Control BMPs
- Buildings, Roof Lines, Downspouts
- Impervious Surfaces
- Standard Labeling

Use your discretion on whether or not you may need to create multiple sheets or can appropriately accommodate these features on one or two sheets. Keep in mind that the Co-Permittee plan reviewer must be able to easily analyze your project utilizing this template and its associated site plans and maps.

A.2 Identify Receiving Waters

Using Table A.1 below, list in order of upstream to downstream, the receiving waters that the project site is tributary to. Continue to fill each row with the Receiving Water's 303(d) listed impairments (if any), designated beneficial uses, and proximity, if any, to a RARE beneficial use. Include a map of the receiving waters in Appendix 1.

Table A.1 Identification of Receiving Waters

Receiving Waters	EPA Approved 303(d) List Impairments	Designated Beneficial Uses	Proximity to RARE Beneficial Use
Perris Valley Storm Drain Channel	N/A	AGR, GWR, MUN, REC1, REC2, WARM, WILD	N/A
San Jacinto River Reach 3 (HU 802.11)	N/A	AGR, GWR, MUN, REC1, REC2, WARM, WILD	N/A
San Jacinto River Reach 2 (HU 802.11)	N/A	GWR, AGR, WILD, WARM, REC1, REC2, MUN	N/A
Canyon Lake (Railroad Canyon Reservoir) (HU 802.11)	Pathogens, Nutrients	AGR, REC1, MUN, GWR, WARM, REC2, WILD	N/A
San Jacinto River Reach 1 (HU 802.32)	N/A	AGR, GWR, MUN, REC1, REC2, WARM, WILD	N/A
Lake Elsinore (HU 802.31)	PCBs, Nutrients, Organic Enrichment/Low Dissolved Oxygen, Sediment Toxicity, Unknown Toxicity	MUN, REC1, REC2, WARM, WILD, AGR, PROC	N/A

A.3 Additional Permits/Approvals required for the Project:

Table A.2 Other Applicable Permits

Agency	Permit Required	
State Department of Fish and Game, 1602 Streambed Alteration Agreement	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
State Water Resources Control Board, Clean Water Act (CWA) Section 401 Water Quality Cert.	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
US Army Corps of Engineers, CWA Section 404 Permit	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
US Fish and Wildlife, Endangered Species Act Section 7 Biological Opinion	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
Statewide Construction General Permit Coverage	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
Statewide Industrial General Permit Coverage (<i>dependent on tenant</i>)	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
Western Riverside MSHCP Consistency Approval (e.g., JPR, DBESP)	<input type="checkbox"/> Y	<input type="checkbox"/> N
Other (<i>please list in the space below as required</i>) City of Perris Grading Permit	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N

If yes is answered to any of the questions above, the Co-Permittee may require proof of approval/coverage from those agencies as applicable including documentation of any associated requirements that may affect this Project-Specific WQMP.

Section B: Optimize Site Utilization (LID Principles)

Review of the information collected in Section 'A' will aid in identifying the principal constraints on site design and selection of LID BMPs as well as opportunities to reduce imperviousness and incorporate LID Principles into the site and landscape design. For example, **constraints** might include impermeable soils, high groundwater, groundwater pollution or contaminated soils, steep slopes, geotechnical instability, high-intensity land use, heavy pedestrian or vehicular traffic, utility locations or safety concerns. **Opportunities** might include existing natural areas, low areas, oddly configured or otherwise unbuildable parcels, easements and landscape amenities including open space and buffers (which can double as locations for bioretention BMPs), and differences in elevation (which can provide hydraulic head). Prepare a brief narrative for each of the site optimization strategies described below. This narrative will help you as you proceed with your LID design and explain your design decisions to others.

The 2010 Santa Ana MS4 Permit further requires that LID Retention BMPs (Infiltration Only or Harvest and Use) be used unless it can be shown that those BMPs are infeasible. Therefore, it is important that your narrative identify and justify if there are any constraints that would prevent the use of those categories of LID BMPs. Similarly, you should also note opportunities that exist which will be utilized during project design. Upon completion of identifying Constraints and Opportunities, include these on your WQMP Site plan in Appendix 1.

Site Optimization

The following questions are based upon Section 3.2 of the WQMP Guidance Document. Review of the WQMP Guidance Document will help you determine how best to optimize your site and subsequently identify opportunities and/or constraints, and document compliance.

Did you identify and preserve existing drainage patterns? If so, how? If not, why?

The existing site is very flat but generally drains from west to east. Runoff exits the site through the eastern boundary and ultimately drains towards the PVSD Channel located approximately 2000 feet east of the site. In the developed condition, a network of catch basins and inlets will collect flows. Treated flows are then conveyed towards the proposed underground storage chambers for mitigation purposes. A preliminary outlet structure and preliminarily sized pump then discharge flows towards the extension of Lateral A-B-10. From there, flows are conveyed north into the existing MDP Line A-B. MDP Line A-B ultimately conveys these flows from west to east into the PVSD Channel similar to the existing flows.

Did you identify and protect existing vegetation? If so, how? If not, why?

The existing vegetation is very minimal. The existing project site is primarily barren, so no existing vegetation is proposed to be protected.

Did you identify and preserve natural infiltration capacity? If so, how? If not, why?

Per a geotechnical investigation, the recommended design infiltration rates vary from 0.4 to 1.1 throughout the site. Due to poor infiltration capacities within the underlying soils of the project site, an infiltration-based BMP is not feasible to treat for water quality requirements. A copy of the investigation report can be found in Appendix 3.

Did you identify and minimize impervious area? If so, how? If not, why?

The impervious area will be minimized as much as possible while maintaining safe and usable facilities onsite. Landscaped areas have been provided throughout the project site along concrete walkways,

around the proposed building, adjacent to parking areas, and in other feasible locations throughout the site.

Did you identify and disperse runoff to adjacent pervious areas? If so, how? If not, why?

Yes, however, based on the nature of the industrial development, not all runoff can feasibly be directed towards a pervious area before being captured. Pervious landscaped areas are proposed around the proposed buildings in order to maximize the chances of runoff dispersing into landscaped areas before being captured. All inlets located onsite are provided with an MWS Treatment Vault to provide water quality treatment.

Section C: Delineate Drainage Management Areas (DMAs)

Utilizing the procedure in Section 3.3 of the WQMP Guidance Document which discusses the methods of delineating and mapping your project site into individual DMAs, complete Table C.1 below to appropriately categorize the types of classification (e.g., Type A, Type B, etc.) per DMA for your project site. Upon completion of this table, this information will then be used to populate and tabulate the corresponding tables for their respective DMA classifications.

Table C.1 DMA Classifications

DMA Name or ID	Surface Type(s) ¹	Area (Sq. Ft.)	DMA Type
DMA 1	Mixed Use – Concrete/Asphalt and Ornamental Landscaping	188,730	D-Biotreatment
DMA 2	Mixed Use – Concrete/Asphalt and Ornamental Landscaping	130,427	D-Biotreatment
DMA 3	Mixed Use – Concrete/Asphalt and Ornamental Landscaping	130,628	D-Biotreatment
DMA 4	Roofs	170,501	D-Biotreatment
DMA 5	Roofs	159,836	D-Biotreatment
DMA 6	Mixed Use – Concrete/Asphalt and Ornamental Landscaping	18,521	D-Biotreatment
DMA 7	Mixed Use – Concrete/Asphalt and Ornamental Landscaping	35,720	D-Biotreatment

¹Reference Table 2-1 in the WQMP Guidance Document to populate this column

Table C.2 Type ‘A’, Self-Treating Areas

DMA Name or ID	Area (Sq. Ft.)	Stabilization Type	Irrigation Type (if any)

Table C.3 Type ‘B’, Self-Retaining Areas

Self-Retaining Area				Type ‘C’ DMAs that are draining to the Self-Retaining Area		
DMA Name/ ID	Post-project surface type	Area (square feet) [A]	Storm Depth (inches) [B]	DMA Name / ID	[C] from Table C.4 = [C]	Required Retention Depth (inches) [D]
DMA 1 - Self-Retaining	LANDSCAPE	9,166	0.64	N/A	N/A	N/A
DMA 2 - Self-Retaining	LANDSCAPE	3,006	0.64	N/A	N/A	N/A

$$[D] = [B] + \frac{[B] \cdot [C]}{[A]}$$

Table C.4 Type 'C', Areas that Drain to Self-Retaining Areas

DMA					Receiving Self-Retaining DMA		
DMA Name/ ID	Area (square feet)	Post-project surface type	Runoff factor	Product	DMA name /ID	Area (square feet)	Ratio
	[A]		[B]	[C] = [A] x [B]		[D]	[C]/[D]

Table C.5 Type 'D', Areas Draining to BMPs

DMA Name or ID	BMP Name or ID
DMA 1	MWS Vault (8' x 24')
DMA 2	MWS Vault (8' x 20')
DMA 3	MWS Vault (8' x 20')
DMA 4	MWS Vault (8' x 24')
DMA 5	MWS Vault (8' x 24')
DMA 6	MWS Vault (4' x 8')
DMA 7	MWS Vault (4' x 8')
DMA 1-7	ADS Underground Storage Chambers (Not used for BMP volume calculations)

Note: More than one drainage management area can drain to a single LID BMP, however, one drainage management area may not drain to more than one BMP.

Section D: Implement LID BMPs

D.1 Infiltration Applicability

Is there an approved downstream ‘Highest and Best Use’ for stormwater runoff (see discussion in Chapter 2.4.4 of the WQMP Guidance Document for further details)? Y N

If yes has been checked, Infiltration BMPs shall not be used for the site. If no, continue working through this section to implement your LID BMPs. It is recommended that you contact your Co-Permittee to verify whether or not your project discharges to an approved downstream ‘Highest and Best Use’ feature.

Geotechnical Report

A Geotechnical Report or Phase I Environmental Site Assessment may be required by the Copermitttee to confirm present and past site characteristics that may affect the use of Infiltration BMPs. In addition, the Co-Permittee, at their discretion, may not require a geotechnical report for small projects as described in Chapter 2 of the WQMP Guidance Document. If a geotechnical report has been prepared, include it in Appendix 3. In addition, if a Phase I Environmental Site Assessment has been prepared, include it in Appendix 4.

Is this project classified as a small project consistent with the requirements of Chapter 2 of the WQMP Guidance Document? Y N

Infiltration Feasibility

Table D.1 below is meant to provide a simple means of assessing which DMAs on your site support Infiltration BMPs and is discussed in the WQMP Guidance Document in Chapter 2.4.5. Check the appropriate box for each question and then list affected DMAs as applicable. If additional space is needed, add a row below the corresponding answer.

Table D.1 Infiltration Feasibility

Does the project site...	YES	NO
...have any DMAs with a seasonal high groundwater mark shallower than 10 feet? If Yes, list affected DMAs:		X
...have any DMAs located within 100 feet of a water supply well? If Yes, list affected DMAs:		X
...have any areas identified by the geotechnical report as posing a public safety risk where infiltration of stormwater could have a negative impact? If Yes, list affected DMAs:		X
...have measured in-situ infiltration rates of less than 1.6 inches / hour? If Yes, list affected DMAs: All DMAs	X	
...have significant cut and/or fill conditions that would preclude in-situ testing of infiltration rates at the final infiltration surface? If Yes, list affected DMAs:		X
...geotechnical report identify other site-specific factors that would preclude effective and safe infiltration? Describe here:		X

If you answered “Yes” to any of the questions above for any DMA, Infiltration BMPs should not be used for those DMAs and you should proceed to the assessment for Harvest and Use below.

D.2 Harvest and Use Assessment

Please check what applies:

- Reclaimed water will be used for the non-potable water demands for the project.
- Downstream water rights may be impacted by Harvest and Use as approved by the Regional Board (verify with the Copermittee).
- The Design Capture Volume will be addressed using Infiltration Only BMPs. In such a case, Harvest and Use BMPs are still encouraged, but it would not be required if the Design Capture Volume will be infiltrated or evapotranspired.

If any of the above boxes have been checked, Harvest and Use BMPs need not be assessed for the site. If neither of the above criteria applies, follow the steps below to assess the feasibility of irrigation use, toilet use and other non-potable uses (e.g., industrial use).

Irrigation Use Feasibility

Complete the following steps to determine the feasibility of harvesting stormwater runoff for Irrigation Use BMPs on your site:

Step 1: Identify the total area of irrigated landscape on the site, and the type of landscaping used.

Total Area of Irrigated Landscape: N/A

Type of Landscaping (Conservation Design or Active Turf): N/A

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for irrigation use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: N/A

Step 3: Cross reference the Design Storm depth for the project site (see Exhibit A of the WQMP Guidance Document) with the left column of Table 2-3 in Chapter 2 to determine the minimum area of Effective Irrigated Area per Tributary Impervious Area (EIATIA).

Enter your EIATIA factor: N/A

Step 4: Multiply the unit value obtained from Step 3 by the total of impervious areas from Step 2 to develop the minimum irrigated area that would be required.

Minimum required irrigated area: N/A

Step 5: Determine if harvesting stormwater runoff for irrigation use is feasible for the project by comparing the total area of irrigated landscape (Step 1) to the minimum required irrigated area (Step 4).

Minimum required irrigated area (Step 4)	Available Irrigated Landscape (Step 1)
N/A	N/A

Toilet Use Feasibility

Complete the following steps to determine the feasibility of harvesting stormwater runoff for toilet flushing uses on your site:

Step 1: Identify the projected total number of daily toilet users during the wet season, and account for any periodic shut downs or other lapses in occupancy:

Projected Number of Daily Toilet Users: N/A

Project Type: N/A

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for toilet use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: N/A

Step 3: Enter the Design Storm depth for the project site (see Exhibit A) into the left column of Table 2-1 in Chapter 2 to determine the minimum number of toilet users per tributary impervious acre (TUTIA).

Enter your TUTIA factor: N/A

Step 4: Multiply the unit value obtained from Step 3 by the total of impervious areas from Step 2 to develop the minimum number of toilet users that would be required.

Minimum number of toilet users: N/A

Step 5: Determine if harvesting stormwater runoff for toilet flushing use is feasible for the project by comparing the Number of Daily Toilet Users (Step 1) to the minimum required number of toilet users (Step 4).

Minimum required Toilet Users (Step 4)	Projected number of toilet users (Step 1)
N/A	N/A

Other Non-Potable Use Feasibility

Are there other non-potable uses for stormwater runoff on the site (e.g. industrial use)? See Chapter 2 of the Guidance for further information. If yes, describe below. If no, write N/A.

N/A

Step 1: Identify the projected average daily non-potable demand, in gallons per day, during the wet season and accounting for any periodic shut downs or other lapses in occupancy or operation.

Average Daily Demand: N/A

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for the identified non-potable use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: N/A

Step 3: Enter the Design Storm depth for the project site (see Exhibit A) into the left column of Table 2-3 in Chapter 2 to determine the minimum demand for non-potable uses per tributary impervious acre.

Enter the factor from Table 2-3: N/A

Step 4: Multiply the unit value obtained from Step 4 by the total of impervious areas from Step 3 to develop the minimum number of gallons per day of non-potable use that would be required.

Minimum required use: N/A

Step 5: Determine if harvesting stormwater runoff for other non-potable use is feasible for the project by comparing the Number of Daily Toilet Users (Step 1) to the minimum required number of toilet users (Step 4).

Minimum required non-potable use (Step 4)	Projected average daily use (Step 1)
N/A	N/A

If Irrigation, Toilet and Other Use feasibility anticipated demands are less than the applicable minimum values, Harvest and Use BMPs are not required and you should proceed to utilize LID Bioretention and Biotreatment, unless a site-specific analysis has been completed that demonstrates technical infeasibility as noted in D.3 below.

D.3 Bioretention and Biotreatment Assessment

Other LID Bioretention and Biotreatment BMPs as described in Chapter 2.4.7 of the WQMP Guidance Document are feasible on nearly all development sites with sufficient advance planning.

Select one of the following:

LID Bioretention/Biotreatment BMPs will be used for some or all DMAs of the project as noted below in Section D.4 (note the requirements of Section 3.4.2 in the WQMP Guidance Document).

A site-specific analysis demonstrating the technical infeasibility of all LID BMPs has been performed and is included in Appendix 5. If you plan to submit an analysis demonstrating the technical infeasibility of LID BMPs, request a pre-submittal meeting with the Copermittee to discuss this option. Proceed to Section E to document your alternative compliance measures.

D.4 Feasibility Assessment Summaries

From the Infiltration, Harvest and Use, Bioretention and Biotreatment Sections above, complete Table D.2 below to summarize which LID BMPs are technically feasible, and which are not, based upon the established hierarchy.

Table D.2 LID Prioritization Summary Matrix

DMA Name/ID	LID BMP Hierarchy				No LID (Alternative Compliance)
	1. Infiltration	2. Harvest and use	3. Bioretention	4. Biotreatment	
DMA 1	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
DMA 2	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
DMA 3	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
DMA 4	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
DMA 5	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
DMA 6	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
DMA 7	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

For those DMAs where LID BMPs are not feasible, provide a brief narrative below summarizing why they are not feasible, include your technical infeasibility criteria in Appendix 5, and proceed to Section E below to document Alternative Compliance measures for those DMAs. Recall that each proposed DMA must pass through the LID BMP hierarchy before alternative compliance measures may be considered.

The sizing information for the proposed MWS treatment vaults can be found in Table D.3. The underground chambers are intended to be used for mitigation/storage purposes only and not as a BMP. The design calculations and drawings for the underground storage chambers can be found in Appendix 6 and the separate drainage study prepared for P20-00020.

D.5 LID BMP Sizing

Each LID BMP must be designed to ensure that the Design Capture Volume will be addressed by the selected BMPs. First, calculate the Design Capture Volume for each LID BMP using the V_{BMP} worksheet in Appendix F of the LID BMP Design Handbook. Second, design the LID BMP to meet the required V_{BMP} using a method approved by the Copermittee. Utilize the worksheets found in the LID BMP Design Handbook or consult with your Copermittee to assist you in correctly sizing your LID BMPs. Complete Table D.3 below to document the Design Capture Volume and the Proposed Volume for each LID BMP. Provide the completed design procedure sheets for each LID BMP in Appendix 6. You may add additional rows to the table below as needed.

Table D.3 DCV Calculations for LID BMPs

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	BMP ID -		
						DMA 1		
	[A]		[B]	[C]	[A] x [C]			
DMA 1 – Concrete / Asphalt	154179	Concrete or Asphalt	1	0.89	137527.6	Design Rainfall Intensity (in/hr)	Design Flow Rate, Q_{BMP} (cfs)	Proposed Flow Rate (cfs)
DMA 1 - L/S	25385	Ornamental Landscaping	0.1	0.11	2804			
DMA 1 – Self-Retaining	9166	Ornamental Landscaping	0.1	0.11	1012.5			
	$A_T = \Sigma[A]$ 188731				$\Sigma = [D]$ 141344.1	[E] 0.2	$[F] = \frac{[D] \times [E]}{12}$ 0.6	[G] 0.7

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	BMP ID -		
						DMA 2		
	[A]		[B]	[C]	[A] x [C]			
DMA 2 – Concrete / Asphalt	112321	Concrete or Asphalt	1	0.89	100189.9	Design Rainfall Intensity (in/hr)	Design Flow Rate, Q_{BMP} (cfs)	Proposed Flow Rate (cfs)
DMA 2 - L/S	15100	Ornamental Landscaping	0.1	0.11	1667.9			
DMA 1 – Self-Retaining	3006	Ornamental Landscaping	0.1	0.11	332			
	$A_T = \Sigma[A]$ 130427				$\Sigma = [D]$ 102189.8	[E] 0.2	$[F] = \frac{[D] \times [E]}{12}$ 0.5	[G] 0.6

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	BMP ID -		
						DMA 3		
	[A]		[B]	[C]	[A] x [C]			
DMA 3 – Concrete / Asphalt	123739	Concrete or Asphalt	1	0.89	110375.2	Design Rainfall Intensity (in/hr)	Design Flow Rate, Q _{BMP} (cfs)	Proposed Flow Rate (cfs)
DMA 3 - L/S	6889	Ornamental Landscaping	0.1	0.11	760.9			
	A _T = Σ[A] 130628				Σ= [D] 111136.1	[E] 0.2	[F] = $\frac{[D] \times [E]}{12}$ 0.5	[G] 0.6

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	BMP ID -		
						DMA 4		
	[A]		[B]	[C]	[A] x [C]			
DMA 4 – Roofs	170501	Roofs	1	0.89	152086.9	Design Rainfall Intensity (in/hr)	Design Flow Rate, Q _{BMP} (cfs)	Proposed Flow Rate (cfs)
	A _T = Σ[A] 170501				Σ= [D] 152086.9	[E] 0.2	[F] = $\frac{[D] \times [E]}{12}$ 0.7	[G] 0.7

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	BMP ID -		
						DMA 5		
	[A]		[B]	[C]	[A] x [C]			
DMA 5 – Roofs	159836	Roofs	1	0.89	142573.7	Design Rainfall Intensity (in/hr)	Design Flow Rate, Q _{BMP} (cfs)	Proposed Flow Rate (cfs)
	A _T = Σ[A] 159836				Σ= [D] 142573.7	[E] 0.2	[F] = $\frac{[D] \times [E]}{12}$ 0.7	[G] 0.7

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	BMP ID - DMA 6 (Redlands Ave)		
	[A]							
DMA 6 – Concrete / Asphalt	16221	Concrete or Asphalt	1	0.89	14469.1	Design Rainfall Intensity (in/hr)	Design Flow Rate, Q _{BMP} (cfs)	Proposed Flow Rate (cfs)
DMA 6 - L/S	2300	Ornamental Landscaping	0.1	0.11	254.1			
	A _T = Σ[A] 18521				Σ= [D] 14723.2	[E] 0.2	[F] = $\frac{[D] \times [E]}{12}$ 0.1	[G] 0.1

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	BMP ID - DMA 7 (Redlands Ave)		
	[A]							
DMA 7 – Concrete / Asphalt	27651	Concrete or Asphalt	1	0.89	24664.7	Design Rainfall Intensity (in/hr)	Design Flow Rate, Q _{BMP} (cfs)	Proposed Flow Rate (cfs)
DMA 7 - L/S	8069	Ornamental Landscaping	0.1	0.11	891.3			
	A _T = Σ[A] 35720				Σ= [D] 25556	[E] 0.2	[F] = $\frac{[D] \times [E]}{12}$ 0.1	[G] 0.1

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

This section is for water quality treatment, which is being considered as flow based and will be treated by the proposed MWS vaults. Although this project is HCOC exempt, due to inadequate infiltration rates, the underground chambers are proposed only for storage in order to mitigate discharged flows from large storm events to an acceptable rate for Lat A-B-10. Mitigation design calculations and drawings can be found in the separate drainage study prepared for P20-00021.

Section E: Alternative Compliance (LID Waiver Program)

LID BMPs are expected to be feasible on virtually all projects. Where LID BMPs have been demonstrated to be infeasible as documented in Section D, other Treatment Control BMPs must be used (subject to LID waiver approval by the Copermittee). Check one of the following Boxes:

LID Principles and LID BMPs have been incorporated into the site design to fully address all Drainage Management Areas. No alternative compliance measures are required for this project and thus this Section is not required to be completed.

- Or -

The following Drainage Management Areas are unable to be addressed using LID BMPs. A site-specific analysis demonstrating technical infeasibility of LID BMPs has been approved by the Co-Permittee and included in Appendix 5. Additionally, no downstream regional and/or sub-regional LID BMPs exist or are available for use by the project. The following alternative compliance measures on the following pages are being implemented to ensure that any pollutant loads expected to be discharged by not incorporating LID BMPs, are fully mitigated.

The sizing information for the proposed MWS treatment vaults can be found in Table D.3. The underground chambers are intended to be used for mitigation/storage purposes only and not as a BMP. The design calculations and drawings for the underground storage chambers can be found in Appendix 6 and the separate drainage study prepared for P20-00020.

E.1 Identify Pollutants of Concern

Utilizing Table A.1 from Section A above which noted your project's receiving waters and their associated EPA approved 303(d) listed impairments, cross reference this information with that of your selected Priority Development Project Category in Table E.1 below. If the identified General Pollutant Categories are the same as those listed for your receiving waters, then these will be your Pollutants of Concern and the appropriate box or boxes will be checked on the last row. The purpose of this is to document compliance and to help you appropriately plan for mitigating your Pollutants of Concern in lieu of implementing LID BMPs.

Table E.1 Potential Pollutants by Land Use Type

Priority Development Project Categories and/or Project Features (check those that apply)	General Pollutant Categories							
	Bacterial Indicators	Metals	Nutrients	Pesticides	Toxic Organic Compounds	Sediments	Trash & Debris	Oil & Grease
<input type="checkbox"/> Detached Residential Development	P	N	P	P	N	P	P	P
<input type="checkbox"/> Attached Residential Development	P	N	P	P	N	P	P	P ⁽²⁾
<input checked="" type="checkbox"/> Commercial/Industrial Development	P ⁽³⁾	P	P ⁽¹⁾	P ⁽¹⁾	P ⁽⁵⁾	P ⁽¹⁾	P	P
<input type="checkbox"/> Automotive Repair Shops	N	P	N	N	P ^(4, 5)	N	P	P
<input type="checkbox"/> Restaurants (>5,000 ft ²)	P	N	N	N	N	N	P	P
<input type="checkbox"/> Hillside Development (>5,000 ft ²)	P	N	P	P	N	P	P	P
<input type="checkbox"/> Parking Lots (>5,000 ft ²)	P ⁽⁶⁾	P	P ⁽¹⁾	P ⁽¹⁾	P ⁽⁴⁾	P ⁽¹⁾	P	P
<input type="checkbox"/> Retail Gasoline Outlets	N	P	N	N	P	N	P	P
Project Priority Pollutant(s) of Concern	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

P = Potential

N = Not Potential

⁽¹⁾ A potential Pollutant if non-native landscaping exists or is proposed onsite; otherwise not expected

⁽²⁾ A potential Pollutant if the project includes uncovered parking areas; otherwise not expected

⁽³⁾ A potential Pollutant is land use involving animal waste

⁽⁴⁾ Specifically petroleum hydrocarbons

⁽⁵⁾ Specifically solvents

⁽⁶⁾ Bacterial indicators are routinely detected in pavement runoff

E.2 Stormwater Credits

Projects that cannot implement LID BMPs but nevertheless implement smart growth principles are potentially eligible for Stormwater Credits. Utilize Table 3-8 within the WQMP Guidance Document to identify your Project Category and its associated Water Quality Credit. If not applicable, write N/A.

Table E.2 Water Quality Credits

Qualifying Project Categories	Credit Percentage ²
N/A	
Total Credit Percentage ¹	

¹Cannot Exceed 50%

²Obtain corresponding data from Table 3-8 in the WQMP Guidance Document

E.3 Sizing Criteria

After you appropriately considered Stormwater Credits for your project, utilize Table E.3 below to appropriately size them to the DCV, or Design Flow Rate, as applicable. Please reference Chapter 3.5.2 of the WQMP Guidance Document for further information.

Table E.3 Treatment Control BMP Sizing

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Area x Runoff Factor	Enter BMP Name / Identifier Here			
	[A]		[B]	[C]	[A] x [C]				
N/A						Design Storm Depth (in)	Minimum Design Capture Volume or Design Flow Rate (cubic feet or cfs)	Total Storm Water Credit % Reduction	Proposed Volume or Flow on Plans (cubic feet or cfs)
	$A_T = \sum[A]$			$\Sigma = [D]$	[E]	$[F] = \frac{[D] \times [E]}{[G]}$	$[F] \times (1-[H])$	[I]	

[B], [C] is obtained as described in Section 2.3.1 from the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is for Flow-Based Treatment Control BMPs [G] = 43,560, for Volume-Based Control Treatment BMPs, [G] = 12

[H] is from the Total Credit Percentage as Calculated from Table E.2 above

[I] as obtained from a design procedure sheet from the BMP manufacturer and should be included in Appendix 6

The sizing information for the proposed MWS treatment vaults can be found in Table D.3. The underground chambers are intended to be used for mitigation/storage purposes only and not as a BMP. The design calculations and drawings for the underground storage chambers can be found in Appendix 6 and the separate drainage study prepared for P20-00020.

E.4 Treatment Control BMP Selection

Treatment Control BMPs typically provide proprietary treatment mechanisms to treat potential pollutants in runoff, but do not sustain significant biological processes. Treatment Control BMPs must have a removal efficiency of a medium or high effectiveness as quantified below:

- **High:** equal to or greater than 80% removal efficiency
- **Medium:** between 40% and 80% removal efficiency

Such removal efficiency documentation (e.g., studies, reports, etc.) as further discussed in Chapter 3.5.2 of the WQMP Guidance Document, must be included in Appendix 6. In addition, ensure that proposed Treatment Control BMPs are properly identified on the WQMP Site Plan in Appendix 1.

Table E.4 Treatment Control BMP Selection

Selected Treatment Control BMP Name or ID ¹	Priority Pollutant(s) of Concern to Mitigate ²	Removal Efficiency Percentage ³
DMA 1-7	Bacteria/Pathogens	Medium
	Sediment	High

¹ Treatment Control BMPs must not be constructed within Receiving Waters. In addition, a proposed Treatment Control BMP may be listed more than once if they possess more than one qualifying pollutant removal efficiency.

² Cross Reference Table E.1 above to populate this column.

³ As documented in a Co-Permittee Approved Study and provided in Appendix 6.

Section F: Hydromodification

F.1 Hydrologic Conditions of Concern (HCOC) Analysis

Once you have determined that the LID design is adequate to address water quality requirements, you will need to assess if the proposed LID Design may still create a HCOC. Review Chapters 2 and 3 (including Figure 3-7) of the WQMP Guidance Document to determine if your project must mitigate for Hydromodification impacts. If your project meets one of the following criteria which will be indicated by the check boxes below, you do not need to address Hydromodification at this time. However, if the project does not qualify for Exemptions 1, 2 or 3, then additional measures must be added to the design to comply with HCOC criteria. This is discussed in further detail below in Section F.2.

HCOC EXEMPTION 1: The Priority Development Project disturbs less than one acre. The Copermitttee has the discretion to require a Project-Specific WQMP to address HCOCs on projects less than one acre on a case by case basis. The disturbed area calculation should include all disturbances associated with larger common plans of development.

Does the project qualify for this HCOC Exemption? Y N

If Yes, HCOC criteria do not apply.

HCOC EXEMPTION 2: The volume and time of concentration¹ of storm water runoff for the post-development condition is not significantly different from the pre-development condition for a 2-year return frequency storm (a difference of 5% or less is considered insignificant) using one of the following methods to calculate:

- Riverside County Hydrology Manual
- Technical Release 55 (TR-55): Urban Hydrology for Small Watersheds (NRCS 1986), or derivatives thereof, such as the Santa Barbara Urban Hydrograph Method
- Other methods acceptable to the Co-Permittee

Does the project qualify for this HCOC Exemption? Y N

If Yes, report results in Table F.1 below and provide your substantiated hydrologic analysis in Appendix 7.

Table F.1 Hydrologic Conditions of Concern Summary

	2 year – 24 hour		
	Pre-condition	Post-condition	% Difference
Time of Concentration	N/A	N/A	N/A
Volume (Cubic Feet)	N/A	N/A	N/A

¹ Time of concentration is defined as the time after the beginning of the rainfall when all portions of the drainage basin are contributing to flow at the outlet.

HCOC EXEMPTION 3: All downstream conveyance channels to an adequate sump (for example, Prado Dam, Lake Elsinore, Canyon Lake, Santa Ana River, or other lake, reservoir or naturally erosion resistant feature) that will receive runoff from the project are engineered and regularly maintained to ensure design flow capacity; no sensitive stream habitat areas will be adversely affected; or are not identified on the Co-Permittees Hydromodification Sensitivity Maps.

Does the project qualify for this HCOC Exemption? Y N

If Yes, HCOC criteria do not apply and note below which adequate sump applies to this HCOC qualifier:

N/A.

F.2 HCOC Mitigation

If none of the above HCOC Exemption Criteria are applicable, HCOC criteria is considered mitigated if they meet one of the following conditions:

- a. Additional LID BMPS are implemented onsite or offsite to mitigate potential erosion or habitat impacts as a result of HCOCs. This can be conducted by an evaluation of site-specific conditions utilizing accepted professional methodologies published by entities such as the California Stormwater Quality Association (CASQA), the Southern California Coastal Water Research Project (SCCRWP), or other Co-Permittee approved methodologies for site-specific HCOC analysis.
- b. The project is developed consistent with an approved Watershed Action Plan that addresses HCOC in Receiving Waters.
- c. Mimicking the pre-development hydrograph with the post-development hydrograph, for a 2-year return frequency storm. Generally, the hydrologic conditions of concern are not significant, if the post-development hydrograph is no more than 10% greater than pre-development hydrograph. In cases where excess volume cannot be infiltrated or captured and reused, discharge from the site must be limited to a flow rate no greater than 110% of the pre-development 2-year peak flow.

Be sure to include all pertinent documentation used in your analysis of the items a, b or c in Appendix 7.

Project is located within the Hydromodification exemption area based on Riverside County WAP geodatabase approved April 20, 2017. See Appendix 7.

This project is HCOC exempt, however, mitigation is still being proposed due to Line A-B not being originally sized to accept flows from this area. Calculations for storage and routing can be found in Appendix 7. Information regarding the tributary area reallocations can be found in the technical memorandum titled "Perris Valley MDP: Line A-B and Line A-C Tributary Watershed Modification" dated February 12, 2020.

Section G: Source Control BMPs

Source control BMPs include permanent, structural features that may be required in your project plans — such as roofs over and berms around trash and recycling areas — and Operational BMPs, such as regular sweeping and “housekeeping”, that must be implemented by the site’s occupant or user. The MEP standard typically requires both types of BMPs. In general, Operational BMPs cannot be substituted for a feasible and effective permanent BMP. Using the Pollutant Sources/Source Control Checklist in Appendix 8, review the following procedure to specify Source Control BMPs for your site:

1. **Identify Pollutant Sources:** Review Column 1 in the Pollutant Sources/Source Control Checklist. Check off the potential sources of Pollutants that apply to your site.
2. **Note Locations on Project-Specific WQMP Exhibit:** Note the corresponding requirements listed in Column 2 of the Pollutant Sources/Source Control Checklist. Show the location of each Pollutant source and each permanent Source Control BMP in your Project-Specific WQMP Exhibit located in Appendix 1.
3. **Prepare a Table and Narrative:** Check off the corresponding requirements listed in Column 3 in the Pollutant Sources/Source Control Checklist. In the left column of Table G.1 below, list each potential source of runoff Pollutants on your site (from those that you checked in the Pollutant Sources/Source Control Checklist). In the middle column, list the corresponding permanent, Structural Source Control BMPs (from Columns 2 and 3 of the Pollutant Sources/Source Control Checklist) used to prevent Pollutants from entering runoff. **Add additional narrative** in this column that explains any special features, materials or methods of construction that will be used to implement these permanent, Structural Source Control BMPs.
4. **Identify Operational Source Control BMPs:** To complete your table, refer once again to the Pollutant Sources/Source Control Checklist. List in the right column of your table the Operational BMPs that should be implemented as long as the anticipated activities continue at the site. Copermittee stormwater ordinances require that applicable Source Control BMPs be implemented; the same BMPs may also be required as a condition of a use permit or other revocable Discretionary Approval for use of the site.

Table G.1 Permanent and Operational Source Control Measures

Potential Sources of Runoff pollutants	Permanent Structural Source Control BMPs	Operational Source Control BMPs
A. <i>On-site storm drain inlets</i>	<i>Mark all inlets with the words “Only Rain Down the Storm Drain” or similar. Catch Basin Markers may be available from the Riverside County Flood Control and Water Conservation District, call 951.955.1200 to verify.</i>	<i>Maintain and periodically repaint or replace inlet markings. Provide stormwater pollution prevention information to new site owners, lessees, or operators. See applicable operational BMPs in Fact Sheet SC-44, “Drainage System Maintenance,” in the CASQA Stormwater Quality Handbooks at www.cabmphandbooks.com</i>
B. <i>Interior floor drains and elevator shaft sump</i>	<i>The interior floor drains and elevator shaft sump pumps will be plumbed to</i>	<i>Inspect and maintain drains to prevent blockages and overflow.</i>

	<i>sanitary sewer</i>	
<i>C. Landscape/Outdoor Pesticide Use</i>	<p><i>Preserve existing native trees, shrubs, and ground cover to the maximum extent possible.</i></p> <p><i>Design landscaping to minimize irrigation and runoff, to promote surface infiltration where appropriate, and to minimize the use of fertilizers and pesticides that can contribute to stormwater pollution.</i></p> <p><i>Where landscaped areas are used to retain or detain stormwater, specify plants that are tolerant of saturated soil conditions.</i></p> <p><i>Consider using pest-resistant plants, especially adjacent to hardscape.</i></p> <p><i>To ensure successful establishment, select plants appropriate to site soils, slopes, climate, sun, wind, rain, land use, air movement, ecological consistency, and plant interactions.</i></p>	<p><i>Maintain landscaping using minimum or no pesticides.</i></p> <p><i>See applicable operational BMPs in “What you should know for.....Landscape and Gardening” at http://rcflood.org/stormwater/</i></p> <p><i>Provide IPM information to new owners, lessees and operators.</i></p> <p><i>Sweep plazas, sidewalks, and parking lots regularly to prevent accumulation of litter and debris. Collect debris from pressure washing to prevent entry into the storm drain system. Collect washwater containing any cleaning agent or degreaser and discharge to the sanitary sewer not to a storm drain.</i></p>
<i>D. Refuse Areas</i>	<p><i>Trash container storage areas shall be paved with an impervious surface, designed not to allow run-on from adjoining areas, designed to divert drainage from adjoining roofs and pavements from the surrounding area, and screened or walled to prevent off-site transport of trash.</i></p> <p><i>Trash dumpsters (containers) shall be leak proof and have attached covers or lids.</i></p> <p><i>Trash enclosures shall be roofed per City standards.</i></p> <p><i>Trash compactors shall be roofed and set on a concrete pad per City standards. The pad shall be a minimum of one foot larger all around than the trash compactor and sloped to drain to a sanitary sewer line. Connection of trash area drains to the MS4 is prohibited.</i></p> <p><i>See CASQA SD-32 BMP Fact Sheets in Appendix 10 for additional information.</i></p> <p><i>Signs shall be posted on or near dumpsters with the words “Do not dump hazardous materials here” or similar.</i></p>	<p><i>Adequate number of receptacles shall be provided. Inspect receptacles regularly; repair or replace leaky receptacles. Keep receptacles covered.</i></p> <p><i>Prohibit/prevent dumping of liquid or hazardous wastes. Post “no hazardous materials” signs. Inspect and pick up litter daily and clean up spills immediately. Keep spill control materials available on-site. See Fact Sheet SC-34, in Appendix 10, “Waste Handling and Disposal” in the CASQA Stormwater Quality Handbook at www.cabmphandbooks.com</i></p>
<i>E. Vehicle and Equipment</i>	<i>If a car wash area is not provided,</i>	<i>Washwater from vehicle and</i>

<p><i>Cleaning</i></p>	<p><i>describe any measures taken to discourage on-site car washing and explain how these will be enforced.</i></p>	<p><i>equipment washing operations shall not be discharged to the storm drain system. Refer to "Outdoor Cleaning Activities and Professional Mobile Service Providers" for many of the Potential Sources of Runoff Pollutants categories below. Brochure can be found at http://rcflood.org/stormwater/</i></p>
<p><i>F. Plazas, Sidewalks and parking lots.</i></p>		<p><i>Sweep plazas, sidewalks, and parking lots regularly to prevent accumulation of litter and debris. Collect debris from pressure washing to prevent entry into the storm drain system. Collect washwater containing any cleaning agent or degreaser and discharge to the sanitary sewer not to a storm drain.</i></p>
<p><i>G. Loading Docks</i></p>	<p><i>Show a preliminary design for the loading dock area, including roofing and drainage. Loading docks shall be covered and/or graded to minimize runoff to and runoff from the loading area. Roof downspouts shall be positioned to direct stormwater away from the loading area. Water from loading dock areas shall be drained to the sanitary sewer, or diverted and collected for ultimate discharge to the sanitary sewer.</i></p> <p><i>Loading dock areas draining directly to the sanitary sewer shall be equipped with a spill control valve or equivalent device, which shall be kept closed during periods of operation.</i></p> <p><i>Provide a roof overhang over the loading area or install door skirts (cowling) at each bay that enclose the end of the trailer.</i></p>	<p><i>Move loaded and unloaded items indoors as soon as possible.</i></p> <p><i>See Fact Sheet SC-30, "Outdoor Loading and Unloading," in the CASQA Stormwater Quality Handbooks at www.cabmphandbooks.com</i></p>
<p><i>H. Fire Sprinkler Test Water</i></p>	<p><i>Water discharged from the fire sprinkler systems shall not enter the storm drain system. Discharged water from fire sprinkler testing shall be collected and used for onsite landscape or disposed of at a local waste water treatment plant.</i></p>	<p><i>See the note in Fact Sheet SC-41, "Building and Grounds Maintenance," in the CASQA Stormwater Quality Handbooks at www.cabmphandbooks.com</i></p>
<p><i>I. Fuel Dispensing Areas</i></p>		<p><i>The property owner shall dry sweep the fueling area routinely.</i></p> <p><i>See the Fact Sheet SD-30, "Fueling Areas" in the CASQA Stormwater</i></p>

Section H: Construction Plan Checklist

Populate Table H.1 below to assist the plan checker in an expeditious review of your project. The first two columns will contain information that was prepared in previous steps, while the last column will be populated with the corresponding plan sheets. This table is to be completed with the submittal of your final Project-Specific WQMP.

Table H.1 Construction Plan Cross-reference

BMP No. or ID	BMP Identifier and Description	Corresponding Plan Sheet(s)
DMA 1-7	MWS Treatment Vaults	PWQMP Exhibit Sheet 2

Note that the updated table — or Construction Plan WQMP Checklist — is **only a reference tool** to facilitate an easy comparison of the construction plans to your Project-Specific WQMP. Co-Permittee staff can advise you regarding the process required to propose changes to the approved Project-Specific WQMP.

Section H will be completed and addressed during Final WQMP.

Section I: Operation, Maintenance and Funding

The Copermittee will periodically verify that Stormwater BMPs on your site are maintained and continue to operate as designed. To make this possible, your Copermittee will require that you include in Appendix 9 of this Project-Specific WQMP:

1. A means to finance and implement facility maintenance in perpetuity, including replacement cost.
2. Acceptance of responsibility for maintenance from the time the BMPs are constructed until responsibility for operation and maintenance is legally transferred. A warranty covering a period following construction may also be required.
3. An outline of general maintenance requirements for the Stormwater BMPs you have selected.
4. Figures delineating and designating pervious and impervious areas, location, and type of Stormwater BMP, and tables of pervious and impervious areas served by each facility. Geo-locating the BMPs using a coordinate system of latitude and longitude is recommended to help facilitate a future statewide database system.
5. A separate list and location of self-retaining areas or areas addressed by LID Principles that do not require specialized O&M or inspections but will require typical landscape maintenance as noted in Chapter 5, pages 85-86, in the WQMP Guidance. Include a brief description of typical landscape maintenance for these areas.

Your local Co-Permittee will also require that you prepare and submit a detailed Stormwater BMP Operation and Maintenance Plan that sets forth a maintenance schedule for each of the Stormwater BMPs built on your site. An agreement assigning responsibility for maintenance and providing for inspections and certification may also be required.

Details of these requirements and instructions for preparing a Stormwater BMP Operation and Maintenance Plan are in Chapter 5 of the WQMP Guidance Document.

Maintenance Mechanism: Privately maintained by Owner.

Will the proposed BMPs be maintained by a Home Owners' Association (HOA) or Property Owners Association (POA)?


Y N

Include your Operation and Maintenance Plan and Maintenance Mechanism in Appendix 9. Additionally, include all pertinent forms of educational materials for those personnel that will be maintaining the proposed BMPs within this Project-Specific WQMP in Appendix 10.

Section I will be completed and addressed during Final WQMP.

Appendix 1: Maps and Site Plans

Location Map, WQMP Site Plan and Receiving Waters Map

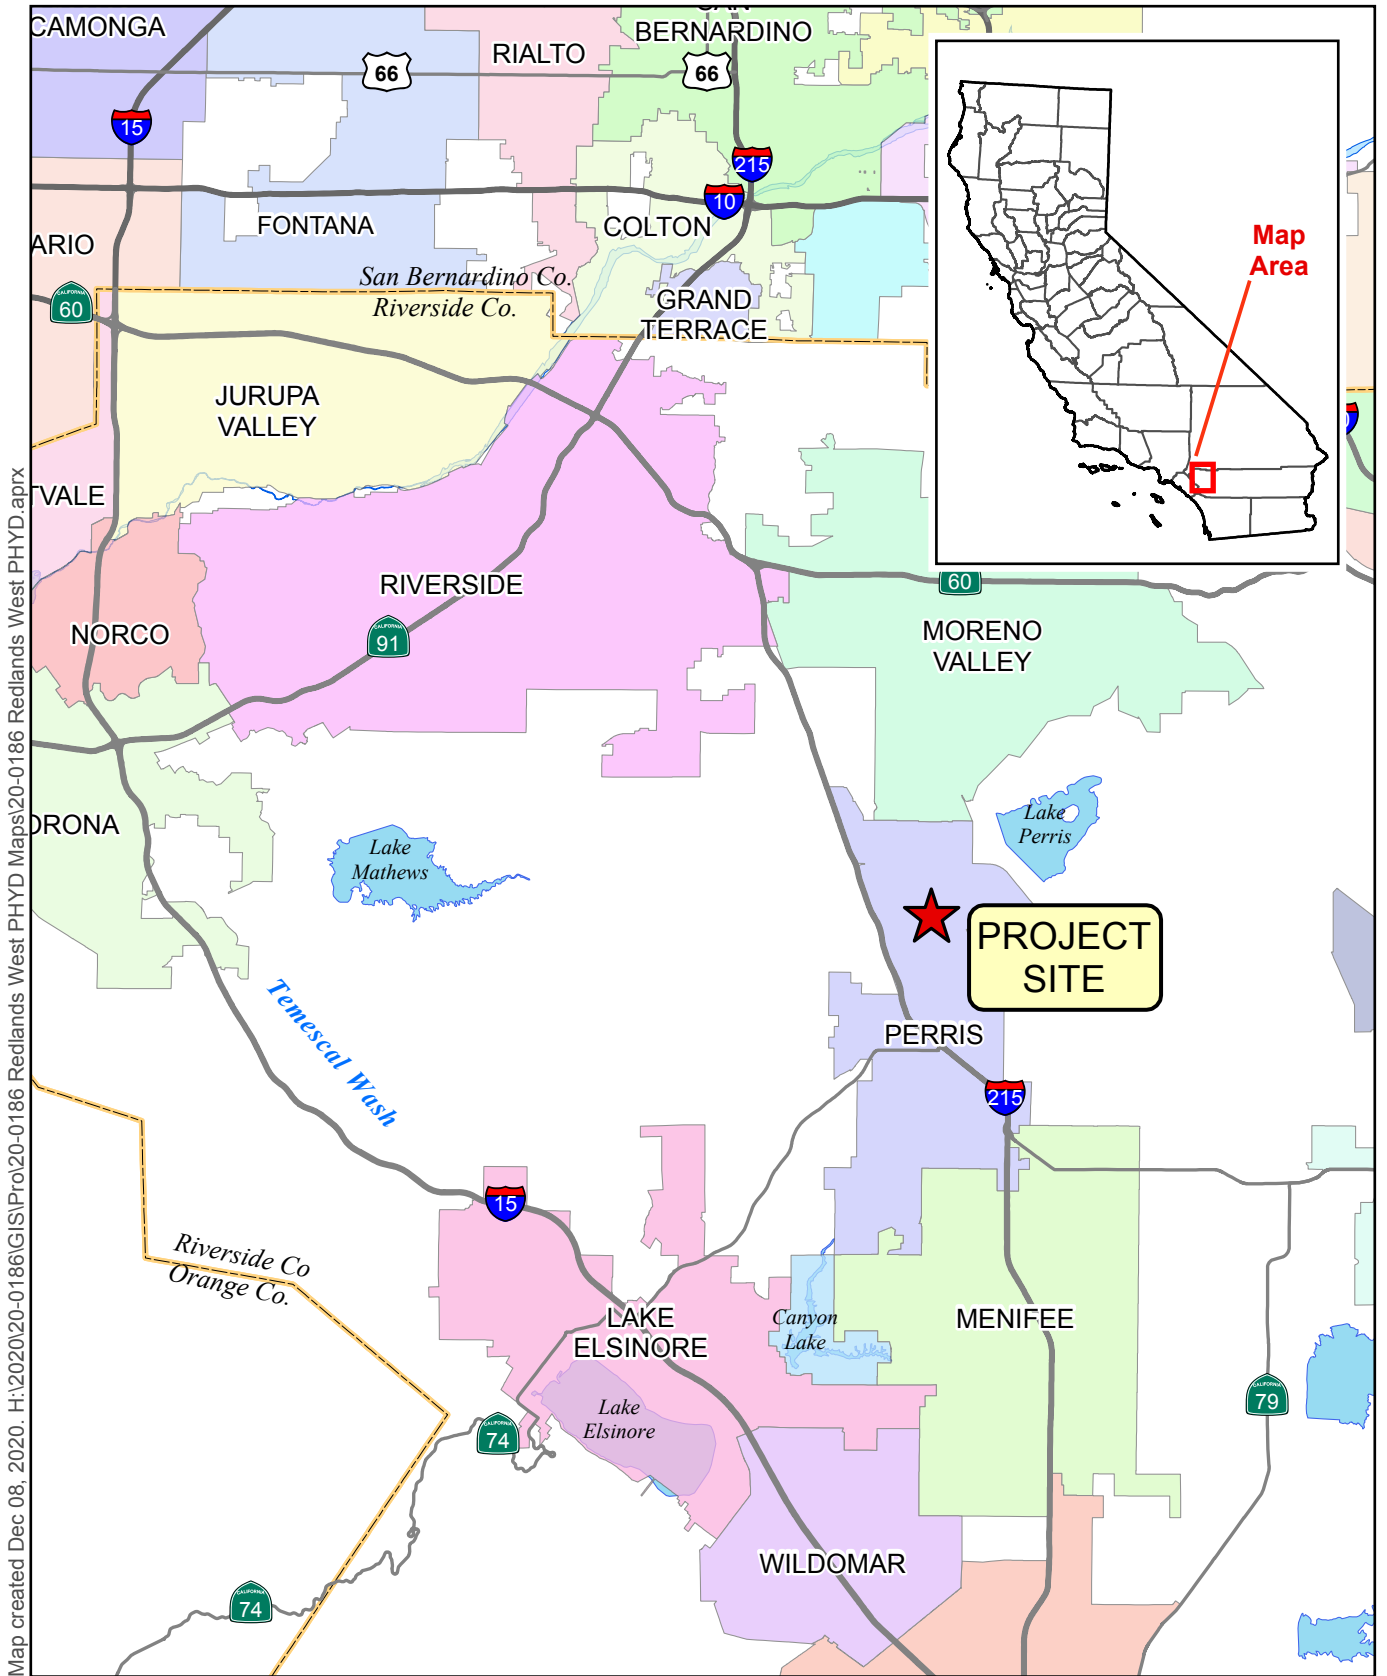


Source: Riverside Co. GIS, 2019

Figure 1 – Vicinity Map
20-0186 Redlands West Industrial



0 2 4 6
Miles

F:\2020\20-0186\GIS\Pro\20-0186 Redlands West.PHYD Maps\20-0186 Redlands West.PHYD.aprx; Map created 08 Dec 2020; ALIS

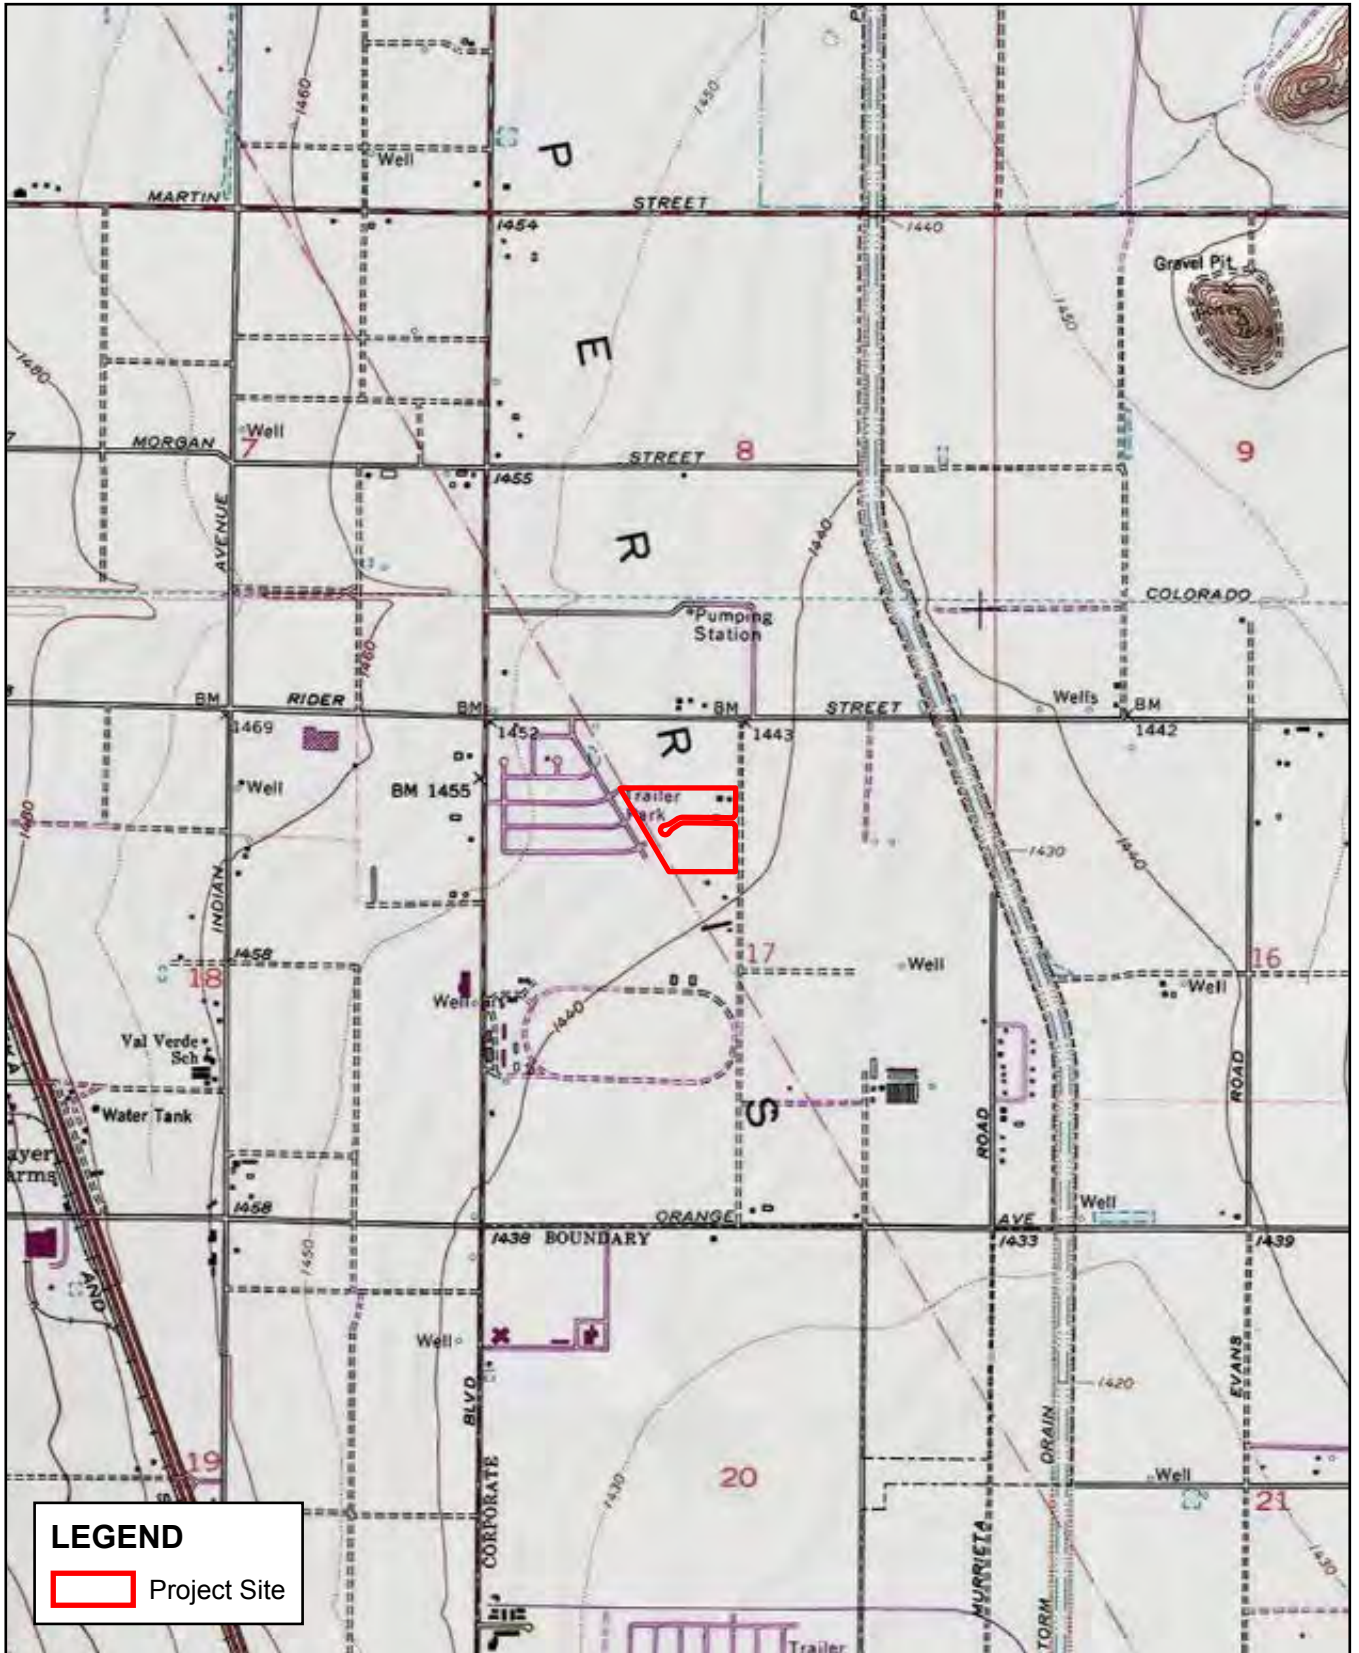


LEGEND


Project Site

Sources: ESRI / USGS 7.5min Quad
DRGs: PERRIS

Figure 2 - USGS Map
20-0186 Redlands West Industrial

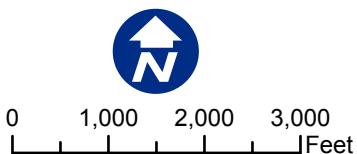


F:\2020\20-0186\GIS\Pro\20-0186 Redlands West.PHYD Maps\20-0186 Redlands West.PHYD.aprx; Map created 08 Dec 2020

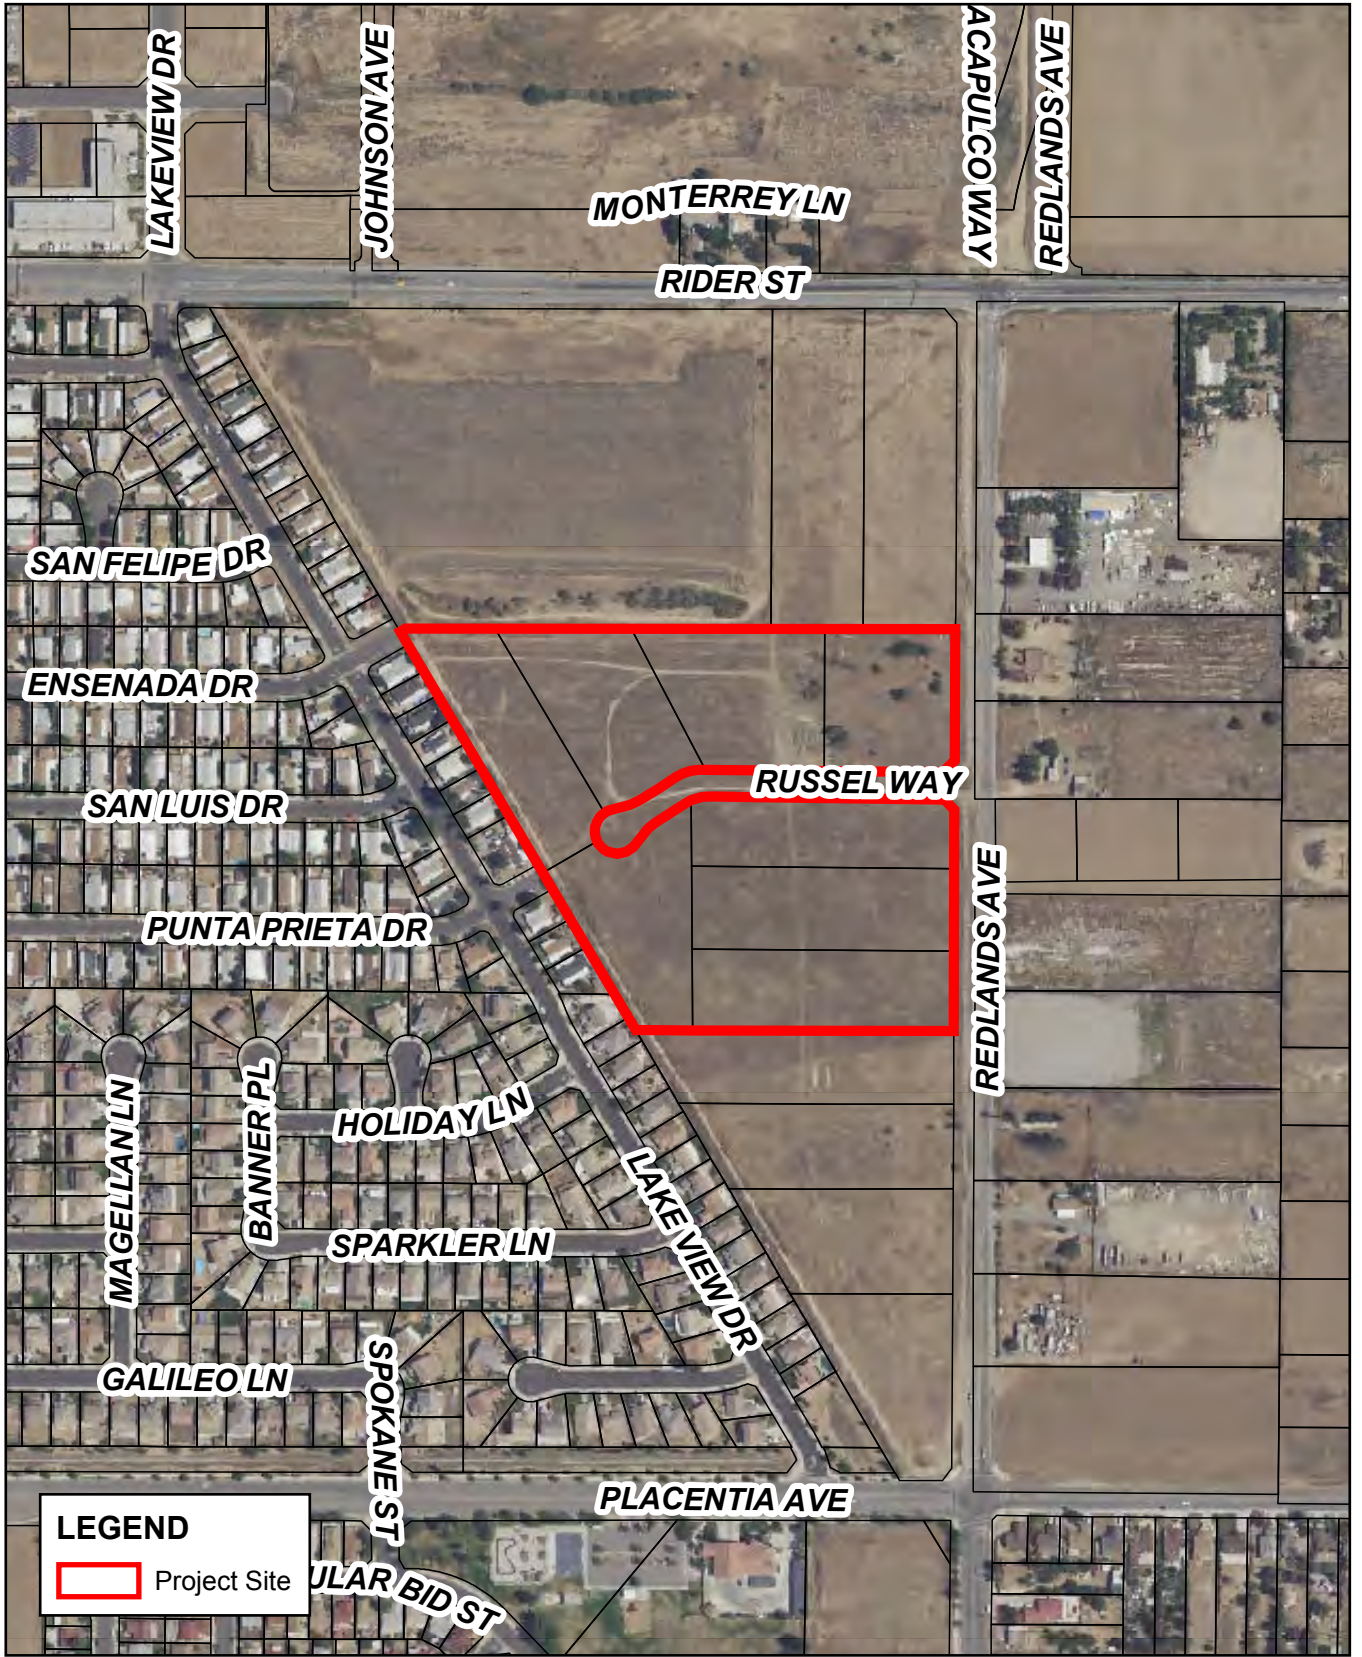


Source: Riverside Co. GIS, Jan. 2020.

Figure 3 - Aerial Map

20-0186 Redlands West Industrial




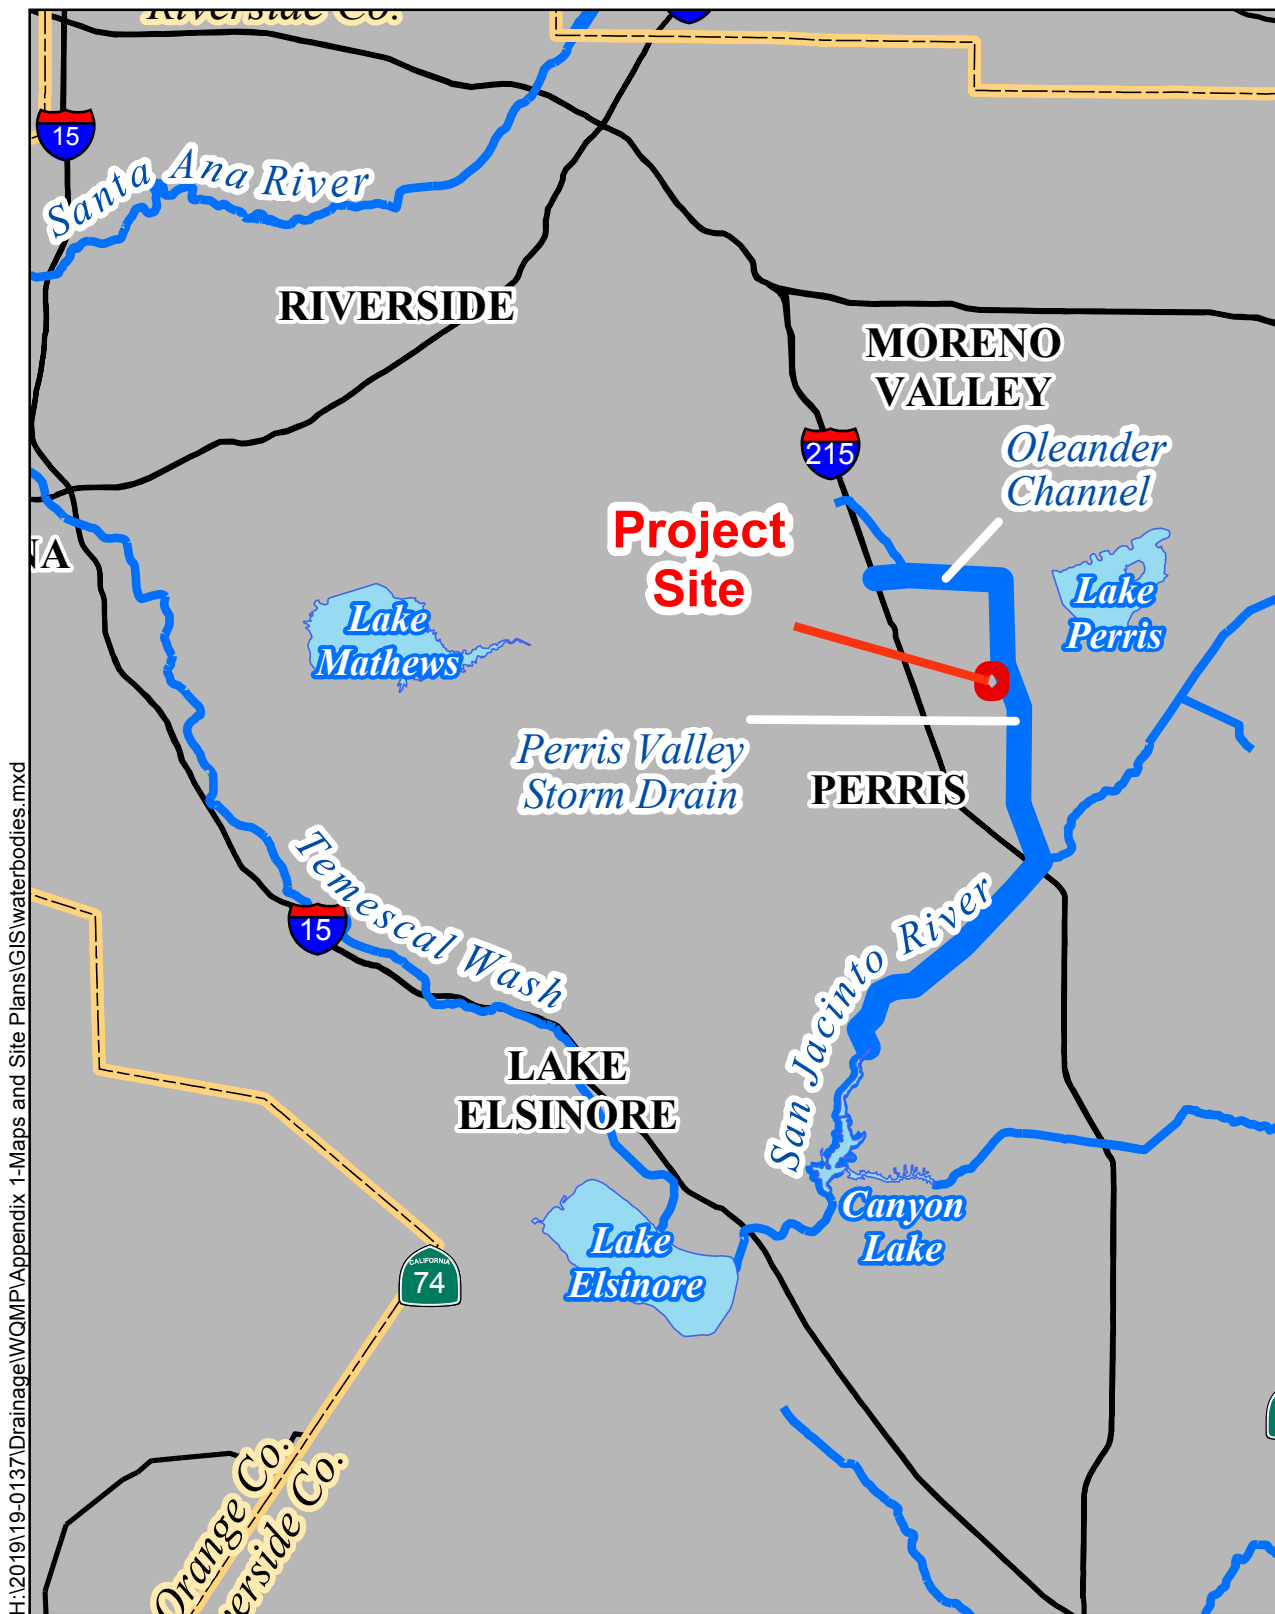

H:\2019\19-0137\Drainage\WQMP\Appendix 1-Maps and Site Plans\GIS\waterbodies.mxd


Sources: USGS 30 Meter DEM;
USGS Digital Line Graph

Figure 4. Receiving Waterbodies




Flowpath

PRELIMINARY WQMP EXHIBIT REDLANDS WEST

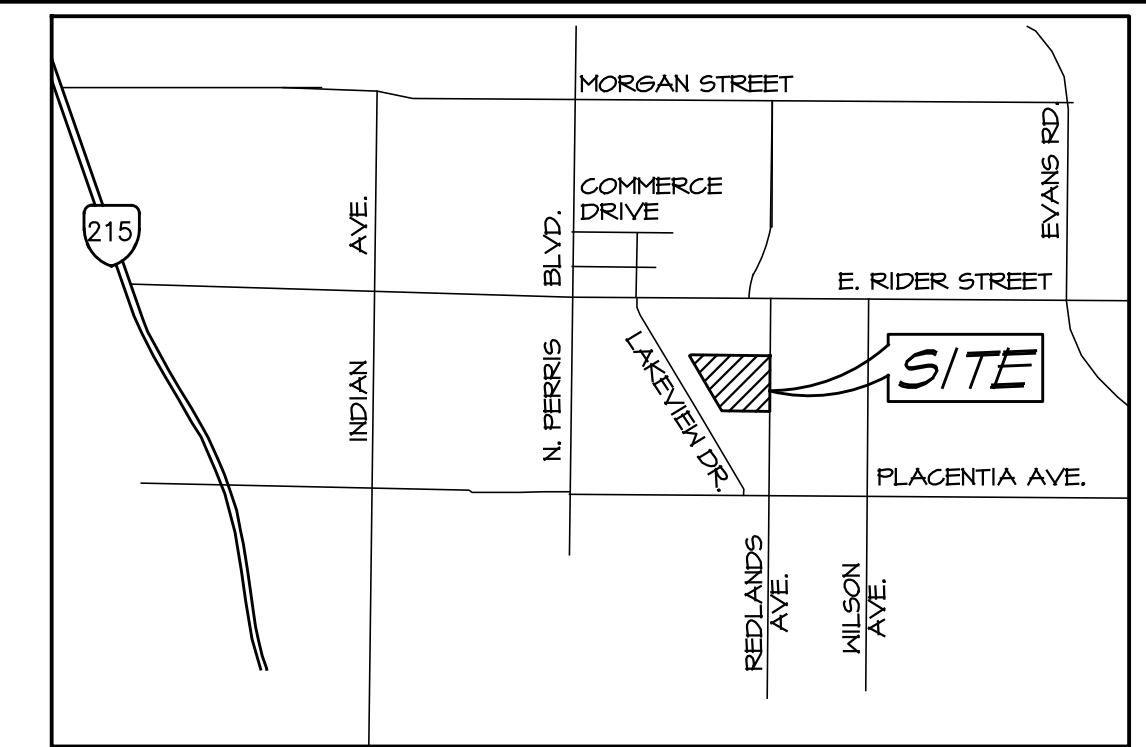

VICINITY MAP
N.T.S.

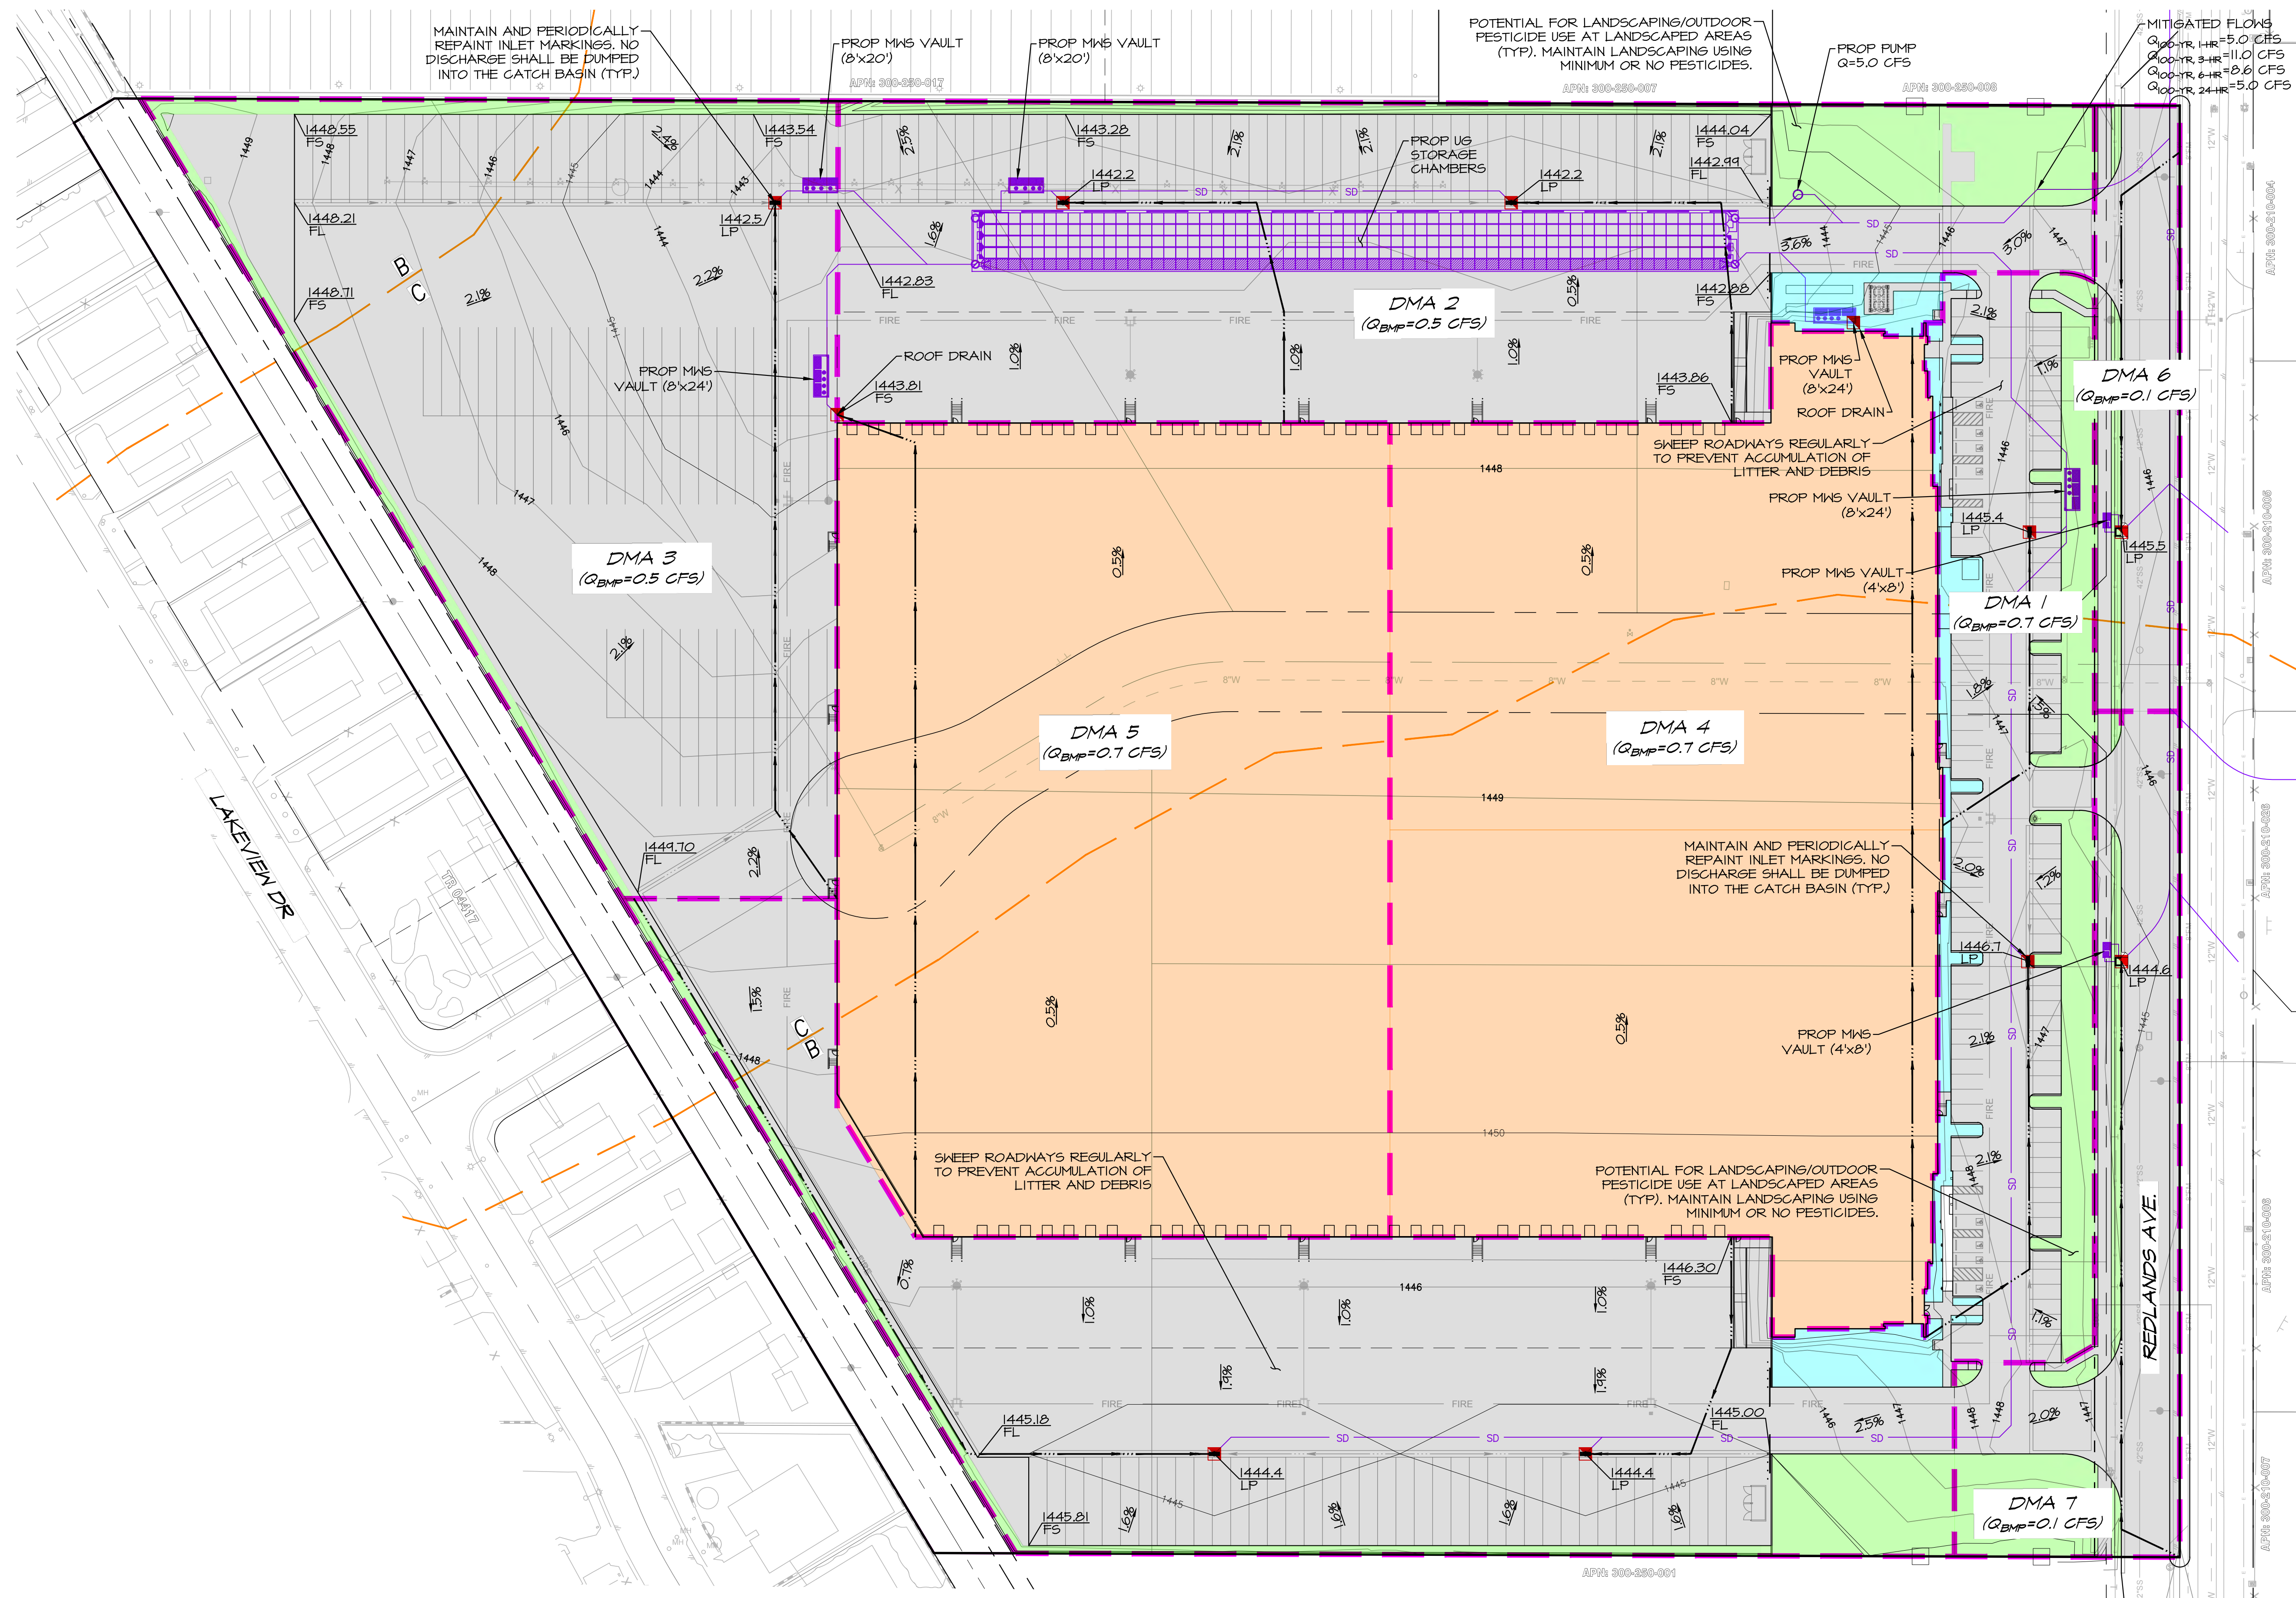

GENERAL NOTES:



1. ALL PROPOSED STORM DRAIN CURB OPENING CATCH BASINS AND DROP INLETS SHALL BE STENCILED PER THE REQUIREMENTS OF THE CITY OF PERRIS AND THE DETAIL ON SHEET 2 (SEE CASQA SD-13).
2. ALL ROOF RUN-OFF SHALL BE DISCHARGED DIRECTLY INTO THE PROPOSED MWS TREATMENT VAULTS PER DETAIL ON SHEET 2 AND BE TREATED BY THE PROPOSED TREATMENT DEVICES BEFORE DISCHARGING INTO THE OFF-SITE MS4 STORM DRAIN FACILITY.
3. ALL ON-SITE FLOWS WILL DRAIN TO THE PROPOSED UNDERGROUND STORAGE CHAMBERS AND DISCHARGE INTO MDP LINE A-B LOCATED NORTH OF THE PROJECT SITE VIA THE EXTENSION OF THE EXISTING STUB-OUT LAT A-B-10.
4. A PROPOSED PUMP, PRELIMINARILY SIZED WITH A CAPACITY OF 5.0 CFS DISCHARGES FLOWS OFFSITE IN COMBINATION WITH A PRELIMINARY OUTLET STRUCTURE DESIGNED FOR THE UNDERGROUND CHAMBERS.
5. FOR FLOWRATES AND OTHER HYDROLOGIC INFORMATION, SEE THE PRELIMINARY DRAINAGE REPORT. NO FLOWRATES OR VOLUMES CALCULATED FOR FLOOD CONTROL PURPOSES AFFECT THIS WATER QUALITY MANAGEMENT PLAN POST CONSTRUCTION BMP EXHIBIT (FLOW RATE BASED TREATMENT).
6. NO OFF-SITE RUN-ON WILL ENTER THE PROJECT SITE.

SITE CONSTRAINTS:

1. THE USE OF INFILTRATION LID BMPs WAS FOUND INFEASIBLE FOR THE SITE DUE TO THE UNDERLYING SOILS.
2. THE USE OF HARVEST AND USE LID BMPs WAS FOUND INFEASIBLE FOR THE SITE DUE TO THE USE OF RECYCLED WATER FOR IRRIGATION PURPOSES.

LEGEND

- ROOF
- IMPERVIOUS (CONCRETE/ASPHALT)
- SELF RETAINING
- LANDSCAPE
- DMA BOUNDARY
- PROJECT BOUNDARY
- FLOWLINE
- NRCS SOIL BOUNDARY
- PROPOSED INLET

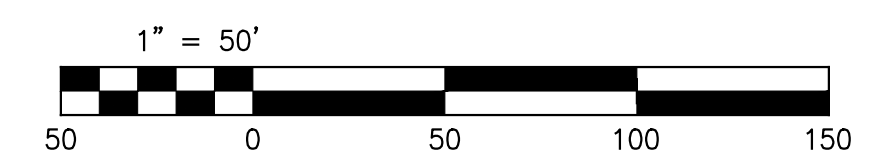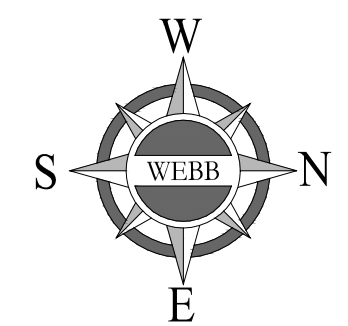


CITY OF PERRIS, CALIFORNIA
REDLANDS WEST
P20-00020
POST CONSTRUCTION BMP SITE PLAN
PWQMP EXHIBIT

SCALE: 1"=50'	ALBERT A. WEBB ASSOCIATES	ENGINEERING CONSULTANTS 3788 MCCRAY STREET RIVERSIDE CA. 92506 PH. (951) 686-1070 FAX (951) 788-1256	W.O. 20-0186 SHEET 1 OF 3 SHEETS DWG. NO.
DATE: 11/16/2020	DESIGNED: AYS	CHECKED: JRG	PLN CK REF: F.B.

H:\2020\20-0186\DRAWING\PWQMP\DWG DRAWINGS\20-0186-PWQMP EXHIBIT.DWG 3/23/2022 6:22:17 PM

**PRELIMINARY WQMP EXHIBIT
REDLANDS WEST**

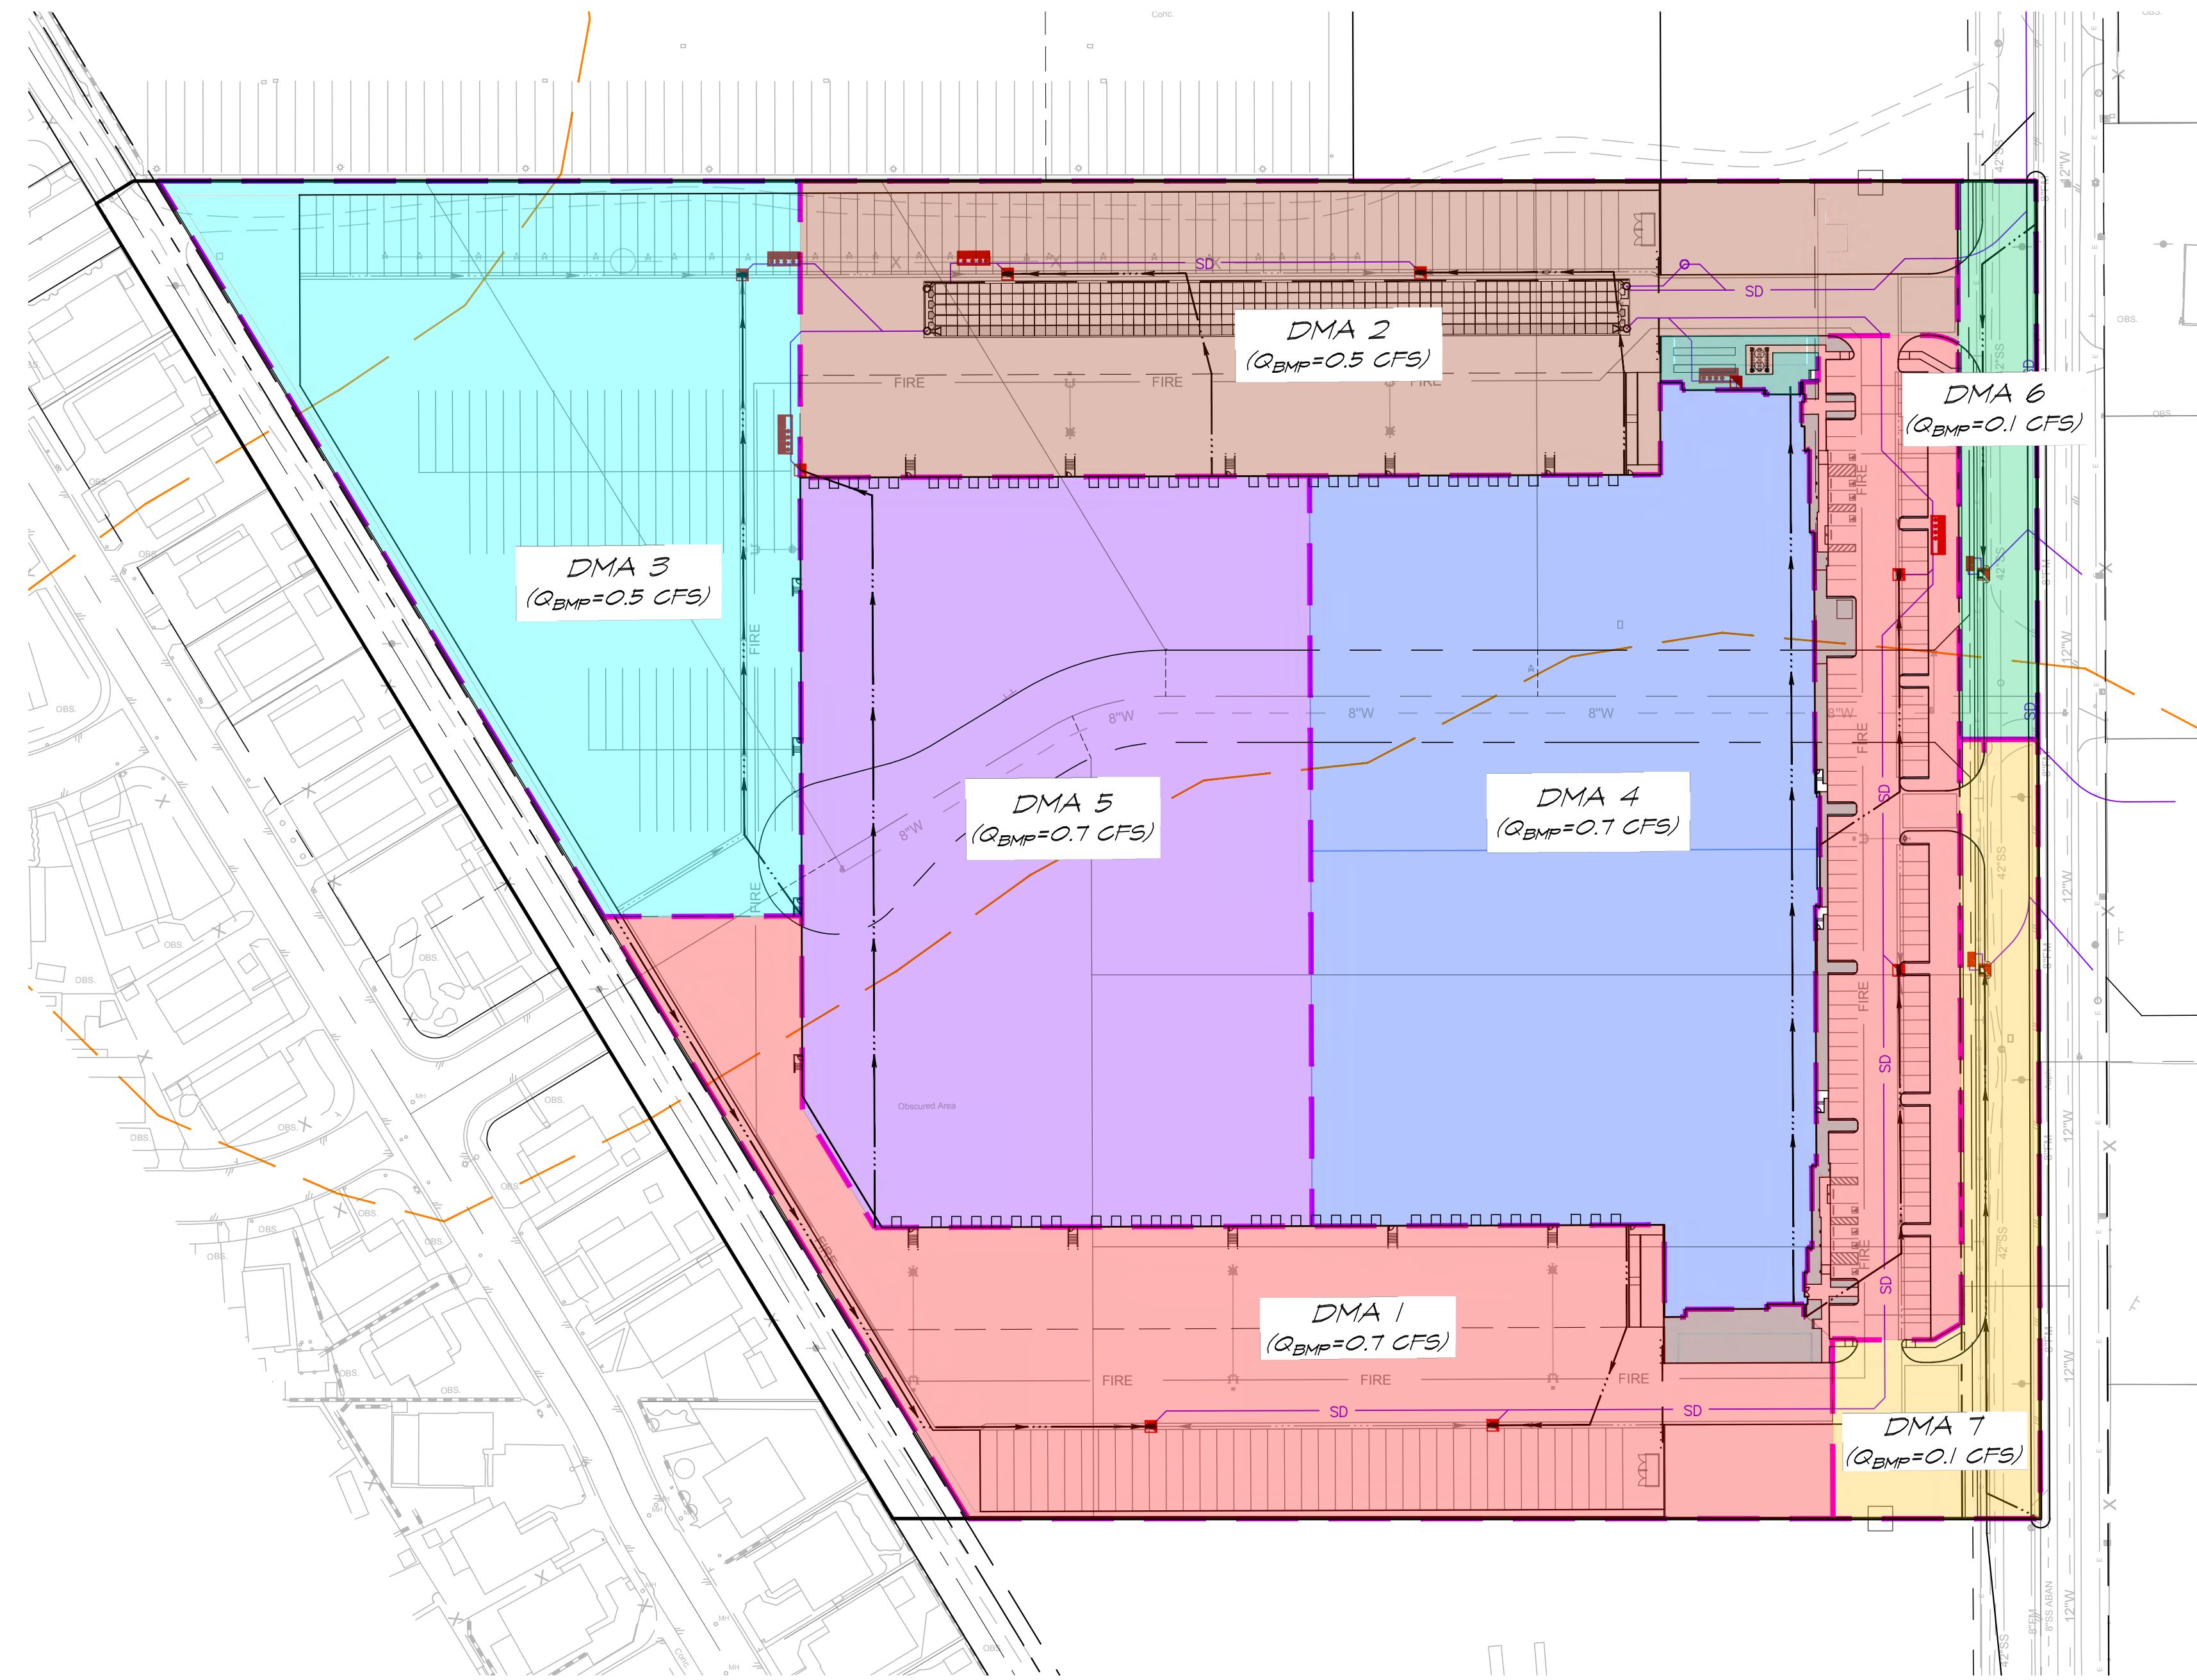

DMA MAP


DMA AREA TABLE							
	DMA 1	DMA 2	DMA 3	DMA 4	DMA 5	DMA 6	DMA 7
CONCRETE (SF)	154,179	112,321	123,739	—	—	16,221	27,651
LANDSCAPE (SF)	25,385	15,100	6,889	—	—	2,300	8,069
SELF-RETAINING (SF)	9,166	3,006	—	—	—	—	—
ROOF (SF)	—	—	—	170,501	159,836	—	—
QBMP (CF)	0.7	0.5	0.5	0.7	0.7	0.1	0.1
QTREAT (CF)	0.7	0.6	0.6	0.7	0.7	0.1	0.1

- DMA-1
- DMA-2
- DMA-3
- DMA-4
- DMA-5
- DMA-6
- DMA-7


CITY OF PERRIS, CALIFORNIA REDLANDS WEST P20-00020 DMA MAP PWQMP EXHIBIT			
SCALE:	N/A	ALBERT A. WEBB ASSOCIATES	ENGINEERING CONSULTANTS 3788 McCRAY STREET RIVERSIDE CA 92506 PH. (951) 686-1070 FAX (951) 788-1256
DATE:	11/16/2020		W.O. 20-0186
DESIGNED:	AYS	2	SHEET
CHECKED:	JRG		3
PLN CK REF:		DWG. NO.	
F.B.			

H:\2020\20-0186\DRAWING\DWG DRAWINGS\20-0186-PWQMP-EXHIBIT.DWG 3/23/2022 6:22:17 PM




PRELIMINARY WQMP EXHIBIT REDLANDS WEST

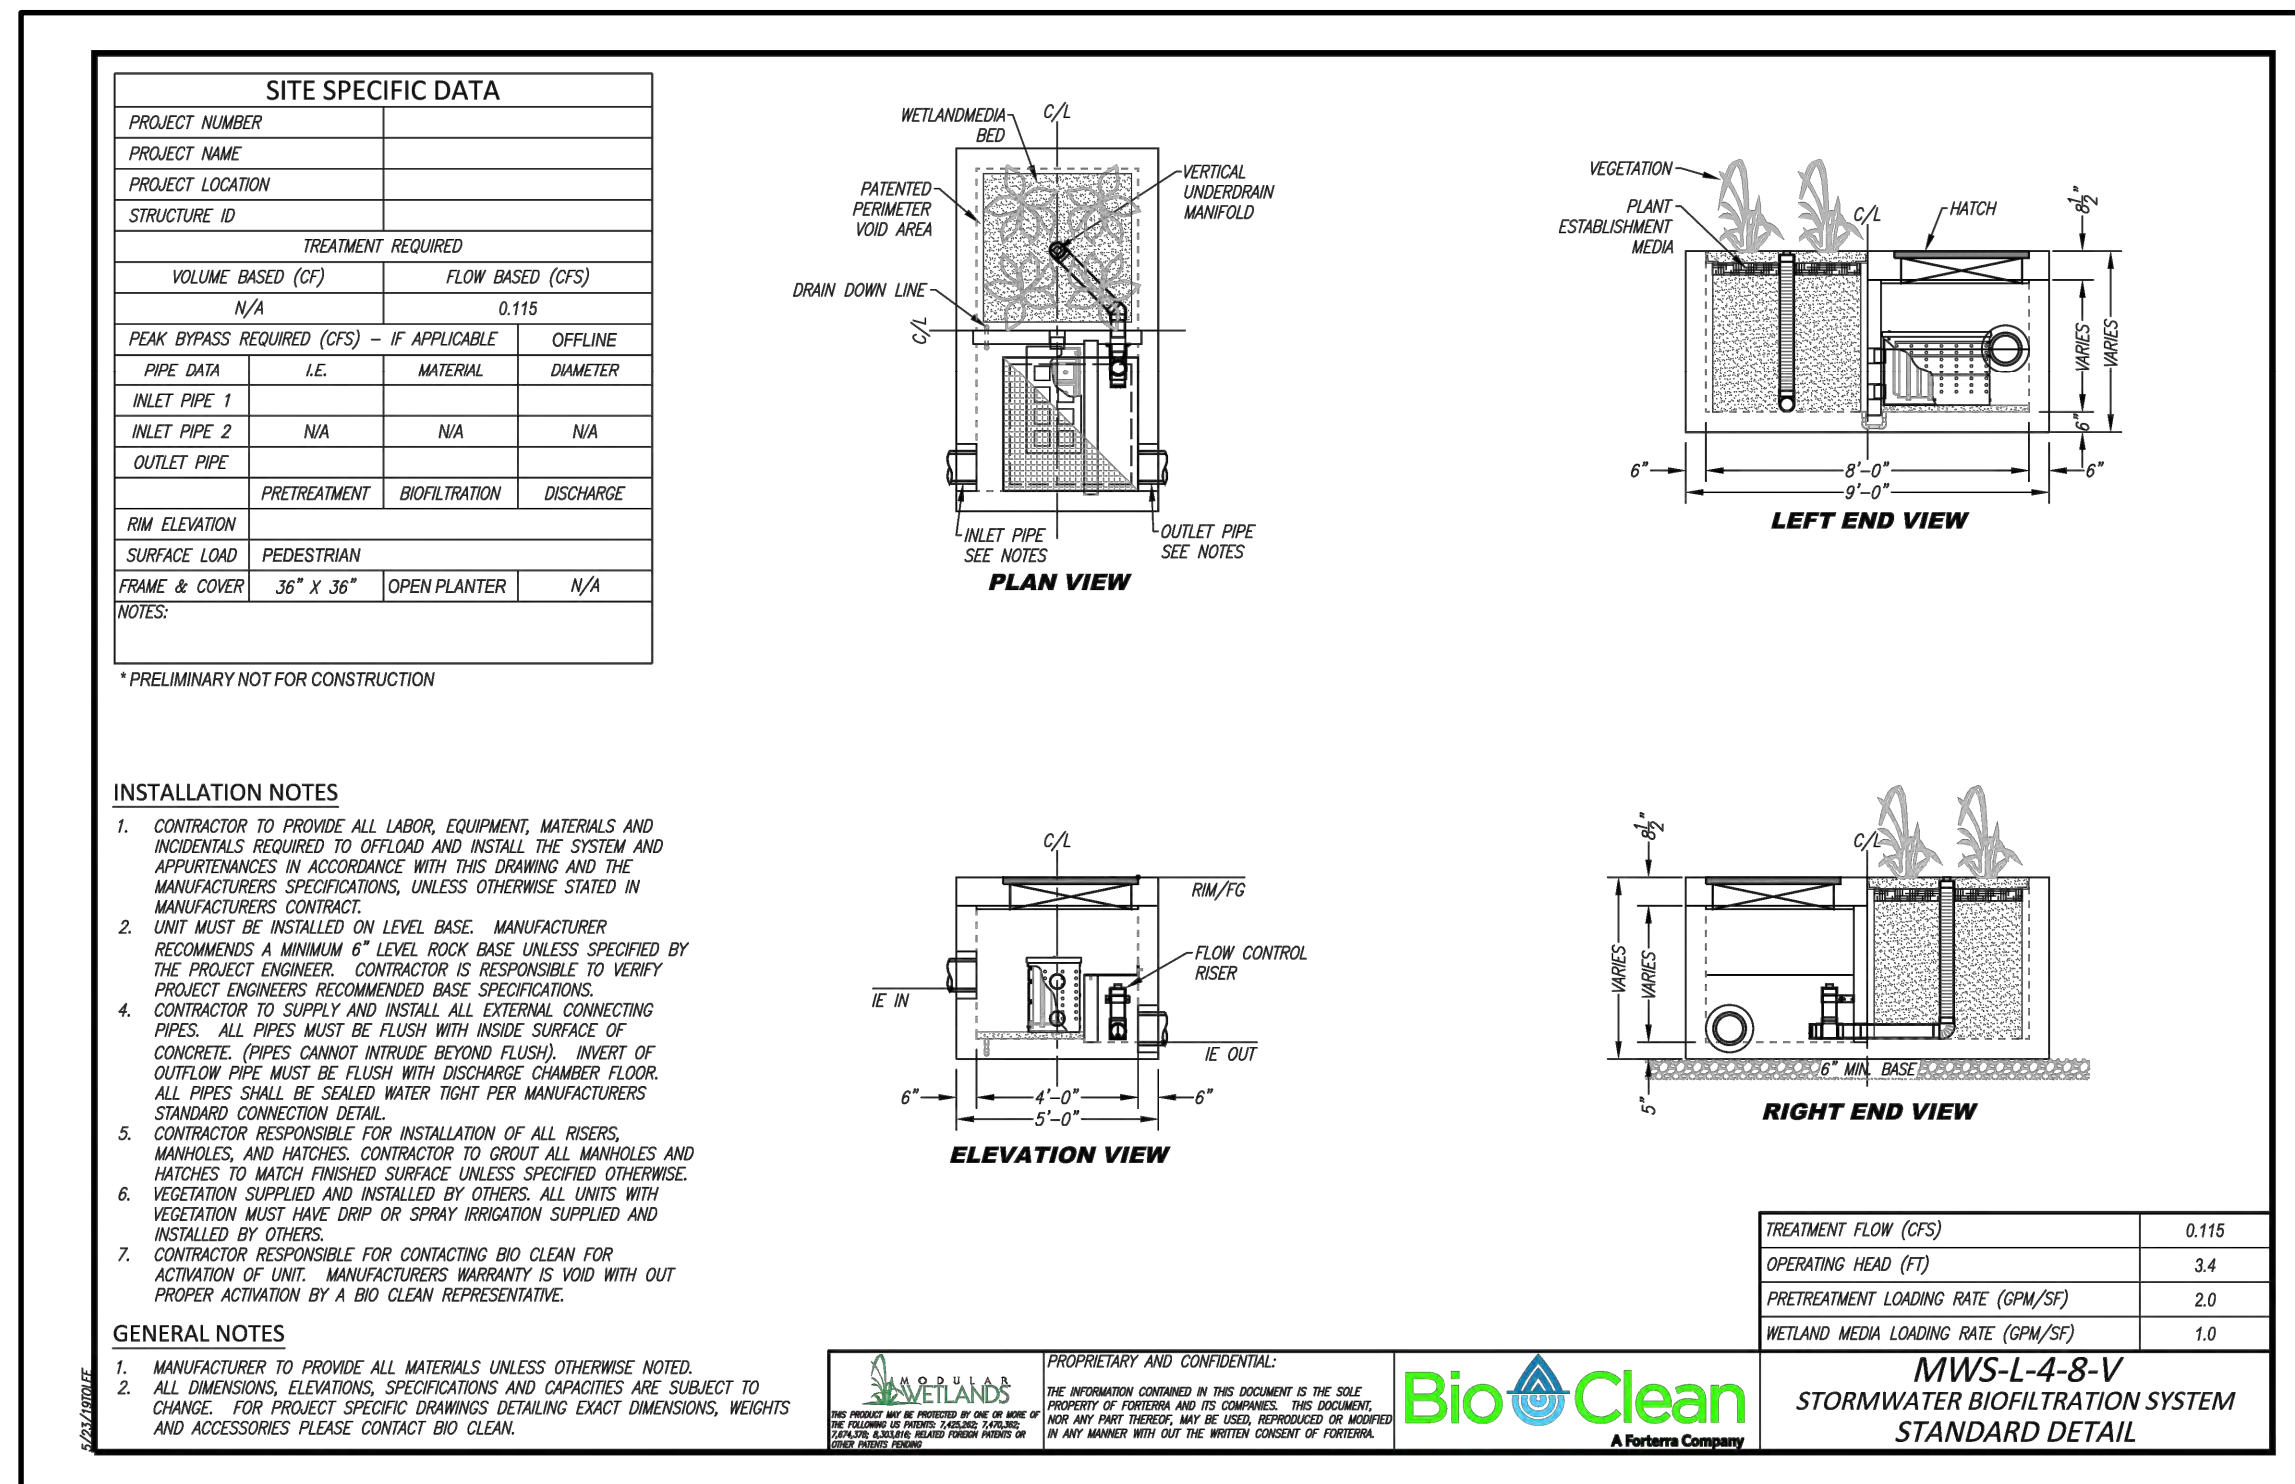


MWS VAULT - 4'x8'
DMA 6 & DMA 7

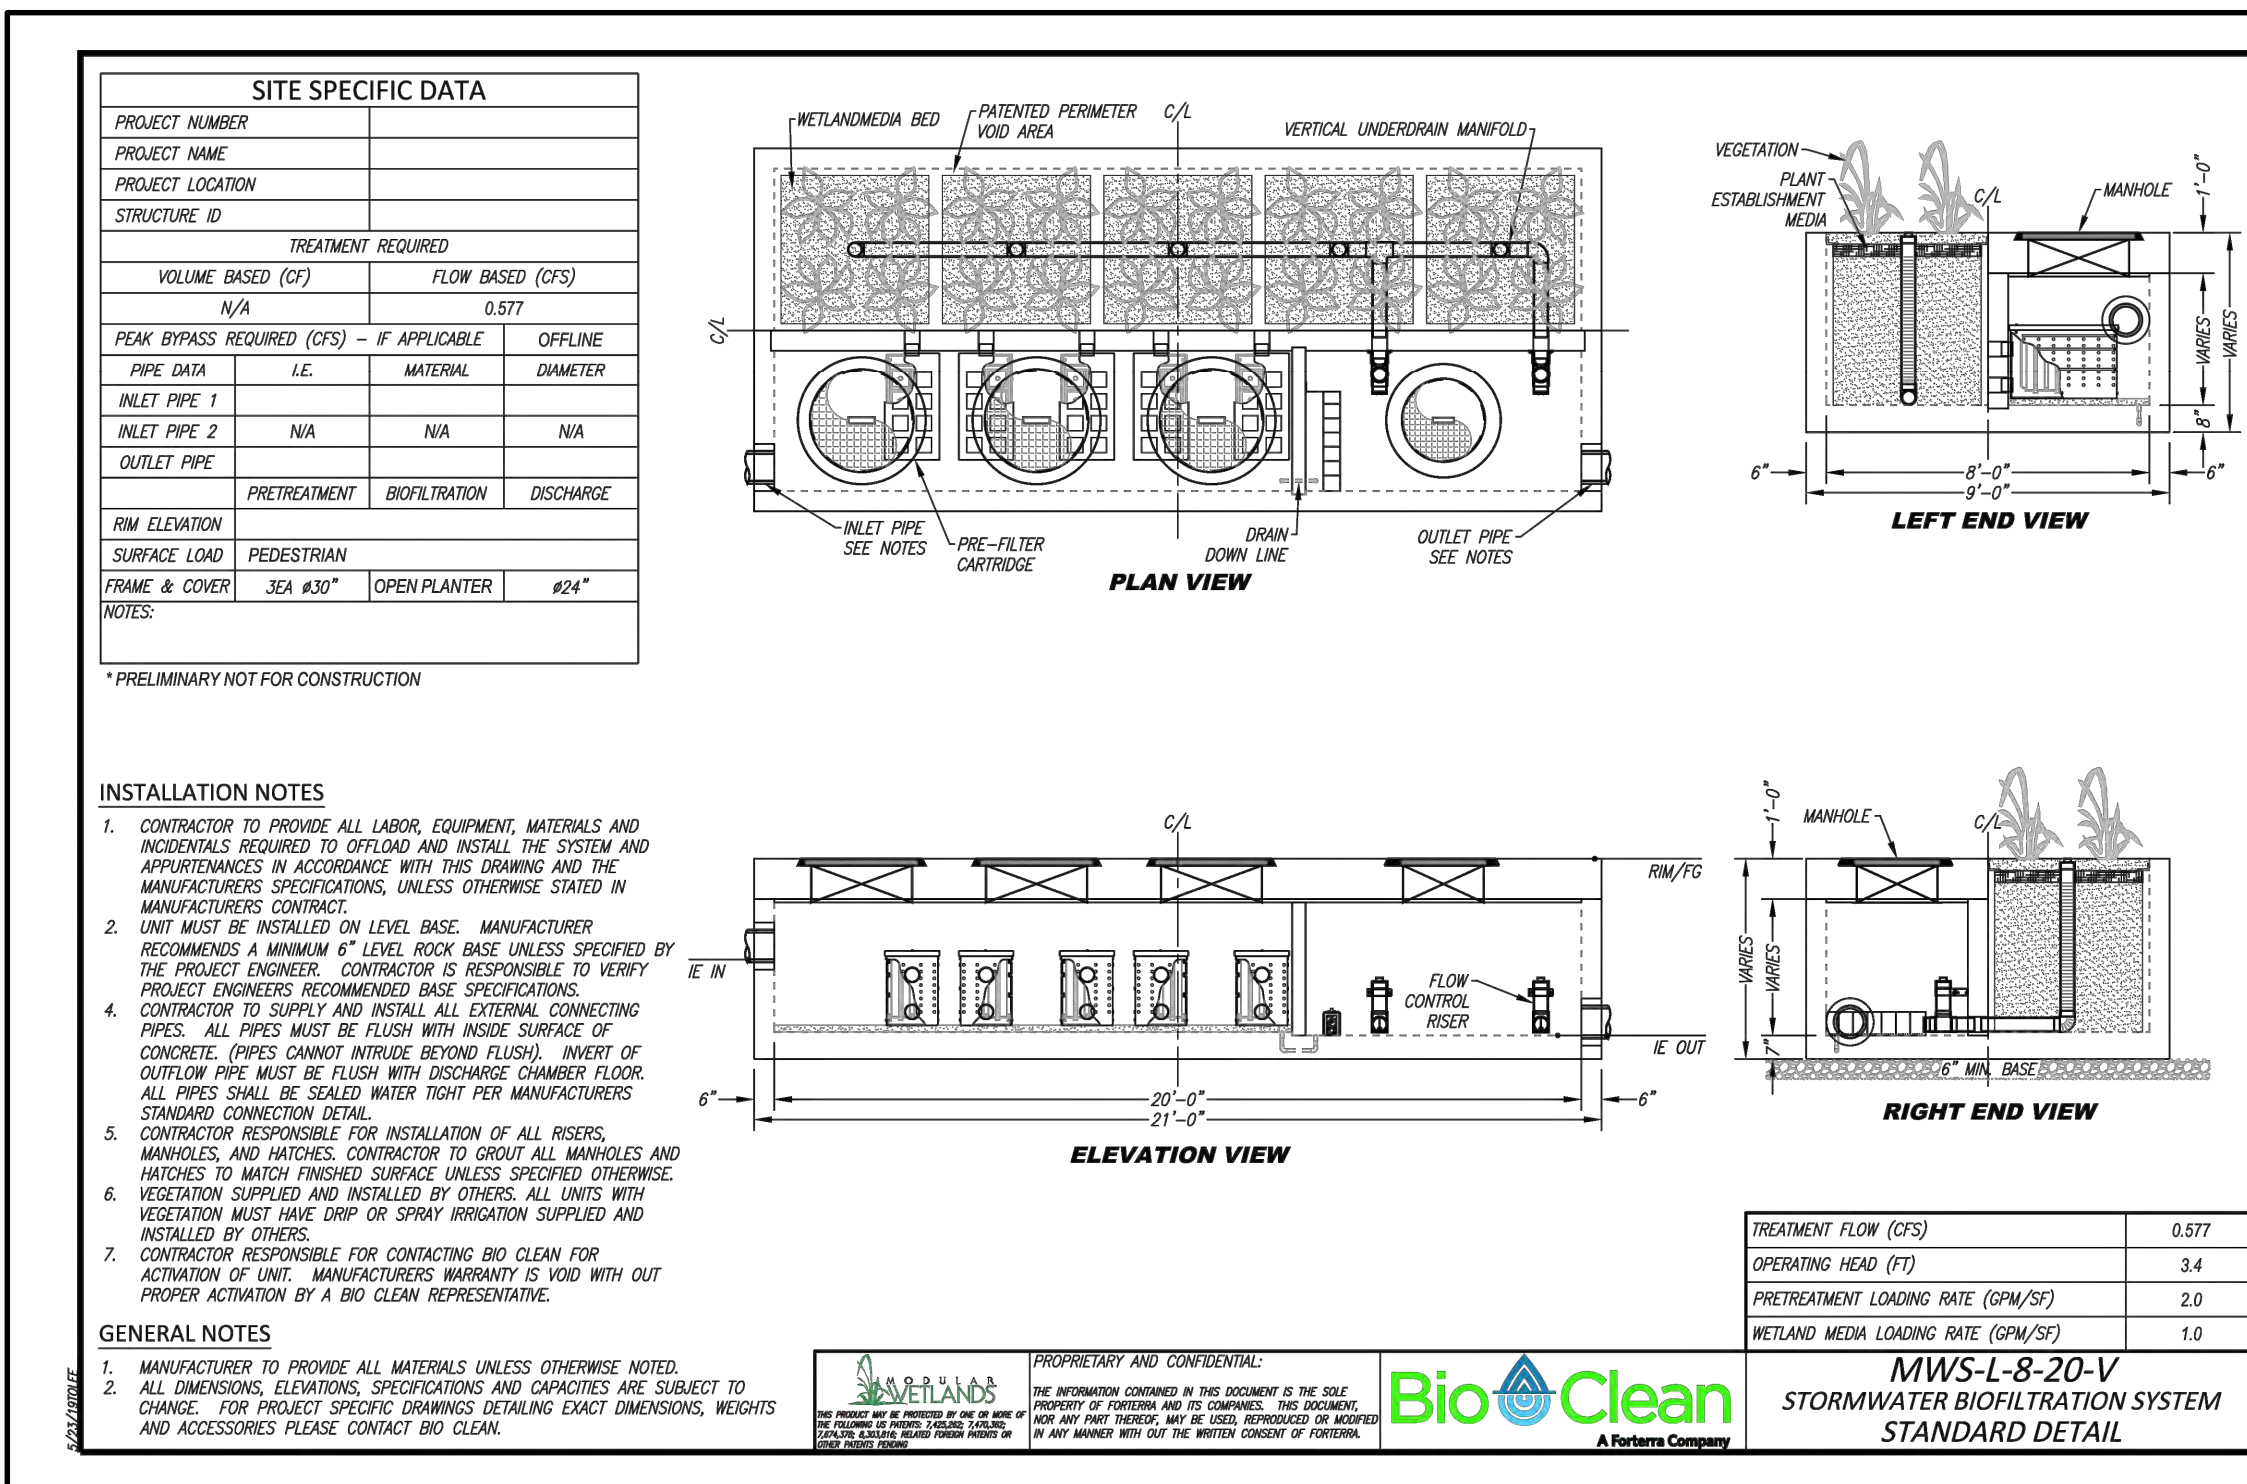


MWS VAULT - 8'x20'
DMA 2 & DMA 3

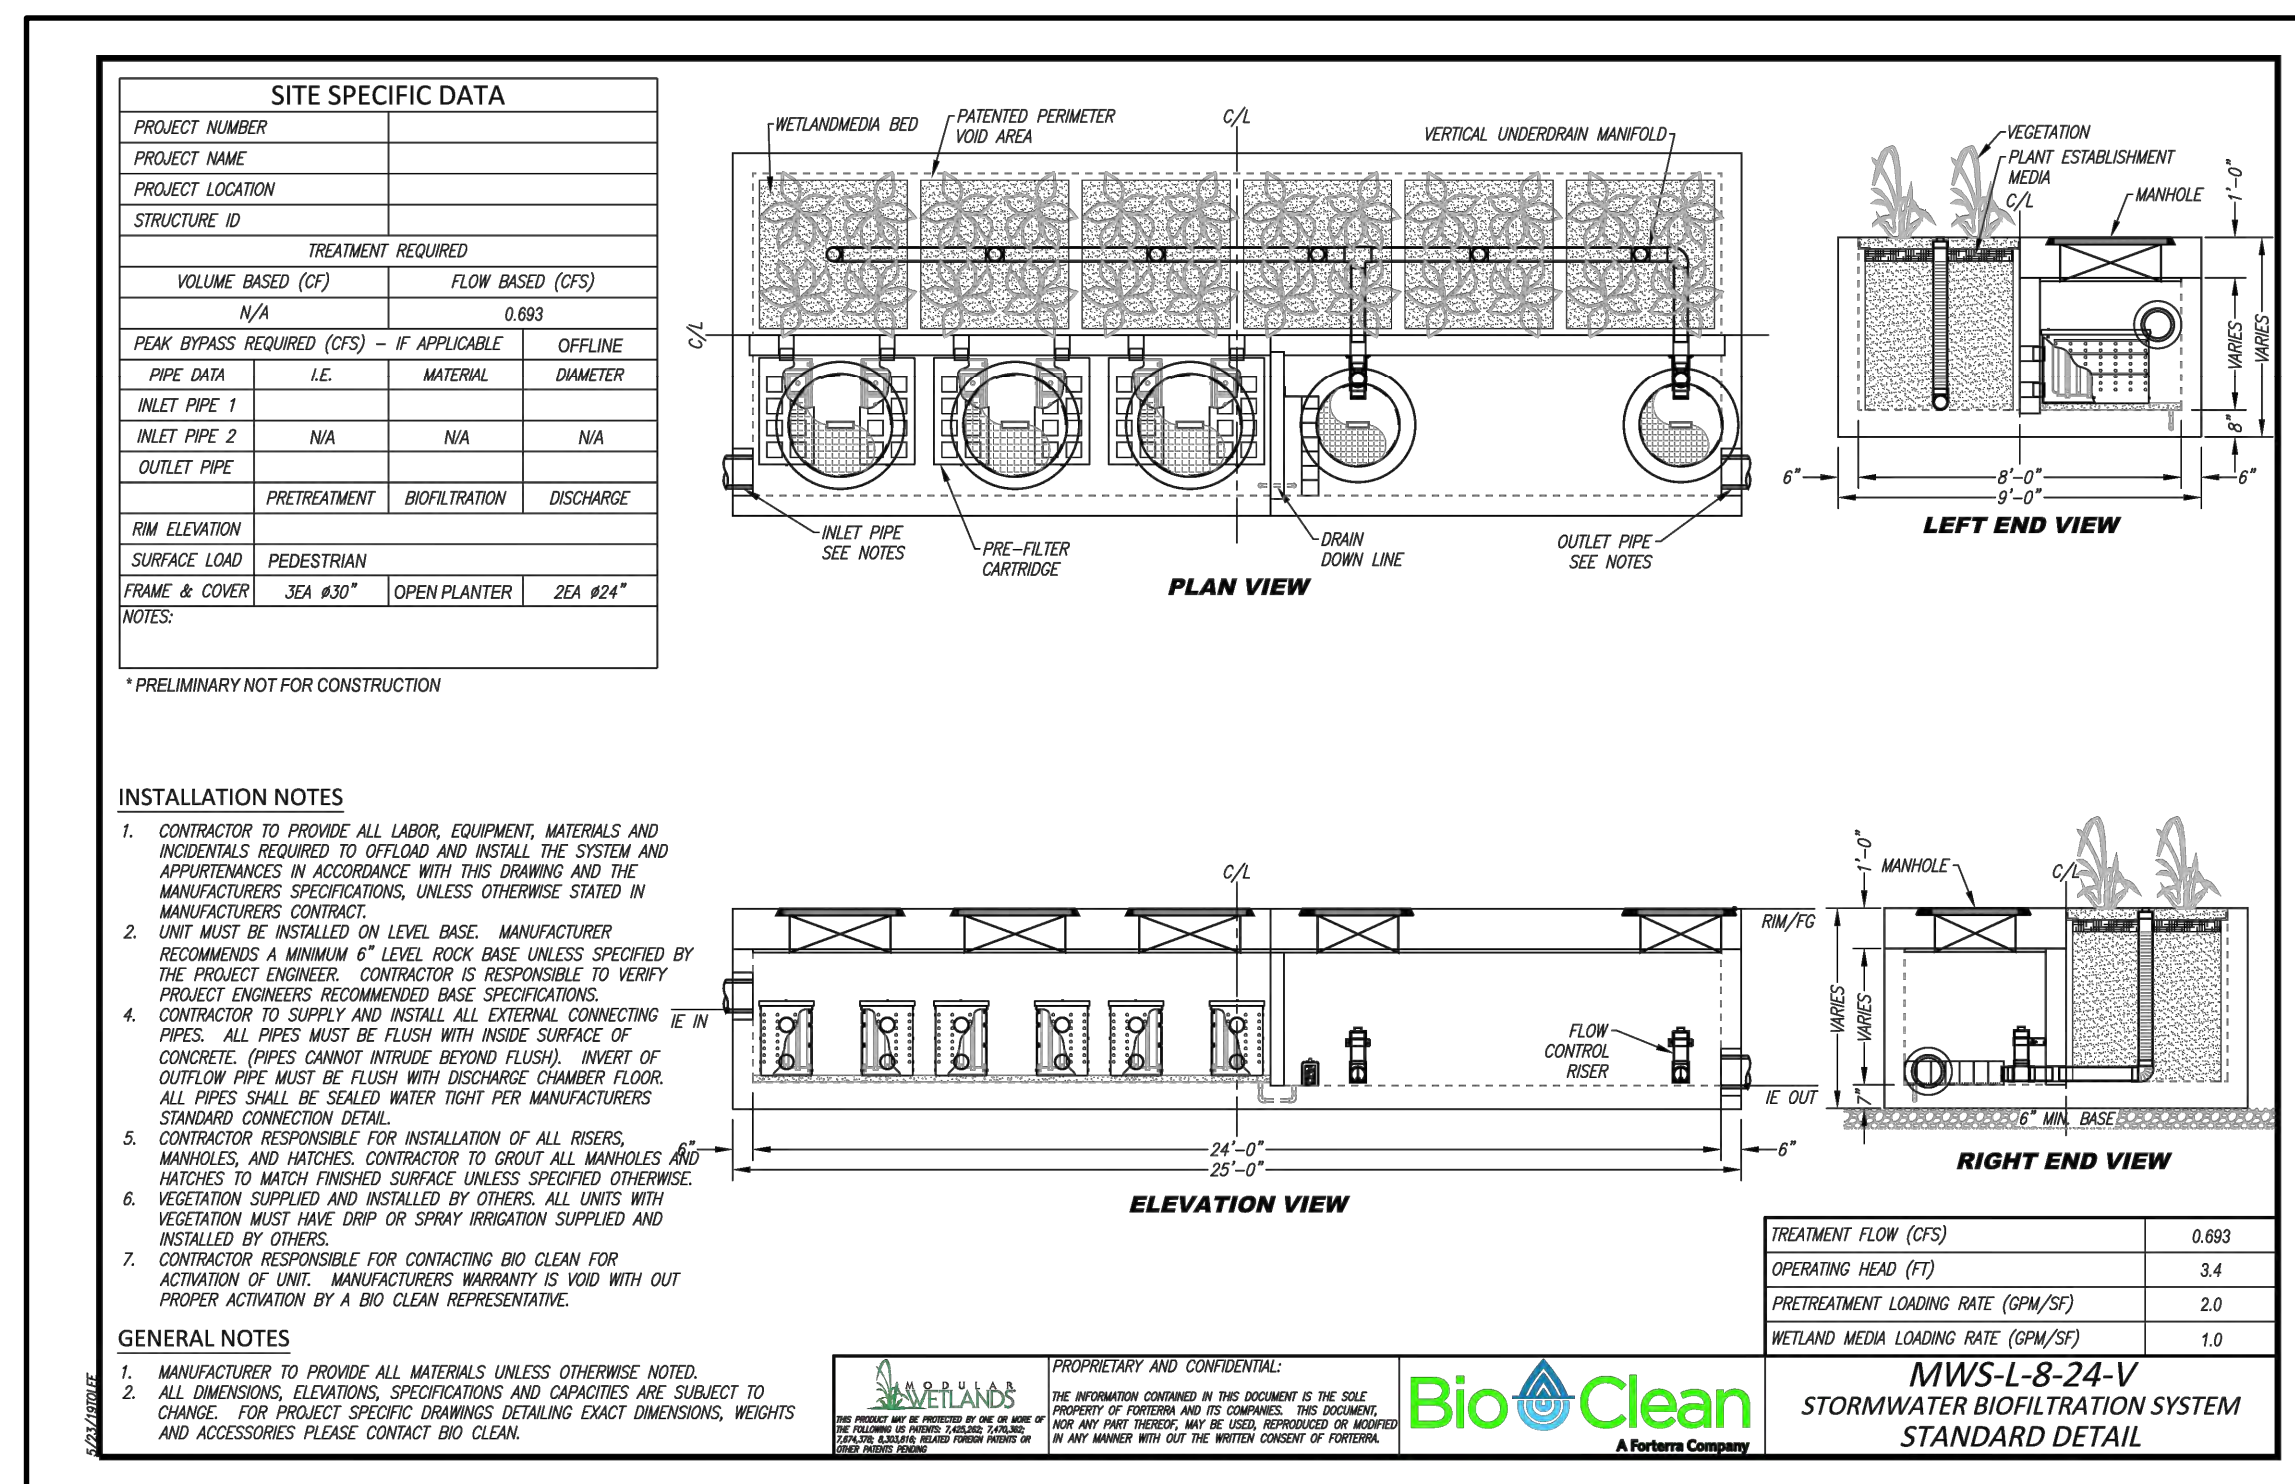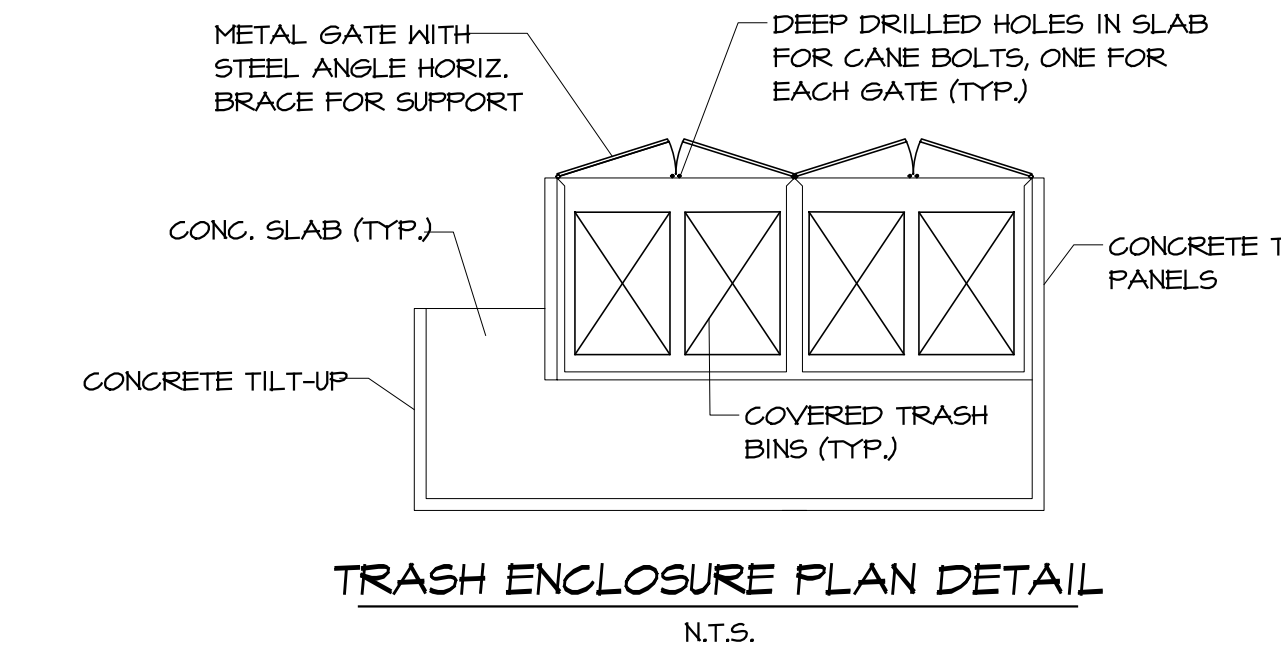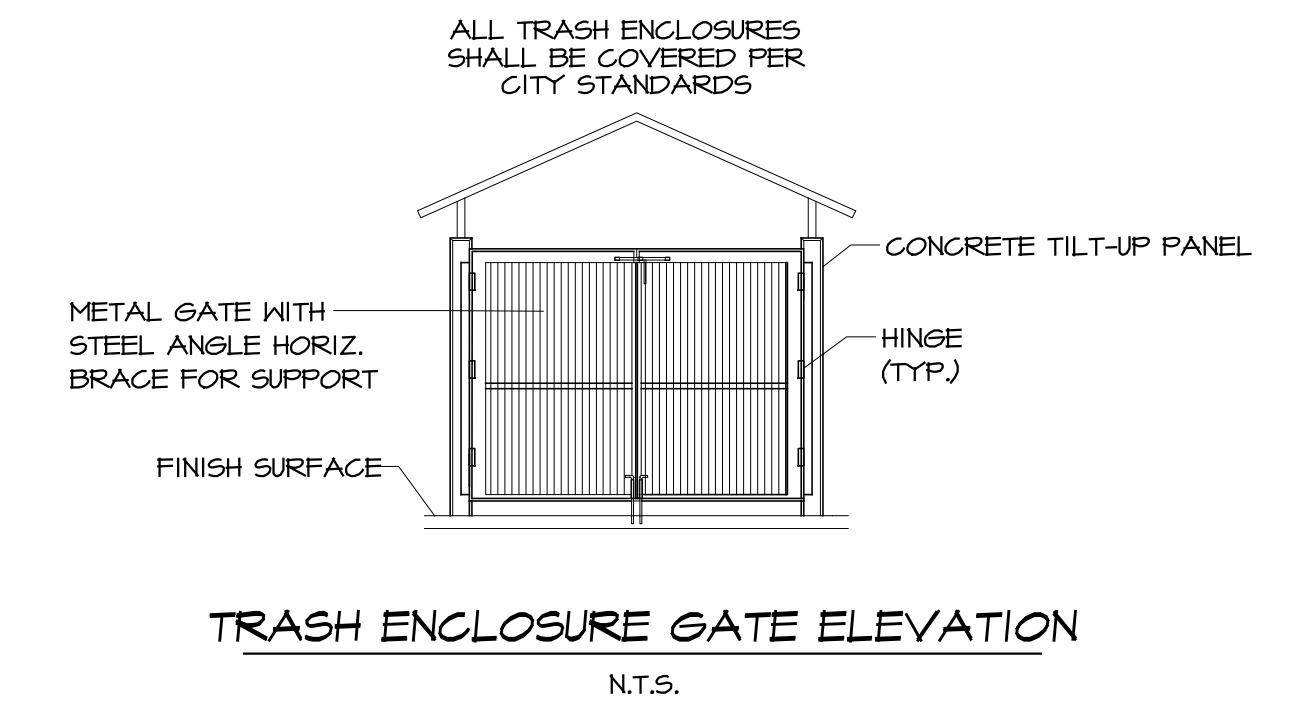


MWS VAULT - 8'x24'
DMA 1, DMA 4, & DMA 5

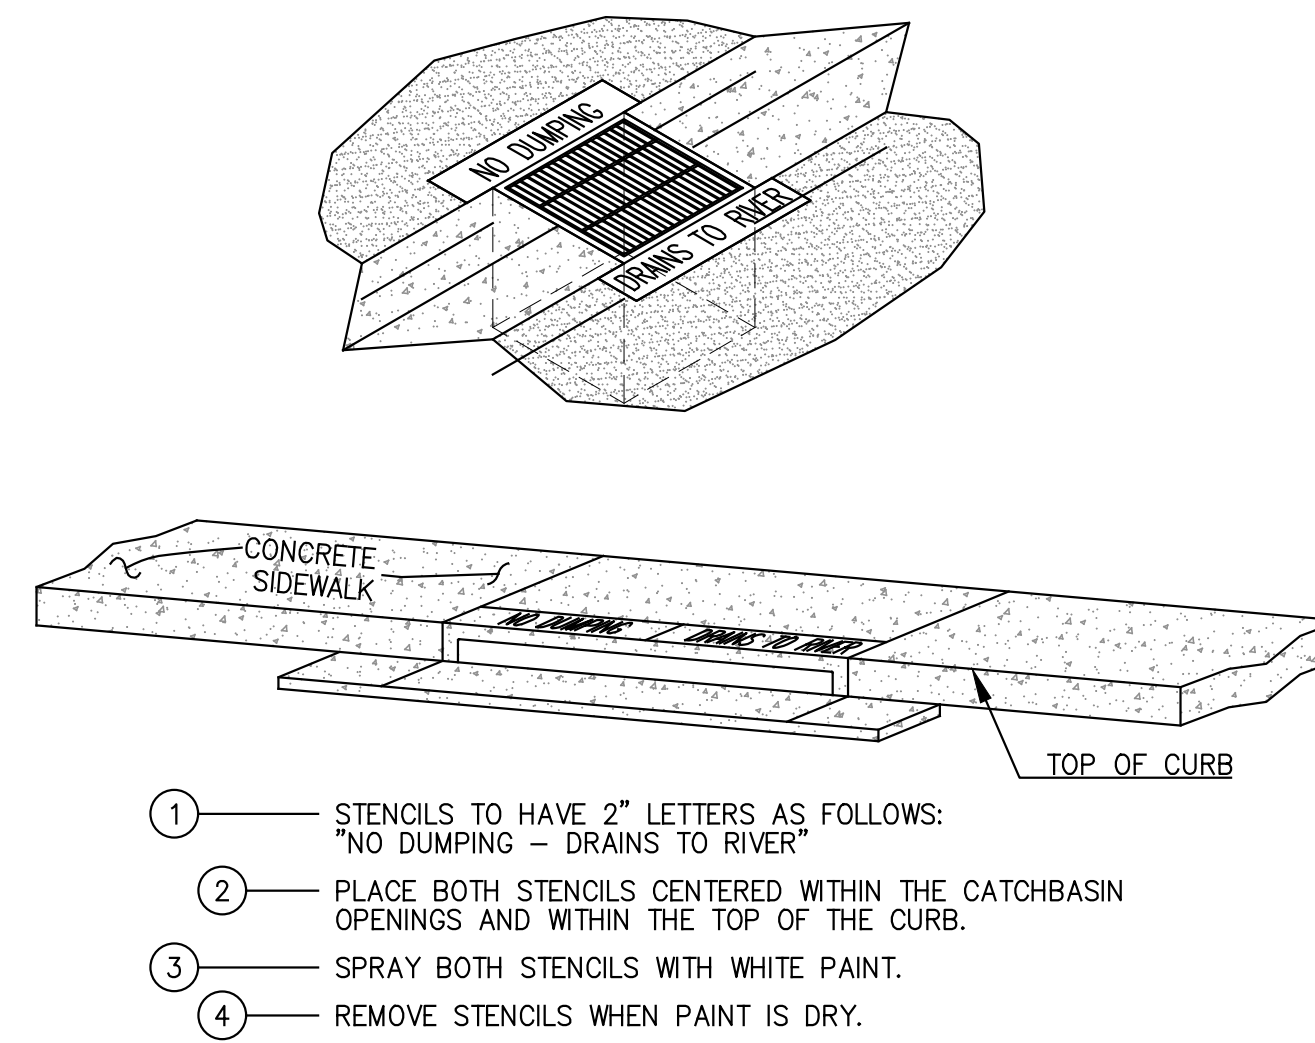


CATCH BASIN STENCILING DETAIL
N.T.S.

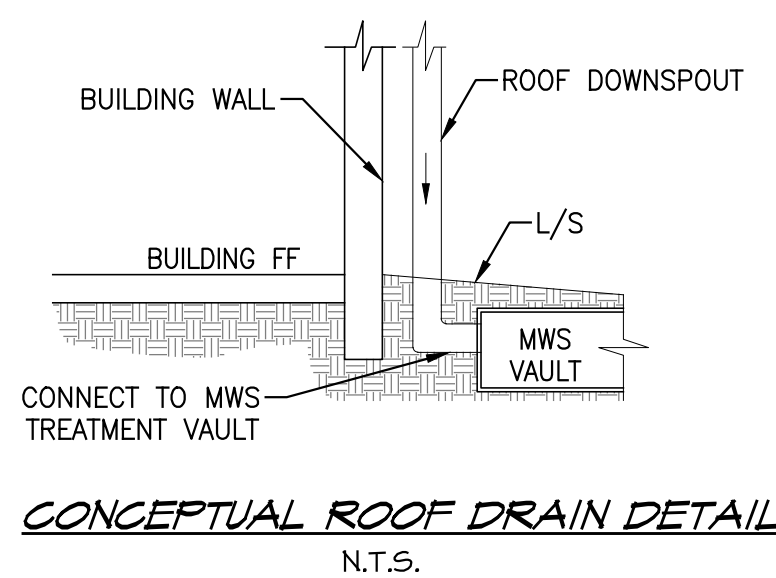

CONCEPTUAL ROOF DRAIN DETAIL
N.T.S.

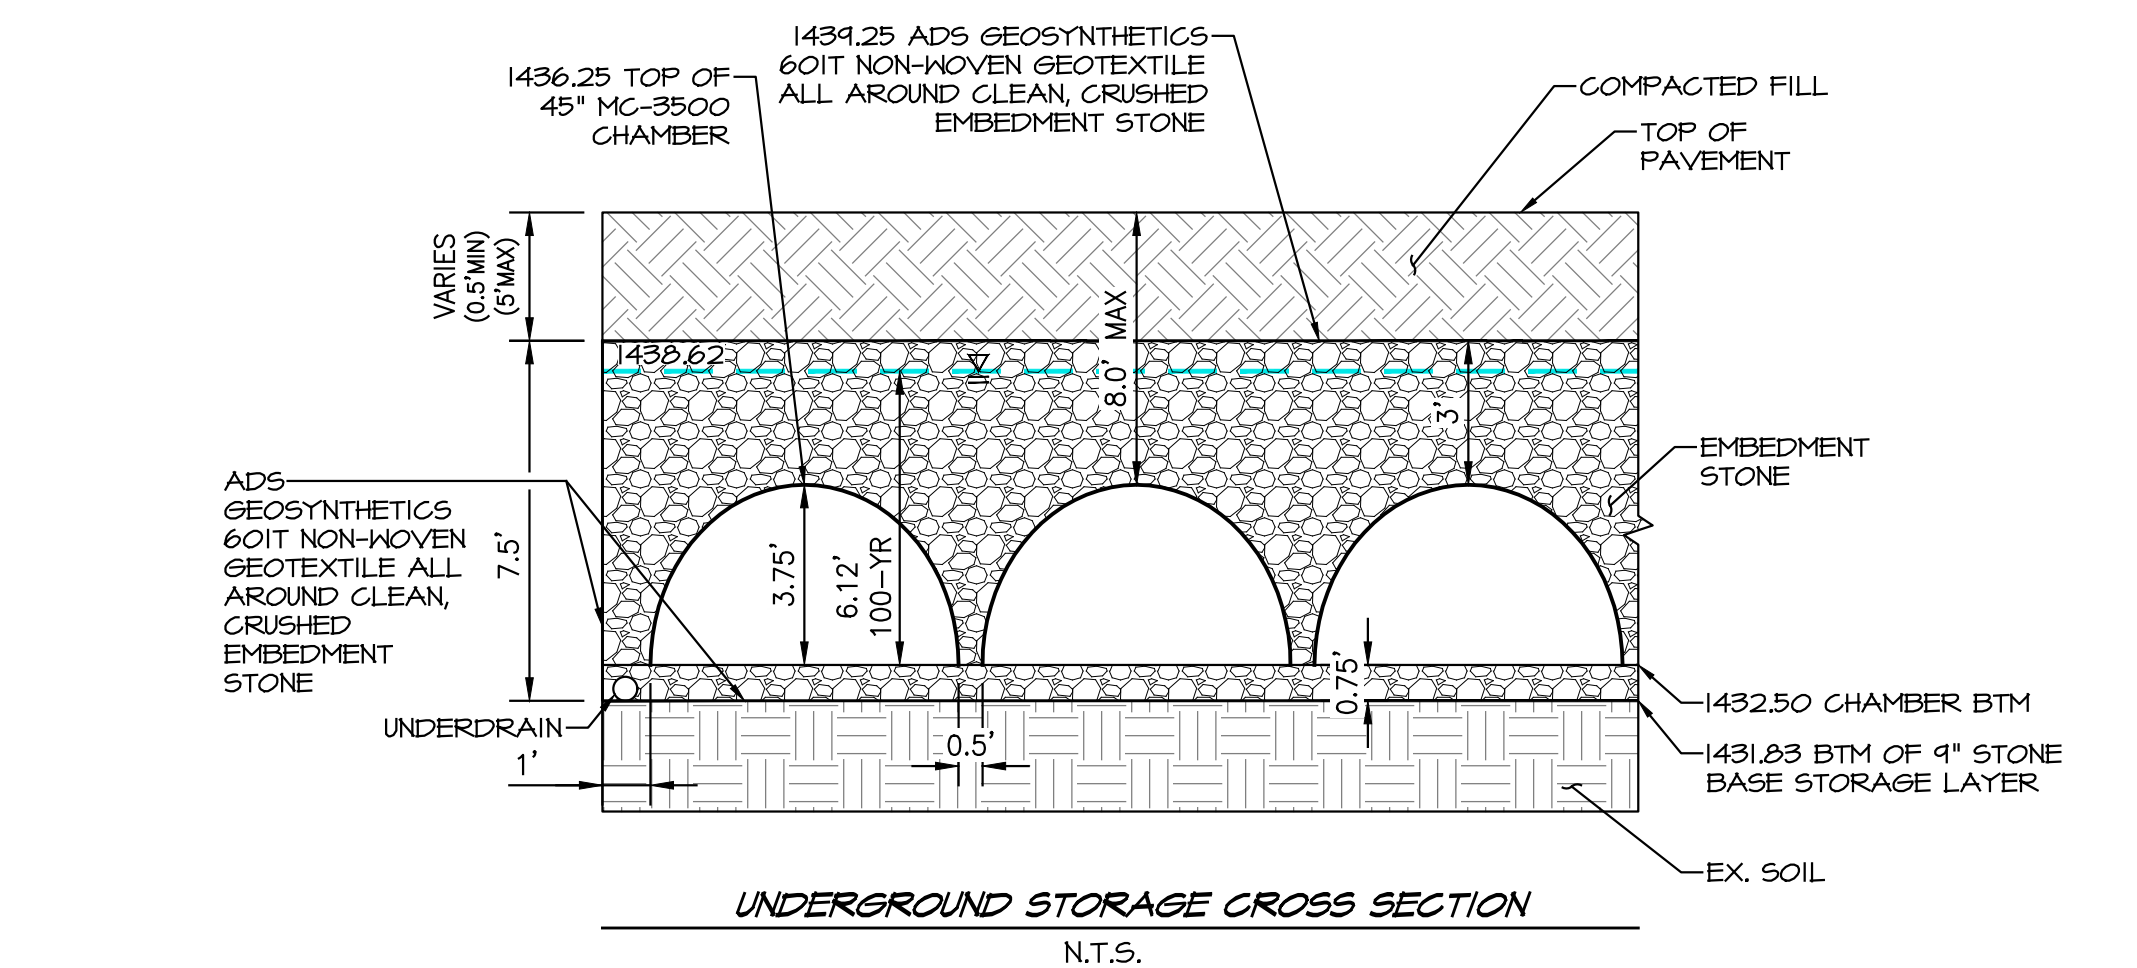

UNDERGROUND STORAGE CROSS SECTION
N.T.S.

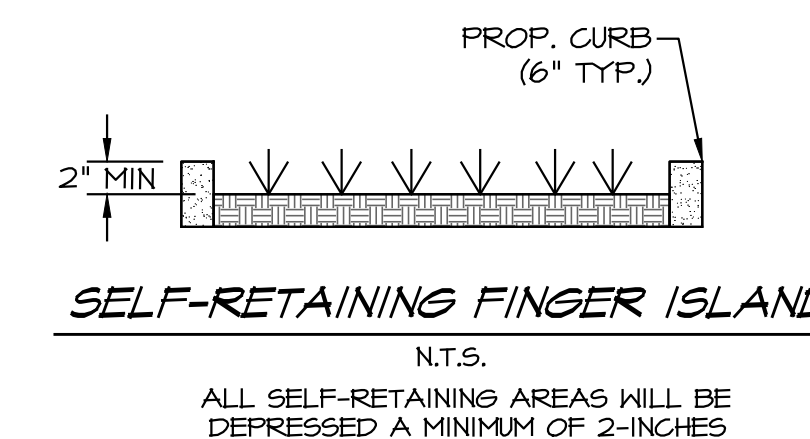

SELF-RETAINING FINGER ISLAND
N.T.S.


CITY OF PERRIS, CALIFORNIA
REDLANDS WEST
P20-00020
DETAILS
PWQMP EXHIBIT

SCALE:	N/A	ALBERT A. ENGINEERING CONSULTANTS	W.O.	20-0186
DATE:	11/16/2020	3738 MCCRAY STREET	RIVERSIDE CA 92506	SHEET
DESIGNED:	AYS	PH. (951) 686-1070		3
CHECKED:	JRG	FAX (951) 788-1256		OF 3 SHEETS
PLN CK REF:				DWG. NO.
F.B.				

H:\2020\20-0186\DRAWING\WQMP\DWG DRAWINGS\20-0186-PWQMP EXHIBIT.DWG 3/23/2022 6:22:17 PM

Appendix 2: Construction Plans

Grading and Drainage Plans

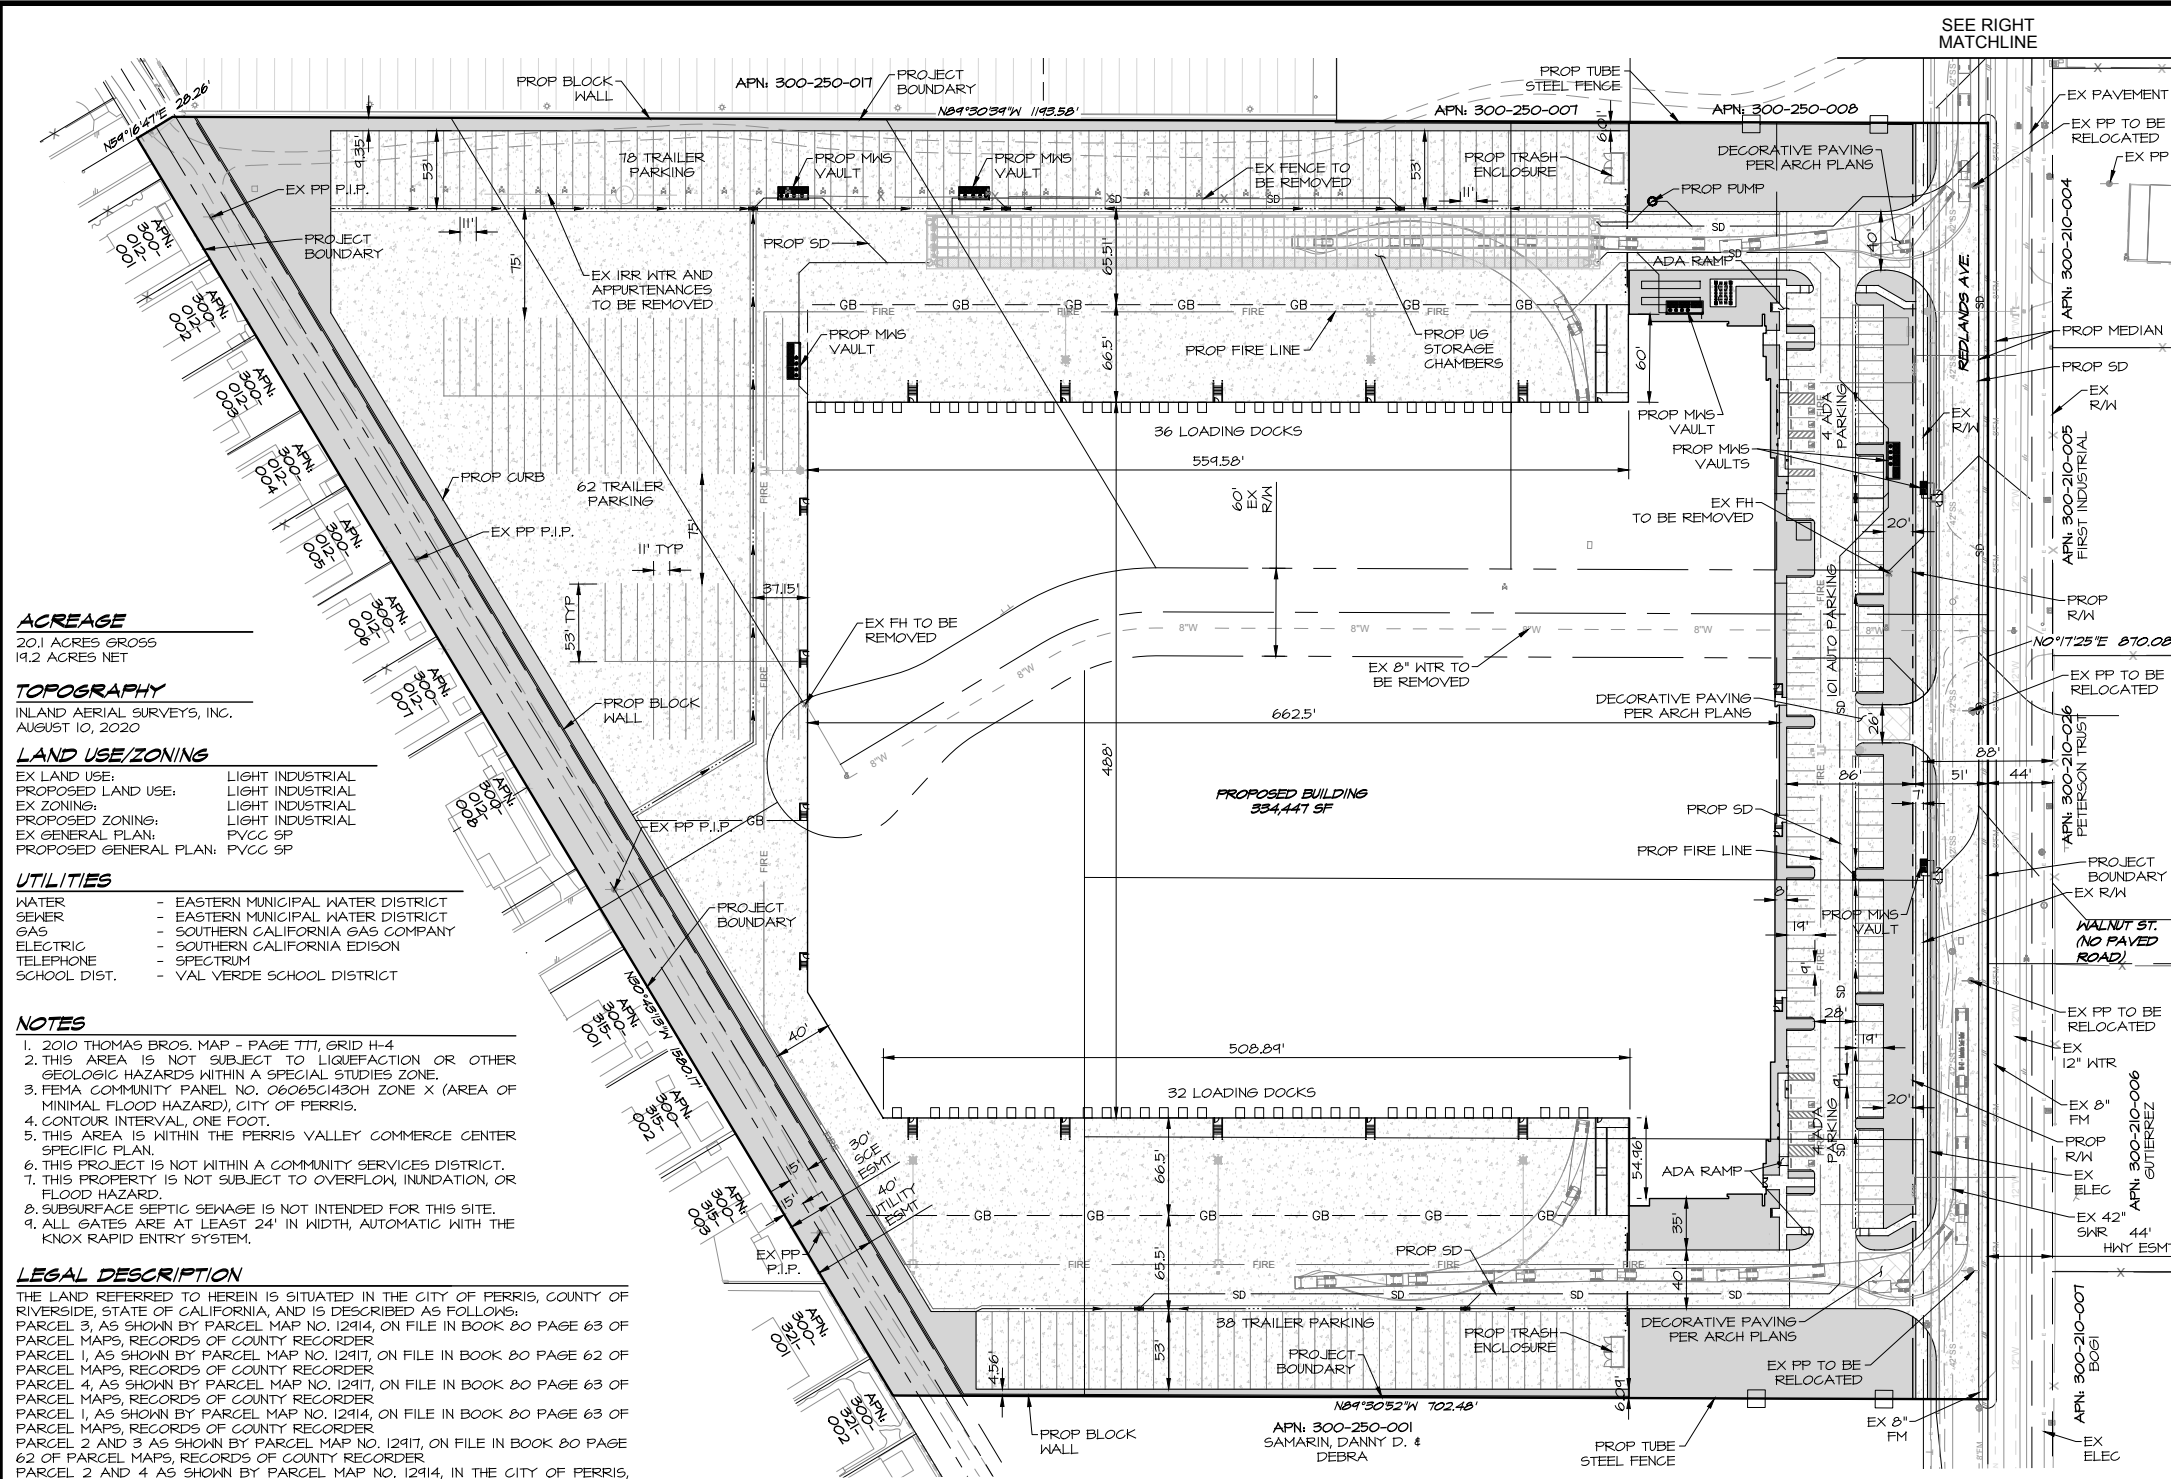

ACREAGE
20.1 ACRES GROSS
14.2 ACRES NET

TOPOGRAPHY
INLAND AERIAL SURVEYS, INC.
AUGUST 10, 2020




LAND USE/ZONING
EX LAND USE: LIGHT INDUSTRIAL
PROPOSED LAND USE: LIGHT INDUSTRIAL
EX ZONING: LIGHT INDUSTRIAL
PROPOSED ZONING: LIGHT INDUSTRIAL
EX GENERAL PLAN: PVCC 5P
PROPOSED GENERAL PLAN: PVCC 5P

UTILITIES
WATER - EASTERN MUNICIPAL WATER DISTRICT
SEWER - EASTERN MUNICIPAL WATER DISTRICT
GAS - SOUTHERN CALIFORNIA GAS COMPANY
ELECTRIC - SOUTHERN CALIFORNIA EDISON
TELEPHONE - SPECTRUM
SCHOOL DIST. - VAL VERDE SCHOOL DISTRICT

NOTES

- 2010 THOMAS BROS. MAP - PAGE TTI, GRID H-4
- THIS AREA IS NOT SUBJECT TO LIQUEFACTION OR OTHER GEOLOGIC HAZARDS WITHIN A SPECIAL STUDIES ZONE.
- FEMA COMMUNITY PANEL NO. 06065C1430H ZONE X (AREA OF MINIMAL FLOOD HAZARD), CITY OF FERRIS.
- CONTOUR INTERVAL, ONE FOOT.
- THIS AREA IS WITHIN THE PERRIS VALLEY COMMERCE CENTER SPECIFIC PLAN.
- THIS PROJECT IS NOT WITHIN A COMMUNITY SERVICES DISTRICT.
- THIS PROPERTY IS NOT SUBJECT TO OVERFLOW, INUNDATION, OR FLOOD HAZARD.
- SUBSURFACE SEPTIC SEWAGE IS NOT INTENDED FOR THIS SITE.
- ALL GATES ARE AT LEAST 24" IN WIDTH, AUTOMATIC WITH THE KNOX RAPID ENTRY SYSTEM.

LEGAL DESCRIPTION
THE LAND REFERRED TO HEREIN IS SITUATED IN THE CITY OF PERRIS, COUNTY OF RIVERSIDE, STATE OF CALIFORNIA, AND IS DESCRIBED AS FOLLOWS:
PARCEL 3, AS SHOWN BY PARCEL MAP NO. 12914, ON FILE IN BOOK 80 PAGE 63 OF PARCEL MAPS, RECORDS OF COUNTY RECORDER
PARCEL 1, AS SHOWN BY PARCEL MAP NO. 12911, ON FILE IN BOOK 80 PAGE 62 OF PARCEL MAPS, RECORDS OF COUNTY RECORDER
PARCEL 4, AS SHOWN BY PARCEL MAP NO. 12917, ON FILE IN BOOK 80 PAGE 63 OF PARCEL MAPS, RECORDS OF COUNTY RECORDER
PARCEL 1, AS SHOWN BY PARCEL MAP NO. 12914, ON FILE IN BOOK 80 PAGE 63 OF PARCEL MAPS, RECORDS OF COUNTY RECORDER
PARCEL 2 AND 3 AS SHOWN BY PARCEL MAP NO. 12917, ON FILE IN BOOK 80 PAGE 62 OF PARCEL MAPS, RECORDS OF COUNTY RECORDER
PARCEL 2 AND 4 AS SHOWN BY PARCEL MAP NO. 12914, IN THE CITY OF PERRIS, COUNTY OF RIVERSIDE, STATE OF CALIFORNIA, AS SHOWN BY MAP ON FILE IN BOOK 80 PAGE 63 OF PARCEL MAPS, RECORDS OF RIVERSIDE COUNTY

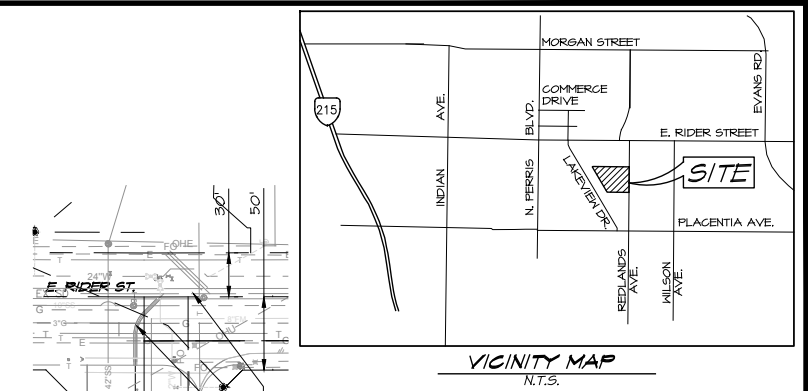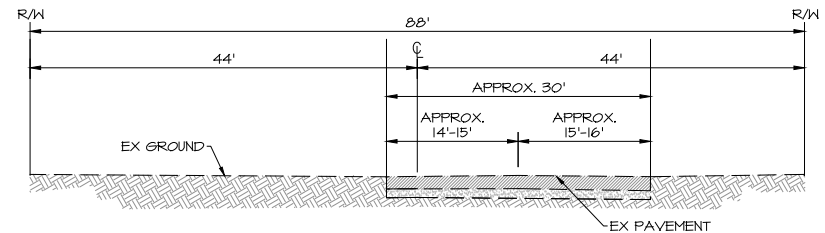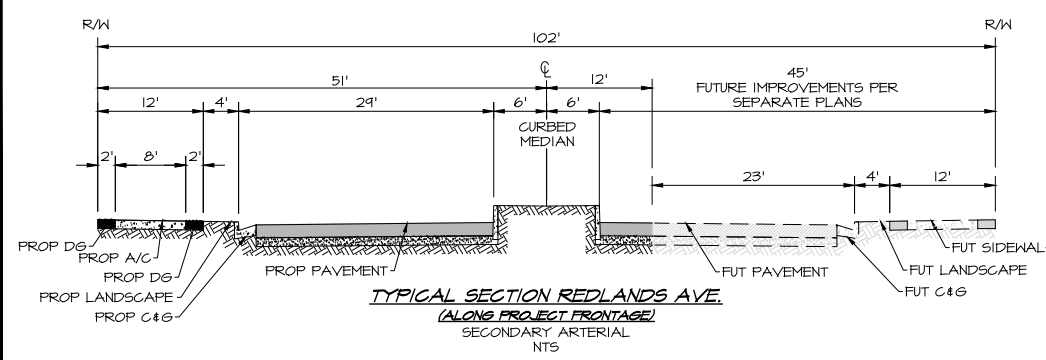

APPLICANT
LAKE CREEK INDUSTRIAL LLC
1302 BRITANNY CROSS ROAD
SANTA ANA, CA 92705
CONTACT: MICHAEL JOHNSON
TEL: 714-200-4681

OWNER
LAKE CREEK INDUSTRIAL LLC
1302 BRITANNY CROSS ROAD
SANTA ANA, CA 92705

APN

300-250-004	300-250-013
300-250-010	300-250-014
300-250-011	300-250-015
300-250-012	300-250-016

EARTHWORK ESTIMATE


RAW CUT/FILL	CUT	FILL
	44,953 C.Y.	44,953 C.Y.

PROJECT DATA

SITE AREA	871,309 SF
	20.1 ACRES GROSS AREA
	14.2 ACRES NET AREA
BUILDING AREA WAREHOUSE	334,040 SF
LOT COVERAGE	34.7%
PARKING REQUIRED	
8,000 OFFICE PARKING (LESS THAN 10%)	00 STALLS
0-20K SF (1/1000 SF)	20 STALLS
20K-40K SF (1/2000 SF)	10 STALLS
40K+ SF (1/5000 SF)	59 STALLS
TOTAL PARKING REQUIRED	89 STALLS
PARKING PROVIDED	
ACCESSIBLE STALLS	8 STALLS
STANDARD STALLS	101 STALLS
FUTURE STALLS	00 STALLS
TOTAL PROVIDED	109 STALLS
LANDSCAPING AREA	
AREA REQUIRED	118,146 SF
AREA PROVIDED	12.0%
GROSS IMPERVIOUS AREA AREA	753,002 SF

LEGEND

[Symbol]	PROPOSED CONCRETE/ASPHALT
[Symbol]	PROPOSED LANDSCAPE
[Symbol]	PROPOSED 14" HIGH BLOCK WALL (PER ARCHITECT PLANS)
[Symbol]	PROPOSED 8" HIGH CHAIN LINK FENCE (PER ARCHITECT PLANS)
[Symbol]	PROPOSED MWS WATER QUALITY TREATMENT VAULT (SIZE VARIES)
[Symbol]	EX POWER POLE
[Symbol]	FIRE LINE
[Symbol]	EX STORM DRAIN
[Symbol]	EX SD
[Symbol]	PROP STORM DRAIN
[Symbol]	PROP FH

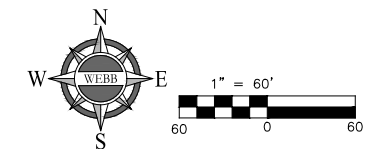

SCALE: 1"=60'	ALBERT A. WEBB ENGINEERING CONSULTANTS
DATE: 12/17/21	3788 MCGRAY STREET RIVERSIDE CA, 92506
DESIGNED: AYS	PH. (951) 686-1070
CHECKED: JRB	FAX (951) 788-1256
PLN CK REF:	
F.B.	

REVISIONS: DATE BY









SCALE: 1"=60'

ALBERT A. WEBB ENGINEERING CONSULTANTS
3788 MCGRAY STREET RIVERSIDE CA, 92506
PH. (951) 686-1070
FAX (951) 788-1256

CITY OF FERRIS
DEVELOPMENT PLAN REVIEW
DPR 20-00020

W.O. 20-0186
SHEET /
OF 2 SHEETS
DWG. NO.

12/17/2021 11:51:39 AM H:\2020\20-0186\DRAWINGS\ENTITLEMENT\DPR\20-186-C-DPR.DWG

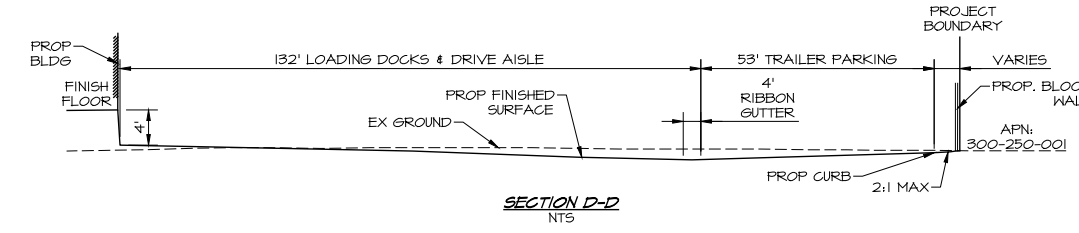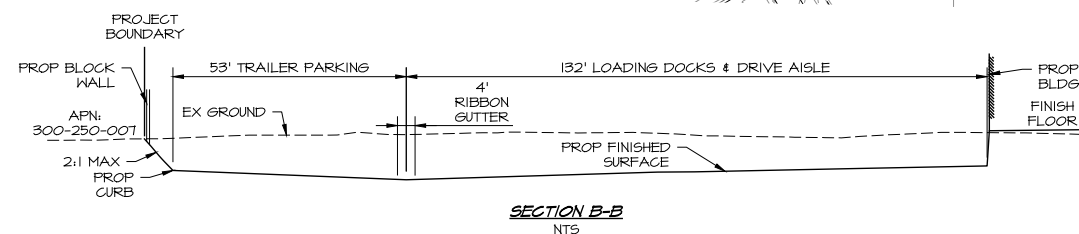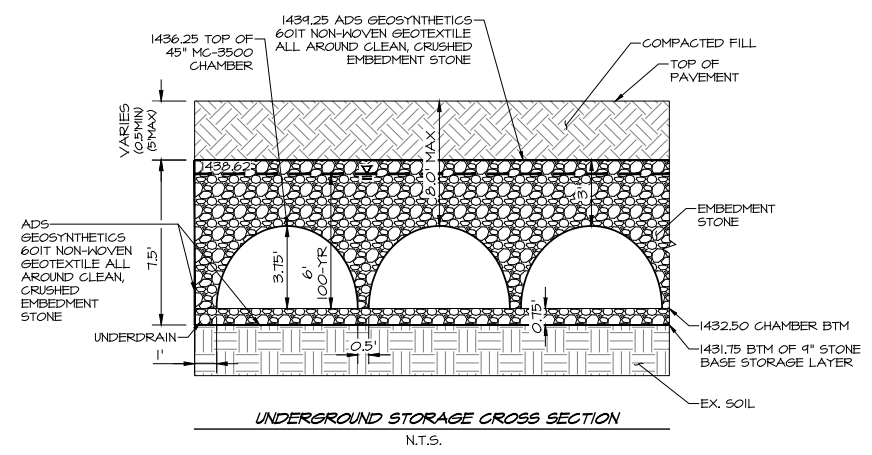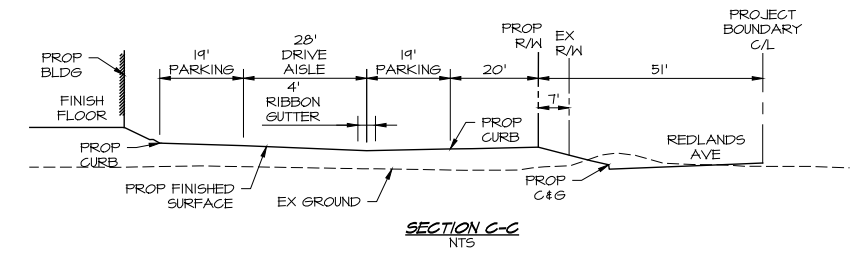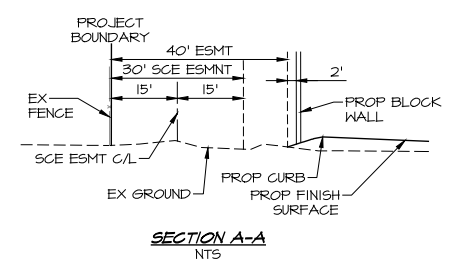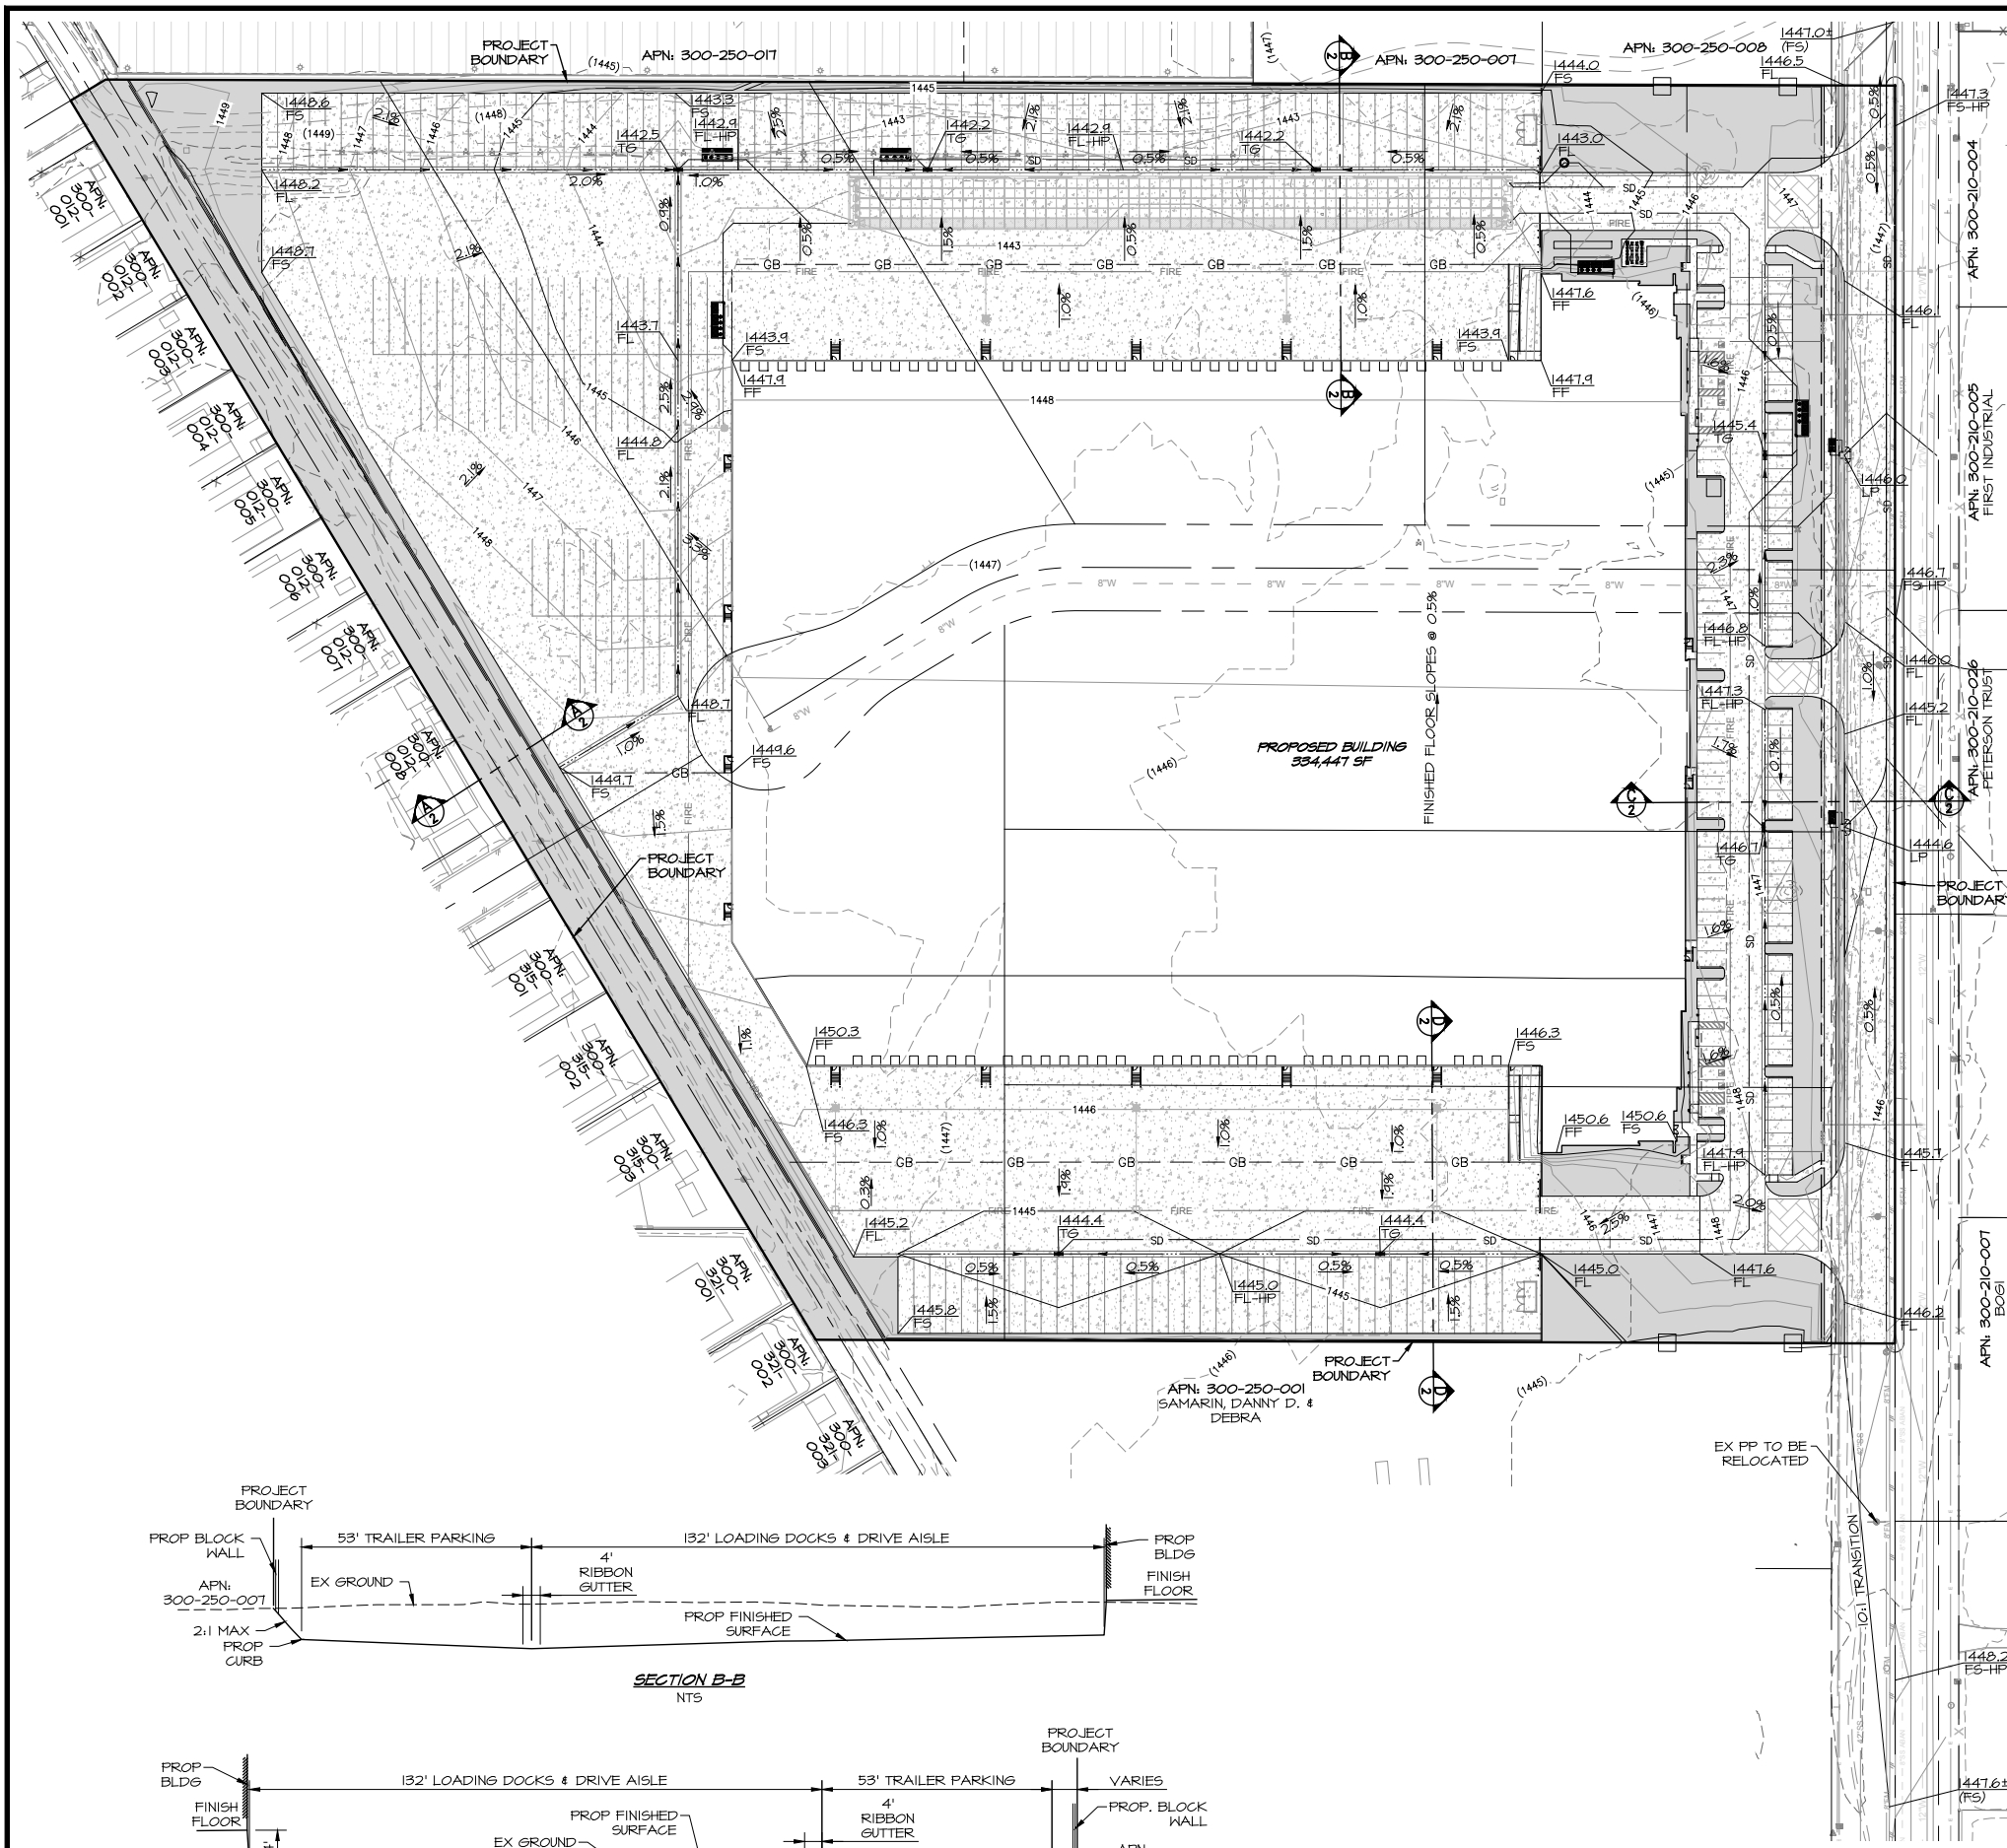

REVISIONS	DATE	BY

SCALE: 1"=60'
 DATE: 12/17/21
 DESIGNED: AYS
 CHECKED: JRB
 PLN CK REF: F.B.
ALBERT A. WEBB ASSOCIATES
 ENGINEERING CONSULTANTS
 3788 MURRAY STREET
 RIVERSIDE CA, 92506
 PH. (951) 686-1070
 FAX (951) 788-1256
 PLOT DATE: 11-Dec-21

CITY OF FERRIS
 DEVELOPMENT PLAN REVIEW
 DPR 20-00020
 CONCEPTUAL GRADING & DRAINAGE PLAN

W.O. 20-0186
 SHEET 2
 OF 2 SHEETS
 DWS. NO.

H:\2020\20-0186\DRAWINGS\ENTITLEMENT\DPR\20-186-C-DPR.DWG 12/17/2021 11:51:39 AM

Appendix 3: Soils Information

Geotechnical Study and Other Infiltration Testing Data

October 30, 2020

Lake Creek Industrial, LLC
1302 Brittany Cross Road
Santa Ana, California 92705

Attention: Mr. Bob Kubichek

Project No.: **20G179-2**

Subject: **Results of Infiltration Testing**
Proposed Redlands West Development
Redlands Avenue, South of Rider Street
Perris, California

References: Geotechnical Investigation, Proposed Warehouse, Redlands Avenue, South of Rider Street, Perris, California, prepared for Black Creek Group by Southern California Geotechnical, Inc. (SCG), SCG Project No. 19G213-1, dated October 25, 2019.

Results of Infiltration Testing, Proposed Warehouse, Redlands Avenue, South of Rider Street, Perris, California, prepared for Black Creek Group, by Southern California Geotechnical, Inc. (SCG), SCG Project No. 19G213-2, dated October 31, 2019.

Mr. Kubichek:

In accordance with your request, we have conducted infiltration testing at the subject site. We are pleased to present this report summarizing the results of the infiltration testing and our design recommendations.

Scope of Services

The scope of services performed for this project was in general accordance with our Proposal No. 20P209R, dated June 17, 2020 and Change Order No. 20G179-CO, dated October 1, 2020. The scope of services included site reconnaissance, subsurface exploration, field testing, and engineering analysis to determine the infiltration rates of the on-site soils. The infiltration testing was performed in general accordance with the guidelines published in Riverside County – Low Impact Development BMP Design Handbook – Section 2.3 of Appendix A, prepared for the Riverside County Department of Environmental Health (RCDEH), dated December, 2013.

Site and Project Description

The subject site is located on the west side of Redlands Avenue, 720± feet south of Rider Street in Perris, California. The site is bounded to the north by an existing warehouse and a vacant lot, to the west by a Southern California Edison easement, to the south by a vacant lot, and to the east by Redlands Avenue. The general location of the site is illustrated on the Site Location Map, enclosed as Plate 1 of this report.



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**
A California Corporation

The subject site consists of eight (8) rectangular to trapezoidal-shaped parcels which total 18.07± acres. The site is currently vacant and undeveloped. Ground surface cover consists of exposed soil with moderate native grass and weed growth, and localized areas of scattered debris and trash, such as clothes, tires, and concrete fragments.

Detailed topographic information was not available at the time of this report. However, based on topographic information obtained from Google Earth, the overall site topography slopes gently downward to the south at a gradient of less than 1± percent.

Proposed Development

The most current preliminary site plan, prepared by RGA, was provided to our office by the client. The plan indicates that the new development will consist of one (1) new commercial/industrial building, 305,780± ft² in size, located in the eastern region of the subject site. Dock-high doors and a truck court will be constructed on the west side of the proposed building. The new building is expected to be surrounded by asphaltic concrete pavements in the parking and drive areas and Portland cement concrete pavements in the loading dock areas. Several landscaped planters and concrete flatwork are also expected to be included throughout the site.

The proposed development will include on-site infiltration to dispose of storm water. Based on the infiltration test exhibit provided by Webb Associates, the project civil engineer, the infiltration system will consist of a below-grade chamber system located in the eastern area of the site. The bottom of the chamber system will be 10± feet below the existing site grades.

Previous Studies

SCG previously conducted a geotechnical investigation at the subject site referenced above. As part of this investigation, seven (7) borings were advanced to depths of 15 to 25± feet below the existing site grades. Native alluvial soils were encountered at the ground surface of all boring locations, extending to at least the maximum depth explored of 25± feet. The near-surface alluvium, in the upper 3 to 9± feet, generally consisted of loose to dense silty fine sands and fine sandy silts with variable amounts of medium to coarse sands and clay content. At greater depths, the alluvial soils generally consisted of stiff to hard clayey silts, medium stiff to very stiff silty clays, and medium dense to dense fine sandy silts. Three (3) of the borings encountered soil strata consisting of medium dense fine to coarse sands at depths ranging from 5½ to 9± feet. Groundwater was not encountered during the drilling of any of the borings.

SCG previously conducted infiltration testing at the subject site, referenced above. The infiltration testing was performed in general accordance with the ASTM Test Method D-3385-03, Standard Test Method for Infiltration Rate of Soils in Field Using Double Ring Infiltrometer. As part of this investigation, subsurface exploration for the infiltration testing consisted of three (3) backhoe-excavated, trenches, (identified as I-1 through I-3), each extending to a depth of 10± feet below existing site grades. Native alluvium was encountered at the ground surface at all three (3) of the infiltration trench locations. The near-surface alluvial soils, extending from the ground surface to 1± foot below the existing site grades, consisted of loose silty fine to medium sands with trace to little coarse sand. At greater depths, the alluvial soils generally consisted of medium dense to very dense silty fine sands and fine to medium sandy silts with variable amounts of medium to coarse sands and clay content, and loose to medium dense fine to coarse sands, extending to at

least the maximum depth explored of 10± feet below the existing site grades. Based on the results of Infiltration Test Nos. I-1 and I-2, we recommend an infiltration rate of 0.3 inches per hour be used for the design of the proposed below-grade chamber system located in the south-central area of the site. Based on the results of Infiltration Test No. I-3, we previously recommended an infiltration rate of 1.3 inches per hour be used for the design of the proposed chamber system located in the east-central area of the site. Infiltration test results are summarized as follows:

<u>Infiltration Test No.</u>	<u>Soil Description</u>	<u>Infiltration Rate (inches/hour)</u>
I-1	Fine to medium Sandy Silt, little Clay, little coarse Sand	0.4
I-2	Fine to medium Sandy Silt, little Clay, trace to little coarse Sand	0.3
I-3	Fine to medium Sandy Silt, trace Clay, trace coarse Sand	1.3

Subsurface Exploration

Scope of Exploration

The subsurface exploration conducted for the infiltration testing consisted of six (6) infiltration test borings advanced to depths of 10± feet below the existing site grades. The infiltration borings were advanced using a truck-mounted drilling rig, equipped with 8-inch diameter hollow stem augers and were logged during drilling by a member of our staff. The approximate locations of the infiltration test borings (identified as I-1 through I-6) are indicated on the Infiltration Test Location Plan, enclosed as Plate 2 of this report.

Upon the completion of the infiltration borings, the bottom of each test boring was covered with 2± inches of clean ¾-inch gravel. A sufficient length of 3-inch-diameter perforated PVC casing was then placed into each test hole so that the PVC casing extended from the bottom of the test hole to the ground surface. Clean ¾-inch gravel was then installed in the annulus surrounding the PVC casing.

Geotechnical Conditions

Native alluvium was encountered at the ground surface at all six (6) infiltration testing locations. In general, the alluvial soils consist of loose to very dense silty fine to medium sands with trace coarse sands and fine sandy silts extending to at least the maximum depth explored of 10± feet below the existing site grades. The Boring Logs, which illustrate the conditions encountered at the infiltration test locations, are included with this report.

Infiltration Testing

As previously mentioned, the infiltration testing was performed in general accordance with the guidelines published in Riverside County – Low Impact Development BMP Design Handbook – Section 2.3 of Appendix A.

Pre-soaking

In accordance with the county infiltration standards, both of the infiltration test borings were pre-soaked prior to the infiltration testing. The pre-soaking process consisted of filling the test borings by inverting a full 5-gallon bottle of clear water supported over each hole so that the water level reaches a level of at least 5 times the hole's radius above the gravel at the bottom of each hole. The pre-soaking was completed after all of the water had percolated through each test hole or after 15 hours since initiating the pre-soak.

Infiltration Testing

Following the pre-soaking process of the infiltration test borings, SCG performed the infiltration testing. Each test hole was filled with water to a depth of at least 5 times the hole's radius above the gravel at the bottom of each test hole, and less than or equal to the water level used during the pre-soaking process. In accordance with the Riverside County guidelines, since "non-sandy soils" were encountered at the bottom of all infiltration test borings (where less than 6 inches of water infiltrated into the surrounding soils for two consecutive 25-minute readings), readings were taken at 30-minute intervals for a total of 6 hours at the six (6) test locations. After each reading, the borings were refilled to the correct water level above the gravel at the bottom of each test hole. The water level readings are presented on the spreadsheets enclosed with this report. The infiltration rates for each of the timed intervals are also tabulated on the spreadsheets.

The infiltration rates from the test are tabulated in inches per hour. In accordance with the typically accepted practice, it is recommended that the most conservative reading from the latter part of the infiltration tests be used as the design infiltration rate. The rates are summarized below:

<u>Infiltration Test No.</u>	<u>Soil Description</u>	<u>Infiltration Rate (inches/hour)</u>
I-1	Silty fine to medium Sand, trace coarse Sand	0.9
I-2	Silty fine to medium Sand, trace coarse Sand	0.4
I-3	Silty fine to medium Sand, trace coarse Sand	0.5
I-4	Fine Sandy Silt, trace medium Sand	0.6
I-5	Fine Sandy Silt	1.1
I-6	Fine Sandy Silt	1.1

Laboratory Testing

Grain Size Analysis

The grain size distribution of selected soils from the base of each infiltration test boring has been determined using a range of wire mesh screens. These tests were performed in general accordance with ASTM D-422 and/or ASTM D-1140. The weight of the portion of the sample retained on each screen is recorded and the percentage finer or coarser of the total weight is

calculated. The results of these tests are presented on Plates C-1 through C-6 of this report.

Design Recommendations

A total of six (6) infiltration tests were performed at the subject site. As noted above, the calculated infiltration rates at the infiltration test locations range from 0.4 to 1.1 inches per hour due to the varying relative densities, and the silt content of the soil encountered at the bottom of each infiltration boring.

Based on the infiltration test results, we recommend a design infiltration rate of 0.4 inches per hour to be used for the proposed infiltration/detention system located in the northern portion of the subject site and 0.6 inches per hour to be used in the southern portion.

The design of the proposed storm water infiltration systems should be performed by the project civil engineer, in accordance with the City of Perris and/or County of Riverside guidelines. However, it is recommended that the systems be constructed so as to facilitate removal of silt and clay, or other deleterious materials from any water that may enter the systems. The presence of such materials would decrease the effective infiltration rates. **It is recommended that the project civil engineer apply an appropriate factor of safety. The infiltration rates recommended above are based on the assumption that only clean water will be introduced to the subsurface profile. Any fines, debris, or organic materials could significantly impact the infiltration rates.** It should be noted that the recommended infiltration rates are based on infiltration testing at six (6) discrete locations and the overall infiltration rates of the storm water infiltration systems could vary considerably.

Construction Considerations

The infiltration rates presented in this report are specific to the tested locations and tested depths. Infiltration rates can be significantly reduced if the soils are exposed to excessive disturbance or compaction during construction. Therefore, the subgrade soils within proposed infiltration system areas should not be overexcavated, undercut or compacted in any significant manner. **It is recommended that a note to this effect be added to the project plans and/or specifications.**

Infiltration versus Permeability

Infiltration rates are based on unsaturated flow. As water is introduced into soils by infiltration, the soils become saturated and the wetting front advances from the unsaturated zone to the saturated zone. Once the soils become saturated, infiltration rates become zero, and water can only move through soils by hydraulic conductivity at a rate determined by pressure head and soil permeability. The infiltration rates presented herein were determined in accordance with the ASTM Test Method D-3385-03 standard, and are considered valid for the time and place of the actual test. Changes in soil moisture content will affect these infiltration rates. Infiltration rates should be expected to decrease until the soils become saturated. Soil permeability values will then govern groundwater movement. Permeability values may be on the order of 10 to 20 times less than infiltration rates. The system designer should incorporate adequate factors of safety

and allow for overflow design into appropriate traditional storm drain systems, which would transport storm water off-site.

Location of Infiltration Systems

The use of on-site storm water infiltration systems carries a risk of creating adverse geotechnical conditions. Increasing the moisture content of the soil can cause the soil to lose internal shear strength and increase its compressibility, resulting in a change in the designed engineering properties. Overlying structures and pavements in the infiltration areas could potentially be damaged due to saturation of subgrade soils. **The proposed infiltration systems for the site should be located at least 25 feet away from any structures, including retaining walls.** Even with this provision of locating the infiltration systems at least 25 feet from any building, it is possible that infiltrating water into the subsurface soils could have an adverse effect on any proposed or existing structure. It should also be noted that utility trenches which happen to collect storm water can also serve as conduits to transmit storm water toward the structure, depending on the slope of the utility trench. Therefore, consideration should also be given to the proposed locations of underground utilities which may pass near the proposed infiltration system.

General Comments

This report has been prepared as an instrument of service for use by the client in order to aid in the evaluation of this property and to assist the architects and engineers in the design and preparation of the project plans and specifications. This report may be provided to the contractor(s) and other design consultants to disclose information relative to the project. However, this report is not intended to be utilized as a specification in and of itself, without appropriate interpretation by the project architect, structural engineer, and/or civil engineer. The design of the infiltration system is the responsibility of the civil engineer. The role of the geotechnical engineer is limited to determination of infiltration rate only. By using the design infiltration rates contained herein, the civil engineer agrees to indemnify, defend, and hold harmless the geotechnical engineer for all aspects of the design and performance of the infiltration system. The reproduction and distribution of this report must be authorized by the client and Southern California Geotechnical, Inc. Furthermore, any reliance on this report by an unauthorized third party is at such party's sole risk, and we accept no responsibility for damage or loss which may occur.

The analysis of this site was based on a subsurface profile interpolated from limited discrete soil samples. While the materials encountered in the project area are considered to be representative of the total area, some variations should be expected between boring locations and testing depths. If the conditions encountered during construction vary significantly from those detailed herein, we should be contacted immediately to determine if the conditions alter the recommendations contained herein.

This report has been based on assumed or provided characteristics of the proposed development. It is recommended that the owner, client, architect, structural engineer, and civil engineer carefully review these assumptions to ensure that they are consistent with the characteristics of the proposed development. If discrepancies exist, they should be brought to our attention to verify that they do not affect the conclusions and recommendations contained herein. We also

recommend that the project plans and specifications be submitted to our office for review to verify that our recommendations have been correctly interpreted.

The analysis, conclusions, and recommendations contained within this report have been promulgated in accordance with generally accepted professional geotechnical engineering practice. No other warranty is implied or expressed.

Closure

We sincerely appreciate the opportunity to be of service on this project. We look forward to providing additional consulting services during the course of the project. If we may be of further assistance in any manner, please contact our office.

Respectfully Submitted,

SOUTHERN CALIFORNIA GEOTECHNICAL, INC.



Jose Zuniga
Staff Engineer




Robert G. Trazo, M.Sc., GE 2655
Principal Engineer




Distribution: (1) Addressee


Enclosures: Plate 1 - Site Location Map
Plate 2 - Infiltration Test Location Plan
Boring Log Legend and Logs (8 pages)
Infiltration Test Results Spreadsheets (6 pages)
Grain Size Distribution Graphs (6 pages)

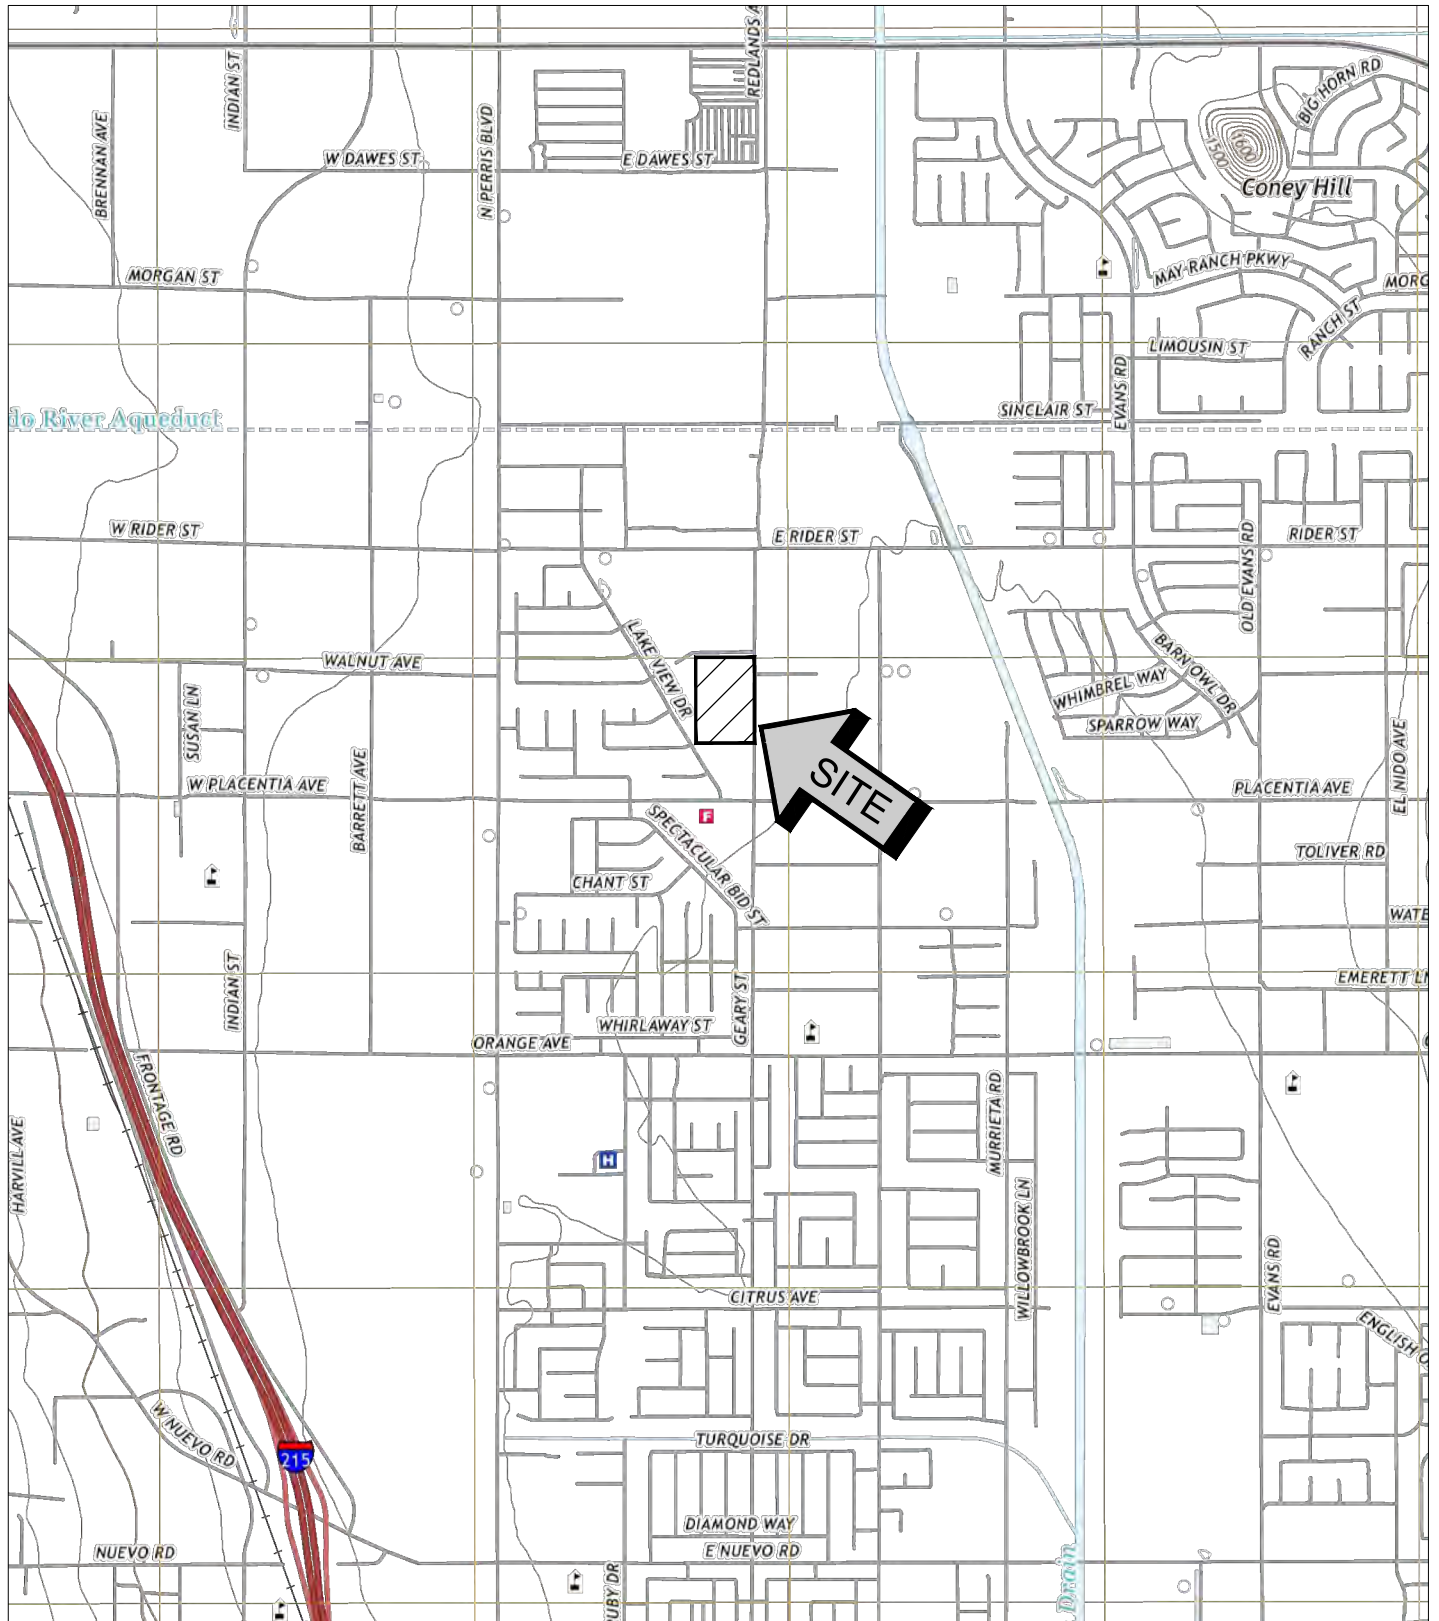


SOURCE: USGS TOPOGRAPHIC MAP OF THE PERRIS QUADRANGLE, RIVERSIDE COUNTY, CALIFORNIA, 2018.



SITE LOCATION MAP	
PROPOSED REDLANDS WEST DEVELOPMENT	
PERRIS, CALIFORNIA	
SCALE: 1" = 2000'	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAZ	
CHKD: RGT	
SCG PROJECT 20G179-2	
PLATE 1	



N.A.P.

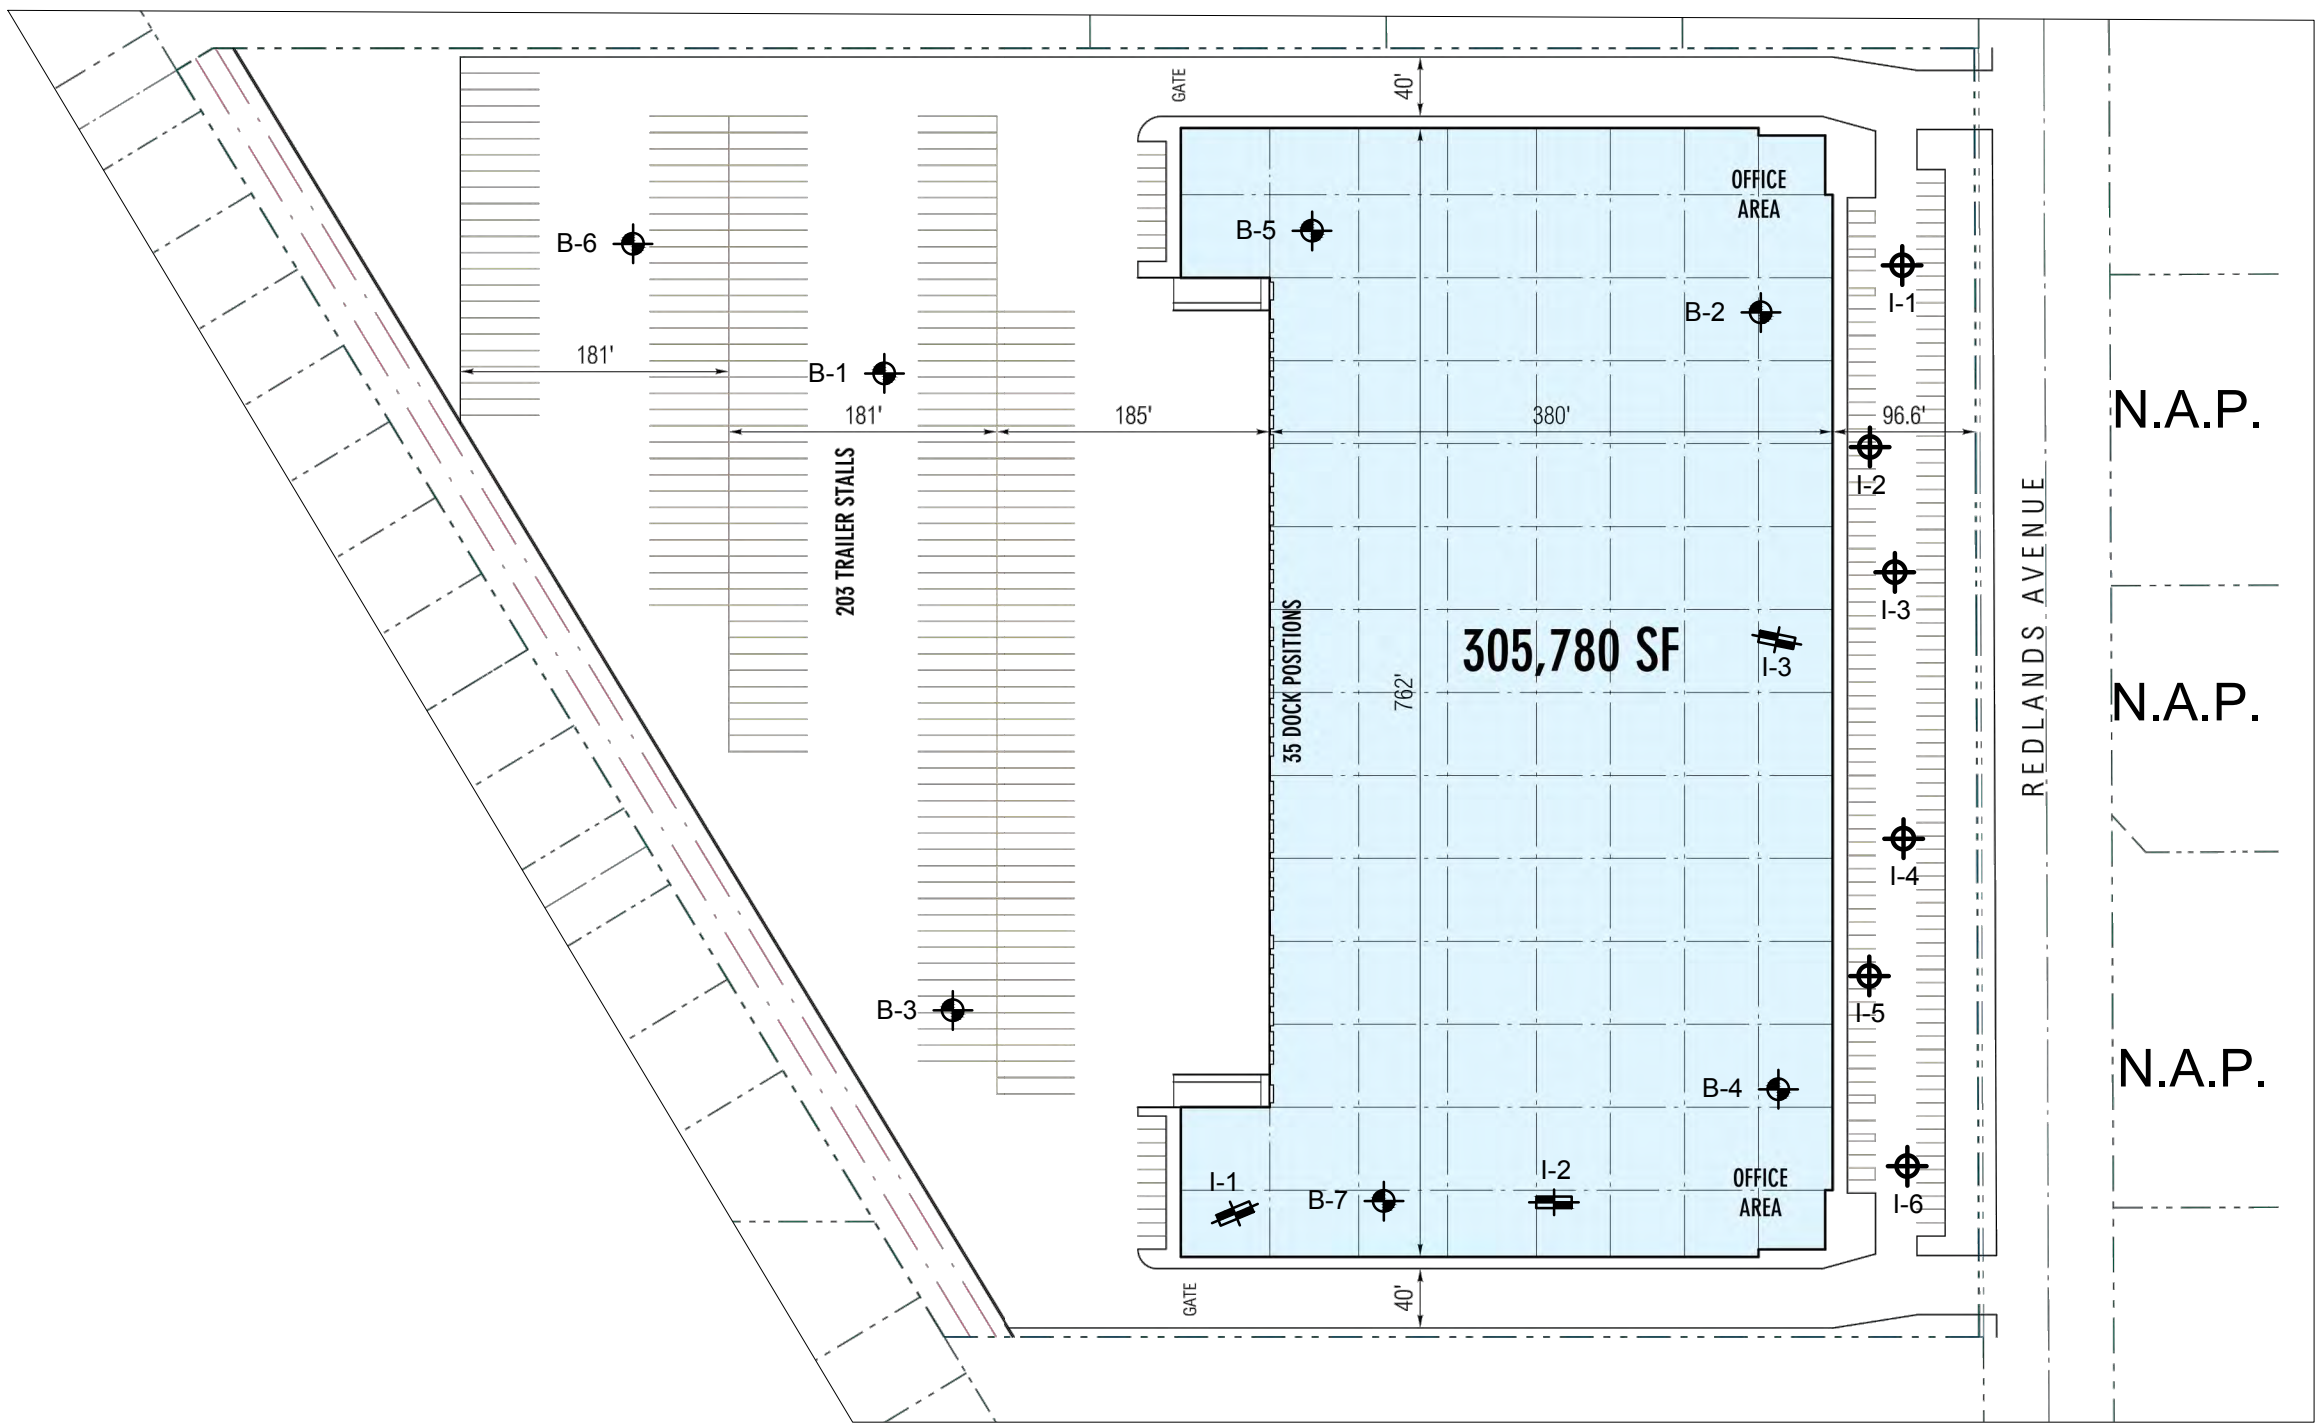

N.A.P.

N.A.P.


N.A.P.

N.A.P.









GEOTECHNICAL LEGEND

- APPROXIMATE INFILTRATION TEST LOCATION
- PREVIOUS BORING LOCATION (SCG PROJECT NO. 19G213-1)
- PREVIOUS BORING LOCATION (SCG PROJECT NO. 19G213-2)

NOTE: PRELIMINARY SITE PLAN PREPARED BY RGA.

INFILTRATION TEST LOCATION PLAN	
PROPOSED REDLANDS WEST DEVELOPMENT	
PERRIS, CALIFORNIA	
SCALE: 1" = 120'	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAZ	
CHKD: RGT	
SCG PROJECT 20G179-2	
PLATE 2	

BORING LOG LEGEND

SAMPLE TYPE	GRAPHICAL SYMBOL	SAMPLE DESCRIPTION
AUGER		SAMPLE COLLECTED FROM AUGER CUTTINGS, NO FIELD MEASUREMENT OF SOIL STRENGTH. (DISTURBED)
CORE		ROCK CORE SAMPLE: TYPICALLY TAKEN WITH A DIAMOND-TIPPED CORE BARREL. TYPICALLY USED ONLY IN HIGHLY CONSOLIDATED BEDROCK.
GRAB		SOIL SAMPLE TAKEN WITH NO SPECIALIZED EQUIPMENT, SUCH AS FROM A STOCKPILE OR THE GROUND SURFACE. (DISTURBED)
CS		CALIFORNIA SAMPLER: 2-1/2 INCH I.D. SPLIT BARREL SAMPLER, LINED WITH 1-INCH HIGH BRASS RINGS. DRIVEN WITH SPT HAMMER. (RELATIVELY UNDISTURBED)
NSR		NO RECOVERY: THE SAMPLING ATTEMPT DID NOT RESULT IN RECOVERY OF ANY SIGNIFICANT SOIL OR ROCK MATERIAL.
SPT		STANDARD PENETRATION TEST: SAMPLER IS A 1.4 INCH INSIDE DIAMETER SPLIT BARREL, DRIVEN 18 INCHES WITH THE SPT HAMMER. (DISTURBED)
SH		SHELBY TUBE: TAKEN WITH A THIN WALL SAMPLE TUBE, PUSHED INTO THE SOIL AND THEN EXTRACTED. (UNDISTURBED)
VANE		VANE SHEAR TEST: SOIL STRENGTH OBTAINED USING A 4 BLADED SHEAR DEVICE. TYPICALLY USED IN SOFT CLAYS-NO SAMPLE RECOVERED.

COLUMN DESCRIPTIONS

DEPTH:

Distance in feet below the ground surface.

SAMPLE:

Sample Type as depicted above.

BLOW COUNT:

Number of blows required to advance the sampler 12 inches using a 140 lb hammer with a 30-inch drop. 50/3" indicates penetration refusal (>50 blows) at 3 inches. WH indicates that the weight of the hammer was sufficient to push the sampler 6 inches or more.

POCKET PEN.:

Approximate shear strength of a cohesive soil sample as measured by pocket penetrometer.

GRAPHIC LOG:

Graphic Soil Symbol as depicted on the following page.

DRY DENSITY:

Dry density of an undisturbed or relatively undisturbed sample in lbs/ft³.

MOISTURE CONTENT:

Moisture content of a soil sample, expressed as a percentage of the dry weight.

LIQUID LIMIT:

The moisture content above which a soil behaves as a liquid.

PLASTIC LIMIT:

The moisture content above which a soil behaves as a plastic.

PASSING #200 SIEVE:

The percentage of the sample finer than the #200 standard sieve.

UNCONFINED SHEAR:

The shear strength of a cohesive soil sample, as measured in the unconfined state.

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS	
			GRAPH	LETTER		
<p>COARSE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE</p>	<p>GRAVEL AND GRAVELLY SOILS</p>	<p>CLEAN GRAVELS</p> <p>(LITTLE OR NO FINES)</p>		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
		<p>MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE</p>	<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
			<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GM	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES
		<p>MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE</p>	<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES
	<p>MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE</p>		<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SP	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES
		<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SM	SILTY SANDS, SAND - SILT MIXTURES	
	<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SC	CLAYEY SANDS, SAND - CLAY MIXTURES		
	<p>FINE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE</p>	<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT LESS THAN 50</p>		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY	
				CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS	
				OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY	
<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT GREATER THAN 50</p>			MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS		
			CH	INORGANIC CLAYS OF HIGH PLASTICITY		
			OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS		
<p>HIGHLY ORGANIC SOILS</p>				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS	

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS



JOB NO.: 20G179-2 DRILLING DATE: 10/7/20 WATER DEPTH: ---
 PROJECT: Proposed Redlands West Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Jose Zuniga READING TAKEN: ---

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
		17			ALLUVIUM: Brown Silty fine Sand, medium dense - dry to damp		4					
		63			@ 3.5 feet, very dense		5					
5		26			Brown Silty fine Sand, trace fine to coarse Gravel, medium dense - dry		1					
		15			Brown Silty fine to medium Sand, trace coarse Sand, medium dense - dry to damp		5			33		
10					Boring Terminated at 10'							

TBL_20G179-2.GPJ_SOCALGEO.GDT_10/30/20



JOB NO.: 20G179-2 DRILLING DATE: 10/7/20 WATER DEPTH: ---
 PROJECT: Proposed Redlands West Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Jose Zuniga READING TAKEN: ---

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
		13			<u>ALLUVIUM</u> : Brown Silty fine to medium Sand, trace coarse Sand, medium dense - damp @ 3.5 feet, loose to medium dense @ 6.0 feet, medium dense	4						
5		10				4						
		25				5						
		19				6			35			
10					Boring Terminated at 10'							

TBL_20G179-2.GPJ_SOCALGEO.GDT_10/30/20



JOB NO.: 20G179-2 DRILLING DATE: 10/7/20 WATER DEPTH: ---
 PROJECT: Proposed Redlands West Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Jose Zuniga READING TAKEN: ---

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
		24			ALLUVIUM: Brown Silty fine Sand, cemented, medium dense - dry to damp		4					
		58			@ 3.5 feet, very dense		5					
5		8			Brown Silty fine to medium Sand, trace coarse Sand, loose - dry to damp		3					
		18			@ 8.5 feet, medium dense, damp		11		46			
10					Boring Terminated at 10'							

TBL_20G179-2.GPJ_SOCALGEO.GDT_10/30/20



JOB NO.: 20G179-2 DRILLING DATE: 10/7/20 WATER DEPTH: ---
 PROJECT: Proposed Redlands West Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Jose Zuniga READING TAKEN: ---

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
		21			<u>ALLUVIUM</u> : Brown Silty fine Sand, medium dense - dry to damp		4				
		27					5				
5		14			Brown fine to coarse Sand, little Silt, medium dense - dry to damp		6				
		22			Brown fine Sandy Silt, trace medium Sand, medium dense - damp		11		66		
10					Boring Terminated at 10'						

TBL_20G179-2.GPJ_SOCALGEO.GDT_10/30/20



JOB NO.: 20G179-2 DRILLING DATE: 10/7/20 WATER DEPTH: ---
 PROJECT: Proposed Redlands West Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Jose Zuniga READING TAKEN: ---

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
		10			<u>ALLUVIUM</u> : Brown Silty fine Sand, little to some medium Sand, loose to medium dense - dry to damp		4				
		27			@ 3.5 feet, cemented, medium dense - damp		12				
5		15			Brown fine Sandy Silt, medium dense - damp		8				
		10			@ 8.5 feet, loose to medium dense, damp to moist		14			81	
10					Boring Terminated at 10'						

TBL_20G179-2.GPJ_SOCALGEO.GDT_10/30/20



JOB NO.: 20G179-2 DRILLING DATE: 10/7/20 WATER DEPTH: ---
 PROJECT: Proposed Redlands West Development DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Jose Zuniga READING TAKEN: ---

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	
SURFACE ELEVATION: --- MSL											
		35			ALLUVIUM: Brown Silty fine to medium Sand, cemented, dense - dry to damp @ 3.5 feet, very dense @ 3.5 feet, medium dense Brown fine Sandy Silt, cemented, medium dense - damp to moist		4				
		68					4				
5		15					5				
		29					14			78	
10					Boring Terminated at 10'						

TBL_20G179-2.GPJ_SOCALGEO.GDT_10/30/20

INFILTRATION CALCULATIONS

Project Name	Proposed Redlands West Development
Project Location	Perris, California
Project Number	20G179-2
Engineer	Jose Zuniga

Test Hole Radius	4 (in)
Test Depth	10 (ft)

Infiltration Test Hole

Interval Number		Time	Time Interval (min)	Water Depth (ft)	Change in Water Level (ft)	Average Head Height (ft)	Infiltration Rate Q (in/hr)		
P1	Initial	7:57 AM	25.0	8.19	0.51	1.56	1.42	Pre-Soak	
	Final	8:22 AM		8.70					
P2	Initial	8:24 AM	25.0	8.74	0.32	1.10	1.21		Infiltration Testing
	Final	8:49 AM		9.06					
1	Initial	8:54 AM	30.0	8.35	0.45	1.43	1.13		
	Final	9:24 AM		8.80					
2	Initial	9:27 AM	30.0	8.21	0.42	1.58	0.96		
	Final	9:57 AM		8.63					
3	Initial	11:00 AM	30.0	8.26	0.40	1.54	0.94		
	Final	11:30 AM		8.66					
4	Initial	11:32 AM	30.0	8.66	0.32	1.18	0.95		
	Final	12:02 PM		8.98					
5	Initial	12:03 PM	30.0	8.44	0.39	1.37	1.02		
	Final	12:33 PM		8.83					
6	Initial	12:34 PM	30.0	8.16	0.38	1.65	0.84		
	Final	1:04 PM		8.54					
7	Initial	1:06 PM	30.0	8.11	0.36	1.71	0.77		
	Final	1:36 PM		8.47					
8	Initial	1:38 PM	30.0	7.88	0.42	1.91	0.81		
	Final	2:08 PM		8.30					
9	Initial	2:10 PM	30.0	7.87	0.40	1.93	0.76		
	Final	2:40 PM		8.27					
10	Initial	2:42 PM	30.0	7.70	0.48	2.06	0.86		
	Final	3:12 PM		8.18					
11	Initial	3:14 PM	30.0	7.92	0.42	1.87	0.82		
	Final	3:44 PM		8.34					
12	Initial	3:46 PM	30.0	7.98	0.41	1.82	0.83		
	Final	4:16 PM		8.39					
13	Initial	4:18 PM	30.0	8.04	0.43	1.75	0.90		
	Final	4:48 PM		8.47					

Per County Standards, Infiltration Rate calculated as follows:

$$Q = \frac{\Delta H(60r)}{\Delta t(r + 2H_{avg})}$$

- Where:
- Q = Infiltration Rate (in inches per hour)
 - ΔH = Change in Height (Water Level) over the time interval
 - r = Test Hole (Borehole) Radius
 - Δt = Time Interval
 - H_{avg} = Average Head Height over the time interval

INFILTRATION CALCULATIONS

Project Name	Proposed Redlands West Development
Project Location	Perris, California
Project Number	20G179-2
Engineer	Jose Zuniga

Test Hole Radius	4 (in)
Test Depth	10 (ft)

Infiltration Test Hole	I-2
------------------------	-----

Interval Number		Time	Time Interval (min)	Water Depth (ft)	Change in Water Level (ft)	Average Head Height (ft)	Infiltration Rate Q (in/hr)		
P1	Initial	7:53 AM	25.0	8.30	0.16	1.62	0.43	Pre-Soak	
	Final	8:18 AM		8.46					
P2	Initial	8:20 AM	25.0	8.47	0.12	1.47	0.35		Infiltration Testing
	Final	8:45 AM		8.59					
1	Initial	9:32 AM	30.0	8.32	0.14	1.61	0.32		
	Final	10:02 AM		8.46					
2	Initial	10:03 AM	30.0	8.18	0.17	1.74	0.36		
	Final	10:33 AM		8.35					
3	Initial	10:33 AM	30.0	8.35	0.11	1.60	0.25		
	Final	11:03 AM		8.46					
4	Initial	11:04 AM	30.0	8.17	0.17	1.75	0.36		
	Final	11:34 AM		8.34					
5	Initial	11:35 AM	30.0	8.11	0.14	1.82	0.28		
	Final	12:05 PM		8.25					
6	Initial	12:06 PM	30.0	8.10	0.16	1.82	0.32		
	Final	12:36 PM		8.26					
7	Initial	12:38 PM	30.0	8.01	0.17	1.91	0.33		
	Final	1:08 PM		8.18					
8	Initial	1:09 PM	30.0	8.06	0.16	1.86	0.32		
	Final	1:39 PM		8.22					
9	Initial	1:41 PM	30.0	8.00	0.19	1.91	0.37		
	Final	2:11 PM		8.19					
10	Initial	2:12 PM	30.0	8.05	0.17	1.87	0.33		
	Final	2:42 PM		8.22					
11	Initial	2:43 PM	30.0	8.00	0.18	1.91	0.35		
	Final	3:13 PM		8.18					
12	Initial	3:15 PM	30.0	8.05	0.18	1.86	0.36		
	Final	3:45 PM		8.23					

Per County Standards, Infiltration Rate calculated as follows:

$$Q = \frac{\Delta H(60r)}{\Delta t(r + 2H_{avg})}$$

- Where:
- Q = Infiltration Rate (in inches per hour)
 - ΔH = Change in Height (Water Level) over the time interval
 - r = Test Hole (Borehole) Radius
 - Δt = Time Interval
 - H_{avg} = Average Head Height over the time interval

INFILTRATION CALCULATIONS

Project Name	Proposed Redlands West Development
Project Location	Perris, California
Project Number	20G179-2
Engineer	Jose Zuniga

Test Hole Radius	4 (in)
Test Depth	10 (ft)

Infiltration Test Hole I-3

Interval Number		Time	Time Interval (min)	Water Depth (ft)	Change in Water Level (ft)	Average Head Height (ft)	Infiltration Rate Q (in/hr)		
P1	Initial	7:44 AM	25.0	8.18	0.15	1.75	0.38	Pre-Soak	
	Final	8:09 AM		8.33					
P2	Initial	8:10 AM	25.0	8.34	0.11	1.61	0.30		
	Final	8:35 AM		8.45					
1	Initial	8:37 AM	30.0	7.91	0.34	1.92	0.65		Infiltration Testing
	Final	9:07 AM		8.25					
2	Initial	9:37 AM	30.0	8.08	0.18	1.83	0.36		
	Final	10:07 AM		8.26					
3	Initial	10:08 AM	30.0	7.90	0.30	1.95	0.57		
	Final	10:38 AM		8.20					
4	Initial	10:39 AM	30.0	8.20	0.15	1.73	0.32		
	Final	11:09 AM		8.35					
5	Initial	11:10 AM	30.0	7.97	0.22	1.92	0.42		
	Final	11:40 AM		8.19					
6	Initial	11:41 AM	30.0	8.03	0.19	1.88	0.37		
	Final	12:11 PM		8.22					
7	Initial	12:11 PM	30.0	7.96	0.24	1.92	0.46		
	Final	12:41 PM		8.20					
8	Initial	12:43 PM	30.0	8.00	0.20	1.90	0.39		
	Final	1:13 PM		8.20					
9	Initial	1:14 PM	30.0	7.93	0.24	1.95	0.45		
	Final	1:44 PM		8.17					
10	Initial	1:45 PM	30.0	7.90	0.26	1.97	0.49		
	Final	2:15 PM		8.16					
11	Initial	2:17 PM	30.0	7.94	0.26	1.93	0.50		
	Final	2:47 PM		8.20					
12	Initial	2:48 PM	30.0	7.95	0.25	1.93	0.48		
	Final	3:18 PM		8.20					

Per County Standards, Infiltration Rate calculated as follows:

$$Q = \frac{\Delta H(60r)}{\Delta t(r + 2H_{avg})}$$

- Where:
- Q = Infiltration Rate (in inches per hour)
 - ΔH = Change in Height (Water Level) over the time interval
 - r = Test Hole (Borehole) Radius
 - Δt = Time Interval
 - H_{avg} = Average Head Height over the time interval

INFILTRATION CALCULATIONS

Project Name	Proposed Redlands West Development
Project Location	Perris, California
Project Number	20G179-2
Engineer	Jose Zuniga

Test Hole Radius	4 (in)
Test Depth	10 (ft)

Infiltration Test Hole	I-4
------------------------	-----

Interval Number		Time	Time Interval (min)	Water Depth (ft)	Change in Water Level (ft)	Average Head Height (ft)	Infiltration Rate Q (in/hr)		
P1	Initial	7:32 AM	25.0	8.46	0.14	1.47	0.41	Pre-Soak	
	Final	7:57 AM		8.60					
P2	Initial	7:59 AM	25.0	8.60	0.05	1.38	0.16		
	Final	8:24 AM		8.65					
1	Initial	8:28 AM	30.0	8.15	0.30	1.70	0.64		Infiltration Testing
	Final	8:58 AM		8.45					
2	Initial	9:42 AM	30.0	8.25	0.20	1.65	0.44		
	Final	10:12 AM		8.45					
3	Initial	10:13 AM	30.0	8.21	0.21	1.69	0.45		
	Final	10:43 AM		8.42					
4	Initial	10:44 AM	30.0	8.17	0.23	1.72	0.49		
	Final	11:14 AM		8.40					
5	Initial	11:15 AM	30.0	8.00	0.33	1.84	0.66		
	Final	11:45 AM		8.33					
6	Initial	11:46 AM	30.0	8.15	0.24	1.73	0.51		
	Final	12:16 PM		8.39					
7	Initial	12:17 PM	30.0	8.10	0.26	1.77	0.54		
	Final	12:47 PM		8.36					
8	Initial	12:48 PM	30.0	8.15	0.25	1.73	0.53		
	Final	1:18 PM		8.40					
9	Initial	1:20 PM	30.0	8.00	0.30	1.85	0.60		
	Final	1:50 PM		8.30					
10	Initial	1:51 PM	30.0	8.04	0.31	1.81	0.63		
	Final	2:21 PM		8.35					
11	Initial	2:22 PM	30.0	8.05	0.30	1.80	0.61		
	Final	2:52 PM		8.35					
12	Initial	2:53 PM	30.0	8.10	0.28	1.76	0.58		
	Final	3:23 PM		8.38					

Per County Standards, Infiltration Rate calculated as follows:

$$Q = \frac{\Delta H(60r)}{\Delta t(r + 2H_{avg})}$$

- Where:
- Q = Infiltration Rate (in inches per hour)
 - ΔH = Change in Height (Water Level) over the time interval
 - r = Test Hole (Borehole) Radius
 - Δt = Time Interval
 - H_{avg} = Average Head Height over the time interval

INFILTRATION CALCULATIONS

Project Name	Proposed Redlands West Development
Project Location	Perris, California
Project Number	20G179-2
Engineer	Jose Zuniga

Test Hole Radius	4 (in)
Test Depth	10 (ft)

Infiltration Test Hole I-5

Interval Number		Time	Time Interval (min)	Water Depth (ft)	Change in Water Level (ft)	Average Head Height (ft)	Infiltration Rate Q (in/hr)		
P1	Initial	7:38 AM	25.0	8.54	0.46	1.23	1.58	Pre-Soak	
	Final	8:03 AM		9.00					
P2	Initial	8:05 AM	25.0	9.00	0.24	0.88	1.10		
	Final	8:30 AM		9.24					
1	Initial	8:32 AM	30.0	8.44	0.41	1.36	1.08		Infiltration Testing
	Final	9:02 AM		8.85					
2	Initial	9:47 AM	30.0	8.66	0.25	1.22	0.72		
	Final	10:17 AM		8.91					
3	Initial	10:18 AM	30.0	8.59	0.28	1.27	0.78		
	Final	10:48 AM		8.87					
4	Initial	10:49 AM	30.0	8.54	0.30	1.31	0.81		
	Final	11:19 AM		8.84					
5	Initial	11:20 AM	30.0	8.00	0.72	1.64	1.59		
	Final	11:50 AM		8.72					
6	Initial	11:51 AM	30.0	8.17	0.54	1.56	1.25		
	Final	12:21 PM		8.71					
7	Initial	12:23 PM	30.0	8.05	0.64	1.63	1.42		
	Final	12:53 PM		8.69					
8	Initial	12:55 PM	30.0	8.07	0.58	1.64	1.28		
	Final	1:25 PM		8.65					
9	Initial	1:27 PM	30.0	7.98	0.66	1.69	1.42		
	Final	1:57 PM		8.64					
10	Initial	2:00 PM	30.0	8.10	0.54	1.63	1.20		
	Final	2:30 PM		8.64					
11	Initial	2:32 PM	30.0	7.95	0.55	1.78	1.13		
	Final	3:02 PM		8.50					
12	Initial	3:08 PM	30.0	7.98	0.54	1.75	1.13		
	Final	3:38 PM		8.52					

Per County Standards, Infiltration Rate calculated as follows:

$$Q = \frac{\Delta H(60r)}{\Delta t(r + 2H_{avg})}$$

- Where:
- Q = Infiltration Rate (in inches per hour)
 - ΔH = Change in Height (Water Level) over the time interval
 - r = Test Hole (Borehole) Radius
 - Δt = Time Interval
 - H_{avg} = Average Head Height over the time interval

INFILTRATION CALCULATIONS

Project Name	Proposed Redlands West Development
Project Location	Perris, California
Project Number	20G179-2
Engineer	Jose Zuniga

Test Hole Radius	4 (in)
Test Depth	10 (ft)

Infiltration Test Hole	I-6
------------------------	-----


Interval Number		Time	Time Interval (min)	Water Depth (ft)	Change in Water Level (ft)	Average Head Height (ft)	Infiltration Rate Q (in/hr)	
P1	Initial	7:23 AM	25.0	8.54	0.46	1.23	1.58	Pre-Soak
	Final	7:48 AM		9.00				
P2	Initial	7:48 AM	25.0	9.00	0.24	0.88	1.10	
	Final	8:13 AM		9.24				
1	Initial	8:15 AM	30.0	8.44	0.41	1.36	1.08	
	Final	8:45 AM		8.85				
2	Initial	9:52 AM	30.0	8.66	0.25	1.22	0.72	
	Final	10:22 AM		8.91				
3	Initial	10:22 AM	30.0	8.59	0.28	1.27	0.78	
	Final	10:52 AM		8.87				
4	Initial	10:52 AM	30.0	8.54	0.30	1.31	0.81	
	Final	11:22 AM		8.84				
5	Initial	11:22 AM	30.0	8.00	0.72	1.64	1.59	
	Final	11:52 AM		8.72				
6	Initial	11:55 AM	30.0	8.17	0.54	1.56	1.25	
	Final	12:25 PM		8.71				
7	Initial	12:26 PM	30.0	8.05	0.64	1.63	1.42	
	Final	12:56 PM		8.69				
8	Initial	12:57 PM	30.0	8.07	0.58	1.64	1.28	
	Final	1:27 PM		8.65				
9	Initial	1:28 PM	30.0	7.98	0.66	1.69	1.42	
	Final	1:58 PM		8.64				
10	Initial	1:59 PM	30.0	8.10	0.54	1.63	1.20	
	Final	2:29 PM		8.64				
11	Initial	2:33 PM	30.0	7.95	0.55	1.78	1.13	
	Final	3:03 PM		8.50				
12	Initial	3:09 PM	30.0	7.98	0.54	1.75	1.13	
	Final	3:39 PM		8.52				

Per County Standards, Infiltration Rate calculated as follows:

$$Q = \frac{\Delta H(60r)}{\Delta t(r + 2H_{avg})}$$

- Where:
- Q = Infiltration Rate (in inches per hour)
 - ΔH = Change in Height (Water Level) over the time interval
 - r = Test Hole (Borehole) Radius
 - Δt = Time Interval
 - H_{avg} = Average Head Height over the time interval

Grain Size Distribution

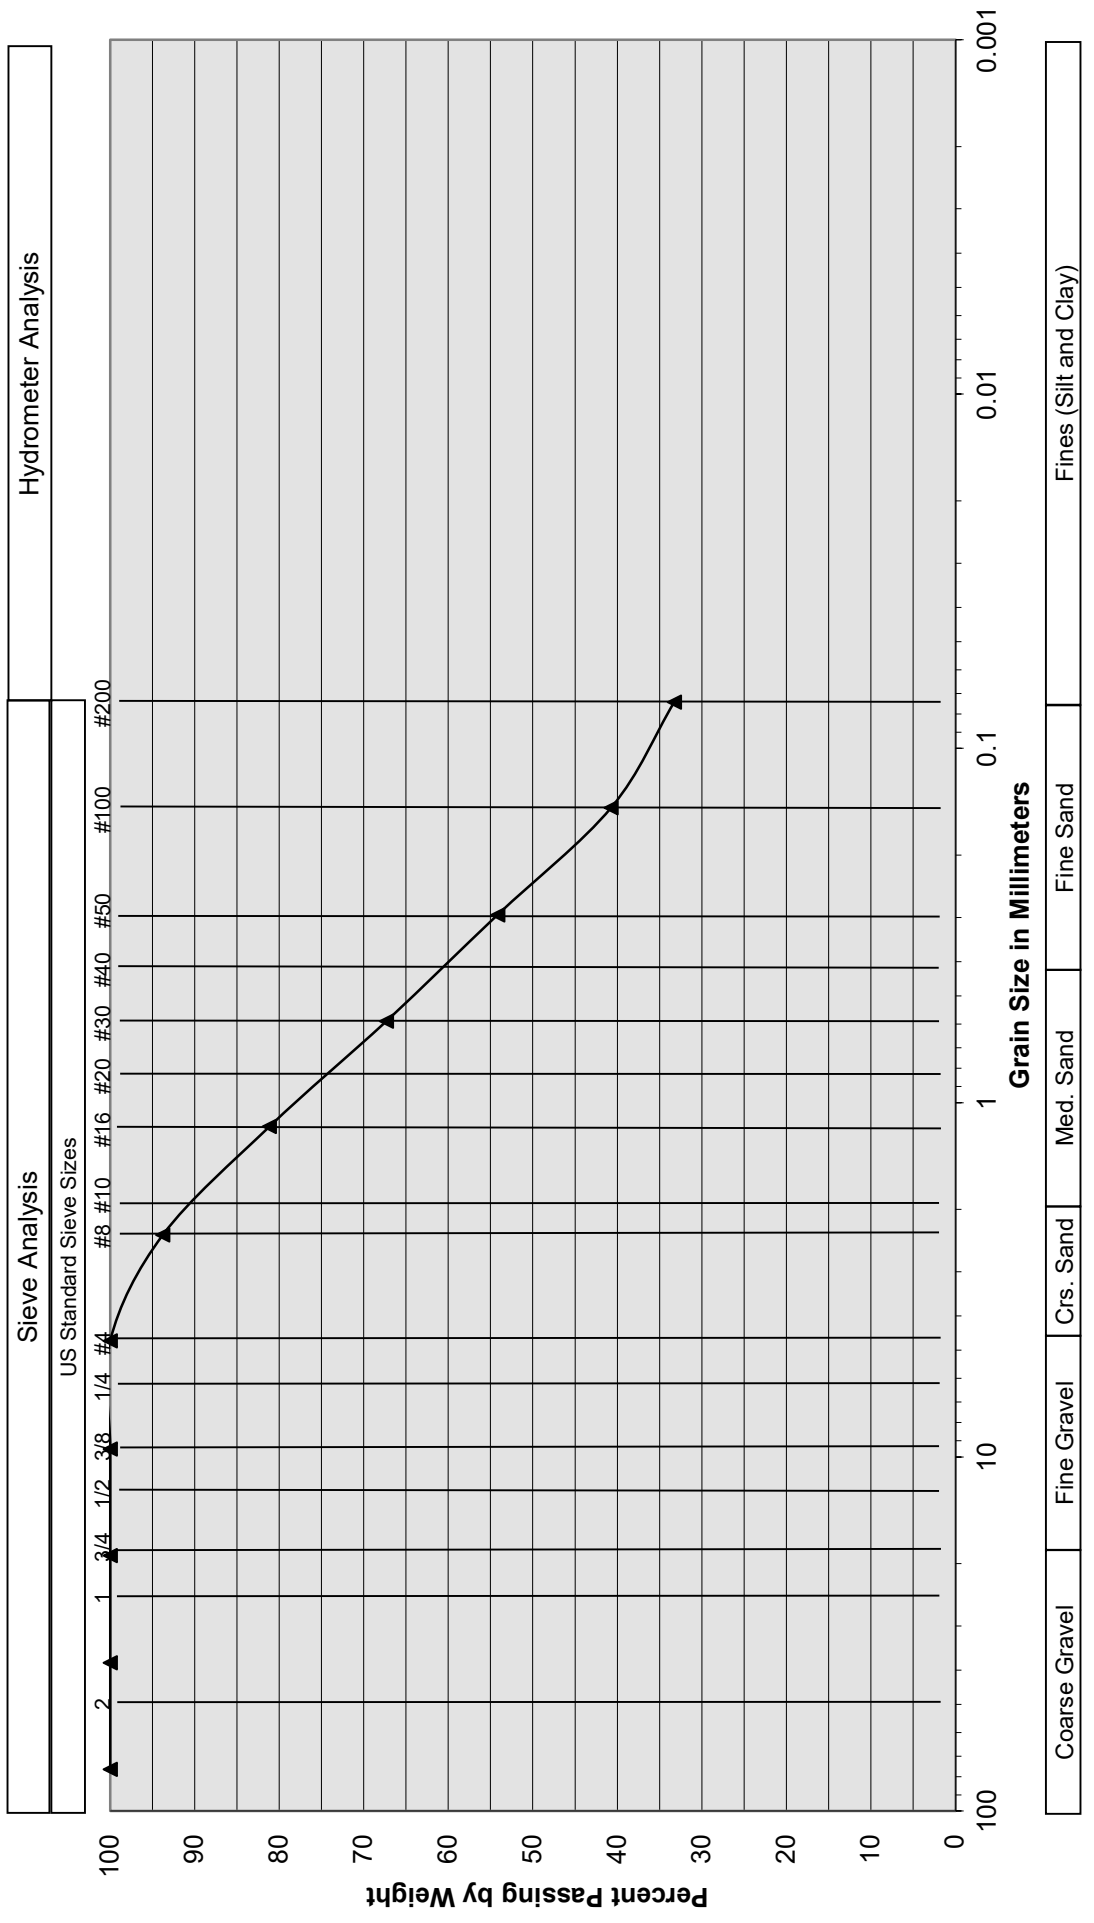


Sample Description	I-1 @ 8 1/2 feet				
Soil Classification	Brown Silty fine to medium Sand, trace coarse Sand				
Proposed Redlands West Development					
Perris, CA					
Project No. 20G179-2					
PLATE C-1					



SOUTHERN CALIFORNIA GEOTECHNICAL
A California Corporation

Grain Size Distribution

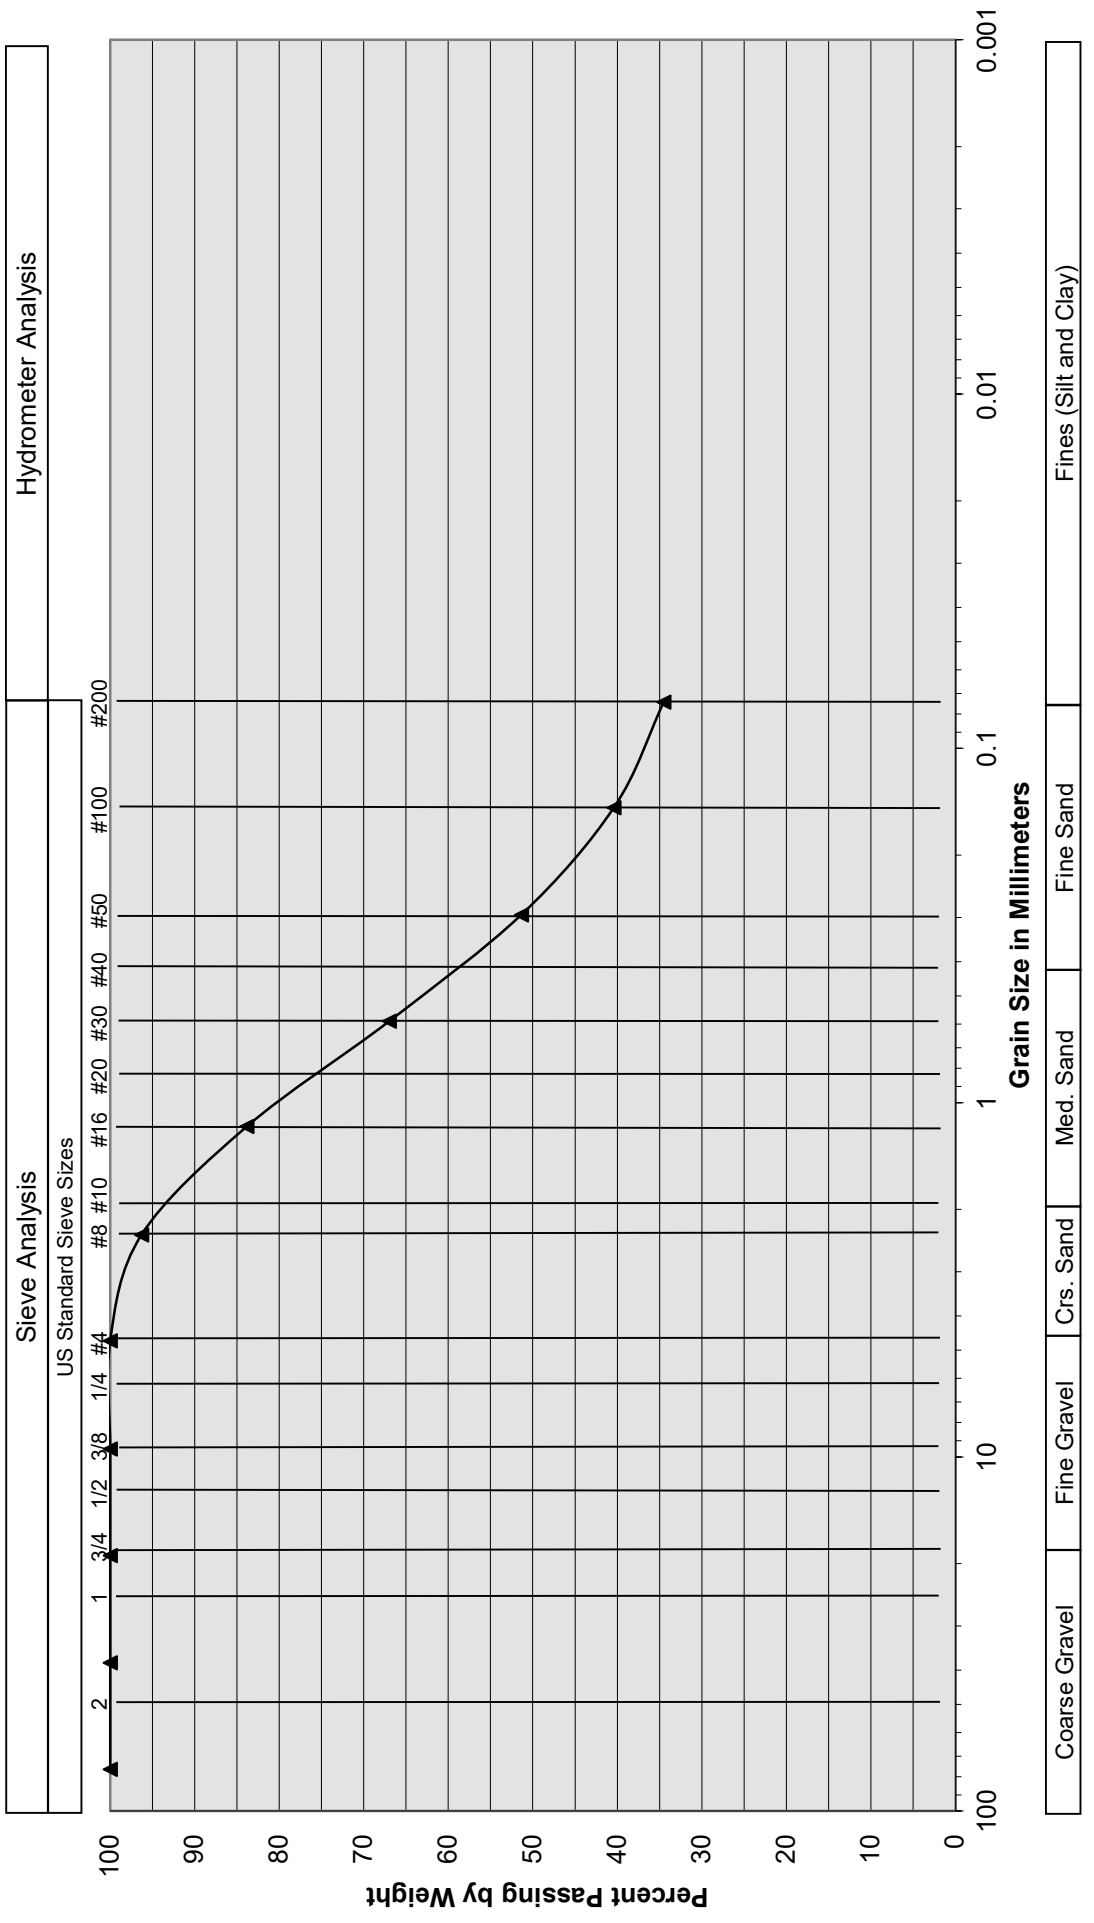


Sample Description	I-2 @ 8 1/2 feet
Soil Classification	Brown Silty fine to medium Sand, trace coarse Sand
Proposed Redlands West Development	
Perris, CA	
Project No. 20G179-2	
PLATE C-2	



SOUTHERN CALIFORNIA GEOTECHNICAL
A California Corporation

Grain Size Distribution

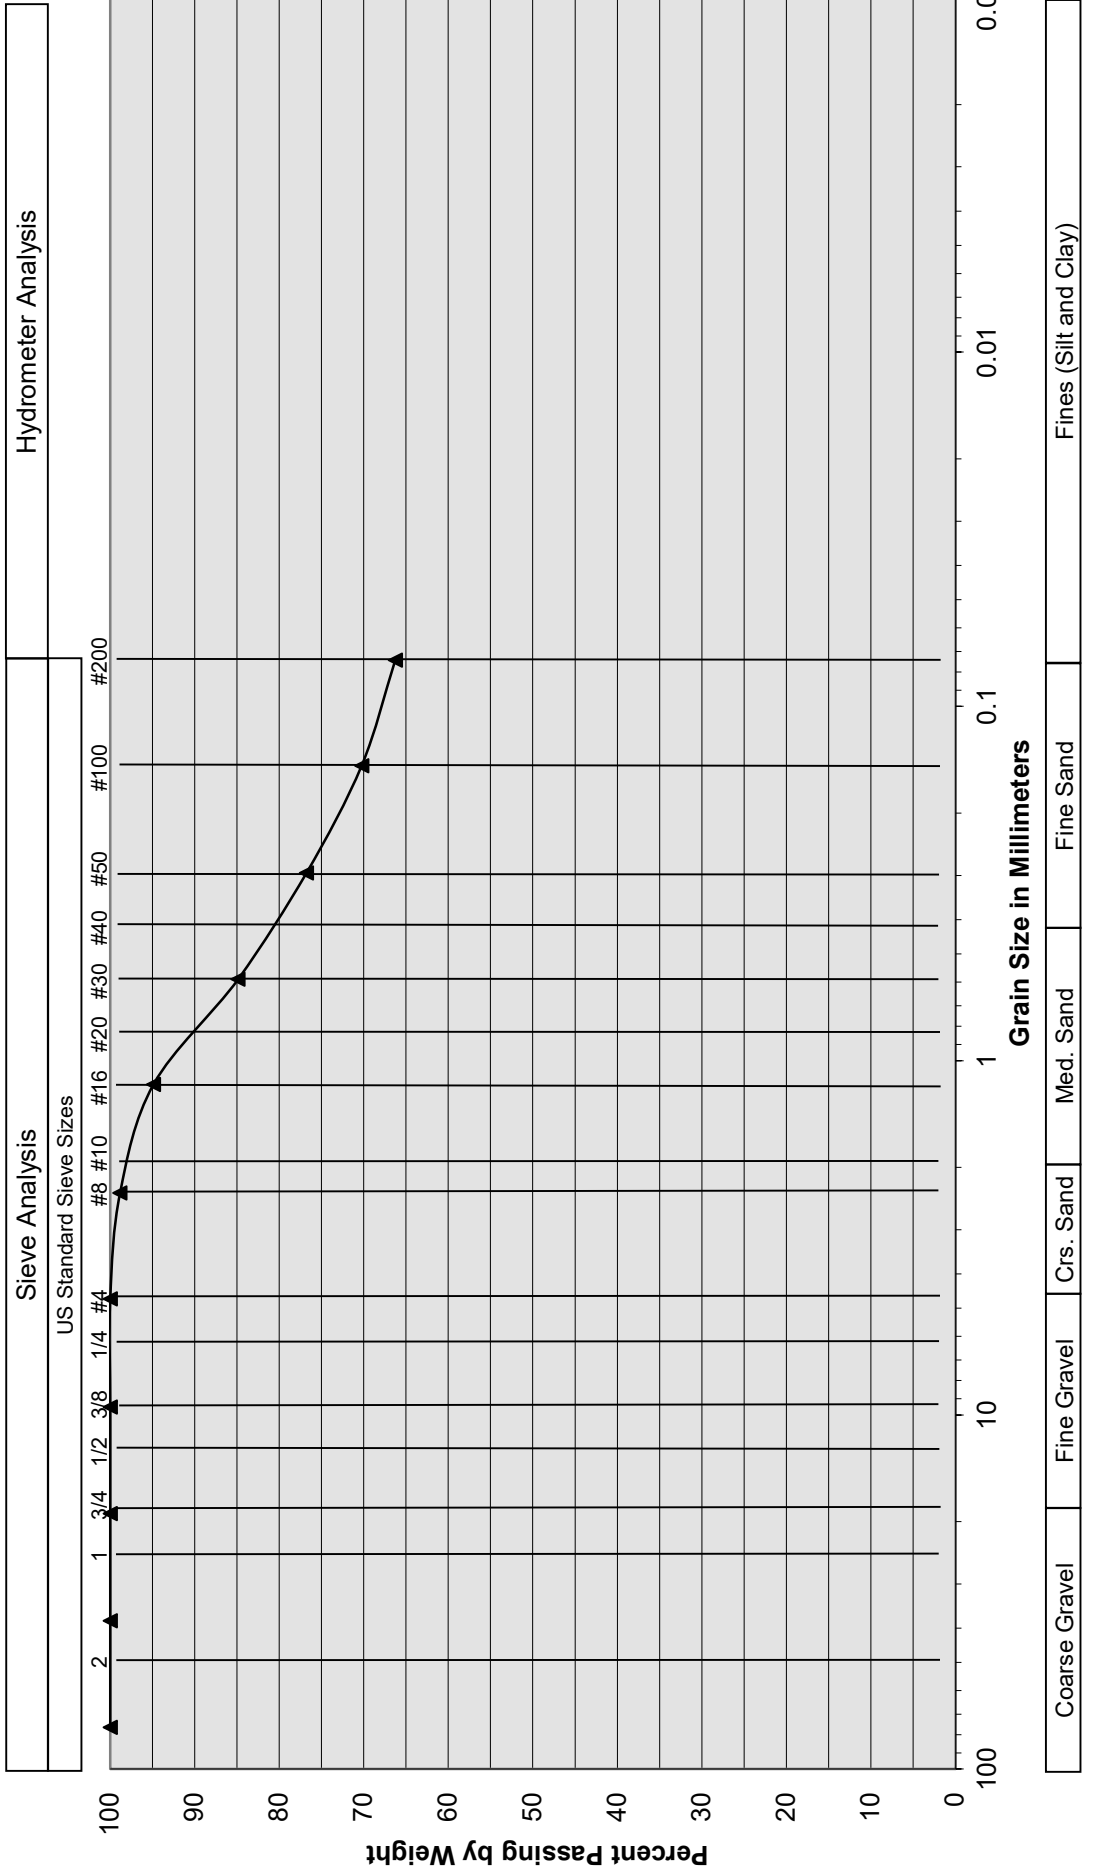

Sample Description: I-4 @ 8 1/2 feet
 Soil Classification: Brown fine Sandy Silt, trace medium Sand

Proposed Redlands West Development
 Perris, CA
 Project No. 20G179-2
PLATE C-4



Appendix 4: Historical Site Conditions

Phase I Environmental Site Assessment or Other Information on Past Site Use

N/A


Appendix 5: LID Infeasibility

LID Technical Infeasibility Analysis

N/A

Appendix 6: BMP Design Details

BMP Sizing, Design Details and other Supporting Documentation

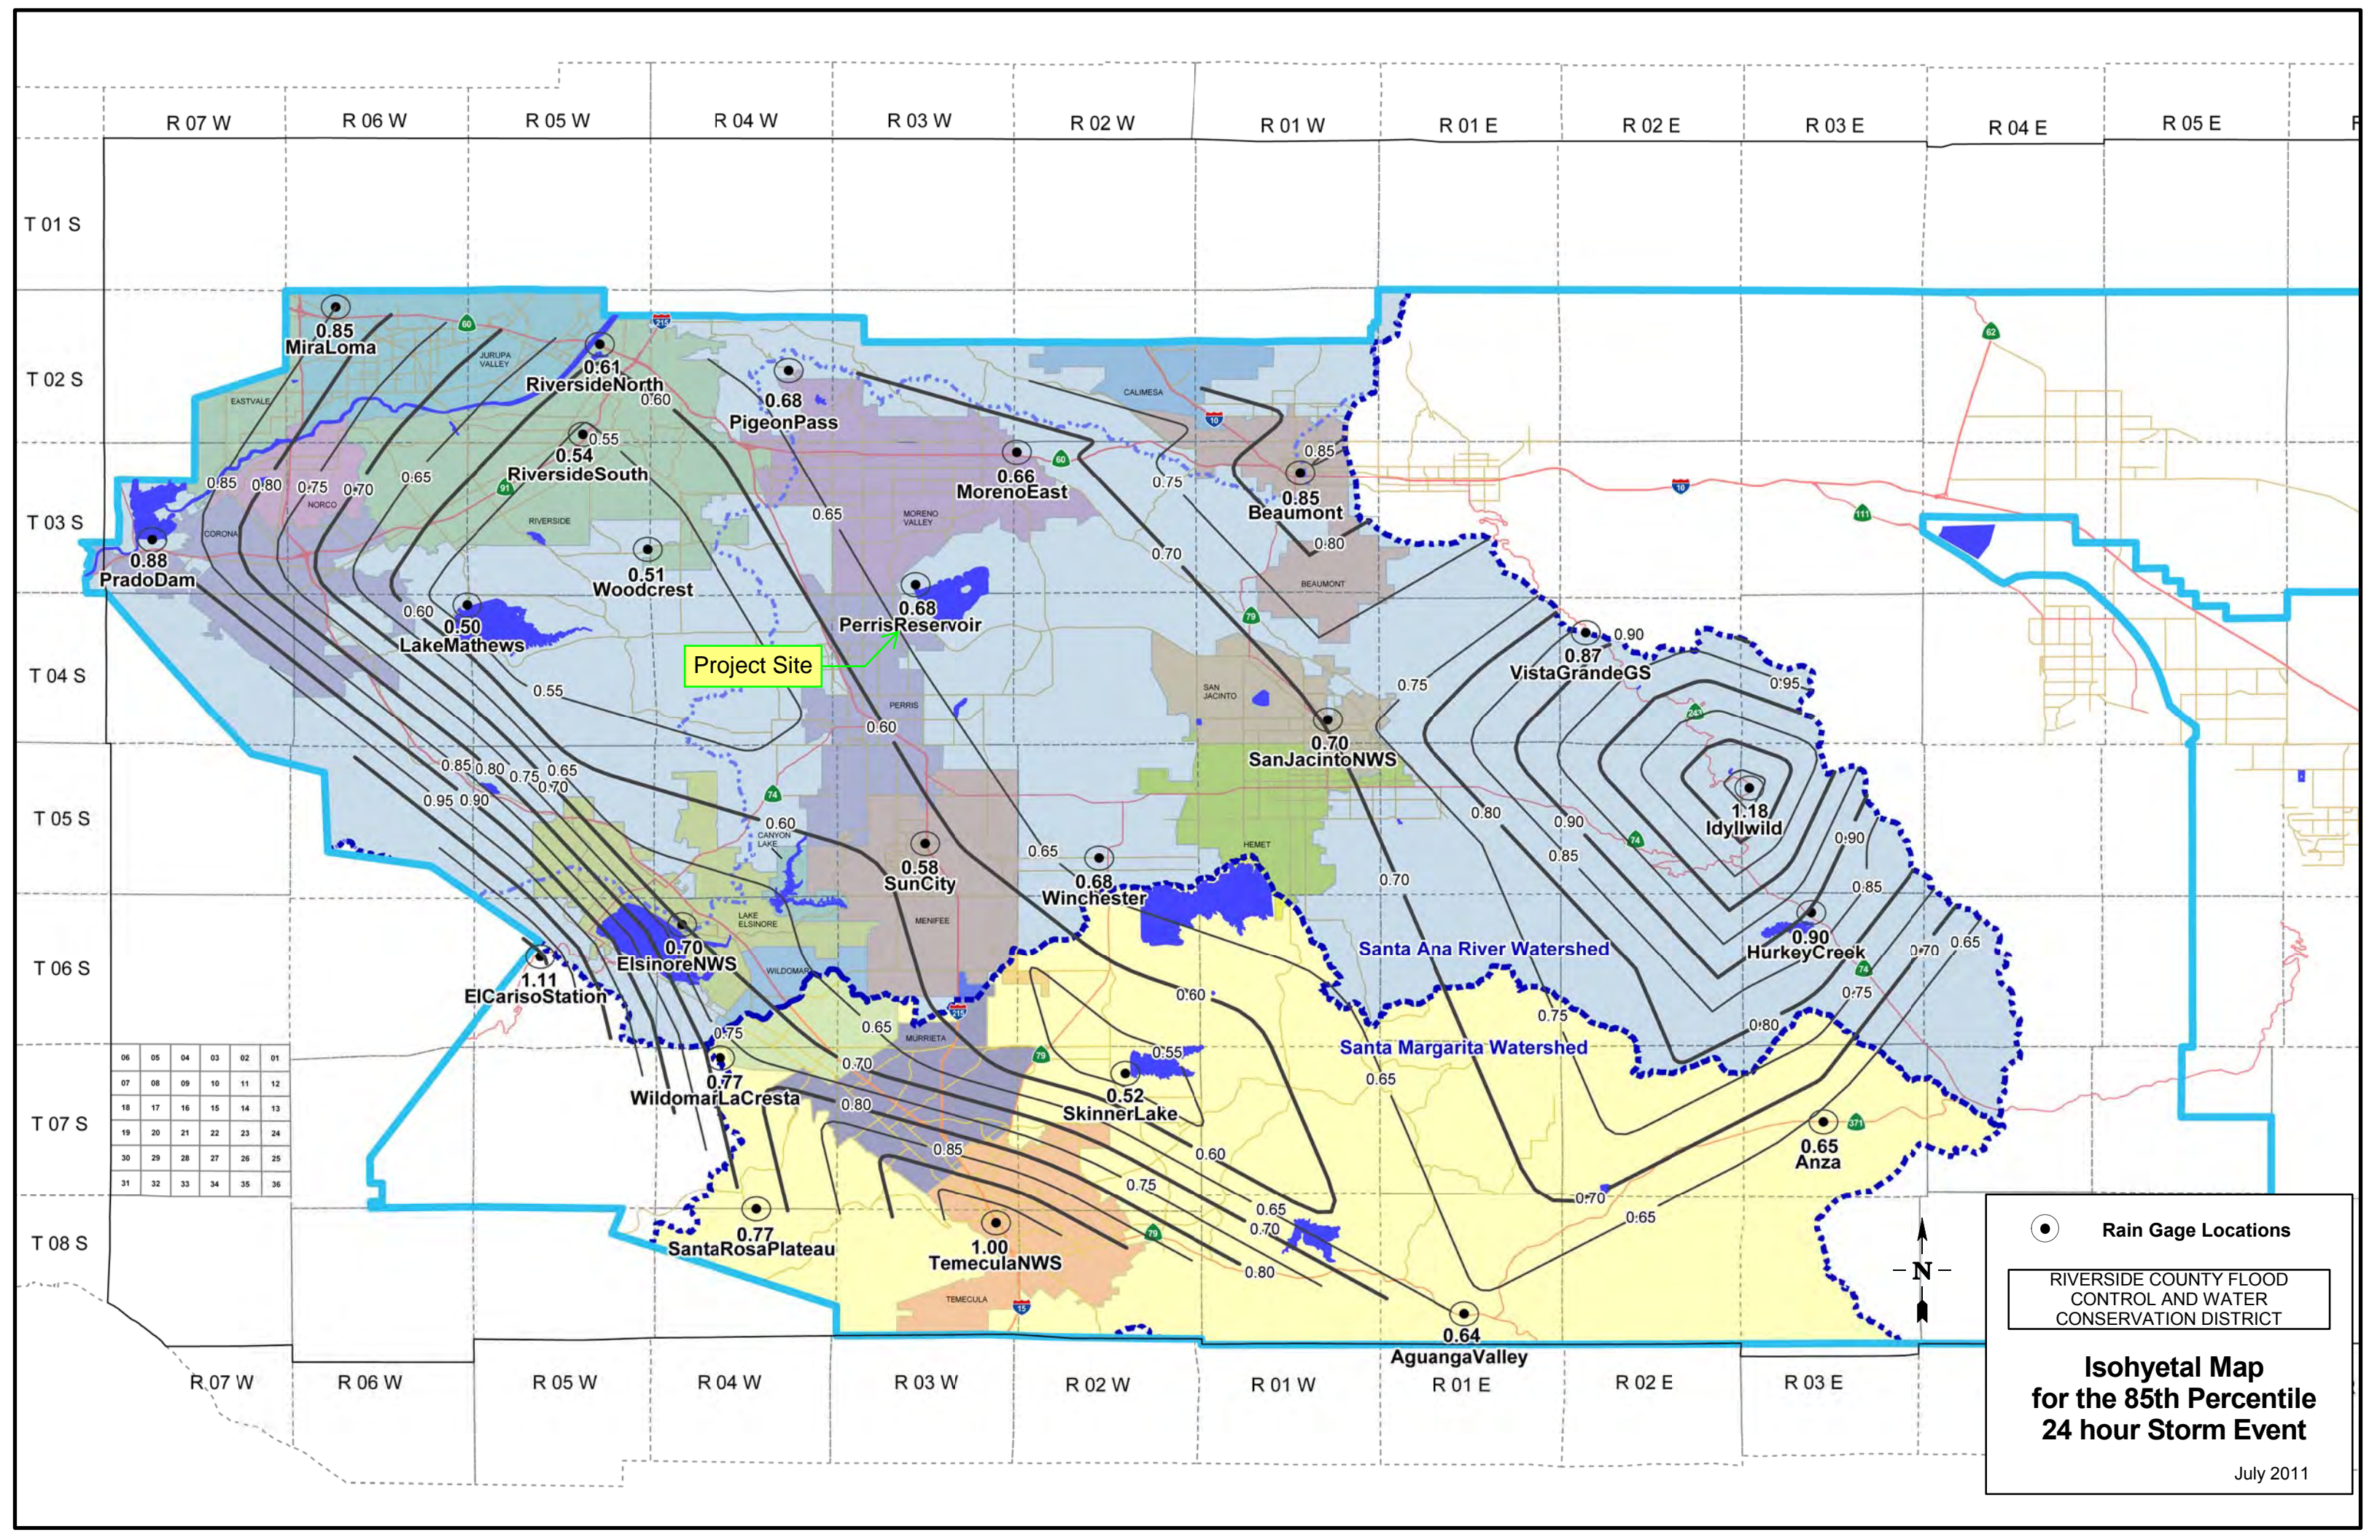

R 07 W R 06 W R 05 W R 04 W R 03 W R 02 W R 01 W R 01 E R 02 E R 03 E R 04 E R 05 E

T 01 S
T 02 S
T 03 S
T 04 S
T 05 S
T 06 S
T 07 S
T 08 S

06	05	04	03	02	01
07	08	09	10	11	12
18	17	16	15	14	13
19	20	21	22	23	24
30	29	28	27	26	25
31	32	33	34	35	36

R 07 W R 06 W R 05 W R 04 W R 03 W R 02 W R 01 W R 01 E R 02 E R 03 E

● Rain Gage Locations

RIVERSIDE COUNTY FLOOD CONTROL AND WATER CONSERVATION DISTRICT

Isohyetal Map for the 85th Percentile 24 hour Storm Event

July 2011

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name Albert A. Webb Associates

Date 1/14/2022

Designed by EA

Case No _____

Company Project Number/Name 20-0186 Redlands West

BMP Identification

BMP NAME / ID DMA 1

Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity

I = 0.20 in/hr

Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type (use pull-down menu)	Effective Imperivous Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
DMA 1 - Concrete / Asphalt	154,179	Concrete or Asphalt	1	0.89	137527.6			
DMA 1 - Landscape	25,385	Ornamental Landscaping	0.1	0.110458	2804			
DMA 1 - Self-Retaining	9,166	Ornamental Landscaping	0.1	0.110458	1012.5			
Total					141344.1	0.20	0.6	0.7

Notes:

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name Albert A. Webb Associates

Date 1/14/2022

Designed by EA

Case No _____

Company Project Number/Name 20-0186 Redlands West

BMP Identification

BMP NAME / ID DMA 2

Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity

I = 0.20 in/hr

Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type (use pull-down menu)	Effective Imperivous Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
DMA 2 - Concrete / Asphalt	112,321	Concrete or Asphalt	1	0.89	100189.9			
DMA 2 - Landscape	15,100	Ornamental Landscaping	0.1	0.110458	1667.9			
DMA 1 - Self-Retaining	3,006	Ornamental Landscaping	0.1	0.110458	332			
Total					102189.8	0.20	0.5	0.6

Notes:

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name	Albert A. Webb Associates	Date	5/13/2021
Designed by	AYS	Case No	
Company Project Number/Name	20-0186 Redlands West		

BMP Identification

BMP NAME / ID DMA 3
Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity I = 0.20 in/hr

Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type (use pull-down menu)	Effective Imperivous Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
DMA 3 - Concrete / Asphalt	123739	Concrete or Asphalt	1	0.89	110375.2			
DMA 3 - Landscape	6889	Ornamental Landscaping	0.1	0.110458	760.9			
Total					111136.1	0.20	0.5	0.6

Notes:

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name **Albert A. Webb Associates**

Date **5/13/2021**

Designed by **AYS**

Case No

Company Project Number/Name

20-0186 Redlands West

BMP Identification

BMP NAME / ID **DMA 4**

Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity

I = **0.20** in/hr

Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type (use pull-down menu)	Effective Imperivous Fraction, I_p	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
DMA 4-Roofs	170501	Roofs	1	0.89	152086.9			
	170501		Total		152086.9	0.20	0.7	0.7

Notes:

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name **Albert A. Webb Associates**

Date **5/13/2021**

Designed by **AYS**

Case No

Company Project Number/Name

20-0186 Redlands West

BMP Identification

BMP NAME / ID **DMA 5**

Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity

I = **0.20** in/hr

Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type (use pull-down menu)	Effective Imperivous Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
DMA 5 - Roofs	159836	Roofs	1	0.89	142573.7			
	159836		Total		142573.7	0.20	0.7	0.7

Notes:

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name Albert A. Webb Associates Date 5/13/2021
 Designed by AYS Case No. _____
 Company Project Number/Name 20-0186 Redlands West

BMP Identification

BMP NAME / ID DMA 6
Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity I = 0.20 in/hr

Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type (use pull-down menu)	Effective Imperivous Fraction, I _f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
DMA 6 - Concrete / Asphalt	16221	Concrete or Asphalt	1	0.89	14469.1			
DMA 6 - Landscape	2300	Ornamental Landscaping	0.1	0.110458	254.1			
Total					14723.2	0.20	0.1	0.1

Notes:

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name Albert A. Webb Associates Date 5/13/2021
 Designed by AYS Case No. _____
 Company Project Number/Name 20-0186 Redlands West

BMP Identification

BMP NAME / ID DMA 7
Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity I = 0.20 in/hr





Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type (use pull-down menu)	Effective Imperivous Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
DMA 7 - Concrete / Asphalt	27651	Concrete or Asphalt	1	0.89	24664.7			
DMA 7 - Landscape	8069	Ornamental Landscaping	0.1	0.110458	891.3			
Total					25556	0.20	0.1	0.1

Notes:

SITE SPECIFIC DATA			
PROJECT NUMBER			
PROJECT NAME			
PROJECT LOCATION			
STRUCTURE ID			
TREATMENT REQUIRED			
VOLUME BASED (CF)		FLOW BASED (CFS)	
N/A			
PEAK BYPASS REQUIRED (CFS) – IF APPLICABLE			
PIPE DATA	I.E.	MATERIAL	DIAMETER
INLET PIPE 1			
INLET PIPE 2			
OUTLET PIPE			
	PRETREATMENT	BIOFILTRATION	DISCHARGE
RIM ELEVATION			
SURFACE LOAD			
FRAME & COVER	36" X 36"		N/A
NOTES:			

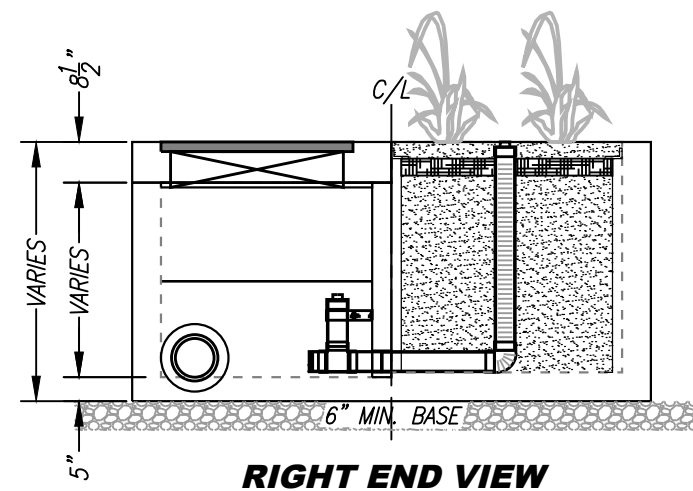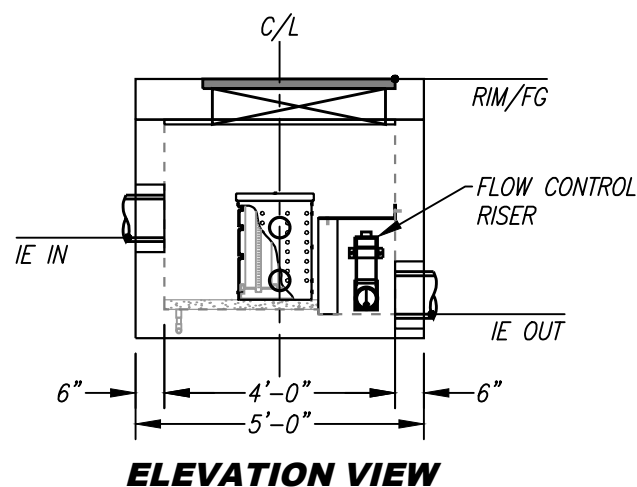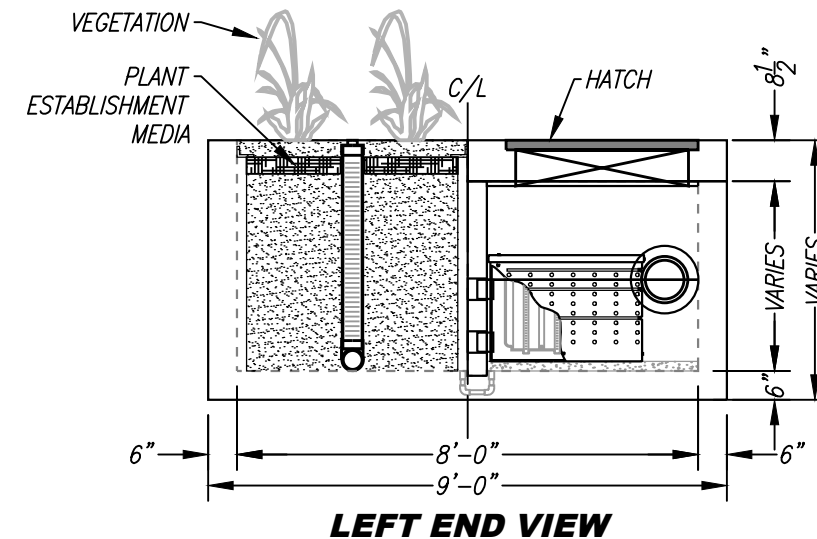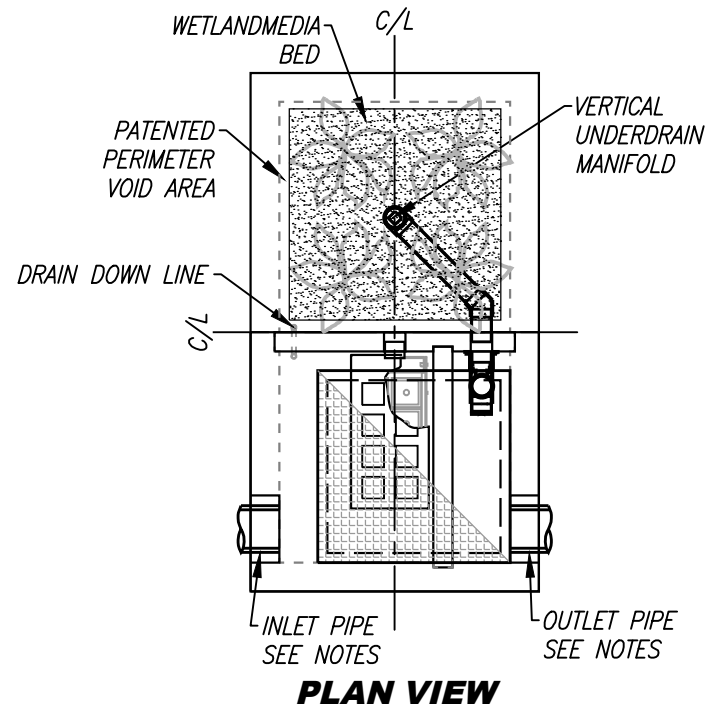


INSTALLATION NOTES

1. CONTRACTOR TO PROVIDE ALL LABOR, EQUIPMENT, MATERIALS AND INCIDENTALS REQUIRED TO OFFLOAD AND INSTALL THE SYSTEM AND APPURTENANCES IN ACCORDANCE WITH THIS DRAWING AND THE MANUFACTURERS SPECIFICATIONS, UNLESS OTHERWISE STATED IN MANUFACTURERS CONTRACT.
2. UNIT MUST BE INSTALLED ON LEVEL BASE. MANUFACTURER RECOMMENDS A MINIMUM 6" LEVEL ROCK BASE UNLESS SPECIFIED BY THE PROJECT ENGINEER. CONTRACTOR IS RESPONSIBLE TO VERIFY PROJECT ENGINEERS RECOMMENDED BASE SPECIFICATIONS.
4. CONTRACTOR TO SUPPLY AND INSTALL ALL EXTERNAL CONNECTING PIPES. ALL PIPES MUST BE FLUSH WITH INSIDE SURFACE OF CONCRETE. (PIPES CANNOT INTRUDE BEYOND FLUSH). INVERT OF OUTFLOW PIPE MUST BE FLUSH WITH DISCHARGE CHAMBER FLOOR. ALL PIPES SHALL BE SEALED WATER TIGHT PER MANUFACTURERS STANDARD CONNECTION DETAIL.
5. CONTRACTOR RESPONSIBLE FOR INSTALLATION OF ALL RISERS, MANHOLES, AND HATCHES. CONTRACTOR TO GROUT ALL MANHOLES AND HATCHES TO MATCH FINISHED SURFACE UNLESS SPECIFIED OTHERWISE.
6. VEGETATION SUPPLIED AND INSTALLED BY OTHERS. ALL UNITS WITH VEGETATION MUST HAVE DRIP OR SPRAY IRRIGATION SUPPLIED AND INSTALLED BY OTHERS.
7. CONTRACTOR RESPONSIBLE FOR CONTACTING BIO CLEAN FOR ACTIVATION OF UNIT. MANUFACTURERS WARRANTY IS VOID WITH OUT PROPER ACTIVATION BY A BIO CLEAN REPRESENTATIVE.

GENERAL NOTES

1. MANUFACTURER TO PROVIDE ALL MATERIALS UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS, ELEVATIONS, SPECIFICATIONS AND CAPACITIES ARE SUBJECT TO CHANGE. FOR PROJECT SPECIFIC DRAWINGS DETAILING EXACT DIMENSIONS, WEIGHTS AND ACCESSORIES PLEASE CONTACT BIO CLEAN.

TREATMENT FLOW (CFS)	
OPERATING HEAD (FT)	
PRETREATMENT LOADING RATE (GPM/SF)	
WETLAND MEDIA LOADING RATE (GPM/SF)	


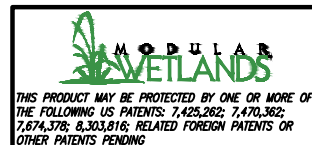


PROPRIETARY AND CONFIDENTIAL:
 THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE SOLE PROPERTY OF FORTERRA AND ITS COMPANIES. THIS DOCUMENT, NOR ANY PART THEREOF, MAY BE USED, REPRODUCED OR MODIFIED IN ANY MANNER WITH OUT THE WRITTEN CONSENT OF FORTERRA.





MWS-L-4-8-V
STORMWATER BIOFILTRATION SYSTEM
STANDARD DETAIL

SITE SPECIFIC DATA			
PROJECT NUMBER			
PROJECT NAME			
PROJECT LOCATION			
STRUCTURE ID			
TREATMENT REQUIRED			
VOLUME BASED (CF)		FLOW BASED (CFS)	
N/A			
PEAK BYPASS REQUIRED (CFS) – IF APPLICABLE			
PIPE DATA	I.E.	MATERIAL	DIAMETER
INLET PIPE 1			
INLET PIPE 2			
OUTLET PIPE			
	PRETREATMENT	BIOFILTRATION	DISCHARGE
RIM ELEVATION			
SURFACE LOAD			
FRAME & COVER	3EA Ø30"		Ø24"
NOTES:			

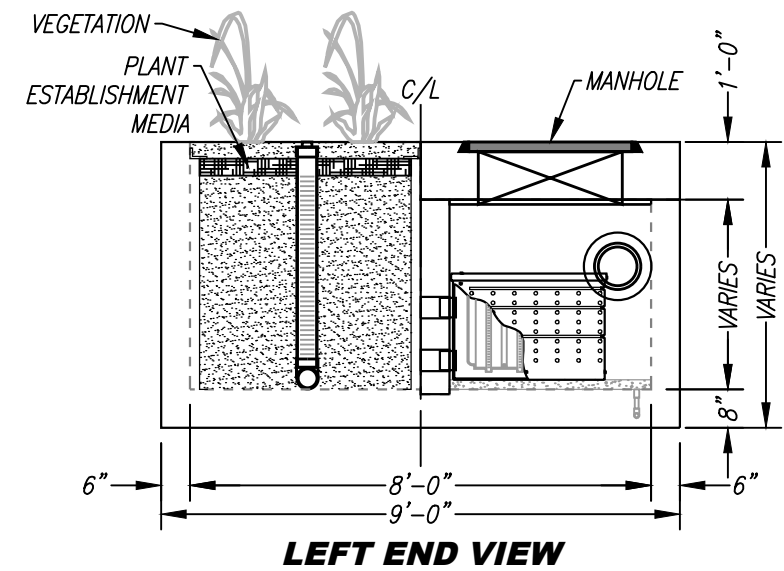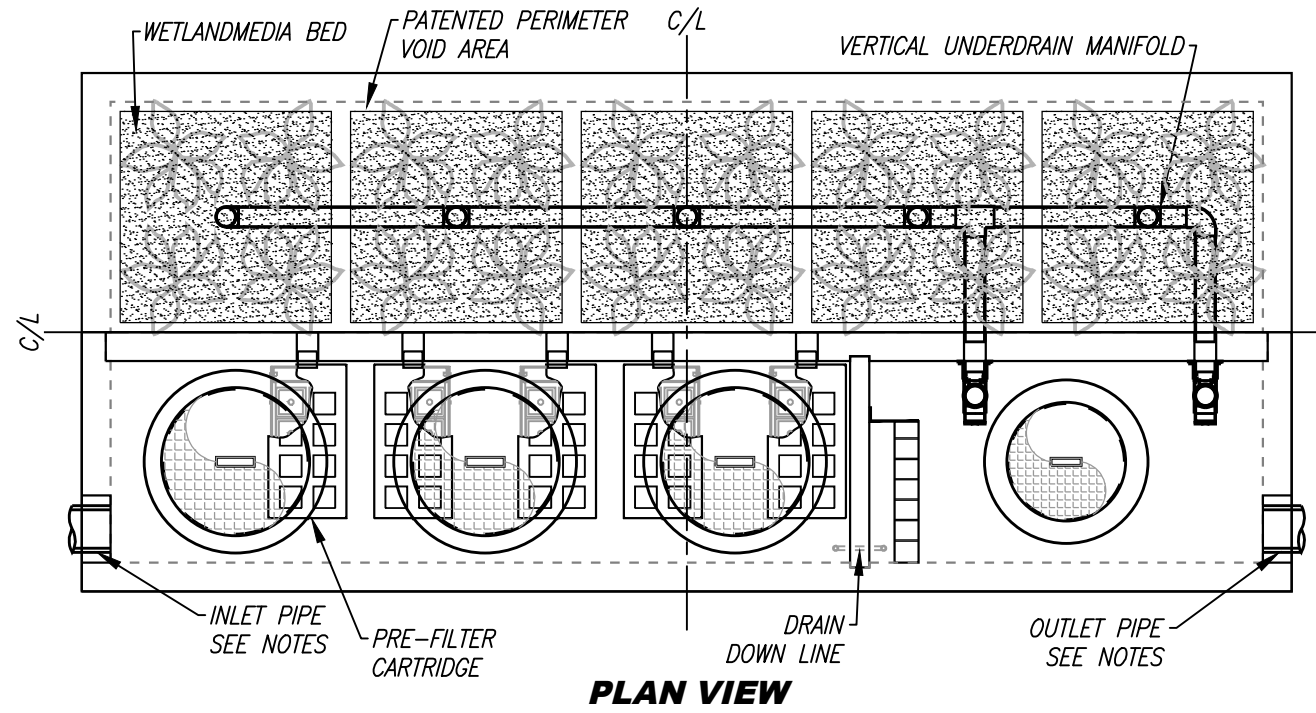

INSTALLATION NOTES

1. CONTRACTOR TO PROVIDE ALL LABOR, EQUIPMENT, MATERIALS AND INCIDENTALS REQUIRED TO OFFLOAD AND INSTALL THE SYSTEM AND APPURTENANCES IN ACCORDANCE WITH THIS DRAWING AND THE MANUFACTURERS SPECIFICATIONS, UNLESS OTHERWISE STATED IN MANUFACTURERS CONTRACT.
2. UNIT MUST BE INSTALLED ON LEVEL BASE. MANUFACTURER RECOMMENDS A MINIMUM 6" LEVEL ROCK BASE UNLESS SPECIFIED BY THE PROJECT ENGINEER. CONTRACTOR IS RESPONSIBLE TO VERIFY PROJECT ENGINEERS RECOMMENDED BASE SPECIFICATIONS.
4. CONTRACTOR TO SUPPLY AND INSTALL ALL EXTERNAL CONNECTING PIPES. ALL PIPES MUST BE FLUSH WITH INSIDE SURFACE OF CONCRETE. (PIPES CANNOT INTRUDE BEYOND FLUSH). INVERT OF OUTFLOW PIPE MUST BE FLUSH WITH DISCHARGE CHAMBER FLOOR. ALL PIPES SHALL BE SEALED WATER TIGHT PER MANUFACTURERS STANDARD CONNECTION DETAIL.
5. CONTRACTOR RESPONSIBLE FOR INSTALLATION OF ALL RISERS, MANHOLES, AND HATCHES. CONTRACTOR TO GROUT ALL MANHOLES AND HATCHES TO MATCH FINISHED SURFACE UNLESS SPECIFIED OTHERWISE.
6. VEGETATION SUPPLIED AND INSTALLED BY OTHERS. ALL UNITS WITH VEGETATION MUST HAVE DRIP OR SPRAY IRRIGATION SUPPLIED AND INSTALLED BY OTHERS.
7. CONTRACTOR RESPONSIBLE FOR CONTACTING BIO CLEAN FOR ACTIVATION OF UNIT. MANUFACTURERS WARRANTY IS VOID WITH OUT PROPER ACTIVATION BY A BIO CLEAN REPRESENTATIVE.

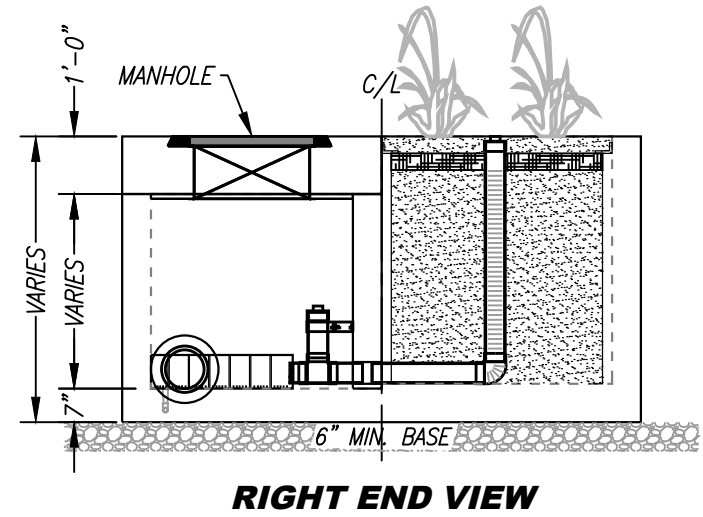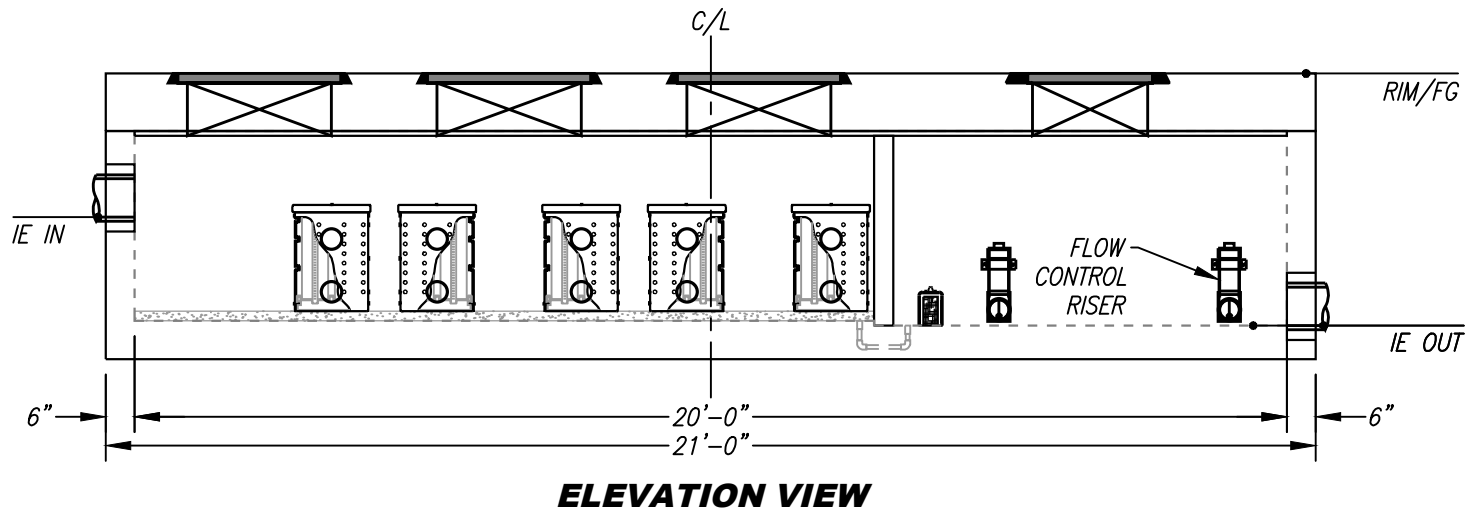

GENERAL NOTES

1. MANUFACTURER TO PROVIDE ALL MATERIALS UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS, ELEVATIONS, SPECIFICATIONS AND CAPACITIES ARE SUBJECT TO CHANGE. FOR PROJECT SPECIFIC DRAWINGS DETAILING EXACT DIMENSIONS, WEIGHTS AND ACCESSORIES PLEASE CONTACT BIO CLEAN.

TREATMENT FLOW (CFS)	
OPERATING HEAD (FT)	
PRETREATMENT LOADING RATE (GPM/SF)	
WETLAND MEDIA LOADING RATE (GPM/SF)	





PROPRIETARY AND CONFIDENTIAL:
 THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE SOLE PROPERTY OF FORTERRA AND ITS COMPANIES. THIS DOCUMENT, NOR ANY PART THEREOF, MAY BE USED, REPRODUCED OR MODIFIED IN ANY MANNER WITH OUT THE WRITTEN CONSENT OF FORTERRA.





MWS-L-8-20-V
STORMWATER BIOFILTRATION SYSTEM
STANDARD DETAIL

SITE SPECIFIC DATA			
PROJECT NUMBER			
PROJECT NAME			
PROJECT LOCATION			
STRUCTURE ID			
TREATMENT REQUIRED			
VOLUME BASED (CF)		FLOW BASED (CFS)	
N/A			
PEAK BYPASS REQUIRED (CFS) – IF APPLICABLE			
PIPE DATA	I.E.	MATERIAL	DIAMETER
INLET PIPE 1			
INLET PIPE 2			
OUTLET PIPE			
	PRETREATMENT	BIOFILTRATION	DISCHARGE
RIM ELEVATION			
SURFACE LOAD			
FRAME & COVER	3EA Ø30"		2EA Ø24"
NOTES:			

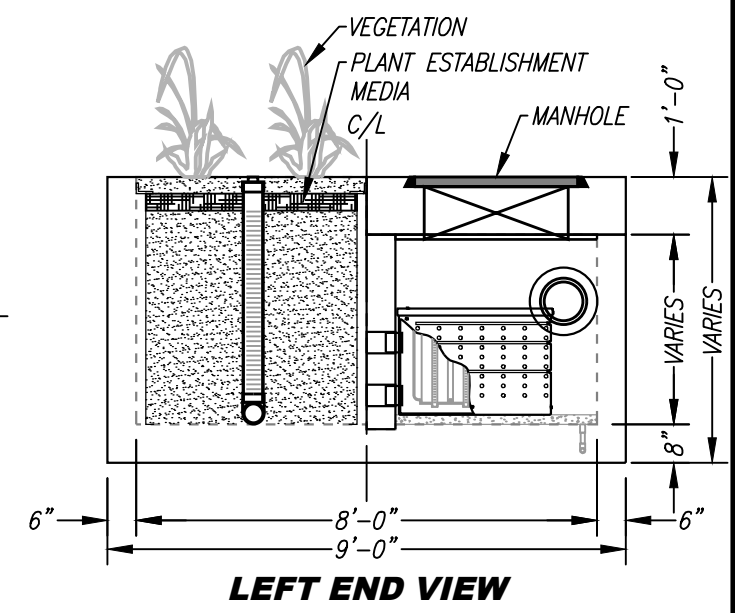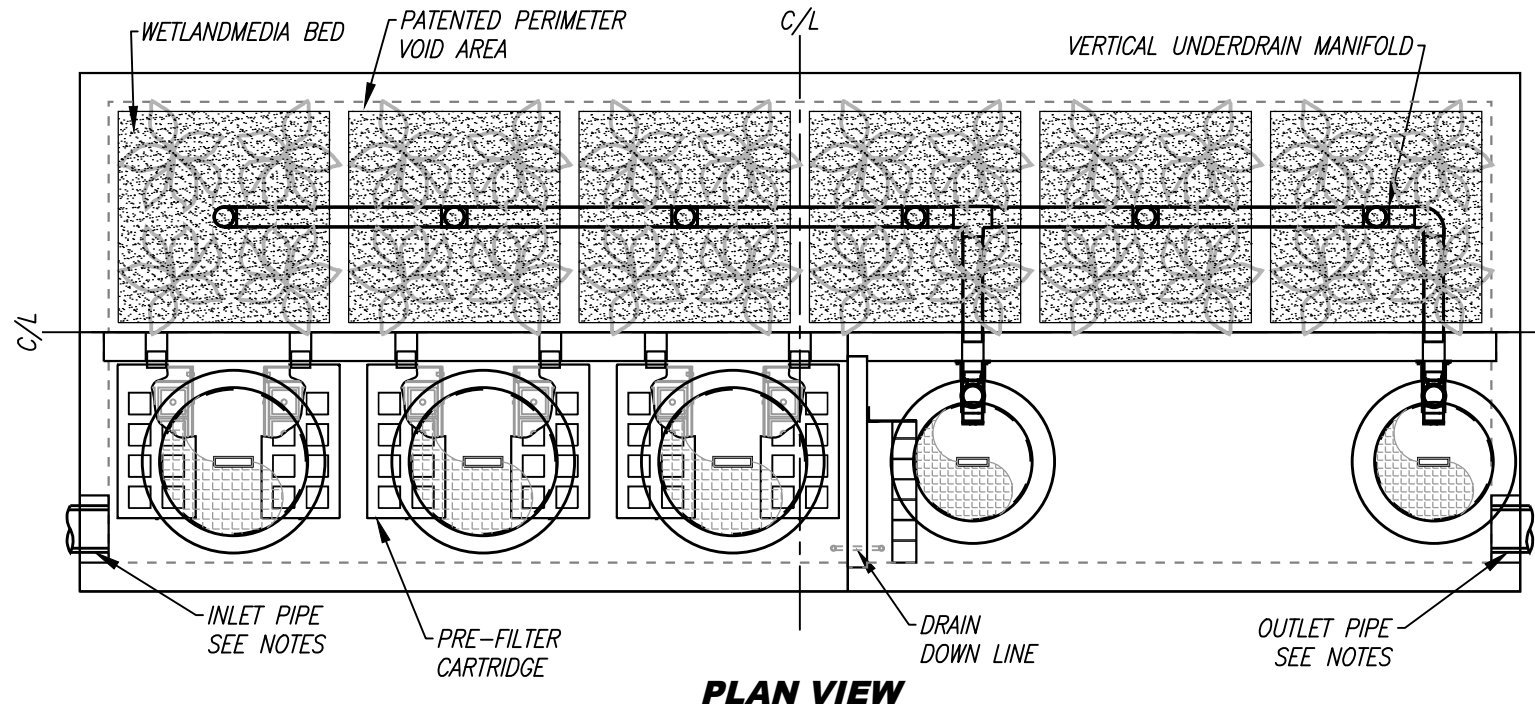


INSTALLATION NOTES

1. CONTRACTOR TO PROVIDE ALL LABOR, EQUIPMENT, MATERIALS AND INCIDENTALS REQUIRED TO OFFLOAD AND INSTALL THE SYSTEM AND APPURTENANCES IN ACCORDANCE WITH THIS DRAWING AND THE MANUFACTURERS SPECIFICATIONS, UNLESS OTHERWISE STATED IN MANUFACTURERS CONTRACT.
2. UNIT MUST BE INSTALLED ON LEVEL BASE. MANUFACTURER RECOMMENDS A MINIMUM 6" LEVEL ROCK BASE UNLESS SPECIFIED BY THE PROJECT ENGINEER. CONTRACTOR IS RESPONSIBLE TO VERIFY PROJECT ENGINEERS RECOMMENDED BASE SPECIFICATIONS.
4. CONTRACTOR TO SUPPLY AND INSTALL ALL EXTERNAL CONNECTING PIPES. ALL PIPES MUST BE FLUSH WITH INSIDE SURFACE OF CONCRETE. (PIPES CANNOT INTRUDE BEYOND FLUSH). INVERT OF OUTFLOW PIPE MUST BE FLUSH WITH DISCHARGE CHAMBER FLOOR. ALL PIPES SHALL BE SEALED WATER TIGHT PER MANUFACTURERS STANDARD CONNECTION DETAIL.
5. CONTRACTOR RESPONSIBLE FOR INSTALLATION OF ALL RISERS, MANHOLES, AND HATCHES. CONTRACTOR TO GROUT ALL MANHOLES AND HATCHES TO MATCH FINISHED SURFACE UNLESS SPECIFIED OTHERWISE.
6. VEGETATION SUPPLIED AND INSTALLED BY OTHERS. ALL UNITS WITH VEGETATION MUST HAVE DRIP OR SPRAY IRRIGATION SUPPLIED AND INSTALLED BY OTHERS.
7. CONTRACTOR RESPONSIBLE FOR CONTACTING BIO CLEAN FOR ACTIVATION OF UNIT. MANUFACTURERS WARRANTY IS VOID WITH OUT PROPER ACTIVATION BY A BIO CLEAN REPRESENTATIVE.

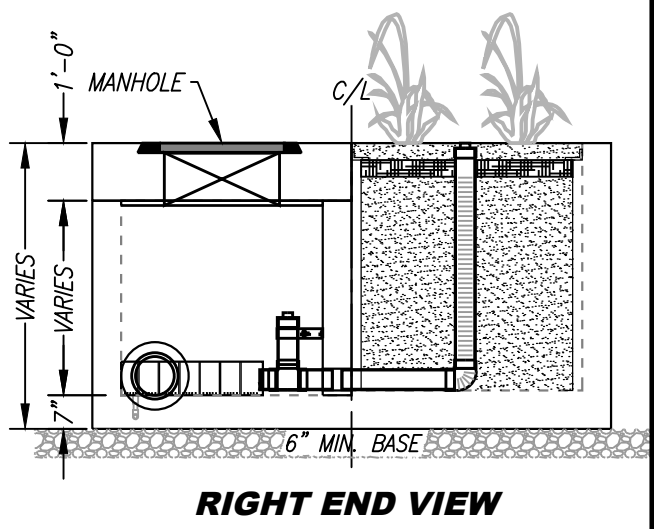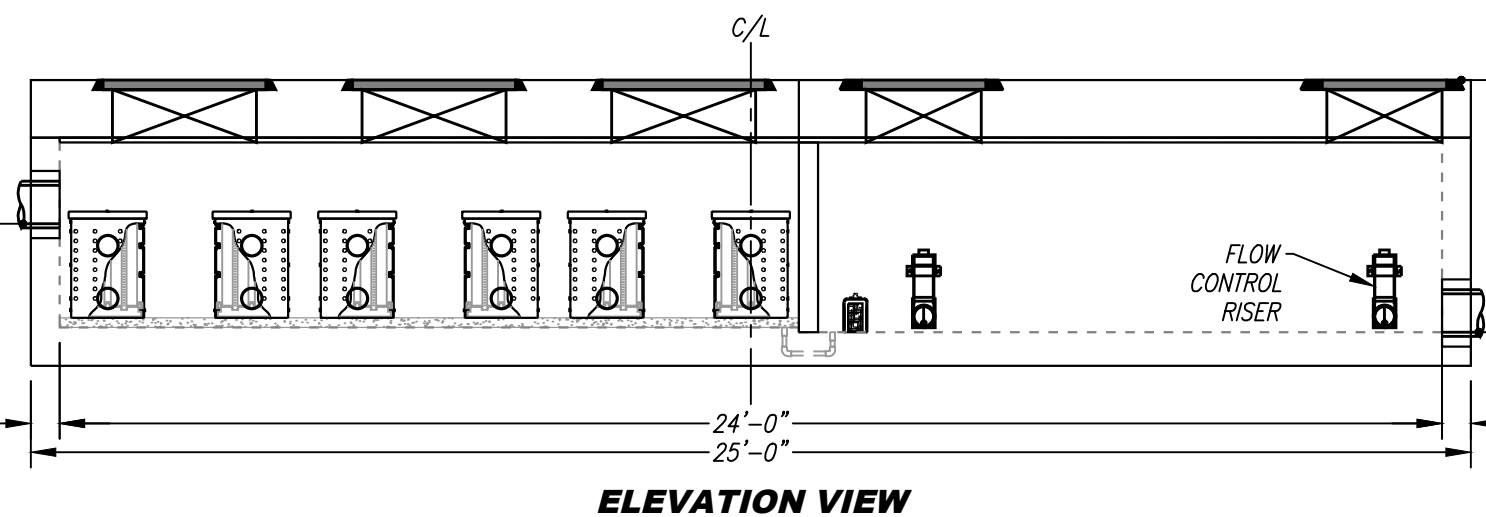

GENERAL NOTES

1. MANUFACTURER TO PROVIDE ALL MATERIALS UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS, ELEVATIONS, SPECIFICATIONS AND CAPACITIES ARE SUBJECT TO CHANGE. FOR PROJECT SPECIFIC DRAWINGS DETAILING EXACT DIMENSIONS, WEIGHTS AND ACCESSORIES PLEASE CONTACT BIO CLEAN.

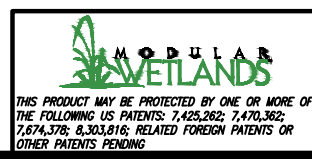

PROPRIETARY AND CONFIDENTIAL:
 THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE SOLE PROPERTY OF FORTERRA AND ITS COMPANIES. THIS DOCUMENT, NOR ANY PART THEREOF, MAY BE USED, REPRODUCED OR MODIFIED IN ANY MANNER WITH OUT THE WRITTEN CONSENT OF FORTERRA.



TREATMENT FLOW (CFS)	
OPERATING HEAD (FT)	
PRETREATMENT LOADING RATE (GPM/SF)	
WETLAND MEDIA LOADING RATE (GPM/SF)	

MWS-L-8-24-V
STORMWATER BIOFILTRATION SYSTEM
STANDARD DETAIL

5/23/19TOL/EE



Modular Wetlands[®] Linear

A Stormwater Biofiltration Solution



OVERVIEW

The Modular Wetlands® Linear (MWS Linear*) represents a pioneering breakthrough in stormwater technology as the only biofiltration system to utilize patented horizontal flow, allowing for a smaller footprint, higher treatment capacity, and a wide range of versatility. While most biofilters use little or no pretreatment, the Modular Wetlands Linear incorporates an advanced pretreatment chamber that includes separation and pre-filter boxes. In this chamber, sediment and hydrocarbons are removed from runoff before entering the biofiltration chamber, reducing maintenance costs and improving performance.


Horizontal flow also gives the system the unique ability to adapt to the environment through a variety of configurations, bypass orientations, and diversion applications.

The Urban Impact

For hundreds of years, natural wetlands surrounding our shores have played an integral role as nature's stormwater treatment system. But as cities grow and develop, our environment's natural filtration systems are blanketed with impervious roads, rooftops, and parking lots.

Bio Clean understands this loss and has spent years re-establishing nature's presence in urban areas, and rejuvenating waterways with the Modular Wetlands Linear.

*Also known as: Modular Wetlands®, Modular Wetlands® System Linear, Modwet™, or MWS Linear™.

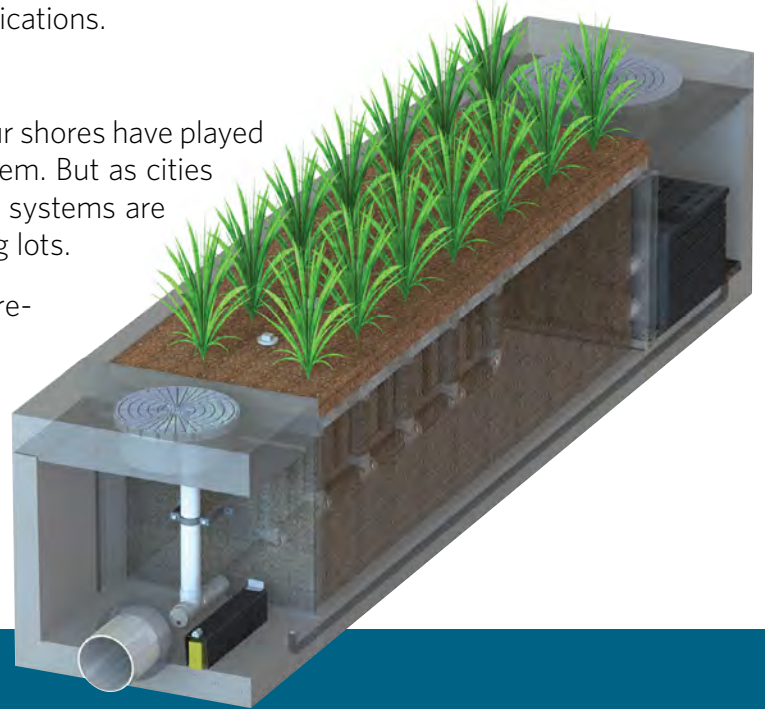

PERFORMANCE

The Modular Wetlands® Linear continues to outperform other treatment methods with superior pollutant removal for TSS, heavy metals, nutrients, hydrocarbons, and bacteria. Since 2007 the Modular Wetlands Linear has been field tested on numerous sites across the country and is proven to effectively remove pollutants through a combination of physical, chemical, and biological filtration processes. In fact, the Modular Wetlands Linear harnesses some of the same biological processes found in natural wetlands in order to collect, transform, and remove even the most harmful pollutants.

66%
REMOVAL
OF
DISSOLVED
ZINC

69%
REMOVAL
OF TOTAL
ZINC

38%
REMOVAL
OF
DISSOLVED
COPPER

85%
REMOVAL
OF TSS

100%
REMOVAL
OF TRASH

45%
REMOVAL
OF
NITROGEN

50%
REMOVAL
OF TOTAL
COPPER

95%
REMOVAL
OF MOTOR
OIL

67%
REMOVAL
OF ORTHO
PHOSPHORUS

64%
REMOVAL
OF TOTAL
PHOSPHORUS

APPROVALS

The Modular Wetlands® Linear (MWS Linear) has successfully met years of challenging technical reviews and testing from some of the most prestigious and demanding agencies in the nation and perhaps the world. Here is a list of some of the most high-profile approvals, certifications, and verifications from around the country.



Washington State Department of Ecology TAPE Approved

The MWS Linear is approved for General Use Level Designation (GULD) for Basic, Enhanced, and Phosphorus treatment at 1 gpm/ft² loading rate. The highest performing BMP on the market for all main pollutant categories.



California Water Resources Control Board, Full Capture Certification

The Modular Wetlands® Linear is the first biofiltration system to receive certification as a full capture trash treatment control device.



Virginia Department of Environmental Quality, Assignment

The Virginia Department of Environmental Quality assigned the MWS Linear the highest phosphorus removal rating for manufactured treatment devices to meet the new Virginia Stormwater Management Program (VSMP) regulation technical criteria.



Maryland Department of the Environment, Approved ESD

Granted Environmental Site Design (ESD) status for new construction, redevelopment, and retrofitting when designed in accordance with the design manual.



MASTEP Evaluation

The University of Massachusetts at Amherst - Water Resources Research Center issued a technical evaluation report noting removal rates up to 84% TSS, 70% total phosphorus, 68.5% total zinc, and more.



Rhode Island Department of Environmental Management, Approved BMP

Approved as an authorized BMP and noted to achieve the following minimum removal efficiencies: 85% TSS, 60% pathogens, 30% total phosphorus, and 30% total nitrogen.

ADVANTAGES

- HORIZONTAL FLOW BIOFILTRATION
- GREATER FILTER SURFACE AREA
- PRETREATMENT CHAMBER
- PATENTED PERIMETER VOID AREA
- FLOW CONTROL
- NO DEPRESSED PLANTER AREA
- AUTO DRAINDOWN MEANS NO MOSQUITO VECTOR

OPERATION

The Modular Wetlands® Linear is the most efficient and versatile biofiltration system on the market, and it is the only system with horizontal flow which:

- Improves performance
- Reduces footprint
- Minimizes maintenance

Figure 1 & Figure 2 illustrate the invaluable benefits of horizontal flow and the multiple treatment stages.


1 PRETREATMENT

SEPARATION

- Trash, sediment, and debris are separated before entering the pre-filter boxes
- Designed for easy maintenance access

PRE-FILTER BOXES

- Over 25 sq. ft. of surface area per box
- Utilizes BioMediaGREEN™ filter material
- Removes over 80% of TSS and 90% of hydrocarbons
- Prevents pollutants that cause clogging from migrating to the biofiltration chamber

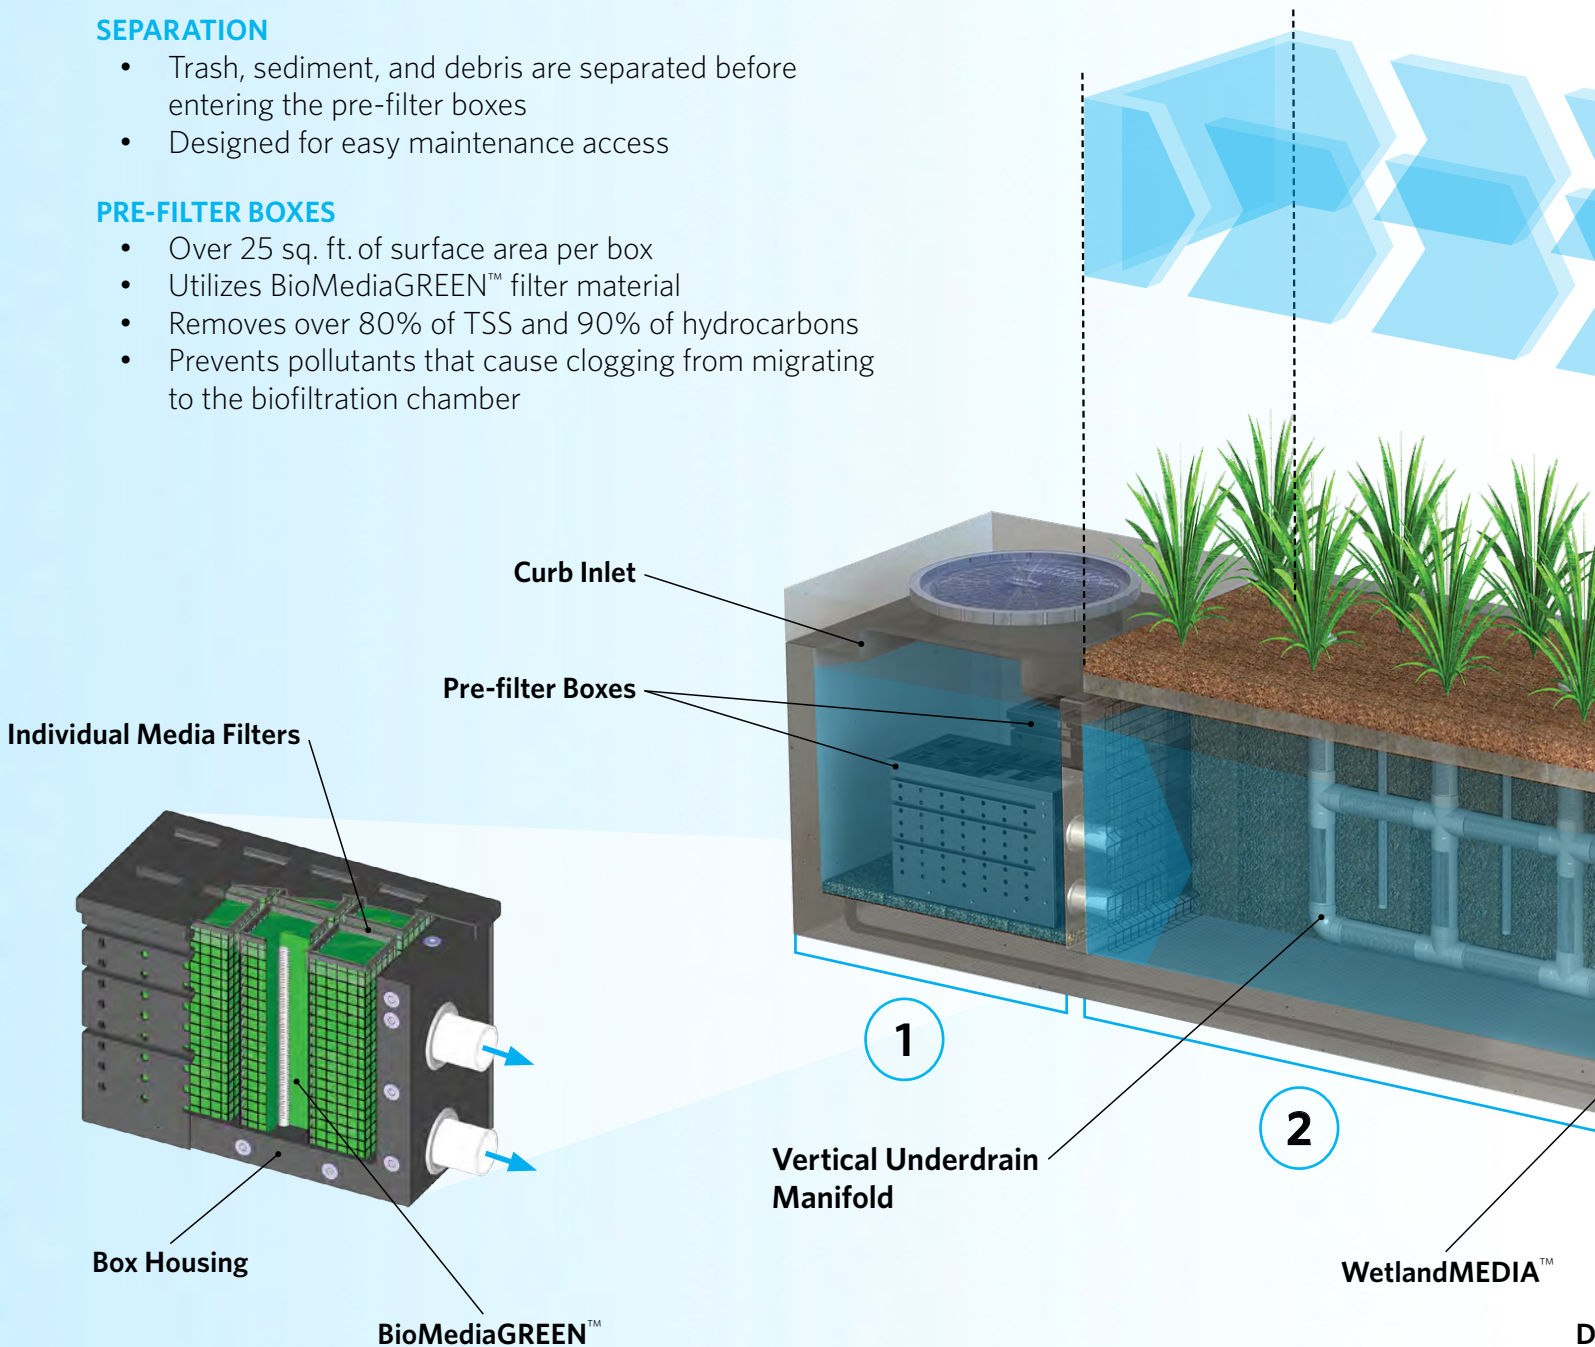

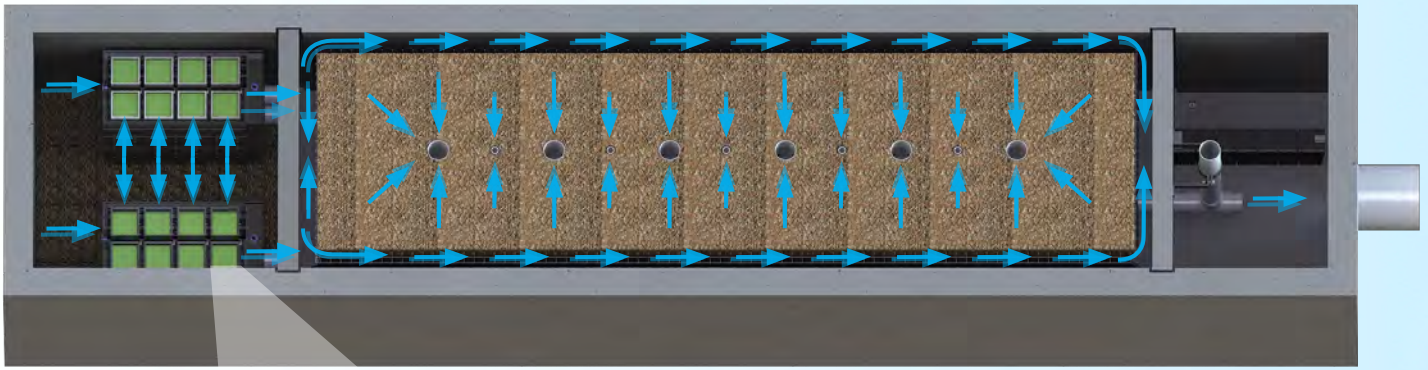


Figure 2,
Top View

2x to 3x more surface area than traditional downward flow bioretention systems.



2 BIOFILTRATION

HORIZONTAL FLOW

- Less clogging than downward flow biofilters
- Water flow is subsurface
- Improves biological filtration

PATENTED PERIMETER VOID AREA

- Vertically extends void area between the walls and the WetlandMEDIA™ on all four sides
- Maximizes surface area of the media for higher treatment capacity

WETLANDMEDIA

- Contains no organics and removes phosphorus
- Greater surface area and 48% void space
- Maximum evapotranspiration
- High ion exchange capacity and lightweight

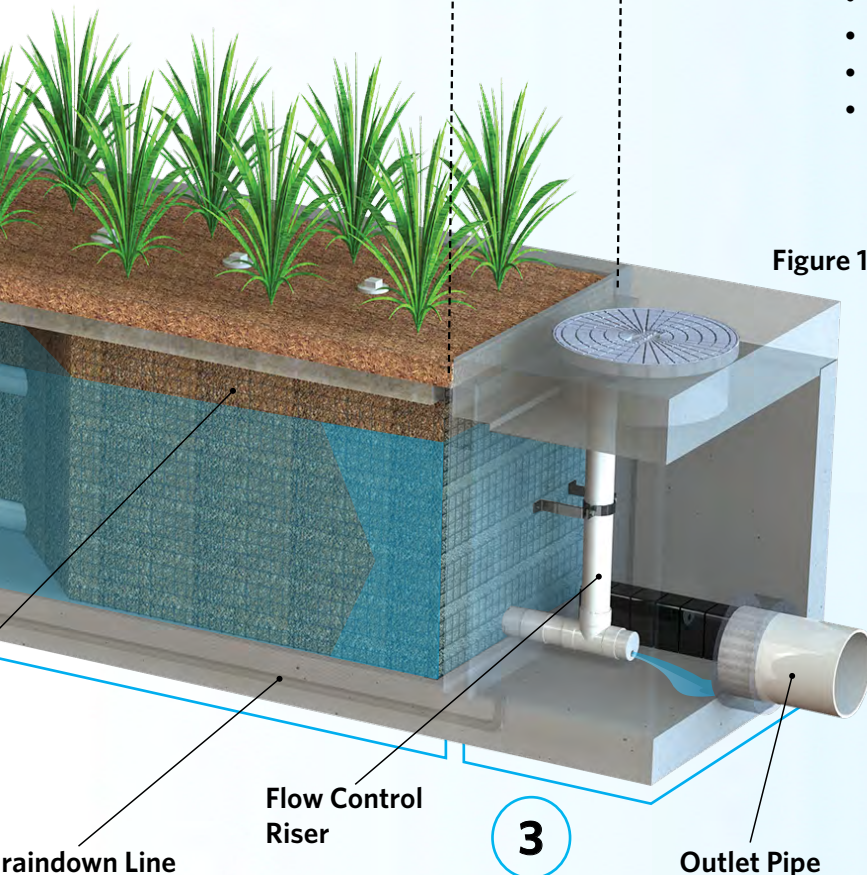
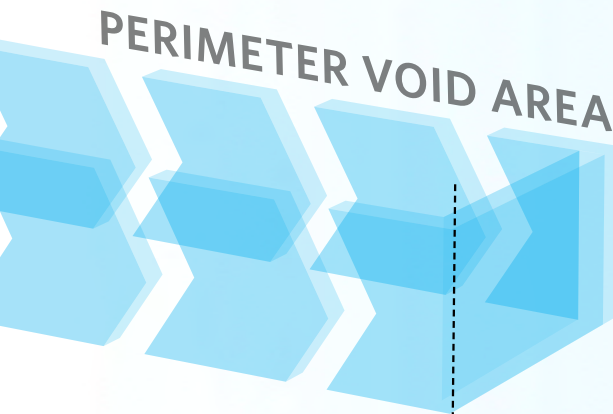


Figure 1

3 DISCHARGE

FLOW CONTROL

- Orifice plate controls flow of water through WetlandMEDIA™ to a level lower than the media's capacity
- Extends the life of the media and improves performance

DRAINDOWN FILTER

- The draindown is an optional feature that completely drains the pretreatment chamber
- Water that drains from the pretreatment chamber between storm events will be treated




CONFIGURATIONS

The Modular Wetlands® Linear is the preferred biofiltration system of civil engineers across the country due to its versatile design. This highly versatile system has available “pipe-in” options on most models, along with built-in curb or grated inlets for simple integration into your storm drain design.




CURB TYPE

The Curb Type configuration accepts sheet flow through a curb opening and is commonly used along roadways and parking lots. It can be used in sump or flow-by conditions. Length of curb opening varies based on model and size.

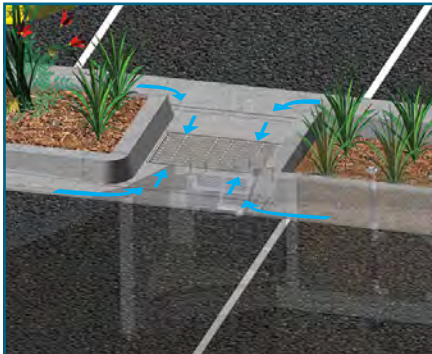

GRATE TYPE

The Grate Type configuration offers the same features and benefits as the Curb Type but with a grated/drop inlet above the systems pretreatment chamber. It has the added benefit of allowing pedestrian access over the inlet. ADA-compliant grates are available to assure easy and safe access. The Grate Type can also be used in scenarios where runoff needs to be intercepted on both sides of landscape islands.

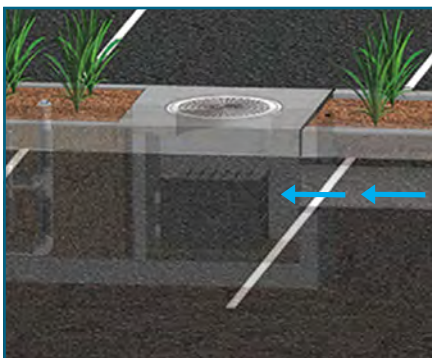

VAULT TYPE

The system's patented horizontal flow biofilter is able to accept inflow pipes directly into the pretreatment chamber, meaning the Modular Wetlands® can be used in end-of-the-line installations. This greatly improves feasibility over typical decentralized designs that are required with other biofiltration/bioretention systems. Another benefit of the “pipe-in” design is the ability to install the system downstream of underground detention systems to meet water quality volume requirements.



DOWNSPOUT TYPE

The Downspout Type is a variation of the Vault Type and is designed to accept a vertical downspout pipe from rooftop and podium areas. Some models have the option of utilizing an internal bypass, simplifying the overall design. The system can be installed as a raised planter, and the exterior can be stuccoed or covered with other finishes to match the look of adjacent buildings.

ORIENTATIONS

SIDE-BY-SIDE

The Side-By-Side orientation places the pretreatment and discharge chamber adjacent to one another with the biofiltration chamber running parallel on either side. This minimizes the system length, providing a highly compact footprint. It has been proven useful in situations such as streets with directly adjacent sidewalks, as half of the system can be placed under that sidewalk. This orientation also offers internal bypass options as discussed below.



END-TO-END

The End-To-End orientation places the pretreatment and discharge chambers on opposite ends of the biofiltration chamber, therefore minimizing the width of the system to 5 ft. (outside dimension). This orientation is perfect for linear projects and street retrofits where existing utilities and sidewalks limit the amount of space available for installation. One limitation of this orientation is that bypass must be external.



BYPASS

INTERNAL BYPASS WEIR (SIDE-BY-SIDE ONLY)

The Side-By-Side orientation places the pretreatment and discharge chambers adjacent to one another allowing for integration of internal bypass. The wall between these chambers can act as a bypass weir when flows exceed the system's treatment capacity, thus allowing bypass from the pretreatment chamber directly to the discharge chamber.

EXTERNAL DIVERSION WEIR STRUCTURE


This traditional offline diversion method can be used with the Modular Wetlands® Linear in scenarios where runoff is being piped to the system. These simple and effective structures are generally configured with two outflow pipes. The first is a smaller pipe on the upstream side of the diversion weir - to divert low flows over to the MWS Linear for treatment. The second is the main pipe that receives water once the system has exceeded treatment capacity and water flows over the weir.

FLOW-BY-DESIGN

This method is one in which the system is placed just upstream of a standard curb or grate inlet to intercept the first flush. Higher flows simply pass by the MWS Linear and into the standard inlet downstream.

DVERT LOW FLOW DIVERSION

This simple yet innovative diversion trough can be installed in existing or new curb and grate inlets to divert the first flush to the Modular Wetlands® Linear via pipe. It works similar to a rain gutter and is installed just below the opening into the inlet. It captures the low flows and channels them over

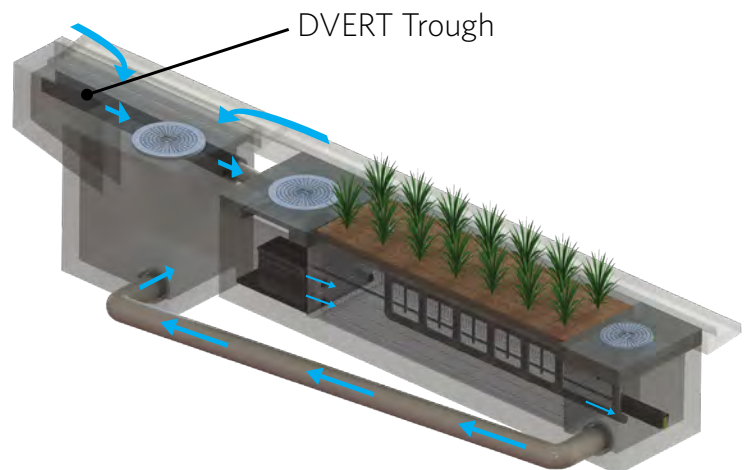

to a connecting pipe exiting out the wall of the inlet and leading to the MWS Linear. The DVERT is perfect for retrofit and green street applications that allow the system to be installed anywhere space is available.

SPECIFICATIONS

FLOW-BASED DESIGNS

The Modular Wetlands® System Linear can be used in stand-alone applications to meet treatment flow requirements, and since it is the only biofiltration system that can accept inflow pipes several feet below the surface, it can be used not only in decentralized design applications but also as a large central end-of-the-line application for maximum feasibility.

MODEL #	DIMENSIONS	WETLAND MEDIA SURFACE AREA (sq. ft.)	TREATMENT FLOW RATE (cfs)
MWS-L-4-4	4' x 4'	23	0.052
MWS-L-4-6	4' x 6'	32	0.073
MWS-L-4-8	4' x 8'	50	0.115
MWS-L-4-13	4' x 13'	63	0.144
MWS-L-4-15	4' x 15'	76	0.175
MWS-L-4-17	4' x 17'	90	0.206
MWS-L-4-19	4' x 19'	103	0.237
MWS-L-4-21	4' x 21'	117	0.268
MWS-L-6-8	7' x 9'	64	0.147
MWS-L-8-8	8' x 8'	100	0.230
MWS-L-8-12	8' x 12'	151	0.346
MWS-L-8-16	8' x 16'	201	0.462
MWS-L-8-20	9' x 21'	252	0.577
MWS-L-8-24	9' x 25'	302	0.693
MWS-L-10-20	10' x 20'	302	0.693

VOLUME-BASED DESIGNS

HORIZONTAL FLOW BIOFILTRATION ADVANTAGE



MODULAR WETLANDS® SYSTEM LINEAR WITH URBANPOND™ PRESTORAGE

In the example above, the Modular Wetlands® System Linear is installed downstream of the UrbanPond storage system. The MWS Linear is designed for the water quality volume and will treat and discharge the required volume within local draindown time requirements. The MWS Linear's unique horizontal flow design, gives it benefits no other biofilter has - the ability to be placed downstream of detention ponds, extended dry detention basins, underground storage systems and permeable paver reservoirs. The system's horizontal flow configuration and built-in orifice control allows it to be installed with just 6" of fall between inlet and outlet pipe for a simple connection to projects with shallow downstream tie-in points.



UrbanPond
Single and Double Modules

DESIGN SUPPORT

Bio Clean engineers are trained to provide you with superior support for all volume sizing configurations throughout the country. Our vast knowledge of state and local regulations allow us to quickly and efficiently size a system to maximize feasibility. Volume control and hydromodification regulations are expanding the need to decrease the cost and size of your biofiltration system. Bio Clean will help you realize these cost savings with the MWS Linear, the only biofilter than can be used downstream of storage BMPs.

ADVANTAGES

- LOWER COST THAN FLOW-BASED DESIGN
- BUILT-IN ORIFICE CONTROL STRUCTURE
- MEETS LID REQUIREMENTS
- WORKS WITH DEEP INSTALLATIONS

APPLICATIONS

The Modular Wetlands® System Linear has been successfully used on numerous new construction and retrofit projects. The system's superior versatility makes it beneficial for a wide range of stormwater and waste water applications - treating rooftops, streetscapes, parking lots, and industrial sites.




INDUSTRIAL

Many states enforce strict regulations for discharges from industrial sites. The Modular Wetlands® has helped various sites meet difficult EPA-mandated effluent limits for dissolved metals and other pollutants.



RESIDENTIAL

Low to high density developments can benefit from the versatile design of the Modular Wetlands®. The system can be used in both decentralized LID design and cost-effective end-of-the-line configurations.

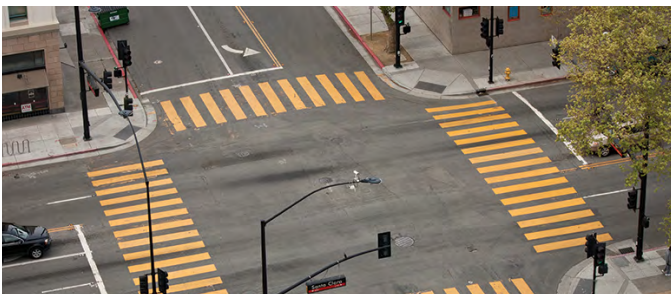

STREETS

Street applications can be challenging due to limited space. The Modular Wetlands® is very adaptable, and it offers the smallest footprint to work around the constraints of existing utilities on retrofit projects.



PARKING LOTS

Parking lots are designed to maximize space and the Modular Wetlands® 4 ft. standard planter width allows for easy integration into parking lot islands and other landscape medians.



COMMERCIAL

Compared to bioretention systems, the Modular Wetlands® can treat far more area in less space, meeting treatment and volume control requirements.



MIXED USE

The Modular Wetlands® can be installed as a raised planter to treat runoff from rooftops or patios, making it perfect for sustainable "live-work" spaces.

More applications include:

- Agriculture
- Reuse
- Low Impact Development
- Waste Water

PLANT SELECTION

Abundant plants, trees, and grasses bring value and an aesthetic benefit to any urban setting, but those in the Modular Wetlands® System Linear do even more - they increase pollutant removal. What's not seen, but very important, is that below grade, the stormwater runoff/flow is being subjected to nature's secret weapon: a dynamic physical, chemical, and biological process working to break down and remove non-point source pollutants. The flow rate is controlled in the Modular Wetlands®, giving the plants more contact time so that pollutants are more successfully decomposed, volatilized, and incorporated into the biomass of the Modular Wetlands'® micro/macro flora and fauna.



A wide range of plants are suitable for use in the Modular Wetlands®, but selections vary by location and climate. View suitable plants by visiting biocleanenvironmental.com/plants.

INSTALLATION



The Modular Wetlands® is simple, easy to install, and has a space-efficient design that offers lower excavation and installation costs compared to traditional tree-box type systems. The structure of the system resembles precast catch basin or utility vaults and is installed in a similar fashion.

The system is delivered fully assembled for quick installation. Generally, the structure can be unloaded and set in place in 15 minutes. Our experienced team of field technicians is available to supervise installations and provide technical support.

MAINTENANCE



Reduce your maintenance costs, man hours, and materials with the Modular Wetlands®. Unlike other biofiltration systems that provide no pretreatment, the Modular Wetlands® is a self-contained treatment train which incorporates simple and effective pretreatment.

Maintenance requirements for the biofilter itself are almost completely eliminated, as the pretreatment chamber removes and isolates trash, sediments, and hydrocarbons. What's left is the simple maintenance of an easily accessible pretreatment chamber that can be cleaned by hand or with a standard vac truck. Only periodic replacement of low-cost media in the pre-filter cartridges is required for long-term operation, and there is absolutely no need to replace expensive biofiltration media.



Bio  Clean
A Forterra Company

5796 Armada Drive Suite 250
Carlsbad, CA 92008
855.566.3938
stormwater@forterrabp.com
biocleanenvironmental.com

STORMTECH MC-3500 CHAMBER

Designed to meet the most stringent industry performance standards for superior structural integrity while providing designers with a cost-effective method to save valuable land and protect water resources. The StormTech system is designed primarily to be used under parking lots, thus maximizing land usage for private (commercial) and public applications. StormTech chambers can also be used in conjunction with Green Infrastructure, thus enhancing the performance and extending the service life of these practices.



STORMTECH MC-3500 CHAMBER (not to scale)

Nominal Chamber Specifications

Size (L x W x H)
90" x 77" x 45"
2,286 mm x 1,956 mm x 1,143 mm

Chamber Storage
109.9 ft³ (3.11 m³)

Min. Installed Storage*
175.0 ft³ (4.96 m³)

Weight
134 lbs (60.8 kg)

Shipping
15 chambers/pallet
7 end caps/pallet
7 pallets/truck

*Assumes a minimum of 12" (300 mm) of stone above, 9" (230 mm) of stone below chambers, 6" (150 mm) of stone between chambers/end caps and 40% stone porosity.

STORMTECH MC-3500 END CAP (not to scale)

Nominal End Cap Specifications



Size (L x W x H)
26.5" x 71" x 45.1"
673 mm x 1,803 mm x 1,145 mm

End Cap Storage
14.9 ft³ (0.42 m³)

Min. Installed Storage*
45.1 ft³ (1.28 m³)

Weight
49 lbs (22.2 kg)

*Assumes a minimum of 12" (300 mm) of stone above, 9" (230 mm) of stone below, 6" (150 mm) of stone between chambers, 6" (150 mm) of stone between chambers/end caps and 40% stone porosity.

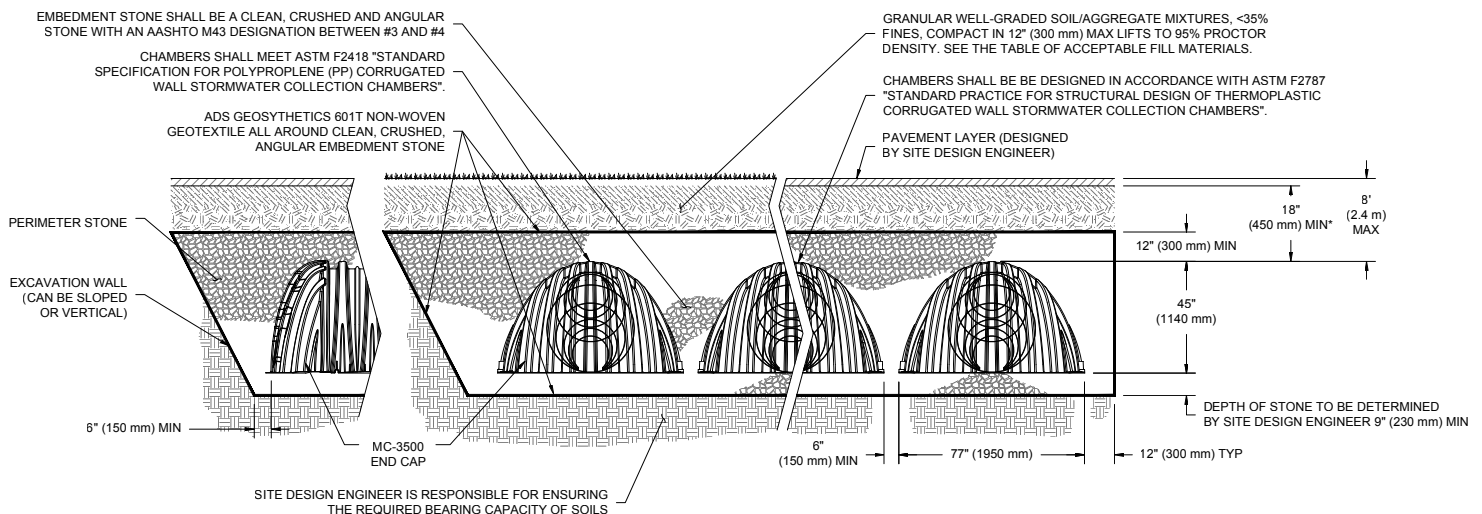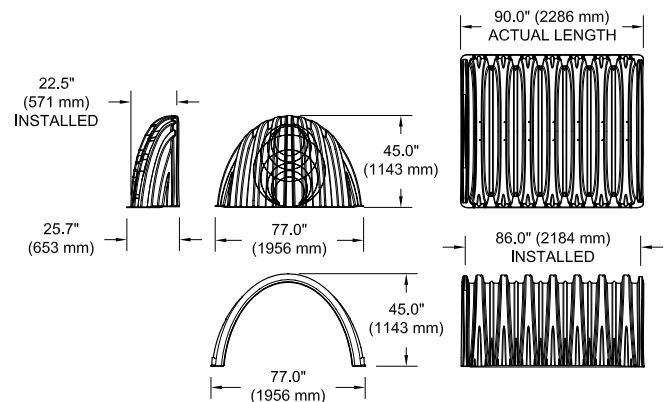

*MINIMUM COVER TO BOTTOM OF FLEXIBLE PAVEMENT. FOR UNPAVED INSTALLATIONS WHERE RUTTING FROM VEHICLES MAY OCCUR, INCREASE COVER TO 24" (600 mm).

MC-3500 CHAMBER SPECIFICATION

STORAGE VOLUME PER CHAMBER FT³ (M³)

	Bare Chamber Storage ft ³ (m ³)	Chamber and Stone Foundation Depth in. (mm)			
		9" (230 mm)	12" (300 mm)	15" (375 mm)	18" (450 mm)
MC-3500 Chamber	109.9 (3.11)	175.0 (4.96)	179.9 (5.09)	184.9 (5.24)	189.9 (5.38)
MC-3500 End Cap	14.9 (.42)	45.1 (1.28)	46.6 (1.32)	48.3 (1.37)	49.9 (1.41)

Note: Assumes 6" (150 mm) row spacing, 40% stone porosity, 12" (300 mm) stone above and includes the bare chamber/end cap volume.

AMOUNT OF STONE PER CHAMBER

ENGLISH TONS (yds ³)	Stone Foundation Depth			
	9"	12"	15"	18"
MC-3500 Chamber	8.5 (6.0)	9.1 (6.5)	9.7 (6.9)	10.4 (7.4)
MC-3500 End Cap	3.9 (2.8)	4.1 (2.9)	4.3 (3.1)	4.5 (3.2)
METRIC KILOGRAMS (m ³)	230 mm	300 mm	375 mm	450 mm
MC-3500 Chamber	7711 (4.6)	8255 (5.0)	8800 (5.3)	9435 (5.7)
MC-3500 End Cap	3538 (2.1)	3719 (2.2)	3901 (2.4)	4082 (2.5)

Note: Assumes 12" (300 mm) of stone above and 6" (150 mm) row spacing and 6" (150 mm) of perimeter stone in front of end caps.

VOLUME EXCAVATION PER CHAMBER YD³ (M³)

	Stone Foundation Depth			
	9" (230 mm)	12" (300 mm)	15" (375mm)	18" (450 mm)
MC-3500 Chamber	11.9 (9.1)	12.4 (9.5)	12.8(9.8)	13.3 (10.2)
MC-3500 End Cap	4.0 (3.1)	4.1 (3.2)	4.3 (3.3)	4.4 (3.4)

Note: Assumes 6" (150 mm) of separation between chamber rows and 24" (600 mm) of cover. The volume of excavation will vary as depth of cover increases.



Working on a project?
Visit us at www.stormtech.com
and utilize the StormTech Design Tool

For more information on the StormTech MC-3500 Chamber and other ADS products, please contact our Customer Service Representatives at 1-800-821-6710

PROJECT INFORMATION	
ENGINEERED PRODUCT MANAGER	
ADS SALES REP	
PROJECT NO.	



SiteASSIST™
FOR STORMTECH
INSTRUCTIONS,
DOWNLOAD THE
INSTALLATION APP



REDLANDS WEST PRELIM

PERRIS, CA

MC-3500 STORMTECH CHAMBER SPECIFICATIONS

1. CHAMBERS SHALL BE STORMTECH MC-3500.
2. CHAMBERS SHALL BE ARCH-SHAPED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
3. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418-16a, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
4. CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
5. THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION DEAD LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
6. CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CONFIGURATIONS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". LOAD CONFIGURATIONS SHALL INCLUDE: 1) INSTANTANEOUS (<1 MIN) AASHTO DESIGN TRUCK LIVE LOAD ON MINIMUM COVER 2) MAXIMUM PERMANENT (75-YR) COVER LOAD AND 3) ALLOWABLE COVER WITH PARKED (1-WEEK) AASHTO DESIGN TRUCK.
7. REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 3".
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/IN/IN. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.
8. ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. UPON REQUEST BY THE SITE DESIGN ENGINEER OR OWNER, THE CHAMBER MANUFACTURER SHALL SUBMIT A STRUCTURAL EVALUATION FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE AS FOLLOWS:
 - THE STRUCTURAL EVALUATION SHALL BE SEALED BY A REGISTERED PROFESSIONAL ENGINEER.
 - THE STRUCTURAL EVALUATION SHALL DEMONSTRATE THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY SECTIONS 3 AND 12.12 OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS FOR THERMOPLASTIC PIPE.
 - THE TEST DERIVED CREEP MODULUS AS SPECIFIED IN ASTM F2418 SHALL BE USED FOR PERMANENT DEAD LOAD DESIGN EXCEPT THAT IT SHALL BE THE 75-YEAR MODULUS USED FOR DESIGN.
9. CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF MC-3500 CHAMBER SYSTEM

1. STORMTECH MC-3500 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
2. STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
3. CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS. STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
4. THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
5. JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
6. MAINTAIN MINIMUM - 6" (150 mm) SPACING BETWEEN THE CHAMBER ROWS.
7. INLET AND OUTLET MANIFOLDS MUST BE INSERTED A MINIMUM OF 12" (300 mm) INTO CHAMBER END CAPS.
8. EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE MEETING THE AASHTO M43 DESIGNATION OF #3 OR #4.
9. STONE MUST BE PLACED ON THE TOP CENTER OF THE CHAMBER TO ANCHOR THE CHAMBERS IN PLACE AND PRESERVE ROW SPACING.
10. THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
11. ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.


NOTES FOR CONSTRUCTION EQUIPMENT

1. STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
2. THE USE OF EQUIPMENT OVER MC-3500 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER TIRE LOADER, DUMP TRUCK, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
3. FULL 36" (900 mm) OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL OR DUMPING.

USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY USING THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-888-892-2694 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

PROPOSED LAYOUT		PROPOSED ELEVATIONS		*INVERT ABOVE BASE OF CHAMBER				
				PART TYPE	ITEM ON LAYOUT	DESCRIPTION	INVERT*	MAX FLOW
310	STORMTECH MC-3500 CHAMBERS	MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):	1444.25					
10	STORMTECH MC-3500 END CAPS	TOP OF STONE:	1439.25					
36	STONE ABOVE (in)	MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):	1438.25	PREFABRICATED END CAP	A	24" BOTTOM CORED END CAP, PART#: MC3500IEPP24BC / TYP OF ALL 24" BOTTOM CONNECTIONS AND ISOLATOR PLUS ROWS	2.06"	
9	STONE BELOW (in)	MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):	1437.75	FLAMP	B	INSTALL FLAMP ON 24" ACCESS PIPE / PART#: MC350024RAMP (TYP 2 PLACES)		
40	STONE VOID	MINIMUM ALLOWABLE GRADE (TOP OF RIGID CONCRETE PAVEMENT):	1437.75	MANIFOLD	C	24" x 24" BOTTOM MANIFOLD, ADS N-12	2.06"	
71059	INSTALLED SYSTEM VOLUME (CF) (PERIMETER STONE INCLUDED) (COVER STONE INCLUDED) (BASE STONE INCLUDED)	MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):	1437.75	MANIFOLD	D	24" x 24" BOTTOM MANIFOLD, ADS N-12	2.06"	
		TOP OF MC-3500 CHAMBER:	1436.25	MANIFOLD	E	24" x 24" BOTTOM MANIFOLD, ADS N-12	2.06"	
		24" x 24" BOTTOM MANIFOLD INVERT:	1432.67	CONCRETE STRUCTURE	F	OCS (DESIGN BY ENGINEER / PROVIDED BY OTHERS)		14.0 CFS OUT
16840	SYSTEM AREA (SF)	24" x 24" BOTTOM MANIFOLD INVERT:	1432.67	CONCRETE STRUCTURE	G	OCS (DESIGN BY ENGINEER / PROVIDED BY OTHERS)		7.0 CFS OUT
991.5	SYSTEM PERIMETER (ft)	24" ISOLATOR ROW PLUS INVERT:	1432.67	CONCRETE STRUCTURE	H	(DESIGN BY ENGINEER / PROVIDED BY OTHERS)		17.0 CFS IN
		24" ISOLATOR ROW PLUS INVERT:	1432.67	W/WEIR				
		24" BOTTOM CONNECTION INVERT:	1432.67	CONCRETE STRUCTURE	I	(DESIGN BY ENGINEER / PROVIDED BY OTHERS)		34.0 CFS IN
		24" BOTTOM CONNECTION INVERT:	1432.67	W/WEIR				
		BOTTOM OF MC-3500 CHAMBER:	1432.50	UNDERDRAIN	J	6" ADS N-12 DUAL WALL PERFORATED HDPE UNDERDRAIN		
		UNDERDRAIN INVERT:	1431.75					
		BOTTOM OF STONE:	1431.75					

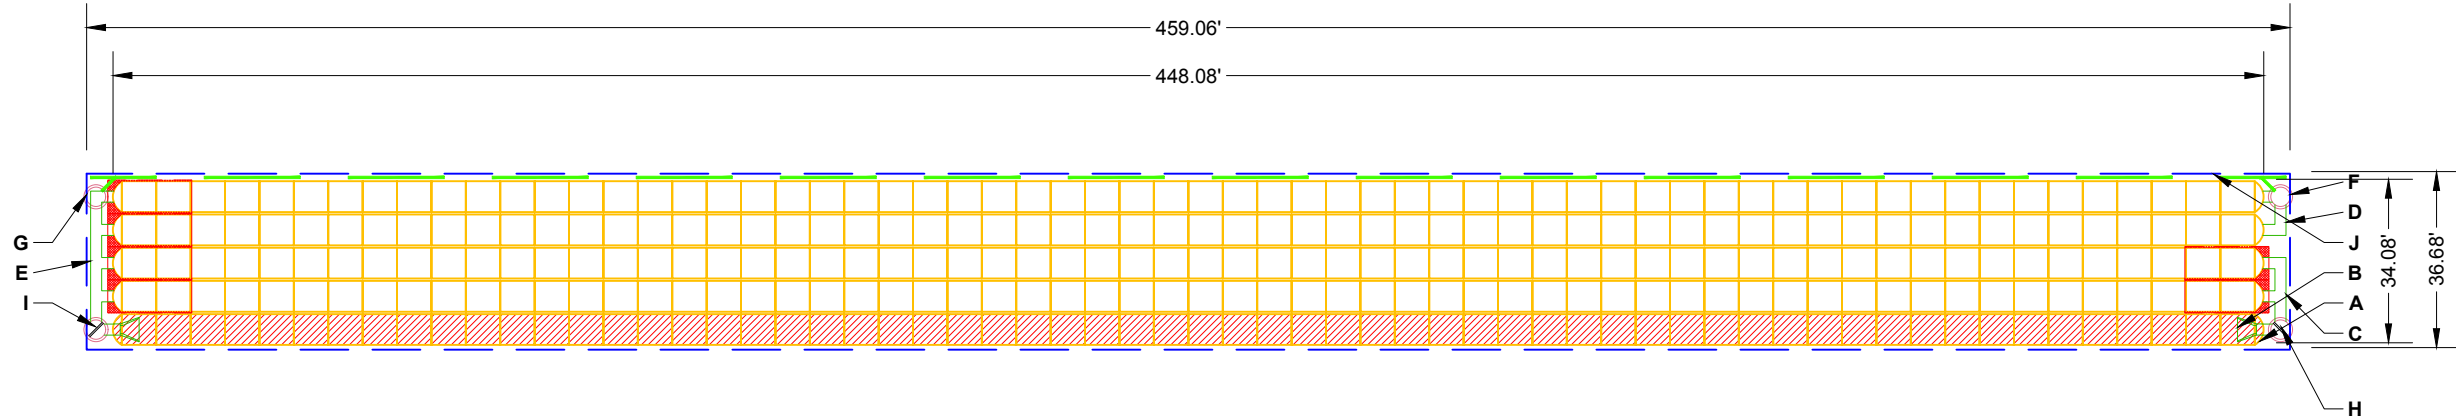

- ISOLATOR ROW PLUS (SEE DETAIL)
- PLACE MINIMUM 17.50' OF ADSPLUS175 WOVEN GEOTEXTILE OVER BEDDING STONE AND UNDERNEATH CHAMBER FEET FOR SCOUR PROTECTION AT ALL CHAMBER INLET ROWS
- BED LIMITS

NOTES

- MANIFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH NOTE #6.32 FOR MANIFOLD SIZING GUIDANCE.
- DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANIFOLD COMPONENTS IN THE FIELD.
- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.
- THIS CHAMBER SYSTEM WAS DESIGNED WITHOUT SITE-SPECIFIC INFORMATION ON SOIL CONDITIONS OR BEARING CAPACITY. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL AND PROVIDING THE BEARING CAPACITY OF THE INSITU SOILS. THE BASE STONE DEPTH MAY BE INCREASED OR DECREASED ONCE THIS INFORMATION IS PROVIDED.
- **NOT FOR CONSTRUCTION:** THIS LAYOUT IS FOR DIMENSIONAL PURPOSES ONLY TO PROVE CONCEPT & THE REQUIRED STORAGE VOLUME CAN BE ACHIEVED ON SITE.

StormTech® Chamber System 888-892-2694 WWW.STORMTECH.COM		4640 TRUEMAN BLVD HILLIARD, OH 43026 1-800-733-7473	
REDLANDS WEST PRELIM PERRIS, CA	DRAWN: AS CHECKED: N/A	DATE: PROJECT #:	SHEET 2 OF 5


THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24" (600 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	AASHTO M145 ¹ A-1, A-2-4, A-3 OR AASHTO M43 ¹ 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 24" (600 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 12" (300 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS.
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	AASHTO M43 ¹ 3, 4	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	AASHTO M43 ¹ 3, 4	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2,3}

PLEASE NOTE:

1. THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
2. STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL COVERAGES WITH A VIBRATORY COMPACTOR.
3. WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.
4. ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.

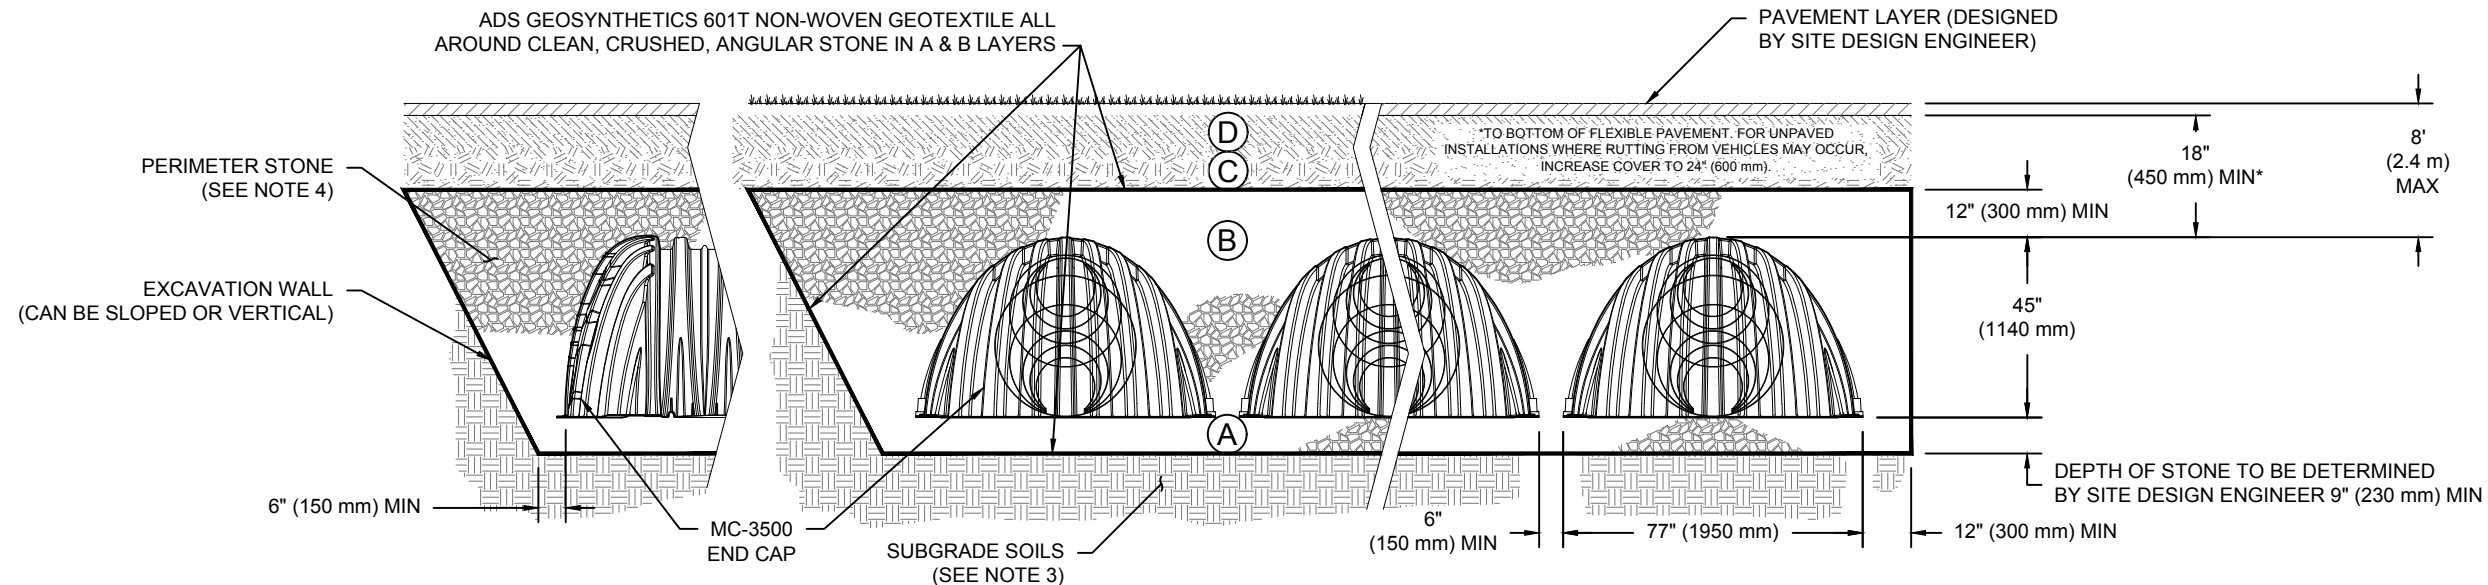

NOTES:

1. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418-16a, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS" CHAMBER CLASSIFICATION 45x76 DESIGNATION SS.
2. MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
3. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
4. PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
5. REQUIREMENTS FOR HANDLING AND INSTALLATION:
 - TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTEGRAL, INTERLOCKING STACKING LUGS.
 - TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 3".
 - TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, a) THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 6.2.8 OF ASTM F2418 SHALL BE GREATER THAN OR EQUAL TO 500 LBS/IN/IN. AND b) TO RESIST CHAMBER DEFORMATION DURING INSTALLATION AT ELEVATED TEMPERATURES (ABOVE 73° F / 23° C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORS.

REDLANDS WEST PRELIM

PERRIS, CA

DESCRIPTION

CHK

DRW

REV

DATE:

DRAWN: AS

CHECKED: N/A

PROJECT #:


StormTech®
Chamber System

888-892-2694 | WWW.STORMTECH.COM

4640 TRUEMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

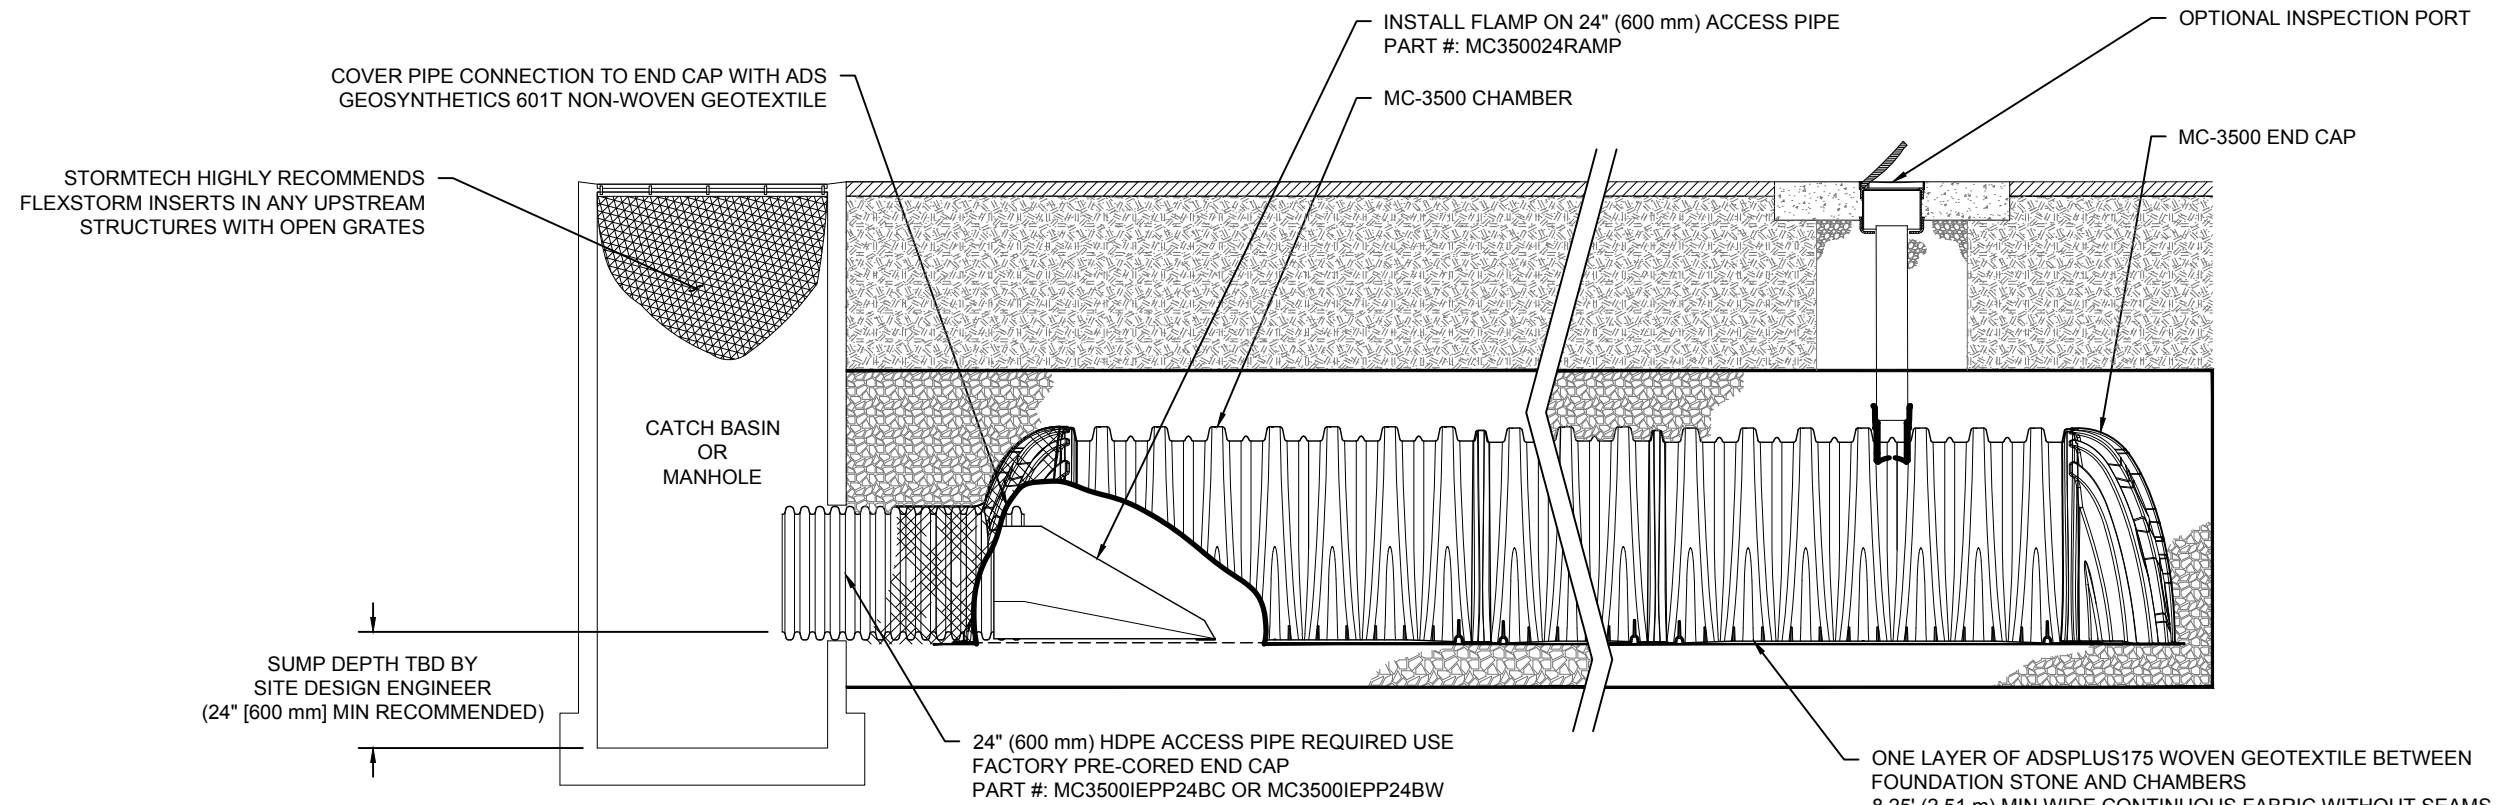

MC-3500 ISOLATOR ROW PLUS DETAIL

NTS



INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT
- A. INSPECTION PORTS (IF PRESENT)
 - A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN
 - A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED
 - A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG
 - A.4. LOWER A CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)
 - A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
 - B. ALL ISOLATOR PLUS ROWS
 - B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS
 - B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW PLUS THROUGH OUTLET PIPE
 - i) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
 - ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
 - B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW PLUS USING THE JETVAC PROCESS
- A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
 - B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
 - C. VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

NOTES


1. INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
2. CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

	REDLANDS WEST PRELIM PERRIS, CA	DRAWN: AS	CHECKED: N/A	
DESCRIPTION	DATE:	PROJECT #:		
CHK				
DRW				
REV				
StormTech® Chamber System		888-892-2694 WWW.STORMTECH.COM		
4640 TRUEMAN BLVD HILLIARD, OH 43026 1-800-733-7473				
THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.				
SHEET		4 OF 5		

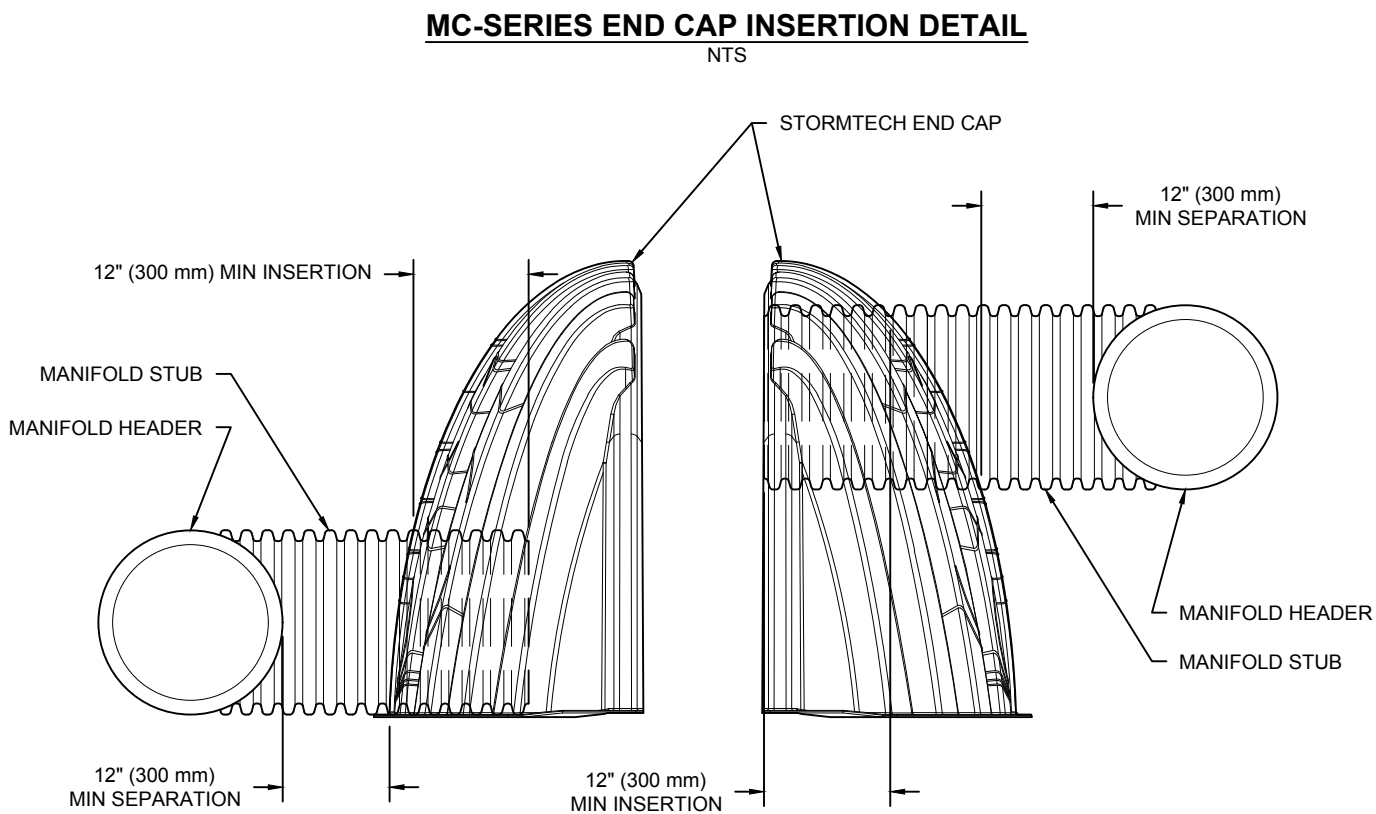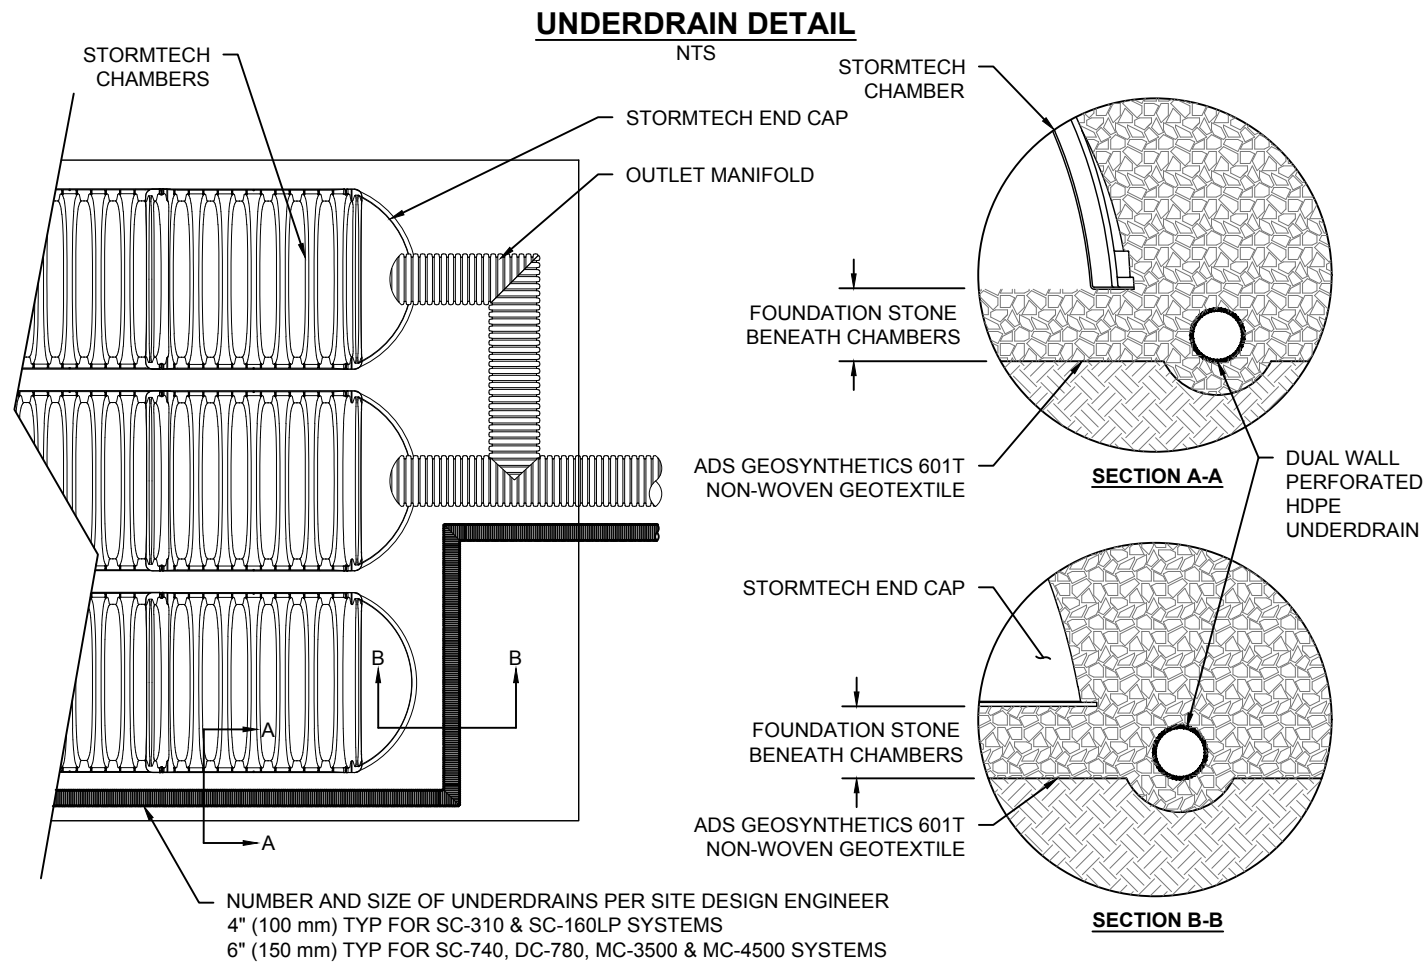

NOTE: MANIFOLD STUB MUST BE LAID HORIZONTAL FOR A PROPER FIT IN END CAP OPENING.

MC-3500 TECHNICAL SPECIFICATION

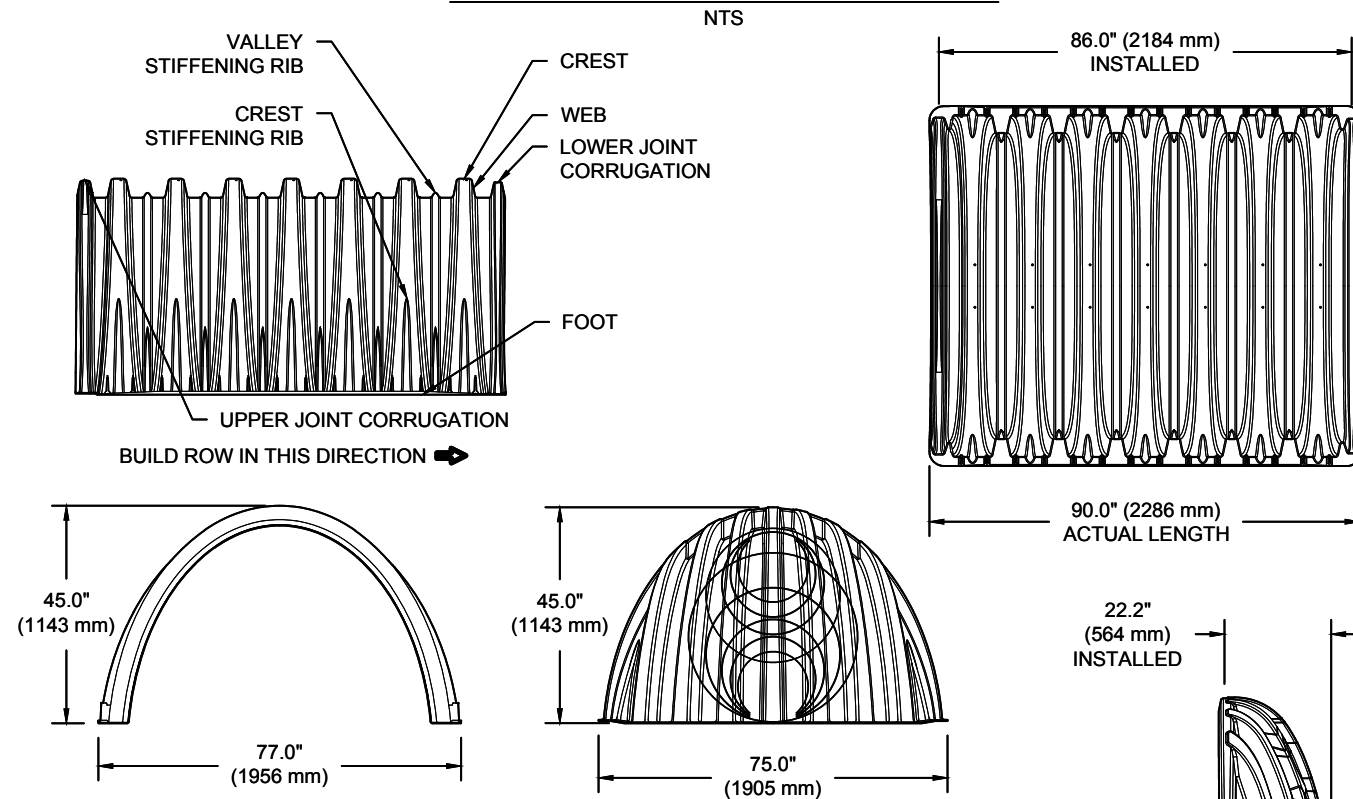

NOMINAL CHAMBER SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)		
77.0" X 45.0" X 86.0"	(1956 mm X 1143 mm X 2184 mm)	
CHAMBER STORAGE	109.9 CUBIC FEET	(3.11 m ³)
MINIMUM INSTALLED STORAGE*	175.0 CUBIC FEET	(4.96 m ³)
WEIGHT	134 lbs.	(60.8 kg)

NOMINAL END CAP SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)		
75.0" X 45.0" X 22.2"	(1905 mm X 1143 mm X 564 mm)	
END CAP STORAGE	14.9 CUBIC FEET	(0.42 m ³)
MINIMUM INSTALLED STORAGE*	45.1 CUBIC FEET	(1.28 m ³)
WEIGHT	49 lbs.	(22.2 kg)

*ASSUMES 12" (305 mm) STONE ABOVE, 9" (229 mm) STONE FOUNDATION, 6" SPACING BETWEEN CHAMBERS, 6" (152 mm) STONE PERIMETER IN FRONT OF END CAPS AND 40% STONE POROSITY

STUBS AT BOTTOM OF END CAP FOR PART NUMBERS ENDING WITH "B"
 STUBS AT TOP OF END CAP FOR PART NUMBERS ENDING WITH "T"
 END CAPS WITH A WELDED CROWN PLATE END WITH "C"
 END CAPS WITH A PREFABRICATED WELDED STUB END WITH "W"

PART #	STUB	B	C
MC3500IEPP06T	6" (150 mm)	33.21" (844 mm)	---
MC3500IEPP06B		---	0.66" (17 mm)
MC3500IEPP08T	8" (200 mm)	31.16" (791 mm)	---
MC3500IEPP08B		---	0.81" (21 mm)
MC3500IEPP10T	10" (250 mm)	29.04" (738 mm)	---
MC3500IEPP10B		---	0.93" (24 mm)
MC3500IEPP12T	12" (300 mm)	26.36" (670 mm)	---
MC3500IEPP12B		---	1.35" (34 mm)
MC3500IEPP15T	15" (375 mm)	23.39" (594 mm)	---
MC3500IEPP15B		---	1.50" (38 mm)
MC3500IEPP18TC	18" (450 mm)	20.03" (509 mm)	---
MC3500IEPP18TW			---
MC3500IEPP18BC			1.77" (45 mm)
MC3500IEPP18BW			---
MC3500IEPP24TC	24" (600 mm)	14.48" (368 mm)	---
MC3500IEPP24TW			---
MC3500IEPP24BC			2.06" (52 mm)
MC3500IEPP24BW			---
MC3500IEPP30BC	30" (750 mm)	---	2.75" (70 mm)

NOTE: ALL DIMENSIONS ARE NOMINAL

CUSTOM PRECORED INVERTS ARE AVAILABLE UPON REQUEST. INVENTORIED MANIFOLDS INCLUDE 12-24" (300-600 mm) SIZE ON SIZE AND 15-48" (375-1200 mm) ECCENTRIC MANIFOLDS. CUSTOM INVERT LOCATIONS ON THE MC-3500 END CAP CUT IN THE FIELD ARE NOT RECOMMENDED FOR PIPE SIZES GREATER THAN 10" (250 mm). THE INVERT LOCATION IN COLUMN 'B' ARE THE HIGHEST POSSIBLE FOR THE PIPE SIZE.

REDLANDS WEST PRELIM
 PERRIS, CA

DESCRIPTION

CHK

DRW

REV

DATE:

PROJECT #:

DRAWN: AS

CHECKED: N/A


StormTech[®]
 Chamber System

888-892-2694 | WWW.STORMTECH.COM

4640 TRUEMAN BLVD
 HILLIARD, OH 43026
 1-800-733-7473




THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

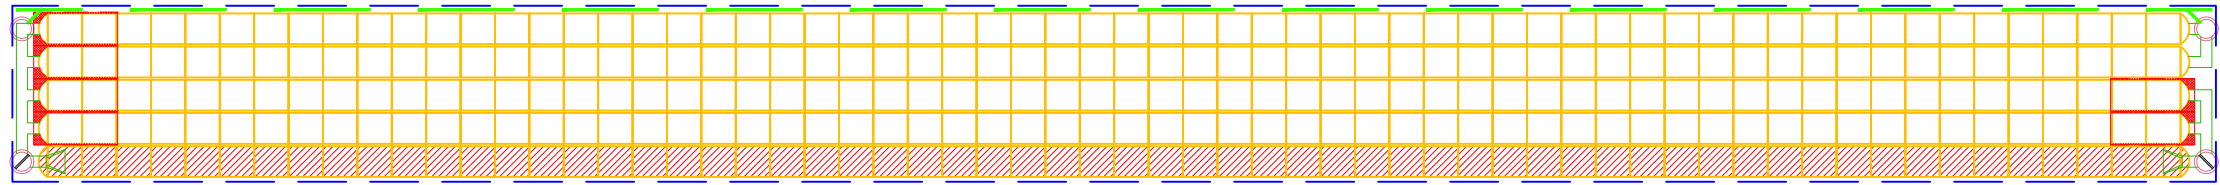

Appendix 7: Hydromodification

Supporting Detail Relating to Hydrologic Conditions of Concern

The project site drains towards the MDP Line A-B via an extension of the existing lateral Lat A-B-10. The Redlands West Industrial project is allocated 20.0 cfs of flow to discharge into Lat A-B-10. Proposed underground storage chambers are required for the site in order to mitigate the 100-year peak flow rates.

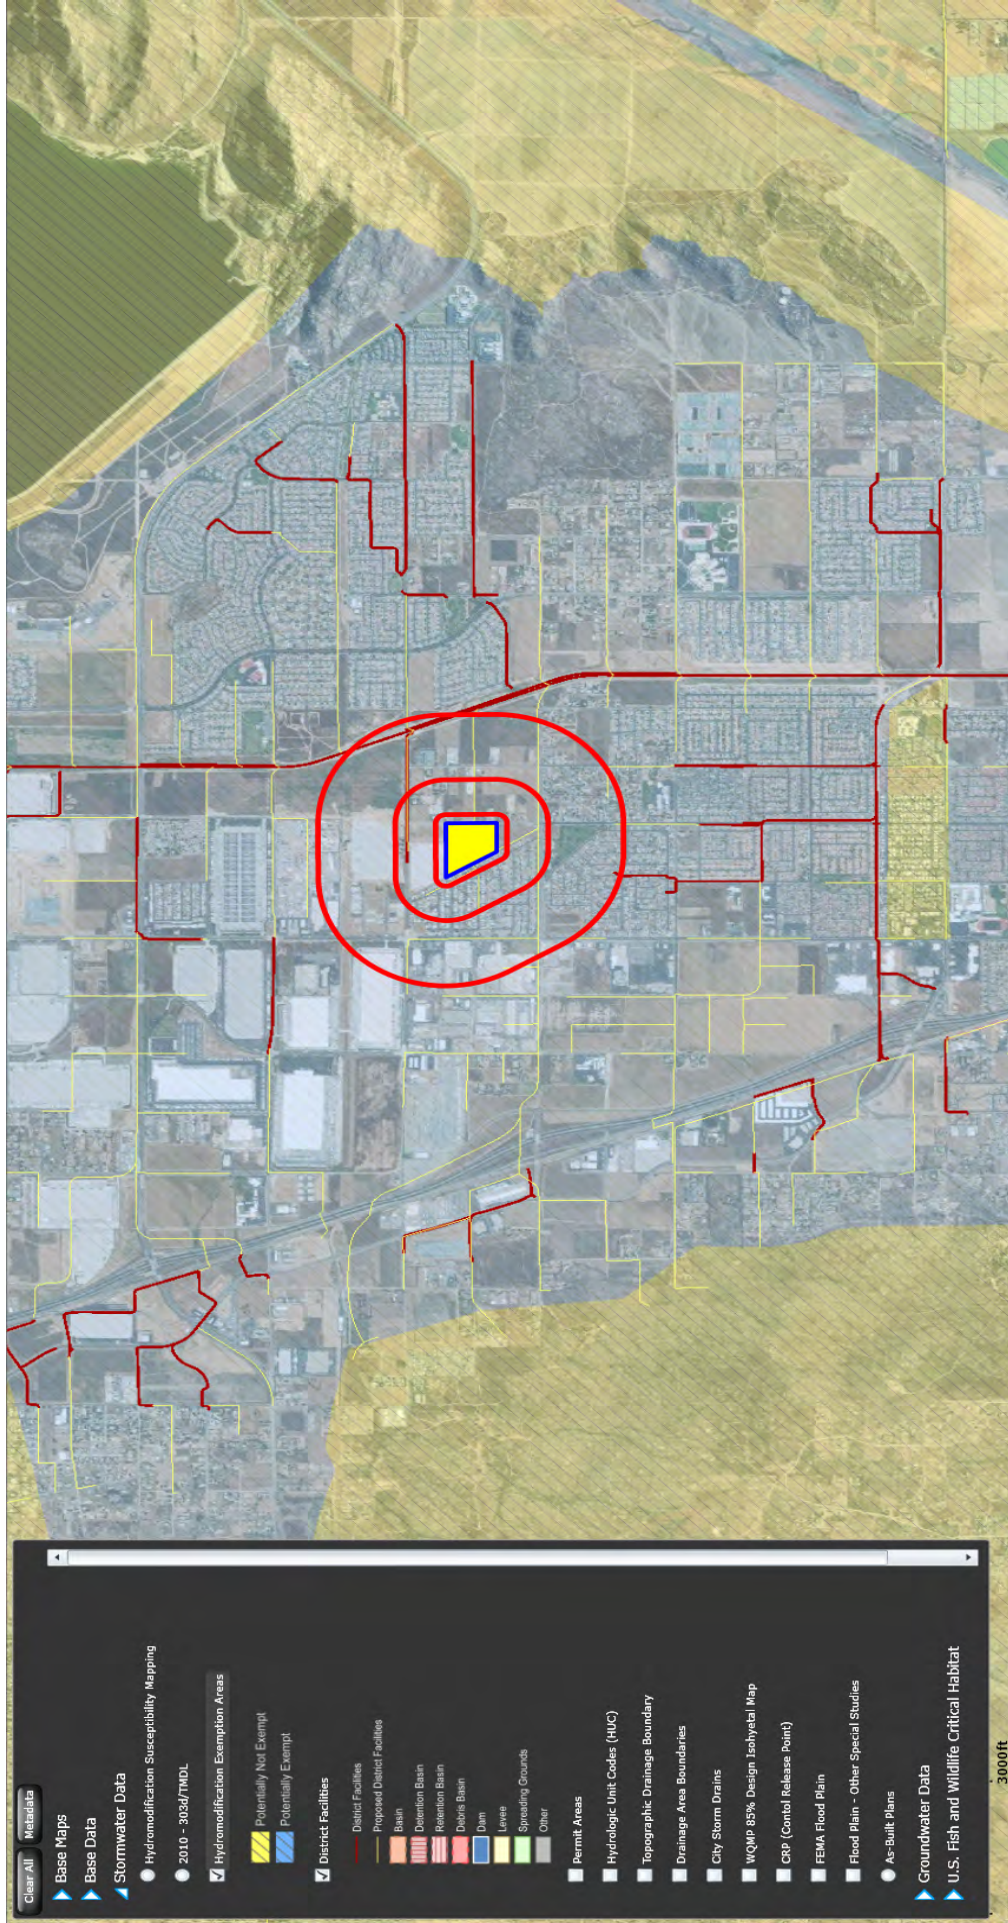

Riverside County
SWCTT

Stormwater Map

DEVELOPED CONDITION										
Cover Type	Condition (Poor,Fair,Good)	Soil Type (A,B,C,D)	COVER TYPE	RI	Land Use	% Impervious	Area (SF)	Area (SF)	Impervious Area (SF)	
Urban	Good	B	RESIDENTIAL OR COMMERCIAL	56	Streets/Conc	0.9	183363	4.21	165027	
Urban	Good	B	RESIDENTIAL OR COMMERCIAL	56	Roof	0.9	195276	4.48	175748	
Urban	Good	B	RESIDENTIAL OR COMMERCIAL	56	Landscape	0	58454	1.34	0	
Urban	Good	C	RESIDENTIAL OR COMMERCIAL	69	Streets/Conc	0.9	254007	5.83	228606	
Urban	Good	C	RESIDENTIAL OR COMMERCIAL	69	Roof	0.9	135061	3.10	121555	
Urban	Good	C	RESIDENTIAL OR COMMERCIAL	69	Landscape	0	51090	1.17	0	
AVERAGE WEIGHTED RI VALUE						TOTAL	877250	20.1		
						TOTAL % IMPERVIOUS		78.8%		
						LOW LOSS RATE		0.270		

DEVELOPED CONDITION								
	EAST			WEST			COMBINED	
RETURN PERIOD (yr)	EVENT (hrs)	VOL (ac-ft)	PEAK (cfs)	EVENT (hrs)	VOL (ac-ft)	PEAK (cfs)	VOL (ac-ft)	PEAK (cfs)
100	1	1.1	36.37	1	1.8	50.07	2.9	86.44
	3	1.6	20.47	3	2.6	31.52	4.2	51.99
	6	2.1	17.76	6	3.3	27.41	5.4	45.17
	24	3.3	5.81	24	5.3	9.47	8.6	15.28

H:\2020\20-0186\Drainage\PHYD\Hydrology\Unit Hydrograph\[20-0186 West StormTech_Cumulative

Storm Event	Developed Condition		Basin Routing Results		
	Volume (Ac-ft)	Peak Flow (cfs)	Peak Flow (cfs)	Max Basin Depth (feet)	Water Surface Elevation (cfs)
EAST 100-Year, 1-Hour	1.1	36.4	5.0	3.98	1434.98
WEST 100-Year, 1-Hour	1.8	50.1	5.0	5.38	1437.88
COMBINED 100-Year, 1-Hour	2.9	86.5	10.0	-	-
EAST 100-Year, 3-Hour	1.6	20.5	5.0	3.59	1434.59
WEST 100-Year, 3-Hour	2.6	31.5	11.0	6.12	1438.62
COMBINED 100-Year, 3-Hour	4.2	52.0	16.0	-	-
EAST 100-Year, 6-Hour	2.1	17.8	5.0	3.05	1434.05
WEST 100-Year, 6-Hour	3.3	27.4	8.6	5.93	1438.43
COMBINED 100-Year, 24-Hour	5.4	45.2	13.6	-	-
EAST 100-Year, 24-Hour	3.3	5.8	5.0	0.55	1431.55
WEST 100-Year, 24-Hour	5.3	9.5	5.0	2.30	1434.80
COMBINED 100-Year, 24-Hour	8.6	15.3	10.0	-	-

H:\2020\20-0186\Drainage\PHYD\Hydrology\Unit Hydrograph\[20-0186 West StormTech_Cumulative_Storages_Spreadsheet_.xls]Cun

Project: Redlands West Industrial



MC-3500
Imperial
310
10
40
1431.75
36
9
16737

[Click Here for Metric](#)

Include Perimeter Stone in Calculations

Chamber Model -
 Units -
 Number of Chambers -
 Number of End Caps -
 Voids in the stone (porosity) -
 Base of STONE Elevation -
 Amount of Stone Above Chambers -
 Amount of Stone Below Chambers -
 Area of system -

sf Min. Area - 16090 sf min. area

Height of System (inches)	Incremental Chamber (cubic feet)	Incremental Single End Cap (cubic feet)	Incremental Chambers (cubic feet)	Incremental End Cap (cubic feet)	Incremental Stone (cubic feet)	Incremental Ch. EC and Stone (cubic feet)	Cumulative System (cubic feet)	Elevation (feet)
90	0.00	0.00	0.00	0.00	557.89	557.89	70750.01	1439.25
89	0.00	0.00	0.00	0.00	557.89	557.89	70192.12	1439.17
88	0.00	0.00	0.00	0.00	557.89	557.89	69634.23	1439.08
87	0.00	0.00	0.00	0.00	557.89	557.89	69076.34	1439.00
86	0.00	0.00	0.00	0.00	557.89	557.89	68518.45	1438.92
85	0.00	0.00	0.00	0.00	557.89	557.89	67960.56	1438.83
84	0.00	0.00	0.00	0.00	557.89	557.89	67402.67	1438.75
83	0.00	0.00	0.00	0.00	557.89	557.89	66844.78	1438.67
82	0.00	0.00	0.00	0.00	557.89	557.89	66286.89	1438.58
81	0.00	0.00	0.00	0.00	557.89	557.89	65729.00	1438.50
80	0.00	0.00	0.00	0.00	557.89	557.89	65171.11	1438.42
79	0.00	0.00	0.00	0.00	557.89	557.89	64613.22	1438.33
78	0.00	0.00	0.00	0.00	557.89	557.89	64055.33	1438.25
77	0.00	0.00	0.00	0.00	557.89	557.89	63497.44	1438.17
76	0.00	0.00	0.00	0.00	557.89	557.89	62939.55	1438.08
75	0.00	0.00	0.00	0.00	557.89	557.89	62381.66	1438.00
74	0.00	0.00	0.00	0.00	557.89	557.89	61823.77	1437.92
73	0.00	0.00	0.00	0.00	557.89	557.89	61265.88	1437.83
72	0.00	0.00	0.00	0.00	557.89	557.89	60707.99	1437.75
71	0.00	0.00	0.00	0.00	557.89	557.89	60150.10	1437.67
70	0.00	0.00	0.00	0.00	557.89	557.89	59592.21	1437.58
69	0.00	0.00	0.00	0.00	557.89	557.89	59034.32	1437.50
68	0.00	0.00	0.00	0.00	557.89	557.89	58476.43	1437.42
67	0.00	0.00	0.00	0.00	557.89	557.89	57918.54	1437.33
66	0.00	0.00	0.00	0.00	557.89	557.89	57360.65	1437.25
65	0.00	0.00	0.00	0.00	557.89	557.89	56802.76	1437.17
64	0.00	0.00	0.00	0.00	557.89	557.89	56244.87	1437.08
63	0.00	0.00	0.00	0.00	557.89	557.89	55686.98	1437.00
62	0.00	0.00	0.00	0.00	557.89	557.89	55129.09	1436.92
61	0.00	0.00	0.00	0.00	557.89	557.89	54571.20	1436.83
60	0.00	0.00	0.00	0.00	557.89	557.89	54013.31	1436.75
59	0.00	0.00	0.00	0.00	557.89	557.89	53455.42	1436.67
58	0.00	0.00	0.00	0.00	557.89	557.89	52897.53	1436.58
57	0.00	0.00	0.00	0.00	557.89	557.89	52339.64	1436.50
56	0.00	0.00	0.00	0.00	557.89	557.89	51781.75	1436.42
55	0.00	0.00	0.00	0.00	557.89	557.89	51223.86	1436.33
54	0.06	0.00	18.01	0.00	568.69	568.69	50665.97	1436.25
53	0.19	0.02	60.17	0.24	533.73	594.14	50097.28	1436.17
52	0.29	0.04	91.13	0.38	521.29	612.79	49503.14	1436.08
51	0.40	0.05	125.13	0.52	507.63	633.28	48890.35	1436.00
50	0.69	0.07	213.03	0.68	472.41	686.11	48257.07	1435.92
49	1.03	0.09	318.77	0.88	430.03	749.68	47570.96	1435.83
48	1.25	0.11	387.35	1.07	402.52	790.94	46821.28	1435.75
47	1.42	0.13	440.89	1.26	381.03	823.18	46030.33	1435.67
46	1.57	0.14	487.67	1.44	362.24	851.36	45207.15	1435.58
45	1.71	0.16	529.22	1.63	345.55	876.40	44355.79	1435.50
44	1.83	0.18	566.83	1.82	330.43	899.08	43479.39	1435.42
43	1.94	0.20	600.71	2.01	316.80	919.52	42580.31	1435.33
42	2.04	0.22	632.66	2.18	303.95	938.79	41660.79	1435.25
41	2.13	0.23	661.75	2.35	292.25	956.35	40722.00	1435.17
40	2.22	0.25	689.51	2.51	281.08	973.10	39765.65	1435.08
39	2.31	0.27	715.11	2.66	270.79	988.55	38792.55	1435.00
38	2.38	0.28	739.28	2.80	261.06	1003.14	37804.00	1434.92
37	2.46	0.29	762.32	2.94	251.79	1017.05	36800.87	1434.83
36	2.53	0.31	783.73	3.08	243.17	1029.98	35783.82	1434.75
35	2.59	0.32	804.06	3.21	234.98	1042.25	34753.84	1434.67
34	2.66	0.33	823.38	3.34	227.20	1053.92	33711.59	1434.58
33	2.72	0.35	841.68	3.47	219.83	1064.98	32657.67	1434.50
32	2.77	0.36	859.10	3.60	212.81	1075.51	31592.69	1434.42
31	2.82	0.37	875.64	3.72	206.14	1085.51	30517.18	1434.33
30	2.88	0.38	891.39	3.84	199.80	1095.03	29431.67	1434.25
29	2.92	0.40	906.48	3.96	193.71	1104.16	28336.64	1434.17
28	2.97	0.41	920.67	4.08	187.99	1112.73	27232.48	1434.08
27	3.01	0.42	933.86	4.19	182.67	1120.72	26119.75	1434.00
26	3.05	0.43	946.51	4.30	177.57	1128.37	24999.03	1433.92
25	3.09	0.44	959.23	4.40	172.44	1136.07	23870.65	1433.83
24	3.13	0.45	970.47	4.51	167.90	1142.88	22734.59	1433.75
23	3.17	0.46	981.36	4.61	163.50	1149.47	21591.71	1433.67
22	3.20	0.47	991.83	4.71	159.28	1155.81	20442.24	1433.58
21	3.23	0.48	1001.65	4.80	155.31	1161.76	19286.43	1433.50
20	3.26	0.49	1011.04	4.89	151.52	1167.45	18124.67	1433.42
19	3.29	0.50	1019.98	4.98	147.91	1172.87	16957.22	1433.33
18	3.32	0.51	1028.57	5.06	144.44	1178.07	15784.36	1433.25
17	3.34	0.51	1036.68	5.14	141.16	1182.98	14606.29	1433.17
16	3.37	0.52	1044.27	5.22	138.09	1187.59	13423.30	1433.08
15	3.39	0.53	1051.68	5.30	135.10	1192.07	12235.72	1433.00
14	3.41	0.54	1058.51	5.37	132.34	1196.21	11043.64	1432.92
13	3.44	0.54	1065.48	5.43	129.53	1200.43	9847.43	1432.83
12	3.46	0.55	1071.89	5.49	126.94	1204.32	8647.00	1432.75
11	3.48	0.56	1078.40	5.55	124.31	1208.26	7442.68	1432.67
10	3.51	0.59	1086.58	5.95	120.88	1213.41	6234.42	1432.58
9	0.00	0.00	0.00	0.00	557.89	557.89	5021.01	1432.50
8	0.00	0.00	0.00	0.00	557.89	557.89	4463.12	1432.42
7	0.00	0.00	0.00	0.00	557.89	557.89	3905.23	1432.33
6	0.00	0.00	0.00	0.00	557.89	557.89	3347.34	1432.25
5	0.00	0.00	0.00	0.00	557.89	557.89	2789.45	1432.17
4	0.00	0.00	0.00	0.00	557.89	557.89	2231.56	1432.08
3	0.00	0.00	0.00	0.00	557.89	557.89	1673.67	1432.00
2	0.00	0.00	0.00	0.00	557.89	557.89	1115.78	1431.92
1	0.00	0.00	0.00	0.00	557.89	557.89	557.89	1431.83

Unit Hydrograph Analysis

Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2008, Version 8.1
Study date 05/12/21 File: PROPWEST1001100.out

+++++

Riverside County Synthetic Unit Hydrology Method
RCFC & WCD Manual date - April 1978

Program License Serial Number 4010

English (in-lb) Input Units Used
English Rainfall Data (Inches) Input Values Used

English Units used in output format

REDLANDS WEST- DEVELOPED CONDITION
100-YEAR STORM EVENT
20-0186 WEST INDUSTRIAL PROJECT
05/12/2020 AYS

Drainage Area = 20.10(Ac.) = 0.031 Sq. Mi.
Drainage Area for Depth-Area Area Adjustment = 20.10(Ac.) = 0.031 Sq. Mi.
Length along longest watercourse = 1915.00(Ft.)
Length along longest watercourse measured to centroid = 500.00(Ft.)
Length along longest watercourse = 0.363 Mi.
Length along longest watercourse measured to centroid = 0.095 Mi.
Difference in elevation = 17.20(Ft.)
Slope along watercourse = 47.4235 Ft./Mi.
Average Manning's 'N' = 0.015
Lag time = 0.048 Hr.
Lag time = 2.88 Min.
25% of lag time = 0.72 Min.
40% of lag time = 1.15 Min.
Unit time = 5.00 Min.
Duration of storm = 1 Hour(s)
User Entered Base Flow = 0.00(CFS)

2 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	0.45	9.05

100 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	1.20	24.12

STORM EVENT (YEAR) = 100.00
Area Averaged 2-Year Rainfall = 0.450(In)
Area Averaged 100-Year Rainfall = 1.200(In)

Point rain (area averaged) = 1.200(In)
Areal adjustment factor = 99.98 %
Adjusted average point rain = 1.200(In)

Sub-Area Data:

Area(Ac.)	Runoff Index	Impervious %
20.100	62.50	0.788

Total Area Entered = 20.10(Ac.)

RI	RI	Infil. Rate	Impervious	Adj. Infil. Rate	Area%	F
AMC2	AMC-2	(In/Hr)	(Dec.%)	(In/Hr)	(Dec.)	(In/Hr)

62.5 62.5 0.443 0.788 0.129 1.000 0.129
 Sum (F) = 0.129

Area averaged mean soil loss (F) (In/Hr) = 0.129
 Minimum soil loss rate ((In/Hr)) = 0.064
 (for 24 hour storm duration)
 Soil low loss rate (decimal) = 0.270

Slope of intensity-duration curve for a 1 hour storm =0.5000

Unit Hydrograph
 VALLEY S-Curve

Unit Hydrograph Data

Unit time period (hrs)	Time % of lag	Distribution Graph %	Unit Hydrograph (CFS)
1	0.083	173.510	38.418
2	0.167	347.020	45.257
3	0.250	520.529	9.969
4	0.333	694.039	4.152
5	0.417	867.549	2.203
		Sum = 100.000	Sum= 20.257

The following loss rate calculations reflect use of the minimum calculated loss rate subtracted from the Storm Rain to produce the maximum Effective Rain value

Unit Time (Hr.)	Pattern Percent	Storm Rain (In/Hr)	Loss rate(In./Hr) Max	Low	Effective (In/Hr)
1	0.08	4.20	0.605	(0.129)	0.476
2	0.17	4.30	0.619	(0.167)	0.490
3	0.25	5.00	0.720	(0.194)	0.591
4	0.33	5.00	0.720	(0.194)	0.591
5	0.42	5.80	0.835	(0.225)	0.706
6	0.50	6.50	0.936	(0.253)	0.807
7	0.58	7.40	1.065	(0.288)	0.937
8	0.67	8.60	1.238	(0.334)	1.109
9	0.75	12.30	1.771	(0.478)	1.642
10	0.83	29.10	4.190	(1.131)	4.061
11	0.92	6.80	0.979	(0.264)	0.850
12	1.00	5.00	0.720	(0.194)	0.591

(Loss Rate Not Used)
 Sum = 100.0 Sum = 12.9

Flood volume = Effective rainfall 1.07(In) times area 20.1(Ac.)/[In]/(Ft.)] = 1.8(Ac.Ft)

Total soil loss = 0.13(In)
 Total soil loss = 0.216(Ac.Ft)
 Total rainfall = 1.20(In)
 Flood volume = 78140.2 Cubic Feet
 Total soil loss = 9399.4 Cubic Feet

Peak flow rate of this hydrograph = 50.071(CFS)

1 - H O U R S T O R M
 R u n o f f H y d r o g r a p h

Hydrograph in 5 Minute intervals ((CFS))

Time(h+m)	Volume Ac.Ft	Q(CFS)	0	15.0	30.0	45.0	60.0
0+ 5	0.0255	3.71	V	Q			
0+10	0.0819	8.18	V	Q			
0+15	0.1512	10.06	V	Q			
0+20	0.2298	11.41	V	Q			
0+25	0.3175	12.74	V	Q			
0+30	0.4186	14.67		Q			
0+35	0.5348	16.88		Q			
0+40	0.6706	19.72		Q	QV		
0+45	0.8486	25.85			QV		
0+50	1.1935	50.07				V	Q

0+55	1.5278	48.54					Q	V	
1+ 0	1.6826	22.48					Q	V	
1+ 5	1.7604	11.29		Q				V	
1+10	1.7860	3.72		Q				V	
1+15	1.7920	0.88	Q					V	
1+20	1.7939	0.26	Q					V	

Unit Hydrograph Analysis

Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2008, Version 8.1
Study date 05/12/21 File: PROPWEST1003100.out

+++++

Riverside County Synthetic Unit Hydrology Method
RCFC & WCD Manual date - April 1978

Program License Serial Number 4010

English (in-lb) Input Units Used
English Rainfall Data (Inches) Input Values Used

English Units used in output format

REDLANDS WEST- DEVELOPED CONDITION
100-YEAR STORM EVENT
20-0186 WEST INDUSTRIAL PROJECT
05/12/2020 AYS

Drainage Area = 20.10(Ac.) = 0.031 Sq. Mi.
Drainage Area for Depth-Area Area Adjustment = 20.10(Ac.) = 0.031 Sq. Mi.
Length along longest watercourse = 1915.00(Ft.)
Length along longest watercourse measured to centroid = 500.00(Ft.)
Length along longest watercourse = 0.363 Mi.
Length along longest watercourse measured to centroid = 0.095 Mi.
Difference in elevation = 17.20(Ft.)
Slope along watercourse = 47.4235 Ft./Mi.
Average Manning's 'N' = 0.015
Lag time = 0.048 Hr.
Lag time = 2.88 Min.
25% of lag time = 0.72 Min.
40% of lag time = 1.15 Min.
Unit time = 5.00 Min.
Duration of storm = 3 Hour(s)
User Entered Base Flow = 0.00(CFS)

2 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	0.80	16.08

100 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	1.90	38.19

STORM EVENT (YEAR) = 100.00
Area Averaged 2-Year Rainfall = 0.800(In)
Area Averaged 100-Year Rainfall = 1.900(In)

Point rain (area averaged) = 1.900(In)
Areal adjustment factor = 99.99 %
Adjusted average point rain = 1.900(In)

Sub-Area Data:

Area(Ac.)	Runoff Index	Impervious %
20.100	62.50	0.788

Total Area Entered = 20.10(Ac.)

RI	RI	Infil. Rate	Impervious	Adj. Infil. Rate	Area%	F
AMC2	AMC-2	(In/Hr)	(Dec.%)	(In/Hr)	(Dec.)	(In/Hr)

62.5 62.5 0.443 0.788 0.129 1.000 0.129
 Sum (F) = 0.129
 Area averaged mean soil loss (F) (In/Hr) = 0.129
 Minimum soil loss rate ((In/Hr)) = 0.064
 (for 24 hour storm duration)
 Soil low loss rate (decimal) = 0.270

Unit Hydrograph
 VALLEY S-Curve

Unit Hydrograph Data

Unit time period (hrs)	Time % of lag	Distribution Graph %	Unit Hydrograph (CFS)
1	0.083	173.510	7.782
2	0.167	347.020	9.168
3	0.250	520.529	2.019
4	0.333	694.039	0.841
5	0.417	867.549	0.446
		Sum = 100.000	Sum= 20.257

The following loss rate calculations reflect use of the minimum calculated loss rate subtracted from the Storm Rain to produce the maximum Effective Rain value

Unit Time (Hr.)	Pattern Percent	Storm Rain (In/Hr)	Loss rate(In./Hr) Max Low	Effective (In/Hr)
1	0.08	1.30	(0.129) 0.080	0.216
2	0.17	1.30	(0.129) 0.080	0.216
3	0.25	1.10	(0.129) 0.068	0.183
4	0.33	1.50	(0.129) 0.092	0.250
5	0.42	1.50	(0.129) 0.092	0.250
6	0.50	1.80	(0.129) 0.111	0.300
7	0.58	1.50	(0.129) 0.092	0.250
8	0.67	1.80	(0.129) 0.111	0.300
9	0.75	1.80	(0.129) 0.111	0.300
10	0.83	1.50	(0.129) 0.092	0.250
11	0.92	1.60	(0.129) 0.098	0.266
12	1.00	1.80	(0.129) 0.111	0.300
13	1.08	2.20	0.129 (0.135)	0.373
14	1.17	2.20	0.129 (0.135)	0.373
15	1.25	2.20	0.129 (0.135)	0.373
16	1.33	2.00	(0.129) 0.123	0.333
17	1.42	2.60	0.129 (0.160)	0.464
18	1.50	2.70	0.129 (0.166)	0.487
19	1.58	2.40	0.129 (0.148)	0.418
20	1.67	2.70	0.129 (0.166)	0.487
21	1.75	3.30	0.129 (0.203)	0.624
22	1.83	3.10	0.129 (0.191)	0.578
23	1.92	2.90	0.129 (0.179)	0.532
24	2.00	3.00	0.129 (0.185)	0.555
25	2.08	3.10	0.129 (0.191)	0.578
26	2.17	4.20	0.129 (0.259)	0.829
27	2.25	5.00	0.129 (0.308)	1.011
28	2.33	3.50	0.129 (0.215)	0.669
29	2.42	6.80	0.129 (0.419)	1.421
30	2.50	7.30	0.129 (0.449)	1.535
31	2.58	8.20	0.129 (0.505)	1.741
32	2.67	5.90	0.129 (0.363)	1.216
33	2.75	2.00	(0.129) 0.123	0.333
34	2.83	1.80	(0.129) 0.111	0.300
35	2.92	1.80	(0.129) 0.111	0.300
36	3.00	0.60	(0.129) 0.037	0.100

(Loss Rate Not Used)
 Sum = 100.0 Sum = 18.7
 Flood volume = Effective rainfall 1.56(In)
 times area 20.1(Ac.)/[(In)/(Ft.)] = 2.6(Ac.Ft)
 Total soil loss = 0.34(In)
 Total soil loss = 0.571(Ac.Ft)
 Total rainfall = 1.90(In)
 Flood volume = 113742.2 Cubic Feet
 Total soil loss = 24875.3 Cubic Feet

 Peak flow rate of this hydrograph = 31.523(CFS)

+++++
 3 - H O U R S T O R M
 R u n o f f H y d r o g r a p h

Hydrograph in 5 Minute intervals ((CFS))

Time(h+m)	Volume Ac.Ft	Q(CFS)	0	10.0	20.0	30.0	40.0
0+ 5	0.0116	1.68	VQ				
0+10	0.0369	3.67	V Q				
0+15	0.0634	3.85	V Q				
0+20	0.0926	4.24	V Q				
0+25	0.1262	4.88	V Q				
0+30	0.1632	5.38	V Q				
0+35	0.2010	5.49	V Q				
0+40	0.2393	5.55	V Q				
0+45	0.2802	5.95	VQ				
0+50	0.3191	5.64	VQ				
0+55	0.3558	5.33	Q				
1+ 0	0.3948	5.67	QV				
1+ 5	0.4398	6.53	Q				
1+10	0.4898	7.26	Q				
1+15	0.5411	7.45	QV				
1+20	0.5907	7.21	Q V				
1+25	0.6451	7.90	Q V				
1+30	0.7085	9.20	QV				
1+35	0.7712	9.11	Q V				
1+40	0.8342	9.15	Q V				
1+45	0.9085	10.78	Q V				
1+50	0.9895	11.77	Q V				
1+55	1.0674	11.30	Q V				
2+ 0	1.1439	11.11	Q V				
2+ 5	1.2227	11.43	Q V				
2+10	1.3162	13.58	Q V				
2+15	1.4357	17.35	Q V				
2+20	1.5520	16.89	Q V				
2+25	1.6911	20.20	Q V				
2+30	1.8810	27.57	Q V				
2+35	2.0981	31.52	Q V				
2+40	2.3049	30.03	Q V				
2+45	2.4371	19.19	Q V				
2+50	2.5059	9.99	Q V				
2+55	2.5580	7.55	Q V				
3+ 0	2.5921	4.95	Q V				
3+ 5	2.6053	1.92	Q V				
3+10	2.6094	0.59	Q V				
3+15	2.6109	0.22	Q V				
3+20	2.6112	0.04	Q V				

Unit Hydrograph Analysis

Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2008, Version 8.1
Study date 05/12/21 File: PROPWEST1006100.out

+++++

Riverside County Synthetic Unit Hydrology Method
RCFC & WCD Manual date - April 1978

Program License Serial Number 4010

English (in-lb) Input Units Used
English Rainfall Data (Inches) Input Values Used

English Units used in output format

REDLANDS WEST- DEVELOPED CONDITION
100-YEAR STORM EVENT
20-0186 WEST INDUSTRIAL PROJECT
05/12/2020 AYS

Drainage Area = 20.10(Ac.) = 0.031 Sq. Mi.
Drainage Area for Depth-Area Area Adjustment = 20.10(Ac.) = 0.031 Sq. Mi.
Length along longest watercourse = 1915.00(Ft.)
Length along longest watercourse measured to centroid = 500.00(Ft.)
Length along longest watercourse = 0.363 Mi.
Length along longest watercourse measured to centroid = 0.095 Mi.
Difference in elevation = 17.20(Ft.)
Slope along watercourse = 47.4235 Ft./Mi.
Average Manning's 'N' = 0.015
Lag time = 0.048 Hr.
Lag time = 2.88 Min.
25% of lag time = 0.72 Min.
40% of lag time = 1.15 Min.
Unit time = 5.00 Min.
Duration of storm = 6 Hour(s)
User Entered Base Flow = 0.00(CFS)

2 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	1.00	20.10

100 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	2.50	50.25

STORM EVENT (YEAR) = 100.00
Area Averaged 2-Year Rainfall = 1.000(In)
Area Averaged 100-Year Rainfall = 2.500(In)

Point rain (area averaged) = 2.500(In)
Areal adjustment factor = 99.99 %
Adjusted average point rain = 2.500(In)

Sub-Area Data:

Area(Ac.)	Runoff Index	Impervious %
20.100	62.50	0.788

Total Area Entered = 20.10(Ac.)

RI	RI	Infil. Rate	Impervious	Adj. Infil. Rate	Area%	F
AMC2	AMC-2	(In/Hr)	(Dec.%)	(In/Hr)	(Dec.)	(In/Hr)

62.5 62.5 0.443 0.788 0.129 1.000 0.129
 Sum (F) = 0.129
 Area averaged mean soil loss (F) (In/Hr) = 0.129
 Minimum soil loss rate ((In/Hr)) = 0.064
 (for 24 hour storm duration)
 Soil low loss rate (decimal) = 0.270

Unit Hydrograph
 VALLEY S-Curve

Unit Hydrograph Data

Unit time period (hrs)	Time % of lag	Distribution Graph %	Unit Hydrograph (CFS)
1	0.083	173.510	38.418
2	0.167	347.020	45.257
3	0.250	520.529	9.969
4	0.333	694.039	4.152
5	0.417	867.549	2.203
		Sum = 100.000	Sum= 20.257

The following loss rate calculations reflect use of the minimum calculated loss rate subtracted from the Storm Rain to produce the maximum Effective Rain value

Unit Time (Hr.)	Pattern Percent	Storm Rain (In/Hr)	Loss rate(In./Hr) Max Low	Effective (In/Hr)
1	0.08	0.150	(0.129)	0.040
2	0.17	0.180	(0.129)	0.049
3	0.25	0.180	(0.129)	0.049
4	0.33	0.180	(0.129)	0.049
5	0.42	0.180	(0.129)	0.049
6	0.50	0.210	(0.129)	0.057
7	0.58	0.210	(0.129)	0.057
8	0.67	0.210	(0.129)	0.057
9	0.75	0.210	(0.129)	0.057
10	0.83	0.210	(0.129)	0.057
11	0.92	0.210	(0.129)	0.057
12	1.00	0.240	(0.129)	0.065
13	1.08	0.240	(0.129)	0.065
14	1.17	0.240	(0.129)	0.065
15	1.25	0.240	(0.129)	0.065
16	1.33	0.240	(0.129)	0.065
17	1.42	0.240	(0.129)	0.065
18	1.50	0.240	(0.129)	0.065
19	1.58	0.240	(0.129)	0.065
20	1.67	0.240	(0.129)	0.065
21	1.75	0.240	(0.129)	0.065
22	1.83	0.240	(0.129)	0.065
23	1.92	0.240	(0.129)	0.065
24	2.00	0.270	(0.129)	0.073
25	2.08	0.240	(0.129)	0.065
26	2.17	0.270	(0.129)	0.073
27	2.25	0.270	(0.129)	0.073
28	2.33	0.270	(0.129)	0.073
29	2.42	0.270	(0.129)	0.073
30	2.50	0.270	(0.129)	0.073
31	2.58	0.270	(0.129)	0.073
32	2.67	0.270	(0.129)	0.073
33	2.75	0.300	(0.129)	0.081
34	2.83	0.300	(0.129)	0.081
35	2.92	0.300	(0.129)	0.081
36	3.00	0.300	(0.129)	0.081
37	3.08	0.300	(0.129)	0.081
38	3.17	0.330	(0.129)	0.089
39	3.25	0.330	(0.129)	0.089
40	3.33	0.330	(0.129)	0.089
41	3.42	0.360	(0.129)	0.097
42	3.50	0.390	(0.129)	0.105
43	3.58	0.420	(0.129)	0.113
44	3.67	0.420	(0.129)	0.113
45	3.75	0.450	(0.129)	0.121

2+20	0.6212	3.98	Q	V				
2+25	0.6487	3.98	Q	Q	V			
2+30	0.6762	3.99	Q	Q	V			
2+35	0.7037	3.99	Q	Q	V			
2+40	0.7312	3.99	Q	Q	V			
2+45	0.7599	4.16	Q	Q	V			
2+50	0.7900	4.37	Q	Q	V			
2+55	0.8203	4.41	Q	Q	V			
3+ 0	0.8508	4.43	Q	Q	V			
3+ 5	0.8814	4.44	Q	Q	V			
3+10	0.9131	4.61	Q	Q	V			
3+15	0.9463	4.81	Q	Q	V			
3+20	0.9797	4.85	Q	Q	V			
3+25	1.0144	5.04	Q	Q	V			
3+30	1.0518	5.42	Q	Q	V			
3+35	1.0920	5.84	Q	Q	V			
3+40	1.1340	6.10	Q	Q	V			
3+45	1.1777	6.35	Q	Q	V			
3+50	1.2230	6.58	Q	Q	V			
3+55	1.2699	6.81	Q	Q	V			
4+ 0	1.3183	7.03	Q	Q	V			
4+ 5	1.3687	7.32	Q	Q	V			
4+10	1.4228	7.85	Q	Q	V			
4+15	1.4808	8.43	Q	Q	V			
4+20	1.5430	9.02	Q	Q	V			
4+25	1.6093	9.63	Q	Q	V			
4+30	1.6782	10.01	Q	Q	V			
4+35	1.7494	10.34	Q	Q	V			
4+40	1.8244	10.89	Q	Q	V			
4+45	1.9034	11.47	Q	Q	V			
4+50	1.9848	11.83	Q	Q	V			
4+55	2.0686	12.16	Q	Q	V			
5+ 0	2.1561	12.71	Q	Q	V			
5+ 5	2.2541	14.23	Q	Q	V			
5+10	2.3702	16.86	Q	Q	V			
5+15	2.5030	19.27	Q	Q	V			
5+20	2.6493	21.24	Q	Q	V			
5+25	2.8119	23.61	Q	Q	V			
5+30	3.0007	27.41	Q	Q	V			
5+35	3.1499	21.67	Q	Q	V			
5+40	3.2208	10.30	Q	Q	V			
5+45	3.2594	5.60	Q	Q	V			
5+50	3.2836	3.52	Q	Q	V			
5+55	3.2984	2.14	Q	Q	V			
6+ 0	3.3078	1.36	Q	Q	V			
6+ 5	3.3125	0.69	Q	Q	V			
6+10	3.3138	0.19	Q	Q	V			
6+15	3.3143	0.07	Q	Q	V			
6+20	3.3144	0.02	Q	Q	V			

Unit Hydrograph Analysis

Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2008, Version 8.1
Study date 05/12/21 File: PROPWEST10024100.out

+++++

Riverside County Synthetic Unit Hydrology Method
RCFC & WCD Manual date - April 1978

Program License Serial Number 4010

English (in-lb) Input Units Used
English Rainfall Data (Inches) Input Values Used

English Units used in output format

REDLANDS WEST- DEVELOPED CONDITION
100-YEAR STORM EVENT
20-0186 WEST INDUSTRIAL PROJECT
05/12/2020 AYS

Drainage Area = 20.10(Ac.) = 0.031 Sq. Mi.
Drainage Area for Depth-Area Area Adjustment = 20.10(Ac.) = 0.031 Sq. Mi.
Length along longest watercourse = 1915.00(Ft.)
Length along longest watercourse measured to centroid = 500.00(Ft.)
Length along longest watercourse = 0.363 Mi.
Length along longest watercourse measured to centroid = 0.095 Mi.
Difference in elevation = 17.20(Ft.)
Slope along watercourse = 47.4235 Ft./Mi.
Average Manning's 'N' = 0.015
Lag time = 0.048 Hr.
Lag time = 2.88 Min.
25% of lag time = 0.72 Min.
40% of lag time = 1.15 Min.
Unit time = 5.00 Min.
Duration of storm = 24 Hour(s)
User Entered Base Flow = 0.00(CFS)

2 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	1.70	34.17

100 YEAR Area rainfall data:

Area(Ac.)[1]	Rainfall(In)[2]	weighting[1*2]
20.10	4.25	85.43

STORM EVENT (YEAR) = 100.00
Area Averaged 2-Year Rainfall = 1.700(In)
Area Averaged 100-Year Rainfall = 4.250(In)

Point rain (area averaged) = 4.250(In)
Areal adjustment factor = 100.00 %
Adjusted average point rain = 4.250(In)

Sub-Area Data:

Area(Ac.)	Runoff Index	Impervious %
20.100	62.50	0.788
Total Area Entered = 20.10(Ac.)		

RI	RI	Infil. Rate	Impervious	Adj. Infil. Rate	Area%	F
AMC2	AMC-2	(In/Hr)	(Dec.%)	(In/Hr)	(Dec.)	(In/Hr)

62.5 62.5 0.443 0.788 0.129 1.000 0.129
 Sum (F) = 0.129
 Area averaged mean soil loss (F) (In/Hr) = 0.129
 Minimum soil loss rate ((In/Hr)) = 0.064
 (for 24 hour storm duration)
 Soil low loss rate (decimal) = 0.270

Unit Hydrograph
 VALLEY S-Curve

Unit Hydrograph Data

Unit time period (hrs)	Time % of lag	Distribution Graph %	Unit Hydrograph (CFS)
1	0.083	173.510	38.418
2	0.167	347.020	45.257
3	0.250	520.529	9.969
4	0.333	694.039	4.152
5	0.417	867.549	2.203
		Sum = 100.000	Sum= 20.257

The following loss rate calculations reflect use of the minimum calculated loss rate subtracted from the Storm Rain to produce the maximum Effective Rain value

Unit Time (Hr.)	Pattern Percent	Storm Rain (In/Hr)	Loss rate(In./Hr) Max Low	Effective (In/Hr)
1	0.08	0.034	(0.228)	0.009 0.025
2	0.17	0.034	(0.227)	0.009 0.025
3	0.25	0.034	(0.227)	0.009 0.025
4	0.33	0.051	(0.226)	0.014 0.037
5	0.42	0.051	(0.225)	0.014 0.037
6	0.50	0.051	(0.224)	0.014 0.037
7	0.58	0.051	(0.223)	0.014 0.037
8	0.67	0.051	(0.222)	0.014 0.037
9	0.75	0.051	(0.221)	0.014 0.037
10	0.83	0.068	(0.220)	0.018 0.050
11	0.92	0.068	(0.220)	0.018 0.050
12	1.00	0.068	(0.219)	0.018 0.050
13	1.08	0.051	(0.218)	0.014 0.037
14	1.17	0.051	(0.217)	0.014 0.037
15	1.25	0.051	(0.216)	0.014 0.037
16	1.33	0.051	(0.215)	0.014 0.037
17	1.42	0.051	(0.214)	0.014 0.037
18	1.50	0.051	(0.214)	0.014 0.037
19	1.58	0.051	(0.213)	0.014 0.037
20	1.67	0.051	(0.212)	0.014 0.037
21	1.75	0.051	(0.211)	0.014 0.037
22	1.83	0.068	(0.210)	0.018 0.050
23	1.92	0.068	(0.209)	0.018 0.050
24	2.00	0.068	(0.208)	0.018 0.050
25	2.08	0.068	(0.208)	0.018 0.050
26	2.17	0.068	(0.207)	0.018 0.050
27	2.25	0.068	(0.206)	0.018 0.050
28	2.33	0.068	(0.205)	0.018 0.050
29	2.42	0.068	(0.204)	0.018 0.050
30	2.50	0.068	(0.203)	0.018 0.050
31	2.58	0.085	(0.203)	0.023 0.062
32	2.67	0.085	(0.202)	0.023 0.062
33	2.75	0.085	(0.201)	0.023 0.062
34	2.83	0.085	(0.200)	0.023 0.062
35	2.92	0.085	(0.199)	0.023 0.062
36	3.00	0.085	(0.198)	0.023 0.062
37	3.08	0.085	(0.198)	0.023 0.062
38	3.17	0.085	(0.197)	0.023 0.062
39	3.25	0.085	(0.196)	0.023 0.062
40	3.33	0.085	(0.195)	0.023 0.062
41	3.42	0.085	(0.194)	0.023 0.062
42	3.50	0.085	(0.194)	0.023 0.062
43	3.58	0.085	(0.193)	0.023 0.062
44	3.67	0.085	(0.192)	0.023 0.062
45	3.75	0.085	(0.191)	0.023 0.062


46	3.83	0.20	0.102	(0.190)	0.028	0.074
47	3.92	0.20	0.102	(0.190)	0.028	0.074
48	4.00	0.20	0.102	(0.189)	0.028	0.074
49	4.08	0.20	0.102	(0.188)	0.028	0.074
50	4.17	0.20	0.102	(0.187)	0.028	0.074
51	4.25	0.20	0.102	(0.186)	0.028	0.074
52	4.33	0.23	0.119	(0.186)	0.032	0.087
53	4.42	0.23	0.119	(0.185)	0.032	0.087
54	4.50	0.23	0.119	(0.184)	0.032	0.087
55	4.58	0.23	0.119	(0.183)	0.032	0.087
56	4.67	0.23	0.119	(0.182)	0.032	0.087
57	4.75	0.23	0.119	(0.182)	0.032	0.087
58	4.83	0.27	0.136	(0.181)	0.037	0.099
59	4.92	0.27	0.136	(0.180)	0.037	0.099
60	5.00	0.27	0.136	(0.179)	0.037	0.099
61	5.08	0.20	0.102	(0.178)	0.028	0.074
62	5.17	0.20	0.102	(0.178)	0.028	0.074
63	5.25	0.20	0.102	(0.177)	0.028	0.074
64	5.33	0.23	0.119	(0.176)	0.032	0.087
65	5.42	0.23	0.119	(0.175)	0.032	0.087
66	5.50	0.23	0.119	(0.175)	0.032	0.087
67	5.58	0.27	0.136	(0.174)	0.037	0.099
68	5.67	0.27	0.136	(0.173)	0.037	0.099
69	5.75	0.27	0.136	(0.172)	0.037	0.099
70	5.83	0.27	0.136	(0.172)	0.037	0.099
71	5.92	0.27	0.136	(0.171)	0.037	0.099
72	6.00	0.27	0.136	(0.170)	0.037	0.099
73	6.08	0.30	0.153	(0.169)	0.041	0.112
74	6.17	0.30	0.153	(0.169)	0.041	0.112
75	6.25	0.30	0.153	(0.168)	0.041	0.112
76	6.33	0.30	0.153	(0.167)	0.041	0.112
77	6.42	0.30	0.153	(0.166)	0.041	0.112
78	6.50	0.30	0.153	(0.166)	0.041	0.112
79	6.58	0.33	0.170	(0.165)	0.046	0.124
80	6.67	0.33	0.170	(0.164)	0.046	0.124
81	6.75	0.33	0.170	(0.163)	0.046	0.124
82	6.83	0.33	0.170	(0.163)	0.046	0.124
83	6.92	0.33	0.170	(0.162)	0.046	0.124
84	7.00	0.33	0.170	(0.161)	0.046	0.124
85	7.08	0.33	0.170	(0.160)	0.046	0.124
86	7.17	0.33	0.170	(0.160)	0.046	0.124
87	7.25	0.33	0.170	(0.159)	0.046	0.124
88	7.33	0.37	0.187	(0.158)	0.050	0.137
89	7.42	0.37	0.187	(0.157)	0.050	0.137
90	7.50	0.37	0.187	(0.157)	0.050	0.137
91	7.58	0.40	0.204	(0.156)	0.055	0.149
92	7.67	0.40	0.204	(0.155)	0.055	0.149
93	7.75	0.40	0.204	(0.155)	0.055	0.149
94	7.83	0.43	0.221	(0.154)	0.060	0.161
95	7.92	0.43	0.221	(0.153)	0.060	0.161
96	8.00	0.43	0.221	(0.152)	0.060	0.161
97	8.08	0.50	0.255	(0.152)	0.069	0.186
98	8.17	0.50	0.255	(0.151)	0.069	0.186
99	8.25	0.50	0.255	(0.150)	0.069	0.186
100	8.33	0.50	0.255	(0.150)	0.069	0.186
101	8.42	0.50	0.255	(0.149)	0.069	0.186
102	8.50	0.50	0.255	(0.148)	0.069	0.186
103	8.58	0.53	0.272	(0.148)	0.073	0.199
104	8.67	0.53	0.272	(0.147)	0.073	0.199
105	8.75	0.53	0.272	(0.146)	0.073	0.199
106	8.83	0.57	0.289	(0.145)	0.078	0.211
107	8.92	0.57	0.289	(0.145)	0.078	0.211
108	9.00	0.57	0.289	(0.144)	0.078	0.211
109	9.08	0.63	0.323	(0.143)	0.087	0.236
110	9.17	0.63	0.323	(0.143)	0.087	0.236
111	9.25	0.63	0.323	(0.142)	0.087	0.236
112	9.33	0.67	0.340	(0.141)	0.092	0.248
113	9.42	0.67	0.340	(0.141)	0.092	0.248
114	9.50	0.67	0.340	(0.140)	0.092	0.248
115	9.58	0.70	0.357	(0.139)	0.096	0.261
116	9.67	0.70	0.357	(0.139)	0.096	0.261
117	9.75	0.70	0.357	(0.138)	0.096	0.261
118	9.83	0.73	0.374	(0.137)	0.101	0.273
119	9.92	0.73	0.374	(0.137)	0.101	0.273
120	10.00	0.73	0.374	(0.136)	0.101	0.273

121	10.08	0.50	0.255	(0.135)	0.069	0.186
122	10.17	0.50	0.255	(0.135)	0.069	0.186
123	10.25	0.50	0.255	(0.134)	0.069	0.186
124	10.33	0.50	0.255	(0.133)	0.069	0.186
125	10.42	0.50	0.255	(0.133)	0.069	0.186
126	10.50	0.50	0.255	(0.132)	0.069	0.186
127	10.58	0.67	0.340	(0.131)	0.092	0.248
128	10.67	0.67	0.340	(0.131)	0.092	0.248
129	10.75	0.67	0.340	(0.130)	0.092	0.248
130	10.83	0.67	0.340	(0.130)	0.092	0.248
131	10.92	0.67	0.340	(0.129)	0.092	0.248
132	11.00	0.67	0.340	(0.128)	0.092	0.248
133	11.08	0.63	0.323	(0.128)	0.087	0.236
134	11.17	0.63	0.323	(0.127)	0.087	0.236
135	11.25	0.63	0.323	(0.126)	0.087	0.236
136	11.33	0.63	0.323	(0.126)	0.087	0.236
137	11.42	0.63	0.323	(0.125)	0.087	0.236
138	11.50	0.63	0.323	(0.125)	0.087	0.236
139	11.58	0.57	0.289	(0.124)	0.078	0.211
140	11.67	0.57	0.289	(0.123)	0.078	0.211
141	11.75	0.57	0.289	(0.123)	0.078	0.211
142	11.83	0.60	0.306	(0.122)	0.083	0.223
143	11.92	0.60	0.306	(0.121)	0.083	0.223
144	12.00	0.60	0.306	(0.121)	0.083	0.223
145	12.08	0.83	0.425	(0.120)	0.115	0.310
146	12.17	0.83	0.425	(0.120)	0.115	0.310
147	12.25	0.83	0.425	(0.119)	0.115	0.310
148	12.33	0.87	0.442	0.118	(0.119)	0.324
149	12.42	0.87	0.442	0.118	(0.119)	0.324
150	12.50	0.87	0.442	0.117	(0.119)	0.325
151	12.58	0.93	0.476	0.117	(0.129)	0.359
152	12.67	0.93	0.476	0.116	(0.129)	0.360
153	12.75	0.93	0.476	0.116	(0.129)	0.360
154	12.83	0.97	0.493	0.115	(0.133)	0.378
155	12.92	0.97	0.493	0.114	(0.133)	0.379
156	13.00	0.97	0.493	0.114	(0.133)	0.379
157	13.08	1.13	0.578	0.113	(0.156)	0.465
158	13.17	1.13	0.578	0.113	(0.156)	0.465
159	13.25	1.13	0.578	0.112	(0.156)	0.466
160	13.33	1.13	0.578	0.111	(0.156)	0.467
161	13.42	1.13	0.578	0.111	(0.156)	0.467
162	13.50	1.13	0.578	0.110	(0.156)	0.468
163	13.58	0.77	0.391	(0.110)	0.106	0.285
164	13.67	0.77	0.391	(0.109)	0.106	0.285
165	13.75	0.77	0.391	(0.109)	0.106	0.285
166	13.83	0.77	0.391	(0.108)	0.106	0.285
167	13.92	0.77	0.391	(0.108)	0.106	0.285
168	14.00	0.77	0.391	(0.107)	0.106	0.285
169	14.08	0.90	0.459	0.106	(0.124)	0.353
170	14.17	0.90	0.459	0.106	(0.124)	0.353
171	14.25	0.90	0.459	0.105	(0.124)	0.354
172	14.33	0.87	0.442	0.105	(0.119)	0.337
173	14.42	0.87	0.442	0.104	(0.119)	0.338
174	14.50	0.87	0.442	0.104	(0.119)	0.338
175	14.58	0.87	0.442	0.103	(0.119)	0.339
176	14.67	0.87	0.442	0.103	(0.119)	0.339
177	14.75	0.87	0.442	0.102	(0.119)	0.340
178	14.83	0.83	0.425	0.102	(0.115)	0.323
179	14.92	0.83	0.425	0.101	(0.115)	0.324
180	15.00	0.83	0.425	0.101	(0.115)	0.324
181	15.08	0.80	0.408	0.100	(0.110)	0.308
182	15.17	0.80	0.408	0.100	(0.110)	0.308
183	15.25	0.80	0.408	0.099	(0.110)	0.309
184	15.33	0.77	0.391	0.099	(0.106)	0.292
185	15.42	0.77	0.391	0.098	(0.106)	0.293
186	15.50	0.77	0.391	0.098	(0.106)	0.293
187	15.58	0.63	0.323	(0.097)	0.087	0.236
188	15.67	0.63	0.323	(0.097)	0.087	0.236
189	15.75	0.63	0.323	(0.096)	0.087	0.236
190	15.83	0.63	0.323	(0.096)	0.087	0.236
191	15.92	0.63	0.323	(0.095)	0.087	0.236
192	16.00	0.63	0.323	(0.095)	0.087	0.236
193	16.08	0.13	0.068	(0.094)	0.018	0.050
194	16.17	0.13	0.068	(0.094)	0.018	0.050
195	16.25	0.13	0.068	(0.093)	0.018	0.050

196	16.33	0.13	0.068	(0.093)	0.018	0.050
197	16.42	0.13	0.068	(0.092)	0.018	0.050
198	16.50	0.13	0.068	(0.092)	0.018	0.050
199	16.58	0.10	0.051	(0.091)	0.014	0.037
200	16.67	0.10	0.051	(0.091)	0.014	0.037
201	16.75	0.10	0.051	(0.090)	0.014	0.037
202	16.83	0.10	0.051	(0.090)	0.014	0.037
203	16.92	0.10	0.051	(0.089)	0.014	0.037
204	17.00	0.10	0.051	(0.089)	0.014	0.037
205	17.08	0.17	0.085	(0.089)	0.023	0.062
206	17.17	0.17	0.085	(0.088)	0.023	0.062
207	17.25	0.17	0.085	(0.088)	0.023	0.062
208	17.33	0.17	0.085	(0.087)	0.023	0.062
209	17.42	0.17	0.085	(0.087)	0.023	0.062
210	17.50	0.17	0.085	(0.086)	0.023	0.062
211	17.58	0.17	0.085	(0.086)	0.023	0.062
212	17.67	0.17	0.085	(0.085)	0.023	0.062
213	17.75	0.17	0.085	(0.085)	0.023	0.062
214	17.83	0.13	0.068	(0.085)	0.018	0.050
215	17.92	0.13	0.068	(0.084)	0.018	0.050
216	18.00	0.13	0.068	(0.084)	0.018	0.050
217	18.08	0.13	0.068	(0.083)	0.018	0.050
218	18.17	0.13	0.068	(0.083)	0.018	0.050
219	18.25	0.13	0.068	(0.083)	0.018	0.050
220	18.33	0.13	0.068	(0.082)	0.018	0.050
221	18.42	0.13	0.068	(0.082)	0.018	0.050
222	18.50	0.13	0.068	(0.081)	0.018	0.050
223	18.58	0.10	0.051	(0.081)	0.014	0.037
224	18.67	0.10	0.051	(0.081)	0.014	0.037
225	18.75	0.10	0.051	(0.080)	0.014	0.037
226	18.83	0.07	0.034	(0.080)	0.009	0.025
227	18.92	0.07	0.034	(0.079)	0.009	0.025
228	19.00	0.07	0.034	(0.079)	0.009	0.025
229	19.08	0.10	0.051	(0.079)	0.014	0.037
230	19.17	0.10	0.051	(0.078)	0.014	0.037
231	19.25	0.10	0.051	(0.078)	0.014	0.037
232	19.33	0.13	0.068	(0.078)	0.018	0.050
233	19.42	0.13	0.068	(0.077)	0.018	0.050
234	19.50	0.13	0.068	(0.077)	0.018	0.050
235	19.58	0.10	0.051	(0.077)	0.014	0.037
236	19.67	0.10	0.051	(0.076)	0.014	0.037
237	19.75	0.10	0.051	(0.076)	0.014	0.037
238	19.83	0.07	0.034	(0.075)	0.009	0.025
239	19.92	0.07	0.034	(0.075)	0.009	0.025
240	20.00	0.07	0.034	(0.075)	0.009	0.025
241	20.08	0.10	0.051	(0.074)	0.014	0.037
242	20.17	0.10	0.051	(0.074)	0.014	0.037
243	20.25	0.10	0.051	(0.074)	0.014	0.037
244	20.33	0.10	0.051	(0.074)	0.014	0.037
245	20.42	0.10	0.051	(0.073)	0.014	0.037
246	20.50	0.10	0.051	(0.073)	0.014	0.037
247	20.58	0.10	0.051	(0.073)	0.014	0.037
248	20.67	0.10	0.051	(0.072)	0.014	0.037
249	20.75	0.10	0.051	(0.072)	0.014	0.037
250	20.83	0.07	0.034	(0.072)	0.009	0.025
251	20.92	0.07	0.034	(0.071)	0.009	0.025
252	21.00	0.07	0.034	(0.071)	0.009	0.025
253	21.08	0.10	0.051	(0.071)	0.014	0.037
254	21.17	0.10	0.051	(0.071)	0.014	0.037
255	21.25	0.10	0.051	(0.070)	0.014	0.037
256	21.33	0.07	0.034	(0.070)	0.009	0.025
257	21.42	0.07	0.034	(0.070)	0.009	0.025
258	21.50	0.07	0.034	(0.069)	0.009	0.025
259	21.58	0.10	0.051	(0.069)	0.014	0.037
260	21.67	0.10	0.051	(0.069)	0.014	0.037
261	21.75	0.10	0.051	(0.069)	0.014	0.037
262	21.83	0.07	0.034	(0.068)	0.009	0.025
263	21.92	0.07	0.034	(0.068)	0.009	0.025
264	22.00	0.07	0.034	(0.068)	0.009	0.025
265	22.08	0.10	0.051	(0.068)	0.014	0.037
266	22.17	0.10	0.051	(0.068)	0.014	0.037
267	22.25	0.10	0.051	(0.067)	0.014	0.037
268	22.33	0.07	0.034	(0.067)	0.009	0.025
269	22.42	0.07	0.034	(0.067)	0.009	0.025
270	22.50	0.07	0.034	(0.067)	0.009	0.025

3+ 5	0.2246	1.26	V	Q				
3+10	0.2333	1.26	V	Q				
3+15	0.2419	1.26	V	Q				
3+20	0.2506	1.26	V	Q				
3+25	0.2593	1.26	V	Q				
3+30	0.2679	1.26	V	Q				
3+35	0.2766	1.26	V	Q				
3+40	0.2852	1.26	V	Q				
3+45	0.2939	1.26	V	Q				
3+50	0.3032	1.35	V	Q				
3+55	0.3133	1.47	V	Q				
4+ 0	0.3236	1.49	V	Q				
4+ 5	0.3340	1.50	V	Q				
4+10	0.3444	1.51	V	Q				
4+15	0.3548	1.51	V	Q				
4+20	0.3658	1.61	V	Q				
4+25	0.3777	1.72	V	Q				
4+30	0.3897	1.74	V	Q				
4+35	0.4018	1.76	V	Q				
4+40	0.4139	1.76	V	Q				
4+45	0.4260	1.76	V	Q				
4+50	0.4388	1.86	V	Q				
4+55	0.4524	1.97	V	Q				
5+ 0	0.4661	2.00	V	Q				
5+ 5	0.4786	1.81	V	Q				
5+10	0.4896	1.59	V	Q				
5+15	0.5002	1.54	V	Q				
5+20	0.5113	1.62	V	Q				
5+25	0.5232	1.72	V	Q				
5+30	0.5352	1.74	V	Q				
5+35	0.5479	1.85	V	Q				
5+40	0.5615	1.97	V	Q				
5+45	0.5753	2.00	V	Q				
5+50	0.5891	2.01	V	Q				
5+55	0.6029	2.01	V	Q				
6+ 0	0.6168	2.01	V	Q				
6+ 5	0.6313	2.11	V	Q				
6+10	0.6466	2.22	V	Q				
6+15	0.6621	2.25	V	Q				
6+20	0.6777	2.26	V	Q				
6+25	0.6932	2.26	V	Q				
6+30	0.7088	2.26	V	Q				
6+35	0.7251	2.36	V	Q				
6+40	0.7421	2.47	V	Q				
6+45	0.7593	2.50	V	Q				
6+50	0.7766	2.51	V	Q				
6+55	0.7939	2.52	V	Q				
7+ 0	0.8113	2.52	V	Q				
7+ 5	0.8286	2.52	V	Q				
7+10	0.8459	2.52	V	Q				
7+15	0.8632	2.52	V	Q				
7+20	0.8812	2.61	V	Q				
7+25	0.9000	2.73	V	Q				
7+30	0.9189	2.75	V	Q				
7+35	0.9386	2.86	V	Q				
7+40	0.9591	2.98	V	Q				
7+45	0.9798	3.00	V	Q				
7+50	1.0012	3.11	V	Q				
7+55	1.0234	3.23	V	Q				
8+ 0	1.0458	3.25	V	Q				
8+ 5	1.0697	3.46	V	Q				
8+10	1.0951	3.69	V	Q				
8+15	1.1208	3.74	V	Q				
8+20	1.1467	3.76	V	Q				
8+25	1.1727	3.77	V	Q				
8+30	1.1987	3.77	V	Q				
8+35	1.2254	3.87	V	Q				
8+40	1.2528	3.98	V	Q				
8+45	1.2804	4.01	V	Q				
8+50	1.3087	4.12	V	Q				
8+55	1.3379	4.23	V	Q				
9+ 0	1.3672	4.26	V	Q				
9+ 5	1.3980	4.46	V	Q				
9+10	1.4303	4.70	V	Q				
9+15	1.4630	4.75	V	Q				

9+20	1.4965	4.86
9+25	1.5309	4.99
9+30	1.5654	5.01
9+35	1.6007	5.12
9+40	1.6368	5.24
9+45	1.6730	5.27
9+50	1.7100	5.37
9+55	1.7479	5.49
10+ 0	1.7859	5.52
10+ 5	1.8193	4.85
10+10	1.8472	4.06
10+15	1.8740	3.88
10+20	1.9002	3.81
10+25	1.9262	3.77
10+30	1.9522	3.77
10+35	1.9815	4.26
10+40	2.0147	4.82
10+45	2.0488	4.95
10+50	2.0833	5.00
10+55	2.1179	5.03
11+ 0	2.1526	5.03
11+ 5	2.1865	4.93
11+10	2.2197	4.82
11+15	2.2528	4.79
11+20	2.2857	4.78
11+25	2.3186	4.78
11+30	2.3515	4.78
11+35	2.3831	4.59
11+40	2.4131	4.36
11+45	2.4428	4.31
11+50	2.4730	4.38
11+55	2.5039	4.49
12+ 0	2.5349	4.51
12+ 5	2.5707	5.20
12+10	2.6121	6.00
12+15	2.6546	6.18
12+20	2.6984	6.35
12+25	2.7432	6.52
12+30	2.7884	6.55
12+35	2.8355	6.84
12+40	2.8849	7.17
12+45	2.9348	7.25
12+50	2.9860	7.42
12+55	3.0384	7.61
13+ 0	3.0911	7.65
13+ 5	3.1485	8.34
13+10	3.2115	9.14
13+15	3.2757	9.32
13+20	3.3405	9.41
13+25	3.4056	9.46
13+30	3.4708	9.47
13+35	3.5263	8.06
13+40	3.5703	6.39
13+45	3.6117	6.02
13+50	3.6521	5.87
13+55	3.6920	5.78
14+ 0	3.7318	5.78
14+ 5	3.7753	6.31
14+10	3.8230	6.93
14+15	3.8717	7.07
14+20	3.9199	7.01
14+25	3.9674	6.89
14+30	4.0147	6.87
14+35	4.0619	6.86
14+40	4.1092	6.87
14+45	4.1566	6.88
14+50	4.2031	6.76
14+55	4.2487	6.61
15+ 0	4.2940	6.59
15+ 5	4.3384	6.45
15+10	4.3818	6.30
15+15	4.4250	6.27
15+20	4.4673	6.14
15+25	4.5085	5.98
15+30	4.5496	5.96

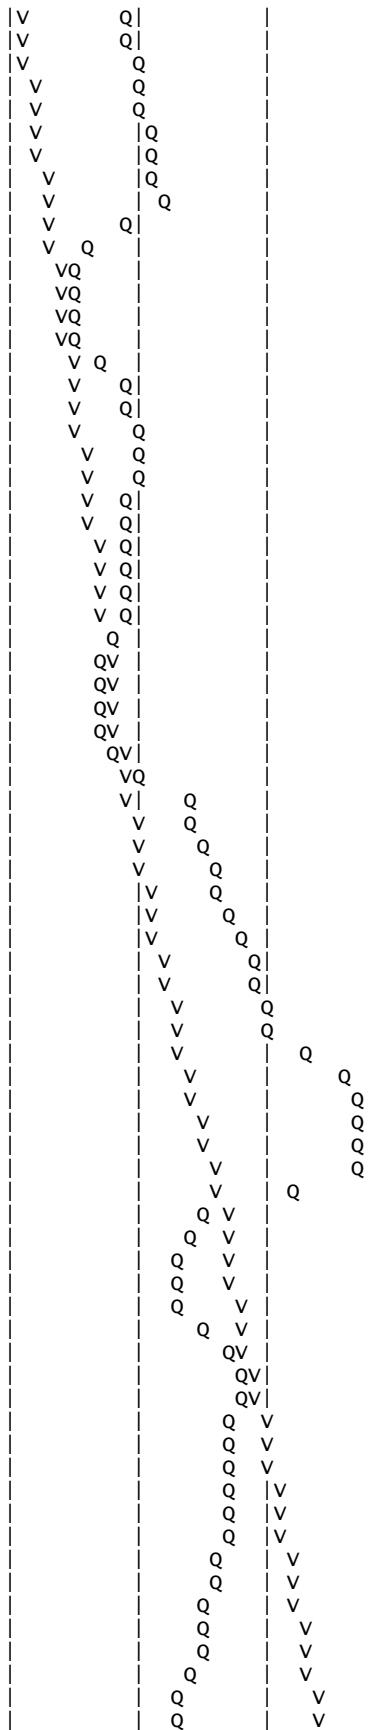

21+50	5.1826	0.65		Q				V	
21+55	5.1864	0.54		Q				V	
22+ 0	5.1899	0.52		Q				V	
22+ 5	5.1941	0.61		Q				V	
22+10	5.1990	0.71		Q				V	
22+15	5.2041	0.74		Q				V	
22+20	5.2086	0.65		Q				V	
22+25	5.2124	0.54		Q				V	
22+30	5.2159	0.52		Q				V	
22+35	5.2194	0.51		Q				V	
22+40	5.2229	0.50		Q				V	
22+45	5.2264	0.50		Q				V	
22+50	5.2298	0.50		Q				V	
22+55	5.2333	0.50		Q				V	
23+ 0	5.2368	0.50		Q				V	
23+ 5	5.2402	0.50		Q				V	
23+10	5.2437	0.50		Q				V	
23+15	5.2471	0.50		Q				V	
23+20	5.2506	0.50		Q				V	
23+25	5.2541	0.50		Q				V	
23+30	5.2575	0.50		Q				V	
23+35	5.2610	0.50		Q				V	
23+40	5.2645	0.50		Q				V	
23+45	5.2679	0.50		Q				V	
23+50	5.2714	0.50		Q				V	
23+55	5.2749	0.50		Q				V	
24+ 0	5.2783	0.50		Q				V	
24+ 5	5.2805	0.31		Q				V	
24+10	5.2810	0.08	Q					V	
24+15	5.2812	0.03	Q					V	
24+20	5.2813	0.01	Q					V	

FLOOD HYDROGRAPH ROUTING PROGRAM
 Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2005
 Study date: 05/12/21

PROPOSED 100-YR, 1-HOUR STORM EVENT
 REDLANDS WEST - ROUTING
 20-0186 UG CHAMBER STORAGE PUMP
 05/12/2021 AYS 5.0 CFS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROPWEST1001100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 16
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 50.071 (CFS)
 Total volume = 1.794 (Ac.Ft)
 Status of hydrographs being held in storage

	Stream 1	Stream 2	Stream 3	Stream 4	Stream 5
Peak (CFS)	0.000	0.000	0.000	0.000	0.000
Vol (Ac.Ft)	0.000	0.000	0.000	0.000	0.000

+++++
 Process from Point/Station 200.000 to Point/Station 201.000
 **** RETARDING BASIN ROUTING ****

User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 16
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-O*dt/2) (Ac.Ft)	(S+O*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.281	5.000	0.264	0.298
1.000	0.443	5.000	0.426	0.460
1.500	0.600	5.000	0.583	0.617
2.000	0.750	5.000	0.733	0.767
2.500	0.891	5.000	0.874	0.908
3.000	1.018	5.000	1.001	1.035
3.500	1.122	5.000	1.105	1.139
4.000	1.202	5.000	1.185	1.219
4.500	1.278	5.000	1.261	1.295
5.000	1.355	5.000	1.338	1.372
5.500	1.432	5.000	1.415	1.449
6.000	1.509	9.240	1.477	1.541
6.500	1.586	17.000	1.527	1.645

Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)	.0	12.5	25.04	37.55	50.07	Depth (Ft.)
0.083	3.71	0.21	0.012	O I					0.02
0.167	8.18	0.88	0.049	O	I				0.09
0.250	10.06	1.83	0.103	O	I				0.18
0.333	11.41	2.86	0.161	O	I				0.29
0.417	12.74	3.92	0.220	O	I				0.39
0.500	14.67	5.00	0.284	O	I				0.51
0.583	16.88	5.00	0.358	O	I				0.74
0.667	19.72	5.00	0.450	O	I				1.02
0.750	25.85	5.00	0.572	O		I			1.41
0.833	50.07	5.00	0.799	O				I	2.17
0.917	48.54	5.00	1.104	O				I	3.42
1.000	22.48	5.00	1.315	O		I			4.74
1.083	11.29	5.00	1.396	O	I				5.27
1.167	3.72	5.00	1.414	O	IO				5.38
1.250	0.88	5.00	1.395	I O					5.26
1.333	0.26	5.00	1.365	I O					5.06
1.417	0.00	5.00	1.331	I O					4.84
1.500	0.00	5.00	1.297	I O					4.62
1.583	0.00	5.00	1.262	I O					4.40
1.667	0.00	5.00	1.228	I O					4.17
1.750	0.00	5.00	1.193	I O					3.95
1.833	0.00	5.00	1.159	I O					3.73
1.917	0.00	5.00	1.124	I O					3.52
2.000	0.00	5.00	1.090	I O					3.35
2.083	0.00	5.00	1.056	I O					3.18
2.167	0.00	5.00	1.021	I O					3.02
2.250	0.00	5.00	0.987	I O					2.88
2.333	0.00	5.00	0.952	I O					2.74
2.417	0.00	5.00	0.918	I O					2.61
2.500	0.00	5.00	0.883	I O					2.47
2.583	0.00	5.00	0.849	I O					2.35
2.667	0.00	5.00	0.815	I O					2.23
2.750	0.00	5.00	0.780	I O					2.11
2.833	0.00	5.00	0.746	I O					1.99
2.917	0.00	5.00	0.711	I O					1.87
3.000	0.00	5.00	0.677	I O					1.76
3.083	0.00	5.00	0.642	I O					1.64
3.167	0.00	5.00	0.608	I O					1.53
3.250	0.00	5.00	0.574	I O					1.42
3.333	0.00	5.00	0.539	I O					1.31
3.417	0.00	5.00	0.505	I O					1.20
3.500	0.00	5.00	0.470	I O					1.09
3.583	0.00	5.00	0.436	I O					0.98
3.667	0.00	5.00	0.401	I O					0.87
3.750	0.00	5.00	0.367	I O					0.77
3.833	0.00	5.00	0.332	I O					0.66
3.917	0.00	5.00	0.298	I O					0.55
4.000	0.00	4.71	0.265	I O					0.47
4.083	0.00	4.16	0.234	I O					0.42
4.167	0.00	3.68	0.207	I O					0.37
4.250	0.00	3.26	0.183	I O					0.33
4.333	0.00	2.88	0.162	IO					0.29
4.417	0.00	2.55	0.143	IO					0.25
4.500	0.00	2.25	0.127	IO					0.23
4.583	0.00	1.99	0.112	IO					0.20
4.667	0.00	1.76	0.099	IO					0.18
4.750	0.00	1.56	0.088	O					0.16
4.833	0.00	1.38	0.078	O					0.14
4.917	0.00	1.22	0.069	O					0.12
5.000	0.00	1.08	0.061	O					0.11
5.083	0.00	0.96	0.054	O					0.10
5.167	0.00	0.84	0.047	O					0.08
5.250	0.00	0.75	0.042	O					0.07
5.333	0.00	0.66	0.037	O					0.07
5.417	0.00	0.58	0.033	O					0.06
5.500	0.00	0.52	0.029	O					0.05
5.583	0.00	0.46	0.026	O					0.05
5.667	0.00	0.40	0.023	O					0.04
5.750	0.00	0.36	0.020	O					0.04
5.833	0.00	0.32	0.018	O					0.03
5.917	0.00	0.28	0.016	O					0.03
6.000	0.00	0.25	0.014	O					0.02

6.083	0.00	0.22	0.012	0					0.02
6.167	0.00	0.19	0.011	0					0.02
6.250	0.00	0.17	0.010	0					0.02
6.333	0.00	0.15	0.009	0					0.02
6.417	0.00	0.13	0.008	0					0.01
6.500	0.00	0.12	0.007	0					0.01
6.583	0.00	0.10	0.006	0					0.01
6.667	0.00	0.09	0.005	0					0.01
6.750	0.00	0.08	0.005	0					0.01
6.833	0.00	0.07	0.004	0					0.01
6.917	0.00	0.06	0.004	0					0.01
7.000	0.00	0.06	0.003	0					0.01
7.083	0.00	0.05	0.003	0					0.01
7.167	0.00	0.04	0.002	0					0.00
7.250	0.00	0.04	0.002	0					0.00
7.333	0.00	0.03	0.002	0					0.00
7.417	0.00	0.03	0.002	0					0.00
7.500	0.00	0.03	0.002	0					0.00
7.583	0.00	0.02	0.001	0					0.00
7.667	0.00	0.02	0.001	0					0.00
7.750	0.00	0.02	0.001	0					0.00
7.833	0.00	0.02	0.001	0					0.00
7.917	0.00	0.01	0.001	0					0.00
8.000	0.00	0.01	0.001	0					0.00
8.083	0.00	0.01	0.001	0					0.00
8.167	0.00	0.01	0.001	0					0.00
8.250	0.00	0.01	0.001	0					0.00

*****HYDROGRAPH DATA*****

Number of intervals = 99
Time interval = 5.0 (Min.)
Maximum/Peak flow rate = 5.000 (CFS)
Total volume = 1.793 (Ac.Ft)

Status of hydrographs being held in storage

	Stream 1	Stream 2	Stream 3	Stream 4	Stream 5
Peak (CFS)	0.000	0.000	0.000	0.000	0.000
Vol (Ac.Ft)	0.000	0.000	0.000	0.000	0.000

FLOOD HYDROGRAPH ROUTING PROGRAM
 Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2005
 Study date: 05/12/21

PROPOSED 100-YR, 3-HOUR STORM EVENT
 REDLANDS WEST - ROUTING
 20-0186 UG CHAMBER STORAGE PUMP
 05/12/2021 AYS 5.0 CFS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROPWEST1003100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 40
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 31.523 (CFS)
 Total volume = 2.611 (Ac.Ft)
 Status of hydrographs being held in storage

	Stream 1	Stream 2	Stream 3	Stream 4	Stream 5
Peak (CFS)	0.000	0.000	0.000	0.000	0.000
Vol (Ac.Ft)	0.000	0.000	0.000	0.000	0.000

+++++
 Process from Point/Station 200.000 to Point/Station 201.000
 **** RETARDING BASIN ROUTING ****

User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 40
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-O*dt/2) (Ac.Ft)	(S+O*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.281	5.000	0.264	0.298
1.000	0.443	5.000	0.426	0.460
1.500	0.600	5.000	0.583	0.617
2.000	0.750	5.000	0.733	0.767
2.500	0.891	5.000	0.874	0.908
3.000	1.018	5.000	1.001	1.035
3.500	1.122	5.000	1.105	1.139
4.000	1.202	5.000	1.185	1.219
4.500	1.278	5.000	1.261	1.295
5.000	1.355	5.000	1.338	1.372
5.500	1.432	5.000	1.415	1.449
6.000	1.509	9.240	1.477	1.541
6.500	1.586	17.000	1.527	1.645

Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)	.0	7.9	15.76	23.64	31.52	Depth (Ft.)
0.083	1.68	0.10	0.005	OI					0.01
0.167	3.67	0.40	0.022	O I					0.04
0.250	3.85	0.78	0.044	O I					0.08
0.333	4.24	1.16	0.065	O I					0.12
0.417	4.88	1.55	0.087	O I					0.16
0.500	5.38	1.97	0.110	O I					0.20
0.583	5.49	2.37	0.133	O I					0.24
0.667	5.55	2.73	0.153	O I					0.27
0.750	5.95	3.08	0.173	O I					0.31
0.833	5.64	3.39	0.191	O I					0.34
0.917	5.33	3.63	0.204	O I					0.36
1.000	5.67	3.85	0.216	O I					0.38
1.083	6.53	4.11	0.231	O I					0.41
1.167	7.26	4.43	0.249	O I					0.44
1.250	7.45	4.77	0.268	O I					0.48
1.333	7.21	5.00	0.285	O I					0.51
1.417	7.90	5.00	0.302	O I					0.57
1.500	9.20	5.00	0.327	O I					0.64
1.583	9.11	5.00	0.355	O I					0.73
1.667	9.15	5.00	0.384	O I					0.82
1.750	10.78	5.00	0.418	O I					0.92
1.833	11.77	5.00	0.461	O I					1.06
1.917	11.30	5.00	0.506	O I					1.20
2.000	11.11	5.00	0.549	O I					1.34
2.083	11.43	5.00	0.592	O I					1.48
2.167	13.58	5.00	0.644	O I					1.65
2.250	17.35	5.00	0.716	O I					1.89
2.333	16.89	5.00	0.800	O I					2.18
2.417	20.20	5.00	0.893	O I					2.51
2.500	27.57	5.00	1.023	O I					3.02
2.583	31.52	5.00	1.192	O I					3.94
2.667	30.03	5.00	1.369	O I					5.09
2.750	19.19	8.36	1.493	O I					5.90
2.833	9.99	11.03	1.527	O IO					6.12
2.917	7.55	9.87	1.515	O IO					6.04
3.000	4.95	8.48	1.495	O IO					5.91
3.083	1.92	6.87	1.466	O IO					5.72
3.167	0.59	5.08	1.433	O IO					5.51
3.250	0.22	5.00	1.402	O IO					5.30
3.333	0.04	5.00	1.368	O IO					5.08
3.417	0.00	5.00	1.334	O IO					4.86
3.500	0.00	5.00	1.299	O IO					4.64
3.583	0.00	5.00	1.265	O IO					4.41
3.667	0.00	5.00	1.230	O IO					4.19
3.750	0.00	5.00	1.196	O IO					3.96
3.833	0.00	5.00	1.162	O IO					3.75
3.917	0.00	5.00	1.127	O IO					3.53
4.000	0.00	5.00	1.093	O IO					3.36
4.083	0.00	5.00	1.058	O IO					3.19
4.167	0.00	5.00	1.024	O IO					3.03
4.250	0.00	5.00	0.989	O IO					2.89
4.333	0.00	5.00	0.955	O IO					2.75
4.417	0.00	5.00	0.920	O IO					2.62
4.500	0.00	5.00	0.886	O IO					2.48
4.583	0.00	5.00	0.852	O IO					2.36
4.667	0.00	5.00	0.817	O IO					2.24
4.750	0.00	5.00	0.783	O IO					2.12
4.833	0.00	5.00	0.748	O IO					1.99
4.917	0.00	5.00	0.714	O IO					1.88
5.000	0.00	5.00	0.679	O IO					1.76
5.083	0.00	5.00	0.645	O IO					1.65
5.167	0.00	5.00	0.611	O IO					1.54
5.250	0.00	5.00	0.576	O IO					1.42
5.333	0.00	5.00	0.542	O IO					1.31
5.417	0.00	5.00	0.507	O IO					1.20
5.500	0.00	5.00	0.473	O IO					1.09
5.583	0.00	5.00	0.438	O IO					0.99
5.667	0.00	5.00	0.404	O IO					0.88
5.750	0.00	5.00	0.370	O IO					0.77
5.833	0.00	5.00	0.335	O IO					0.67
5.917	0.00	5.00	0.301	O IO					0.56
6.000	0.00	4.75	0.267	O IO					0.48

6.083	0.00	4.20	0.236	I	o					0.42
6.167	0.00	3.72	0.209	I	o					0.37
6.250	0.00	3.29	0.185	I	o					0.33
6.333	0.00	2.91	0.163	I	o					0.29
6.417	0.00	2.57	0.145	I	o					0.26
6.500	0.00	2.28	0.128	I	o					0.23
6.583	0.00	2.01	0.113	I	o					0.20
6.667	0.00	1.78	0.100	IO						0.18
6.750	0.00	1.58	0.089	IO						0.16
6.833	0.00	1.39	0.078	IO						0.14
6.917	0.00	1.23	0.069	IO						0.12
7.000	0.00	1.09	0.061	IO						0.11
7.083	0.00	0.96	0.054	o						0.10
7.167	0.00	0.85	0.048	o						0.09
7.250	0.00	0.75	0.042	o						0.08
7.333	0.00	0.67	0.037	o						0.07
7.417	0.00	0.59	0.033	o						0.06
7.500	0.00	0.52	0.029	o						0.05
7.583	0.00	0.46	0.026	o						0.05
7.667	0.00	0.41	0.023	o						0.04
7.750	0.00	0.36	0.020	o						0.04
7.833	0.00	0.32	0.018	o						0.03
7.917	0.00	0.28	0.016	o						0.03
8.000	0.00	0.25	0.014	o						0.03
8.083	0.00	0.22	0.012	o						0.02
8.167	0.00	0.20	0.011	o						0.02
8.250	0.00	0.17	0.010	o						0.02
8.333	0.00	0.15	0.009	o						0.02
8.417	0.00	0.14	0.008	o						0.01
8.500	0.00	0.12	0.007	o						0.01
8.583	0.00	0.11	0.006	o						0.01
8.667	0.00	0.09	0.005	o						0.01
8.750	0.00	0.08	0.005	o						0.01
8.833	0.00	0.07	0.004	o						0.01
8.917	0.00	0.06	0.004	o						0.01
9.000	0.00	0.06	0.003	o						0.01
9.083	0.00	0.05	0.003	o						0.01
9.167	0.00	0.04	0.003	o						0.00
9.250	0.00	0.04	0.002	o						0.00
9.333	0.00	0.04	0.002	o						0.00
9.417	0.00	0.03	0.002	o						0.00
9.500	0.00	0.03	0.002	o						0.00
9.583	0.00	0.02	0.001	o						0.00
9.667	0.00	0.02	0.001	o						0.00
9.750	0.00	0.02	0.001	o						0.00
9.833	0.00	0.02	0.001	o						0.00
9.917	0.00	0.01	0.001	o						0.00
10.000	0.00	0.01	0.001	o						0.00
10.083	0.00	0.01	0.001	o						0.00
10.167	0.00	0.01	0.001	o						0.00
10.250	0.00	0.01	0.001	o						0.00

*****HYDROGRAPH DATA*****

Number of intervals = 123
Time interval = 5.0 (Min.)
Maximum/Peak flow rate = 11.026 (CFS)
Total volume = 2.611 (Ac.Ft)
Status of hydrographs being held in storage
Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
Peak (CFS) 0.000 0.000 0.000 0.000 0.000
Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

FLOOD HYDROGRAPH ROUTING PROGRAM
 Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2005
 Study date: 05/12/21

PROPOSED 100-YR, 6-HOUR STORM EVENT
 REDLANDS WEST - ROUTING
 20-0186 UG CHAMBER STORAGE PUMP
 05/12/2021 AYS 5.0 CFS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROPWEST1006100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 76
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 27.414 (CFS)
 Total volume = 3.314 (Ac.Ft)
 Status of hydrographs being held in storage

	Stream 1	Stream 2	Stream 3	Stream 4	Stream 5
Peak (CFS)	0.000	0.000	0.000	0.000	0.000
Vol (Ac.Ft)	0.000	0.000	0.000	0.000	0.000

+++++
 Process from Point/Station 200.000 to Point/Station 201.000
 **** RETARDING BASIN ROUTING ****

User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 76
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-O*dt/2) (Ac.Ft)	(S+O*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.281	5.000	0.264	0.298
1.000	0.443	5.000	0.426	0.460
1.500	0.600	5.000	0.583	0.617
2.000	0.750	5.000	0.733	0.767
2.500	0.891	5.000	0.874	0.908
3.000	1.018	5.000	1.001	1.035
3.500	1.122	5.000	1.105	1.139
4.000	1.202	5.000	1.185	1.219
4.500	1.278	5.000	1.261	1.295
5.000	1.355	5.000	1.338	1.372
5.500	1.432	5.000	1.415	1.449
6.000	1.509	9.240	1.477	1.541
6.500	1.586	17.000	1.527	1.645

Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)	.0	6.9	13.71	20.56	27.41	Depth (Ft.)
0.083	0.85	0.05	0.003	O					0.00
0.167	2.03	0.21	0.012	O I					0.02
0.250	2.45	0.44	0.025	O I					0.04
0.333	2.59	0.68	0.038	O I					0.07
0.417	2.65	0.91	0.051	O I					0.09
0.500	2.83	1.12	0.063	O I					0.11
0.583	3.03	1.33	0.075	O I					0.13
0.667	3.08	1.53	0.086	O I					0.15
0.750	3.10	1.71	0.096	O I					0.17
0.833	3.11	1.87	0.105	O I					0.19
0.917	3.11	2.01	0.113	O I					0.20
1.000	3.28	2.15	0.121	O I					0.21
1.083	3.48	2.29	0.129	O I					0.23
1.167	3.52	2.43	0.137	O I					0.24
1.250	3.54	2.56	0.144	O I					0.26
1.333	3.55	2.67	0.150	O I					0.27
1.417	3.55	2.77	0.156	O I					0.28
1.500	3.55	2.86	0.161	O I					0.29
1.583	3.55	2.94	0.165	O I					0.29
1.667	3.55	3.01	0.169	O I					0.30
1.750	3.55	3.07	0.173	O I					0.31
1.833	3.55	3.13	0.176	O I					0.31
1.917	3.55	3.18	0.179	O I					0.32
2.000	3.72	3.23	0.182	O I					0.32
2.083	3.75	3.29	0.185	O I					0.33
2.167	3.77	3.34	0.188	O I					0.33
2.250	3.94	3.40	0.191	O I					0.34
2.333	3.98	3.47	0.195	O					0.35
2.417	3.98	3.53	0.198	O					0.35
2.500	3.99	3.58	0.201	O					0.36
2.583	3.99	3.63	0.204	O					0.36
2.667	3.99	3.67	0.206	O					0.37
2.750	4.16	3.72	0.209	O					0.37
2.833	4.37	3.78	0.212	O I					0.38
2.917	4.41	3.85	0.216	O I					0.39
3.000	4.43	3.92	0.220	O I					0.39
3.083	4.44	3.98	0.223	O I					0.40
3.167	4.61	4.04	0.227	O I					0.40
3.250	4.81	4.12	0.231	O I					0.41
3.333	4.85	4.20	0.236	O I					0.42
3.417	5.04	4.29	0.241	O					0.43
3.500	5.42	4.40	0.247	O I					0.44
3.583	5.84	4.54	0.255	O I					0.45
3.667	6.10	4.70	0.264	O I					0.47
3.750	6.35	4.88	0.274	O I					0.49
3.833	6.58	5.00	0.285	O I					0.51
3.917	6.81	5.00	0.296	O I					0.55
4.000	7.03	5.00	0.310	O I					0.59
4.083	7.32	5.00	0.325	O I					0.63
4.167	7.85	5.00	0.342	O I					0.69
4.250	8.43	5.00	0.364	O I					0.76
4.333	9.02	5.00	0.390	O I					0.84
4.417	9.63	5.00	0.419	O I					0.93
4.500	10.01	5.00	0.453	O I					1.03
4.583	10.34	5.00	0.488	O I					1.14
4.667	10.89	5.00	0.527	O I					1.27
4.750	11.47	5.00	0.569	O I					1.40
4.833	11.83	5.00	0.615	O I					1.55
4.917	12.16	5.00	0.663	O I					1.71
5.000	12.71	5.00	0.715	O I					1.88
5.083	14.23	5.00	0.773	O I					2.08
5.167	16.86	5.00	0.846	O I					2.34
5.250	19.27	5.00	0.935	O I					2.68
5.333	21.24	5.00	1.041	O I					3.11
5.417	23.61	5.00	1.161	O I					3.74
5.500	27.41	5.00	1.302	O I					4.65
5.583	21.67	5.21	1.436	O I					5.52
5.667	10.30	8.64	1.498	O I					5.93
5.750	5.60	8.42	1.494	O I					5.90
5.833	3.52	7.19	1.472	O I					5.76
5.917	2.14	5.80	1.447	O I					5.59
6.000	1.36	5.00	1.421	O I					5.43

6.083	0.69	5.00	1.394	I	0	5.25
6.167	0.19	5.00	1.363	I	0	5.05
6.250	0.07	5.00	1.329	I	0	4.83
6.333	0.02	5.00	1.295	I	0	4.61
6.417	0.00	5.00	1.261	I	0	4.39
6.500	0.00	5.00	1.226	I	0	4.16
6.583	0.00	5.00	1.192	I	0	3.94
6.667	0.00	5.00	1.157	I	0	3.72
6.750	0.00	5.00	1.123	I	0	3.51
6.833	0.00	5.00	1.088	I	0	3.34
6.917	0.00	5.00	1.054	I	0	3.17
7.000	0.00	5.00	1.020	I	0	3.01
7.083	0.00	5.00	0.985	I	0	2.87
7.167	0.00	5.00	0.951	I	0	2.73
7.250	0.00	5.00	0.916	I	0	2.60
7.333	0.00	5.00	0.882	I	0	2.47
7.417	0.00	5.00	0.847	I	0	2.35
7.500	0.00	5.00	0.813	I	0	2.22
7.583	0.00	5.00	0.778	I	0	2.10
7.667	0.00	5.00	0.744	I	0	1.98
7.750	0.00	5.00	0.710	I	0	1.87
7.833	0.00	5.00	0.675	I	0	1.75
7.917	0.00	5.00	0.641	I	0	1.64
8.000	0.00	5.00	0.606	I	0	1.52
8.083	0.00	5.00	0.572	I	0	1.41
8.167	0.00	5.00	0.537	I	0	1.30
8.250	0.00	5.00	0.503	I	0	1.19
8.333	0.00	5.00	0.469	I	0	1.08
8.417	0.00	5.00	0.434	I	0	0.97
8.500	0.00	5.00	0.400	I	0	0.87
8.583	0.00	5.00	0.365	I	0	0.76
8.667	0.00	5.00	0.331	I	0	0.65
8.750	0.00	5.00	0.296	I	0	0.55
8.833	0.00	4.68	0.263	I	0	0.47
8.917	0.00	4.14	0.233	I	0	0.41
9.000	0.00	3.66	0.206	I	0	0.37
9.083	0.00	3.24	0.182	I	0	0.32
9.167	0.00	2.87	0.161	I	0	0.29
9.250	0.00	2.53	0.142	I	0	0.25
9.333	0.00	2.24	0.126	I	0	0.22
9.417	0.00	1.98	0.111	I	0	0.20
9.500	0.00	1.75	0.099	I	0	0.18
9.583	0.00	1.55	0.087	IO		0.16
9.667	0.00	1.37	0.077	IO		0.14
9.750	0.00	1.21	0.068	IO		0.12
9.833	0.00	1.07	0.060	IO		0.11
9.917	0.00	0.95	0.053	IO		0.09
10.000	0.00	0.84	0.047	o		0.08
10.083	0.00	0.74	0.042	o		0.07
10.167	0.00	0.66	0.037	o		0.07
10.250	0.00	0.58	0.033	o		0.06
10.333	0.00	0.51	0.029	o		0.05
10.417	0.00	0.45	0.026	o		0.05
10.500	0.00	0.40	0.023	o		0.04
10.583	0.00	0.36	0.020	o		0.04
10.667	0.00	0.31	0.018	o		0.03
10.750	0.00	0.28	0.016	o		0.03
10.833	0.00	0.25	0.014	o		0.02
10.917	0.00	0.22	0.012	o		0.02
11.000	0.00	0.19	0.011	o		0.02
11.083	0.00	0.17	0.010	o		0.02
11.167	0.00	0.15	0.008	o		0.02
11.250	0.00	0.13	0.007	o		0.01
11.333	0.00	0.12	0.007	o		0.01
11.417	0.00	0.10	0.006	o		0.01
11.500	0.00	0.09	0.005	o		0.01
11.583	0.00	0.08	0.005	o		0.01
11.667	0.00	0.07	0.004	o		0.01
11.750	0.00	0.06	0.004	o		0.01
11.833	0.00	0.06	0.003	o		0.01
11.917	0.00	0.05	0.003	o		0.00
12.000	0.00	0.04	0.002	o		0.00
12.083	0.00	0.04	0.002	o		0.00
12.167	0.00	0.03	0.002	o		0.00
12.250	0.00	0.03	0.002	o		0.00

12.333	0.00	0.03	0.002	0					0.00
12.417	0.00	0.02	0.001	0					0.00
12.500	0.00	0.02	0.001	0					0.00
12.583	0.00	0.02	0.001	0					0.00
12.667	0.00	0.02	0.001	0					0.00
12.750	0.00	0.01	0.001	0					0.00
12.833	0.00	0.01	0.001	0					0.00
12.917	0.00	0.01	0.001	0					0.00
13.000	0.00	0.01	0.001	0					0.00
13.083	0.00	0.01	0.001	0					0.00

*****HYDROGRAPH DATA*****

Number of intervals = 157
Time interval = 5.0 (Min.)
Maximum/Peak flow rate = 8.641 (CFS)
Total volume = 3.314 (Ac.Ft)

Status of hydrographs being held in storage

	Stream 1	Stream 2	Stream 3	Stream 4	Stream 5
Peak (CFS)	0.000	0.000	0.000	0.000	0.000
Vol (Ac.Ft)	0.000	0.000	0.000	0.000	0.000

FLOOD HYDROGRAPH ROUTING PROGRAM
 Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2005
 Study date: 05/12/21

PROPOSED 100-YR, 24-HOUR STORM EVENT
 REDLANDS WEST - ROUTING
 20-0186 UG CHAMBER STORAGE PUMP
 05/12/2021 AYS 5.0 CFS

Program License Serial Number 4010

***** HYDROGRAPH INFORMATION *****

From study/file name: PROPWEST10024100.rte
 *****HYDROGRAPH DATA*****
 Number of intervals = 292
 Time interval = 5.0 (Min.)
 Maximum/Peak flow rate = 9.468 (CFS)
 Total volume = 5.281 (Ac.Ft)
 Status of hydrographs being held in storage

	Stream 1	Stream 2	Stream 3	Stream 4	Stream 5
Peak (CFS)	0.000	0.000	0.000	0.000	0.000
Vol (Ac.Ft)	0.000	0.000	0.000	0.000	0.000

+++++
 Process from Point/Station 200.000 to Point/Station 201.000
 **** RETARDING BASIN ROUTING ****

User entry of depth-outflow-storage data

Total number of inflow hydrograph intervals = 292
 Hydrograph time unit = 5.000 (Min.)
 Initial depth in storage basin = 0.00(Ft.)

Initial basin depth = 0.00 (Ft.)
 Initial basin storage = 0.00 (Ac.Ft)
 Initial basin outflow = 0.00 (CFS)

Depth vs. Storage and Depth vs. Discharge data:

Basin Depth (Ft.)	Storage (Ac.Ft)	Outflow (CFS)	(S-O*dt/2) (Ac.Ft)	(S+O*dt/2) (Ac.Ft)
0.000	0.000	0.000	0.000	0.000
0.500	0.281	5.000	0.264	0.298
1.000	0.443	5.000	0.426	0.460
1.500	0.600	5.000	0.583	0.617
2.000	0.750	5.000	0.733	0.767
2.500	0.891	5.000	0.874	0.908
3.000	1.018	5.000	1.001	1.035
3.500	1.122	5.000	1.105	1.139
4.000	1.202	5.000	1.185	1.219
4.500	1.278	5.000	1.261	1.295
5.000	1.355	5.000	1.338	1.372
5.500	1.432	5.000	1.415	1.449
6.000	1.509	9.240	1.477	1.541
6.500	1.586	17.000	1.527	1.645

Hydrograph Detention Basin Routing

Graph values: 'I'= unit inflow; 'O'=outflow at time shown

Time (Hours)	Inflow (CFS)	Outflow (CFS)	Storage (Ac.Ft)	.0	2.4	4.73	7.10	9.47	Depth (Ft.)
0.083	0.19	0.01	0.001	O					0.00
0.167	0.42	0.05	0.003	OI					0.00
0.250	0.47	0.09	0.005	OI					0.01
0.333	0.59	0.14	0.008	OI					0.01
0.417	0.71	0.20	0.011	O I					0.02
0.500	0.74	0.26	0.015	O I					0.03
0.583	0.75	0.32	0.018	OI					0.03
0.667	0.75	0.37	0.021	OI					0.04
0.750	0.75	0.41	0.023	OI					0.04
0.833	0.85	0.46	0.026	OI					0.05
0.917	0.96	0.51	0.029	O I					0.05
1.000	0.99	0.56	0.032	O I					0.06
1.083	0.90	0.61	0.034	OI					0.06
1.167	0.80	0.64	0.036	O					0.06
1.250	0.77	0.65	0.037	O					0.07
1.333	0.76	0.67	0.037	O					0.07
1.417	0.75	0.68	0.038	O					0.07
1.500	0.75	0.69	0.039	O					0.07
1.583	0.75	0.69	0.039	O					0.07
1.667	0.75	0.70	0.039	O					0.07
1.750	0.75	0.71	0.040	O					0.07
1.833	0.85	0.72	0.040	O					0.07
1.917	0.96	0.74	0.042	OI					0.07
2.000	0.99	0.77	0.043	OI					0.08
2.083	1.00	0.79	0.045	OI					0.08
2.167	1.01	0.82	0.046	OI					0.08
2.250	1.01	0.84	0.047	OI					0.08
2.333	1.01	0.86	0.048	OI					0.09
2.417	1.01	0.88	0.049	OI					0.09
2.500	1.01	0.89	0.050	O					0.09
2.583	1.10	0.91	0.051	O					0.09
2.667	1.22	0.94	0.053	OI					0.09
2.750	1.24	0.97	0.055	OI					0.10
2.833	1.25	1.00	0.056	OI					0.10
2.917	1.26	1.03	0.058	OI					0.10
3.000	1.26	1.06	0.059	OI					0.11
3.083	1.26	1.08	0.061	OI					0.11
3.167	1.26	1.10	0.062	OI					0.11
3.250	1.26	1.12	0.063	OI					0.11
3.333	1.26	1.14	0.064	OI					0.11
3.417	1.26	1.15	0.065	OI					0.11
3.500	1.26	1.16	0.065	OI					0.12
3.583	1.26	1.17	0.066	OI					0.12
3.667	1.26	1.18	0.066	OI					0.12
3.750	1.26	1.19	0.067	O					0.12
3.833	1.35	1.20	0.068	O					0.12
3.917	1.47	1.23	0.069	O					0.12
4.000	1.49	1.26	0.071	OI					0.13
4.083	1.50	1.29	0.072	OI					0.13
4.167	1.51	1.31	0.074	OI					0.13
4.250	1.51	1.33	0.075	OI					0.13
4.333	1.61	1.36	0.076	OI					0.14
4.417	1.72	1.39	0.078	OI					0.14
4.500	1.74	1.43	0.081	OI					0.14
4.583	1.76	1.47	0.083	OI					0.15
4.667	1.76	1.50	0.084	O					0.15
4.750	1.76	1.53	0.086	O					0.15
4.833	1.86	1.56	0.088	OI					0.16
4.917	1.97	1.61	0.090	OI					0.16
5.000	2.00	1.65	0.093	OI					0.16
5.083	1.81	1.68	0.094	OI					0.17
5.167	1.59	1.68	0.094	O					0.17
5.250	1.54	1.67	0.094	O					0.17
5.333	1.62	1.66	0.093	O					0.17
5.417	1.72	1.66	0.093	O					0.17
5.500	1.74	1.67	0.094	O					0.17
5.583	1.85	1.68	0.095	OI					0.17
5.667	1.97	1.71	0.096	OI					0.17
5.750	2.00	1.74	0.098	OI					0.17
5.833	2.01	1.77	0.100	OI					0.18
5.917	2.01	1.80	0.101	O					0.18
6.000	2.01	1.82	0.102	O					0.18

6.083	2.11	1.85	0.104	OI				0.19
6.167	2.22	1.89	0.106	OI				0.19
6.250	2.25	1.93	0.108	OI				0.19
6.333	2.26	1.96	0.110	OI				0.20
6.417	2.26	2.00	0.112	OI				0.20
6.500	2.26	2.03	0.114	OI				0.20
6.583	2.36	2.06	0.116	OI				0.21
6.667	2.47	2.10	0.118	OI				0.21
6.750	2.50	2.15	0.121	OI				0.21
6.833	2.51	2.19	0.123	OI				0.22
6.917	2.52	2.23	0.125	OI				0.22
7.000	2.52	2.26	0.127	OI				0.23
7.083	2.52	2.29	0.129	OI				0.23
7.167	2.52	2.31	0.130	OI				0.23
7.250	2.52	2.34	0.131	OI				0.23
7.333	2.61	2.36	0.133	OI				0.24
7.417	2.73	2.40	0.135	OI				0.24
7.500	2.75	2.44	0.137	OI				0.24
7.583	2.86	2.48	0.139	OI				0.25
7.667	2.98	2.53	0.142	O I				0.25
7.750	3.00	2.58	0.145	O I				0.26
7.833	3.11	2.64	0.148	O I				0.26
7.917	3.23	2.70	0.152	O I				0.27
8.000	3.25	2.76	0.155	O I				0.28
8.083	3.46	2.83	0.159	O I				0.28
8.167	3.69	2.92	0.164	O I				0.29
8.250	3.74	3.01	0.169	O I				0.30
8.333	3.76	3.09	0.174	O I				0.31
8.417	3.77	3.17	0.178	O I				0.32
8.500	3.77	3.24	0.182	O I				0.32
8.583	3.87	3.31	0.186	O I				0.33
8.667	3.98	3.38	0.190	O I				0.34
8.750	4.01	3.45	0.194	O I				0.35
8.833	4.12	3.52	0.198	O I				0.35
8.917	4.23	3.60	0.202	O I				0.36
9.000	4.26	3.67	0.206	O I				0.37
9.083	4.46	3.75	0.211	O I				0.38
9.167	4.70	3.85	0.216	O I				0.38
9.250	4.75	3.95	0.222	O I				0.39
9.333	4.86	4.05	0.227	O I				0.40
9.417	4.99	4.15	0.233	O I				0.41
9.500	5.01	4.25	0.239	O I				0.42
9.583	5.12	4.34	0.244	O I				0.43
9.667	5.24	4.44	0.249	O I				0.44
9.750	5.27	4.53	0.255	O I				0.45
9.833	5.37	4.62	0.260	O I				0.46
9.917	5.49	4.72	0.265	O I				0.47
10.000	5.52	4.81	0.270	O I				0.48
10.083	4.85	4.85	0.273	O				0.49
10.167	4.06	4.81	0.270	I O				0.48
10.250	3.88	4.71	0.265	I O				0.47
10.333	3.81	4.61	0.259	I O				0.46
10.417	3.77	4.52	0.254	I O				0.45
10.500	3.77	4.43	0.249	I O				0.44
10.583	4.26	4.38	0.246	O				0.44
10.667	4.82	4.40	0.247	O I				0.44
10.750	4.95	4.46	0.250	O I				0.45
10.833	5.00	4.52	0.254	O I				0.45
10.917	5.03	4.57	0.257	O I				0.46
11.000	5.03	4.63	0.260	O I				0.46
11.083	4.93	4.67	0.262	O I				0.47
11.167	4.82	4.69	0.264	O I				0.47
11.250	4.79	4.71	0.264	O I				0.47
11.333	4.78	4.71	0.265	O I				0.47
11.417	4.78	4.72	0.265	O I				0.47
11.500	4.78	4.73	0.266	O I				0.47
11.583	4.59	4.72	0.265	O				0.47
11.667	4.36	4.69	0.264	IO				0.47
11.750	4.31	4.65	0.261	IO				0.47
11.833	4.38	4.62	0.259	IO				0.46
11.917	4.49	4.60	0.258	O				0.46
12.000	4.51	4.58	0.258	O				0.46
12.083	5.20	4.62	0.259	O I				0.46
12.167	6.00	4.73	0.266	O	I			0.47
12.250	6.18	4.89	0.275	O	I			0.49

12.333	6.35	5.00	0.284			0	I			0.51
12.417	6.52	5.00	0.294			0	I			0.54
12.500	6.55	5.00	0.304			0	I			0.57
12.583	6.84	5.00	0.316			0	I			0.61
12.667	7.17	5.00	0.330			0	I			0.65
12.750	7.25	5.00	0.345			0	I			0.70
12.833	7.42	5.00	0.361			0	I			0.75
12.917	7.61	5.00	0.378			0	I			0.80
13.000	7.65	5.00	0.396			0	I			0.86
13.083	8.34	5.00	0.417			0		I		0.92
13.167	9.14	5.00	0.443			0			I	1.00
13.250	9.32	5.00	0.472			0			I	1.09
13.333	9.41	5.00	0.502			0			I	1.19
13.417	9.46	5.00	0.533			0			I	1.29
13.500	9.47	5.00	0.563			0			I	1.38
13.583	8.06	5.00	0.589			0		I		1.47
13.667	6.39	5.00	0.605			0	I			1.52
13.750	6.02	5.00	0.613			0	I			1.54
13.833	5.87	5.00	0.619			0	I			1.56
13.917	5.78	5.00	0.625			0	I			1.58
14.000	5.78	5.00	0.630			0	I			1.60
14.083	6.31	5.00	0.638			0	I			1.63
14.167	6.93	5.00	0.649			0	I			1.66
14.250	7.07	5.00	0.663			0	I			1.71
14.333	7.01	5.00	0.677			0	I			1.76
14.417	6.89	5.00	0.690			0	I			1.80
14.500	6.87	5.00	0.703			0	I			1.84
14.583	6.86	5.00	0.716			0	I			1.89
14.667	6.87	5.00	0.729			0	I			1.93
14.750	6.88	5.00	0.742			0	I			1.97
14.833	6.76	5.00	0.754			0	I			2.01
14.917	6.61	5.00	0.766			0	I			2.06
15.000	6.59	5.00	0.777			0	I			2.09
15.083	6.45	5.00	0.787			0	I			2.13
15.167	6.30	5.00	0.797			0	I			2.17
15.250	6.27	5.00	0.805			0	I			2.20
15.333	6.14	5.00	0.814			0	I			2.23
15.417	5.98	5.00	0.821			0	I			2.25
15.500	5.96	5.00	0.828			0	I			2.28
15.583	5.50	5.00	0.833			0	I			2.29
15.667	4.97	5.00	0.834			0				2.30
15.750	4.85	5.00	0.834			0				2.30
15.833	4.80	5.00	0.833			0				2.29
15.917	4.78	5.00	0.831			0				2.29
16.000	4.78	5.00	0.830			0				2.28
16.083	3.33	5.00	0.823		I	0				2.26
16.167	1.62	5.00	0.806		I	0				2.20
16.250	1.25	5.00	0.781		I	0				2.11
16.333	1.09	5.00	0.755		I	0				2.02
16.417	1.01	5.00	0.728		I	0				1.93
16.500	1.01	5.00	0.700		I	0				1.83
16.583	0.91	5.00	0.672		I	0				1.74
16.667	0.80	5.00	0.644		I	0				1.65
16.750	0.77	5.00	0.615		I	0				1.55
16.833	0.76	5.00	0.585		I	0				1.45
16.917	0.75	5.00	0.556		I	0				1.36
17.000	0.75	5.00	0.527		I	0				1.27
17.083	0.95	5.00	0.498		I	0				1.18
17.167	1.18	5.00	0.471		I	0				1.09
17.250	1.23	5.00	0.445		I	0				1.01
17.333	1.25	5.00	0.419		I	0				0.93
17.417	1.26	5.00	0.393		I	0				0.85
17.500	1.26	5.00	0.368		I	0				0.77
17.583	1.26	5.00	0.342		I	0				0.69
17.667	1.26	5.00	0.316		I	0				0.61
17.750	1.26	5.00	0.290		I	0				0.53
17.833	1.16	4.72	0.265		I	0				0.47
17.917	1.05	4.30	0.242		I	0				0.43
18.000	1.02	3.92	0.221		I	0				0.39
18.083	1.01	3.59	0.202		I	0				0.36
18.167	1.01	3.29	0.185		I	0				0.33
18.250	1.01	3.03	0.170		I	0				0.30
18.333	1.01	2.79	0.157		I	0				0.28
18.417	1.01	2.59	0.145		I	0				0.26
18.500	1.01	2.40	0.135		I	0				0.24

18.583	0.91	2.24	0.126	I	O					0.22
18.667	0.80	2.08	0.117	I	O					0.21
18.750	0.77	1.93	0.108	I	O					0.19
18.833	0.66	1.79	0.100	I	O					0.18
18.917	0.54	1.65	0.093	I	O					0.17
19.000	0.52	1.52	0.086	I	O					0.15
19.083	0.61	1.41	0.079	I	O					0.14
19.167	0.71	1.32	0.074	I	O					0.13
19.250	0.74	1.26	0.071	I	O					0.13
19.333	0.85	1.20	0.068	I	O					0.12
19.417	0.96	1.17	0.066	O						0.12
19.500	0.99	1.15	0.064	O						0.11
19.583	0.90	1.12	0.063	O						0.11
19.667	0.80	1.09	0.061	IO						0.11
19.750	0.77	1.06	0.059	IO						0.11
19.833	0.66	1.02	0.057	IO						0.10
19.917	0.54	0.97	0.054	IO						0.10
20.000	0.52	0.92	0.052	IO						0.09
20.083	0.61	0.88	0.049	O						0.09
20.167	0.71	0.85	0.048	O						0.09
20.250	0.74	0.84	0.047	O						0.08
20.333	0.75	0.83	0.046	O						0.08
20.417	0.75	0.82	0.046	O						0.08
20.500	0.75	0.81	0.046	O						0.08
20.583	0.75	0.80	0.045	O						0.08
20.667	0.75	0.80	0.045	O						0.08
20.750	0.75	0.79	0.045	O						0.08
20.833	0.66	0.78	0.044	O						0.08
20.917	0.54	0.76	0.043	IO						0.08
21.000	0.52	0.74	0.041	IO						0.07
21.083	0.61	0.72	0.040	O						0.07
21.167	0.71	0.71	0.040	O						0.07
21.250	0.74	0.71	0.040	O						0.07
21.333	0.65	0.71	0.040	O						0.07
21.417	0.54	0.70	0.039	IO						0.07
21.500	0.52	0.68	0.038	IO						0.07
21.583	0.61	0.66	0.037	O						0.07
21.667	0.71	0.66	0.037	O						0.07
21.750	0.74	0.67	0.038	O						0.07
21.833	0.65	0.67	0.038	O						0.07
21.917	0.54	0.66	0.037	IO						0.07
22.000	0.52	0.65	0.037	IO						0.06
22.083	0.61	0.64	0.036	O						0.06
22.167	0.71	0.64	0.036	O						0.06
22.250	0.74	0.65	0.037	O						0.07
22.333	0.65	0.66	0.037	O						0.07
22.417	0.54	0.65	0.037	IO						0.06
22.500	0.52	0.64	0.036	IO						0.06
22.583	0.51	0.62	0.035	IO						0.06
22.667	0.50	0.61	0.034	IO						0.06
22.750	0.50	0.60	0.034	IO						0.06
22.833	0.50	0.59	0.033	O						0.06
22.917	0.50	0.58	0.032	O						0.06
23.000	0.50	0.57	0.032	O						0.06
23.083	0.50	0.56	0.031	O						0.06
23.167	0.50	0.55	0.031	O						0.06
23.250	0.50	0.55	0.031	O						0.05
23.333	0.50	0.54	0.030	O						0.05
23.417	0.50	0.54	0.030	O						0.05
23.500	0.50	0.53	0.030	O						0.05
23.583	0.50	0.53	0.030	O						0.05
23.667	0.50	0.53	0.030	O						0.05
23.750	0.50	0.52	0.029	O						0.05
23.833	0.50	0.52	0.029	O						0.05
23.917	0.50	0.52	0.029	O						0.05
24.000	0.50	0.52	0.029	O						0.05
24.083	0.31	0.50	0.028	O						0.05
24.167	0.08	0.47	0.026	IO						0.05
24.250	0.03	0.42	0.024	IO						0.04
24.333	0.01	0.38	0.021	IO						0.04
24.417	0.00	0.33	0.019	IO						0.03
24.500	0.00	0.29	0.017	O						0.03
24.583	0.00	0.26	0.015	O						0.03
24.667	0.00	0.23	0.013	O						0.02
24.750	0.00	0.20	0.011	O						0.02

24.833	0.00	0.18	0.010	0					0.02
24.917	0.00	0.16	0.009	0					0.02
25.000	0.00	0.14	0.008	0					0.01
25.083	0.00	0.12	0.007	0					0.01
25.167	0.00	0.11	0.006	0					0.01
25.250	0.00	0.10	0.005	0					0.01
25.333	0.00	0.09	0.005	0					0.01
25.417	0.00	0.08	0.004	0					0.01
25.500	0.00	0.07	0.004	0					0.01
25.583	0.00	0.06	0.003	0					0.01
25.667	0.00	0.05	0.003	0					0.01
25.750	0.00	0.05	0.003	0					0.00
25.833	0.00	0.04	0.002	0					0.00
25.917	0.00	0.04	0.002	0					0.00
26.000	0.00	0.03	0.002	0					0.00
26.083	0.00	0.03	0.002	0					0.00
26.167	0.00	0.03	0.001	0					0.00
26.250	0.00	0.02	0.001	0					0.00
26.333	0.00	0.02	0.001	0					0.00
26.417	0.00	0.02	0.001	0					0.00
26.500	0.00	0.02	0.001	0					0.00
26.583	0.00	0.01	0.001	0					0.00
26.667	0.00	0.01	0.001	0					0.00
26.750	0.00	0.01	0.001	0					0.00
26.833	0.00	0.01	0.001	0					0.00

*****HYDROGRAPH DATA*****
Number of intervals = 322
Time interval = 5.0 (Min.)
Maximum/Peak flow rate = 5.000 (CFS)
Total volume = 5.281 (Ac.Ft)
Status of hydrographs being held in storage
Stream 1 Stream 2 Stream 3 Stream 4 Stream 5
Peak (CFS) 0.000 0.000 0.000 0.000 0.000
Vol (Ac.Ft) 0.000 0.000 0.000 0.000 0.000

Appendix 8: Source Control

Pollutant Sources/Source Control Checklist

**To be provided during final engineering.*

Appendix 9: O&M

Operation and Maintenance Plan and Documentation of Finance, Maintenance and Recording Mechanisms

**To be provided during final engineering.*

Appendix 10: Educational Materials

BMP Fact Sheets, Maintenance Guidelines and Other End-User BMP Information

**To be provided during final engineering.*