

# Appendix G-2

(Site 2 – South Nance West)

Preliminary Hydrology Calculations for Perris  
Trailer Yard Nance Street and Webster Avenue

Thienes Engineering, Inc.

November 15, 2022



**Thienes Engineering, Inc.**  
CIVIL ENGINEERING • LAND SURVEYING

**PRELIMINARY HYDROLOGY  
CALCULATIONS**

FOR

**SOUTH NANCE TRAILER YARD – WEST  
NANCE STREET BETWEEN NEVADA AVE. AND WEBSTER AVE.  
PERRIS, CALIFORNIA**

PREPARED FOR

**LAKE CREEK INDUSTRIAL, LLC  
1302 BRITTANY CROSS ROAD  
SANTA ANA, CALIFORNIA 92705**

JANUARY 27, 2023

JOB NO. 4130

PREPARED BY

**THIENES ENGINEERING  
14349 FIRESTONE BOULEVARD  
LA MIRADA, CALIFORNIA 90638  
(714) 521-4811**

**PRELIMINARY HYDROLOGY  
CALCULATIONS**

**FOR**

**SOUTH NANCE TRAILER YARD – WEST**

---

REINHARD STENZEL      DATE:  
R.C.E. 56155  
EXP. 12/31/24

## INTRODUCTION

### A: PROJECT LOCATION

The project site is located south of Nance Street between Patterson Avenue and Webster Avenue in the City of Perris, California. Please see next page for vicinity map.


### B: STUDY PURPOSE

The purpose of this study is to determine the existing and proposed condition 100-year peak flow rates from the project site.

### C: PROJECT STAFF:

Thienes Engineering staff involved in this study include:

Reinhard Stenzel  
Brian Weil

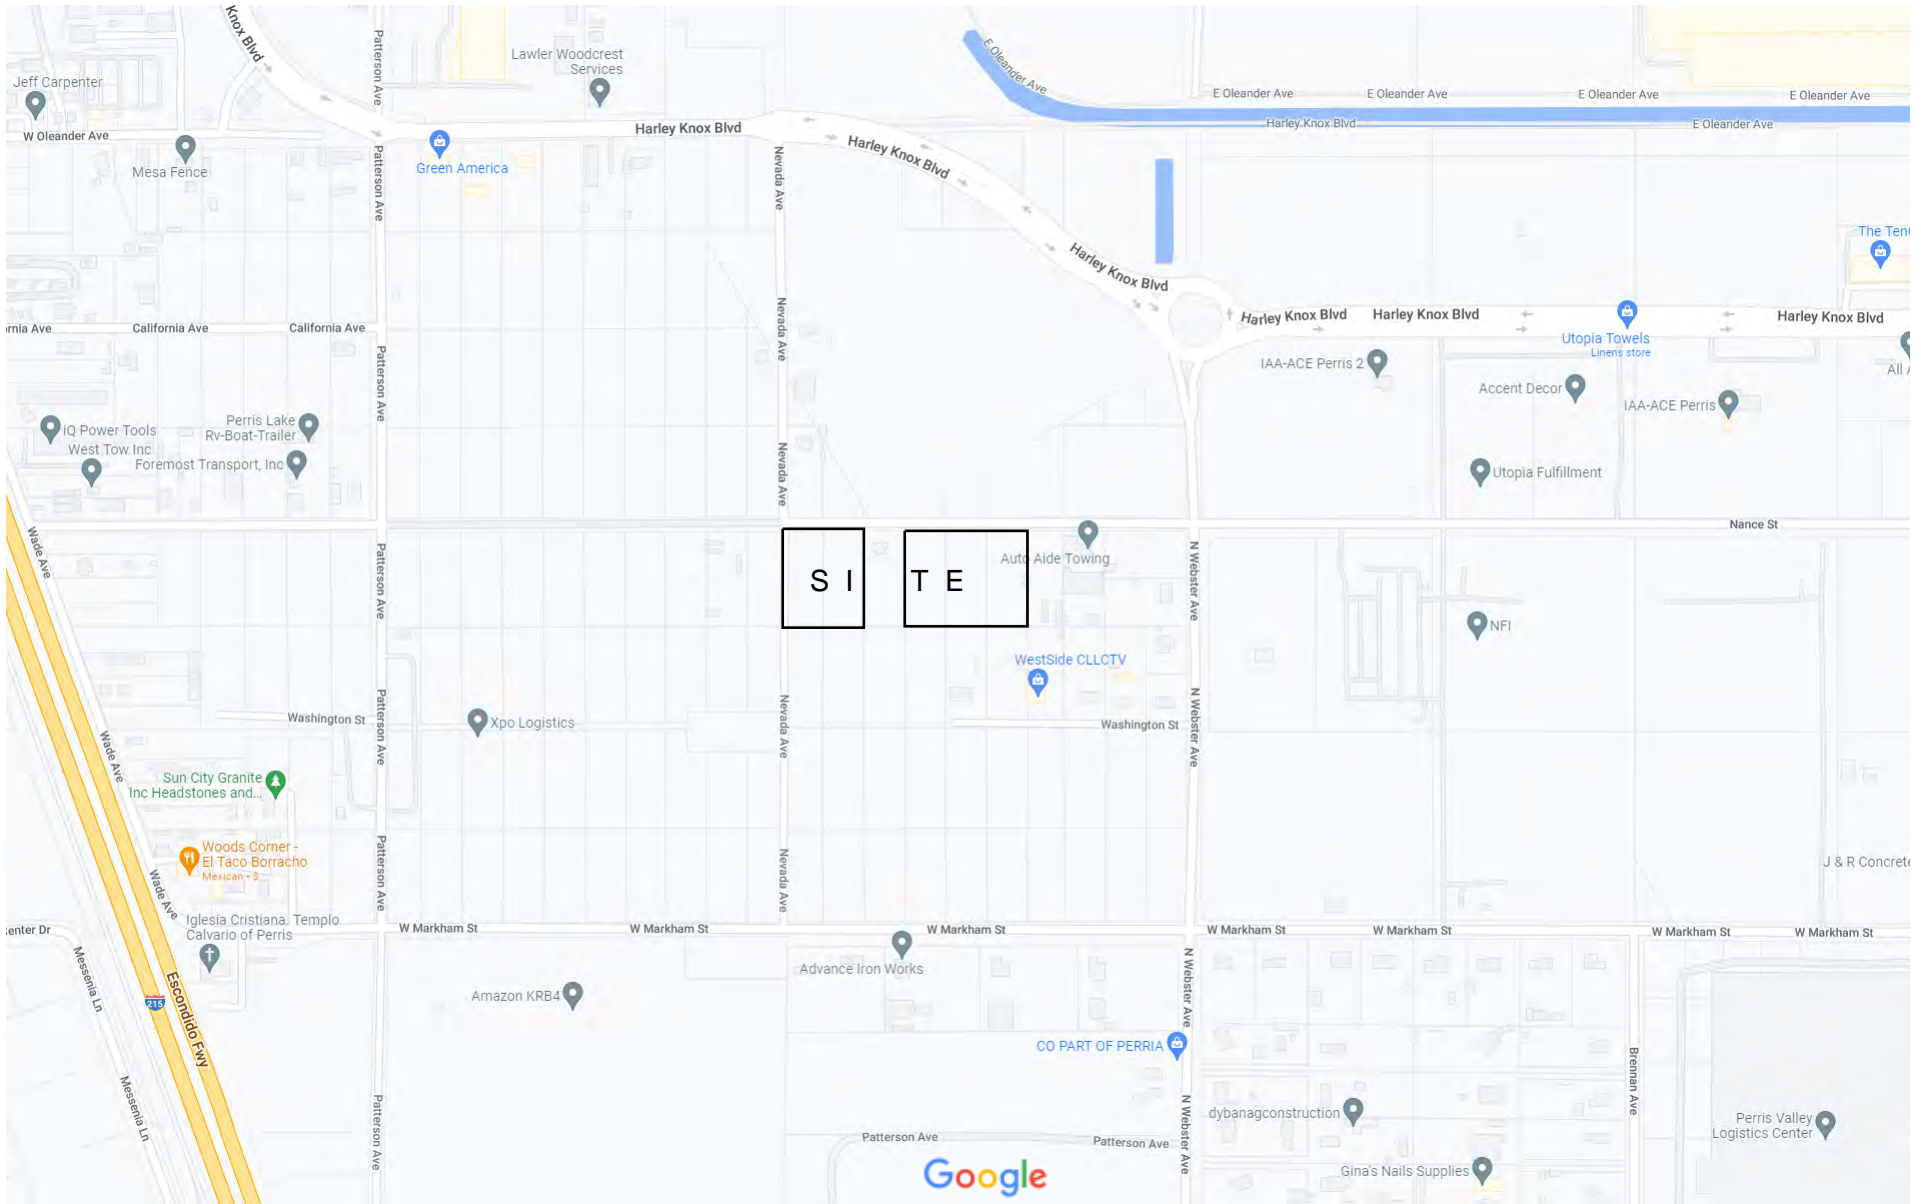

## DISCUSSION

The project site encompasses approximately 1.82 acres. Proposed improvements to the site include a single 11,700 square feet building as well as truck and vehicle parking. Proposed landscaping will be along the property lines.

### Master Plan Hydrology

According to the 1991 Master Drainage Plan (MDP) for the Perris Valley Area, there is no master planned drainage facility adjacent to the project site. The MDP hydrology map indicates that drainage from the project site is tributary to Storm Drain Lateral B-5 in Webster Avenue to the east. The MDP facility has been constructed in Webster Avenue from Markham Avenue north to the Perris Valley Storm Channel, Line "B". Peak flow rates shown on existing storm drain plans are consistent with Webb and Associates updated hydrology for Lateral B-5.

The maps also indicate that Storm Drain Lateral B-6.1 in Nevada Avenue will extend to Nance Street and intercept offsite storm flows from the west of Nevada Avenue (projected). However, until Storm Drain Lateral B-6.1 is constructed and properties to the west are developed, storm flows generated south of Nance Street from Nevada Avenue (projected) west to Patterson Avenue will be tributary to Nance Street adjacent to the project.

See Appendix "A" for Master Plan reference material.

### FEMA Flood Zone

The project site is located on Flood Insurance Rate MAP (FIRM) Number 06065C1430H that has an effective date of August 18, 2014. According to the FIRM, the project site is not within a designated flood zone.

See Appendix "A" for Flood Insurance Rate Map reference material.

## Offsite

Offsite storm flows from the west are tributary to the project site. Tributary to the site are offsite flows from both Nance Street and the adjacent lots that extend west to Patterson Avenue.

The offsite 100-year runoff in Nance Street from the west (Nodes 0-2, 1.99 acres) that is tributary to the site is approximately 2.6 cfs.

The offsite 100-year runoff from the adjacent lots to the west (Nodes 10-12, 7.86 acres) that is tributary to the site is approximately 9.1 cfs. These flows will be intercepted by a ditch along the west property line and conveyed through the project site in a storm drain that will “burp-out” to Nance Street.

See Appendix “B” for offsite hydrology calculations and Appendix “D” for offsite hydrology map (included on both the existing and proposed condition hydrology maps).

## Existing Condition

The project site is currently vacant, undeveloped land. Runoff from the site generally drains from southwest to northeast.

The existing condition 100-year runoff from the site (Nodes 100-101, 1.82 acres) that is tributary to Nance Street is approximately 2.8 cfs.

See Appendix “B” for existing condition hydrology calculations and Appendix “D” for existing condition hydrology map.

## Proposed Condition

The project will collect storm flows into an underground storm drain system and discharge to Nance Street via a burp-out structure.

The proposed condition unmitigated 100-year runoff from the site (Nodes 100-123, 1.72 acres) that is tributary to Nance Street is approximately 6.1 cfs.

There is also 0.10 acres of landscaping and driveway that drain directly to Nance Street.

See Appendix “B” for proposed condition hydrology calculations and Appendix “D” for proposed condition hydrology map.

## Detention

For final design, Riverside County typically requires detention analysis for the 1-hour, 3-hour, 6-hour and 24-hour duration events for the 2-year, 5-year and 10-year return frequencies. Detention basin and outlet sizing will ensure that none of these storm events has a higher peak discharge in the post-development condition than in the pre-development condition. Therefore, there will be no negative impact on existing downstream drainage facilities.

A memo from the Riverside County Flood Control and Water Conservation District states: “For preliminary design purposes, sizing may be based on the difference in runoff hydrograph volume between the “developed” condition and the “pre-developed” condition for the 24-hour duration event for the 10-year return frequency. Final design of the basin, including a complete hydrology study, will not be required until the improvement plan stage of this development.”.

Hydrographs were established using the area of the project site (site only, no offsite area) for the existing and proposed condition for the 10-year 24-hour design storm. The existing condition runoff volume is approximately 0.055 acre feet and the proposed condition runoff volume is approximately 0.344 acre feet, meaning the difference in the 10-year 24-hour storm runoff volume is approximately 0.289 acre-feet. This volume has been provided in the proposed truck yard at a depth of about 1.25’. Final design will include basin routing.

See Appendix “C” for existing and proposed condition hydrographs.

## Methodology

Rational method hydrology calculations were computed using the Riverside County Rational Method program (by AES software). Flood hydrograph hydrology calculations were computed using the UNRIV program (by CivilDesign). The soil type is “B” per the Riverside County Flood Control and Water Conservation District Hydrology Manual. See Appendix “A” for reference materials.

APPENDIX

DESCRIPTION

A

REFERENCE MATERIALS

B

HYDROLOGY CALCULATIONS

C


DETENTION CALCULATIONS

D

HYDROLOGY MAPS

# **APPENDIX A**

## **REFERENCE MATERIALS**

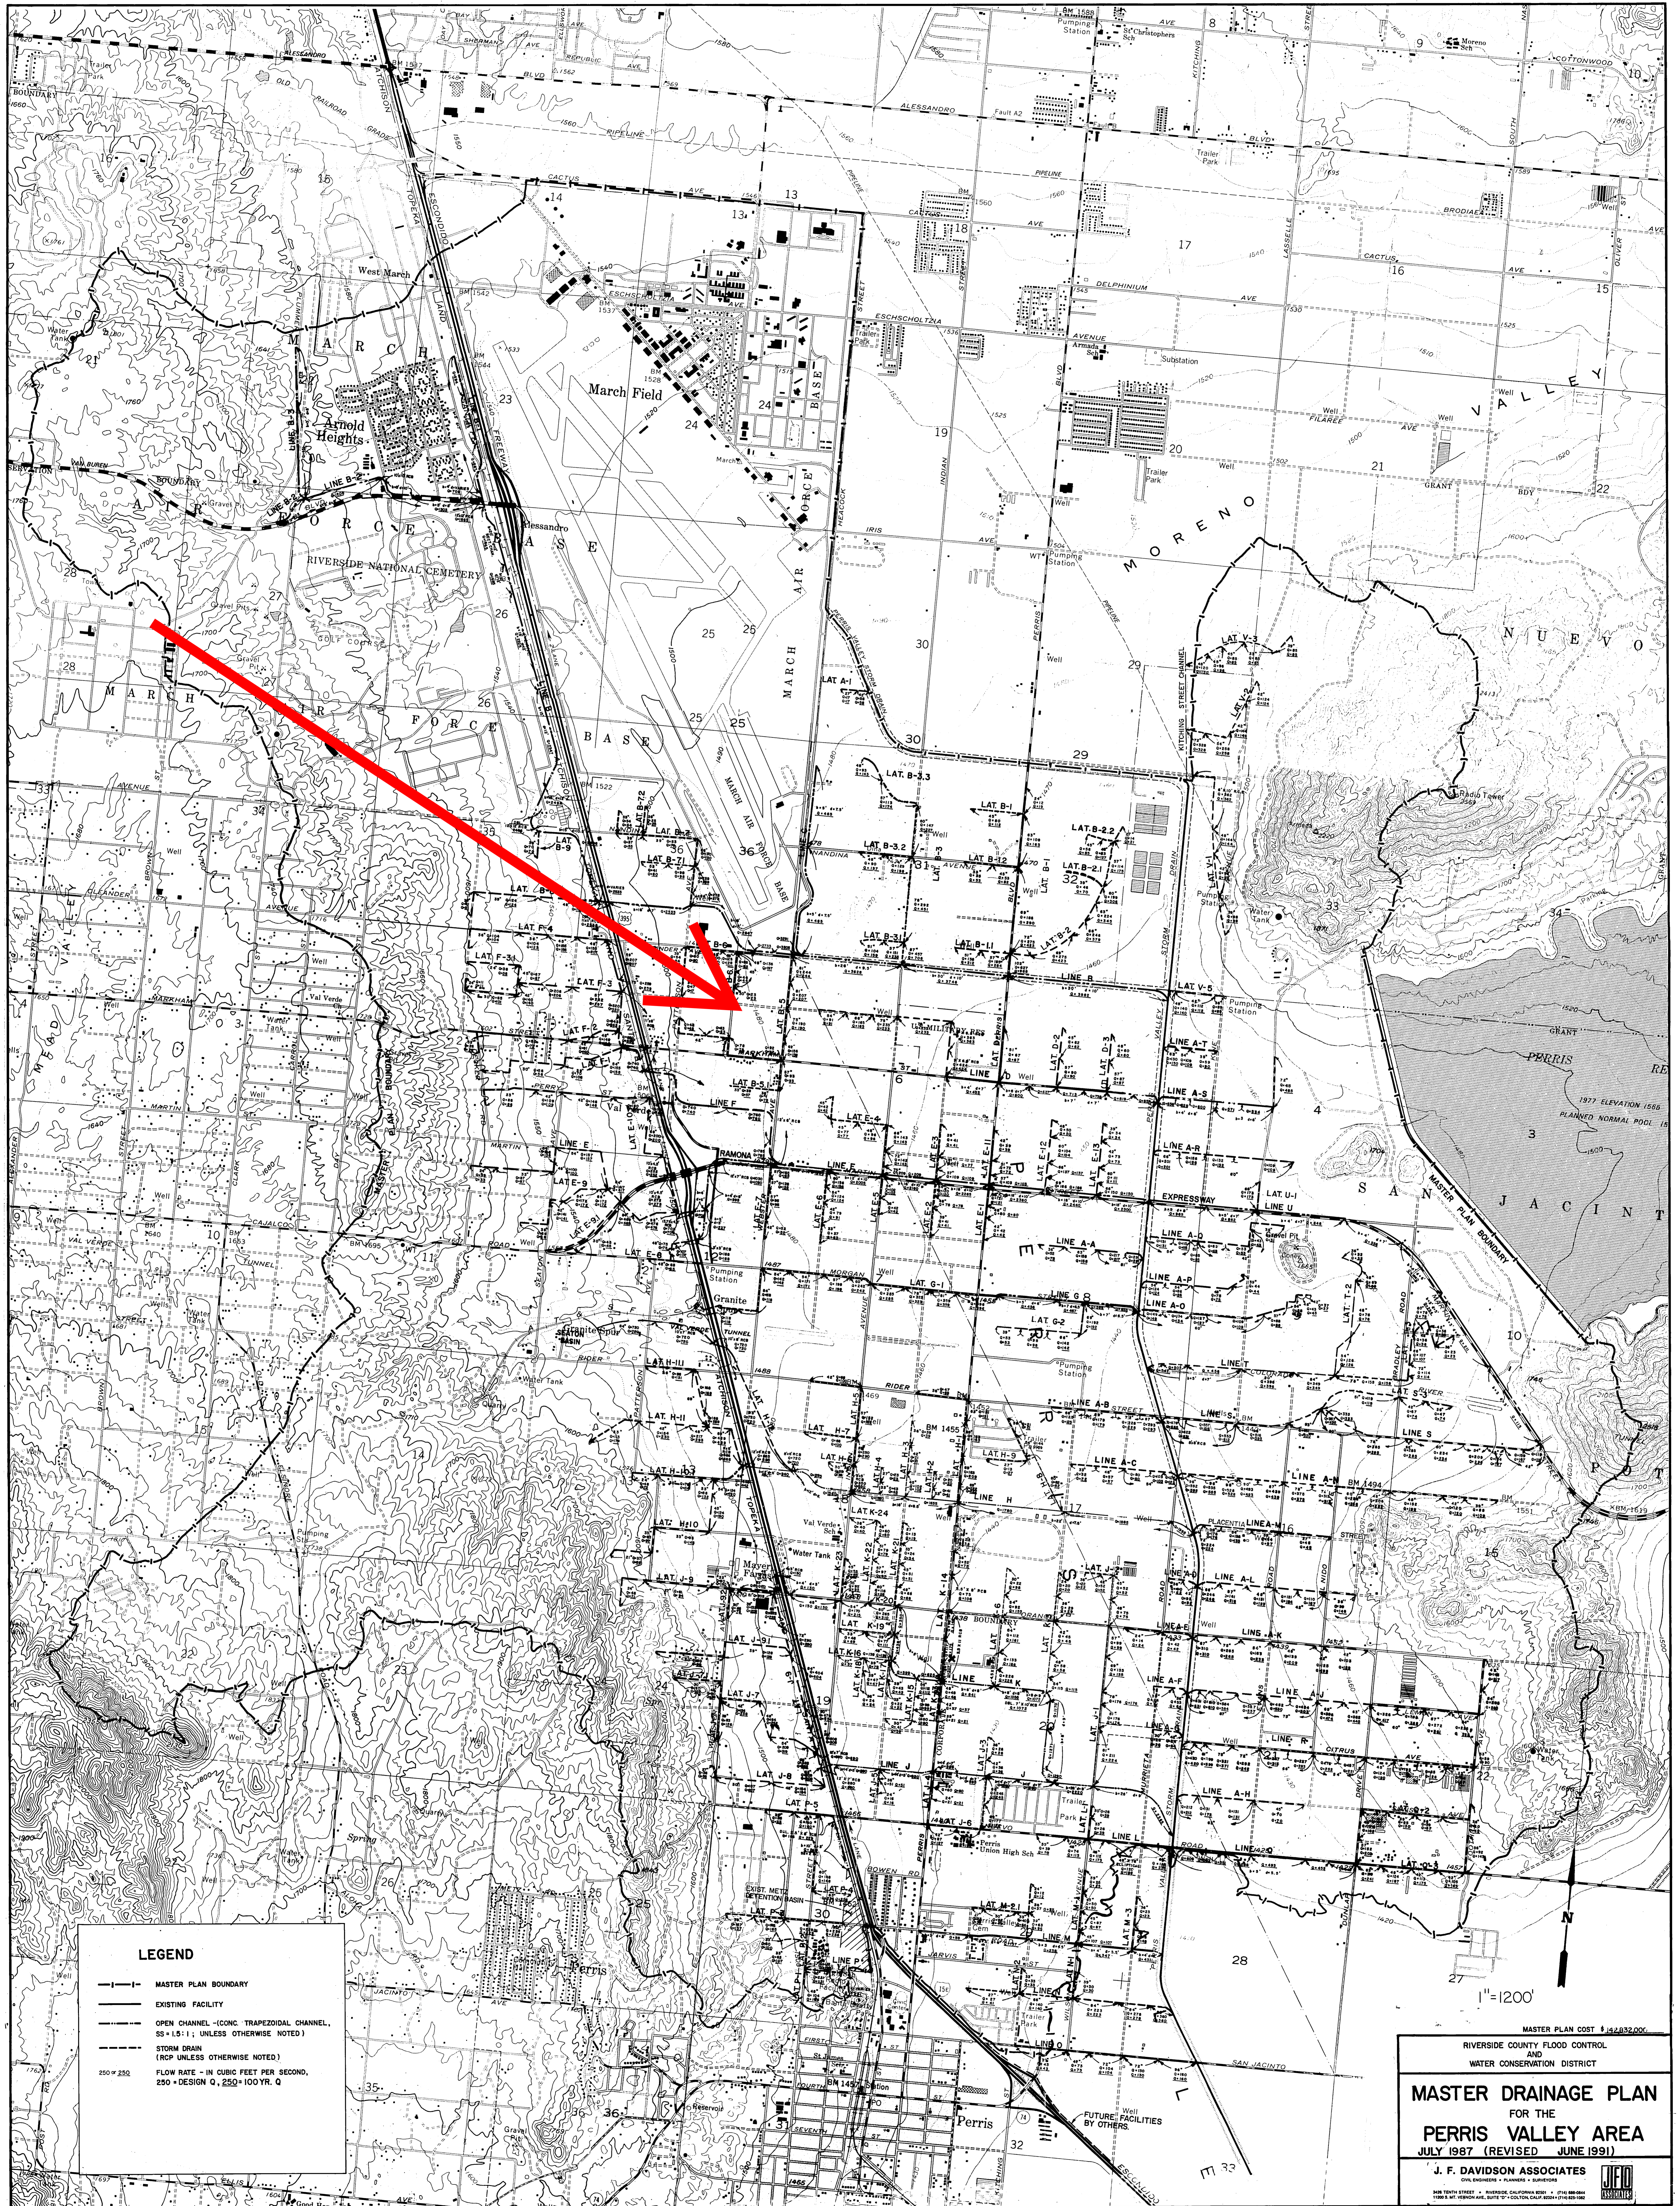

**LEGEND**

- MASTER PLAN BOUNDARY
- EXISTING FACILITY
- OPEN CHANNEL (CONC. TRAPEZOIDAL CHANNEL, 50' x 15' 11" UNLESS OTHERWISE NOTED)
- STORM DRAIN (RCP UNLESS OTHERWISE NOTED)
- FLOW RATE - IN CUBIC FEET PER SECOND, 250' x 250" DESIGN Q, 250' x 100' YR. Q

1" = 1200'

MASTER PLAN COST \$1,428,320.00


RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

**MASTER DRAINAGE PLAN**  
FOR THE  
**PERRIS VALLEY AREA**  
JULY 1987 (REVISED JUNE 1991)

J. F. DAVIDSON ASSOCIATES  
CIVIL ENGINEERS • PLANNERS • SURVEYORS



300 NORTH STREET • RIVERSIDE, CALIFORNIA 92501 • (714) 948-8844  
11085 W. VERNON AVE. SUITE 100 • COVINGTON, CALIFORNIA 95926



**LEGEND**

- MASTER PLAN BOUNDARY
- EXISTING FACILITY
- OPEN CHANNEL (CONC. TRAPEZOIDAL CHANNEL, SS = 1.5:1, UNLESS OTHERWISE NOTED)
- STORM DRAIN (RCP UNLESS OTHERWISE NOTED)
- FLOW RATE - IN CUBIC FEET PER SECOND, 250 = 10 YR, 250 = 100 YR

0 1000 2000 3000  
SCALE: 1" = 1000'

MASTER PLAN COST  
RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

**MASTER DRAINAGE PLAN  
FOR THE  
PERRIS VALLEY AREA**  
APRIL 1991

J. F. DAVIDSON ASSOCIATES

8K3

**FACILITIES' DRAINAGE BOUNDARIES**

8K3  
1/2

Riverside County Rational Hydrology Program

CIVILCADD/CIVILDESIGN Engineering Software, (c) 1989 - 2005 Version 7.1  
Rational Hydrology Study Date: 08/23/16 File: B5.out

-----  
integra Pacific Industrial  
100-Year Storm, Ultimate Conditions  
Lateral B-5 Storm Drain  
-----

\*\*\*\*\* Hydrology Study Control Information \*\*\*\*\*

English (in-lb) Units used in input data file  
-----

Program License Serial Number 4010  
-----

Rational Method Hydrology Program based on  
Riverside County Flood Control & Water Conservation District  
1978 hydrology manual

Storm event (year) = 100.00 Antecedent Moisture Condition = 2

Standard intensity-duration curves data (Plate D-4.1)

For the [ Perris Valley ] area used.

10 year storm 10 minute intensity = 1.880 (In/Hr)

10 year storm 60 minute intensity = 0.780 (In/Hr)

100 year storm 10 minute intensity = 2.690 (In/Hr)

100 year storm 60 minute intensity = 1.120 (In/Hr)

Storm event year = 100.0

Calculated rainfall intensity data:

1 hour intensity = 1.120 (In/Hr)

Slope of intensity duration curve = 0.4900

+++++  
Process from Point/Station 10.000 to Point/Station 11.000  
\*\*\*\* INITIAL AREA EVALUATION \*\*\*\*

-----  
Initial area flow distance = 708.000 (Ft.)

Top (of initial area) elevation = 1488.000 (Ft.)

Bottom (of initial area) elevation = 1482.700 (Ft.)

Difference in elevation = 5.300 (Ft.)

Slope = 0.00749 s(percent) = 0.75

TC =  $k(0.300) * [(length^3) / (elevation\ change)]^{0.2}$

Initial area time of concentration = 11.023 min.

Rainfall intensity = 2.569 (In/Hr) for a 100.0 year storm

COMMERCIAL subarea type

Runoff Coefficient = 0.874

Decimal fraction soil group A = 0.000

Decimal fraction soil group B = 1.000

Decimal fraction soil group C = 0.000

Decimal fraction soil group D = 0.000

RI index for soil (AMC 2) = 56.00

Pervious area fraction = 0.100; Impervious fraction = 0.900

Initial subarea runoff = 11.226 (CFS)

Total initial stream area = 5.000 (Ac.)

Pervious area fraction = 0.100

\*\*\*\*\*  
Process from Point/Station 11.000 to Point/Station 12.000  
\*\*\*\* STREET FLOW TRAVEL TIME + SUBAREA FLOW ADDITION \*\*\*\*

---

Top of street segment elevation = 1482.700(Ft.)  
End of street segment elevation = 1477.500(Ft.)  
Length of street segment = 653.000(Ft.)  
Height of curb above gutter flowline = 6.0(In.)  
Width of half street (curb to crown) = 22.000(Ft.)  
Distance from crown to crossfall grade break = 18.000(Ft.)  
Slope from gutter to grade break (v/hz) = 0.020  
Slope from grade break to crown (v/hz) = 0.020  
Street flow is on [2] side(s) of the street  
Distance from curb to property line = 10.000(Ft.)  
Slope from curb to property line (v/hz) = 0.025  
Gutter width = 2.000(Ft.)  
Gutter hike from flowline = 2.000(In.)  
Manning's N in gutter = 0.0150  
Manning's N from gutter to grade break = 0.0150  
Manning's N from grade break to crown = 0.0150  
Estimated mean flow rate at midpoint of street = 16.086(CFS)  
Depth of flow = 0.463(Ft.), Average velocity = 2.722(Ft/s)  
Streetflow hydraulics at midpoint of street travel:  
Halfstreet flow width = 16.816(Ft.)  
Flow velocity = 2.72(Ft/s)  
Travel time = 4.00 min. TC = 15.02 min.  
Adding area flow to street  
COMMERCIAL subarea type  
Runoff Coefficient = 0.871  
Decimal fraction soil group A = 0.000  
Decimal fraction soil group B = 1.000  
Decimal fraction soil group C = 0.000  
Decimal fraction soil group D = 0.000  
RI index for soil(AMC 2) = 56.00  
Pervious area fraction = 0.100; Impervious fraction = 0.900  
Rainfall intensity = 2.208(In/Hr) for a 100.0 year storm  
Subarea runoff = 9.615(CFS) for 5.000(Ac.)  
Total runoff = 20.841(CFS) Total area = 10.000(Ac.)  
Street flow at end of street = 20.841(CFS)  
Half street flow at end of street = 10.421(CFS)  
Depth of flow = 0.499(Ft.), Average velocity = 2.900(Ft/s)  
Flow width (from curb towards crown)= 18.620(Ft.)

\*\*\*\*\*  
Process from Point/Station 12.000 to Point/Station 13.000  
\*\*\*\* PIPEFLOW TRAVEL TIME (Program estimated size) \*\*\*\*

---

Upstream point/station elevation = 1477.500(Ft.)  
Downstream point/station elevation = 1476.500(Ft.)  
Pipe length = 329.00(Ft.) Manning's N = 0.013  
No. of pipes = 1 Required pipe flow = 20.841(CFS)  
Nearest computed pipe diameter = 30.00(In.)  
Calculated individual pipe flow = 20.841(CFS)  
Normal flow depth in pipe = 22.71(In.)  
Flow top width inside pipe = 25.73(In.)  
Critical Depth = 18.61(In.)  
Pipe flow velocity = 5.23(Ft/s)  
Travel time through pipe = 1.05 min.  
Time of concentration (TC) = 16.07 min.

+++++  
Process from Point/Station 12.000 to Point/Station 13.000  
\*\*\*\* SUBAREA FLOW ADDITION \*\*\*\*

---

COMMERCIAL subarea type  
Runoff Coefficient = 0.870  
Decimal fraction soil group A = 0.000  
Decimal fraction soil group B = 1.000  
Decimal fraction soil group C = 0.000  
Decimal fraction soil group D = 0.000  
RI index for soil(AMC 2) = 56.00  
Pervious area fraction = 0.100; Impervious fraction = 0.900  
Time of concentration = 16.07 min.  
Rainfall intensity = 2.136(In/Hr) for a 100.0 year storm  
Subarea runoff = 18.590(CFS) for 10.000(Ac.)  
Total runoff = 39.431(CFS) Total area = 20.000(Ac.)

+++++  
Process from Point/Station 13.000 to Point/Station 14.000  
\*\*\*\* PIPEFLOW TRAVEL TIME (Program estimated size) \*\*\*\*

---

Upstream point/station elevation = 1476.500(Ft.)  
Downstream point/station elevation = 1474.550(Ft.)  
Pipe length = 648.00(Ft.) Manning's N = 0.013  
No. of pipes = 1 Required pipe flow = 39.431(CFS)  
Nearest computed pipe diameter = 39.00(In.)  
Calculated individual pipe flow = 39.431(CFS)  
Normal flow depth in pipe = 28.13(In.)  
Flow top width inside pipe = 34.98(In.)  
Critical Depth = 23.98(In.)  
Pipe flow velocity = 6.15(Ft/s)  
Travel time through pipe = 1.76 min.  
Time of concentration (TC) = 17.83 min.

+++++  
Process from Point/Station 13.000 to Point/Station 14.000  
\*\*\*\* SUBAREA FLOW ADDITION \*\*\*\*

---

COMMERCIAL subarea type  
Runoff Coefficient = 0.869  
Decimal fraction soil group A = 0.000  
Decimal fraction soil group B = 1.000  
Decimal fraction soil group C = 0.000  
Decimal fraction soil group D = 0.000  
RI index for soil(AMC 2) = 56.00  
Pervious area fraction = 0.100; Impervious fraction = 0.900  
Time of concentration = 17.83 min.  
Rainfall intensity = 2.030(In/Hr) for a 100.0 year storm  
Subarea runoff = 35.297(CFS) for 20.000(Ac.)  
Total runoff = 74.728(CFS) Total area = 40.000(Ac.)

+++++  
Process from Point/Station 14.000 to Point/Station 15.000  
\*\*\*\* PIPEFLOW TRAVEL TIME (Program estimated size) \*\*\*\*

---

Upstream point/station elevation = 1474.550(Ft.)  
Downstream point/station elevation = 1472.630(Ft.)  
Pipe length = 642.00(Ft.) Manning's N = 0.013  
No. of pipes = 1 Required pipe flow = 74.728(CFS)  
Nearest computed pipe diameter = 48.00(In.)  
Calculated individual pipe flow = 74.728(CFS)  
Normal flow depth in pipe = 37.41(In.)  
Flow top width inside pipe = 39.81(In.)  
Critical Depth = 31.39(In.)  
Pipe flow velocity = 7.11(Ft/s)  
Travel time through pipe = 1.50 min.  
Time of concentration (TC) = 19.33 min.

+++++  
Process from Point/Station 14.000 to Point/Station 15.000  
\*\*\*\* SUBAREA FLOW ADDITION \*\*\*\*

---

COMMERCIAL subarea type  
Runoff Coefficient = 0.870  
Decimal fraction soil group A = 0.000  
Decimal fraction soil group B = 0.900  
Decimal fraction soil group C = 0.100  
Decimal fraction soil group D = 0.000  
RI index for soil(AMC 2) = 57.30  
Pervious area fraction = 0.100; Impervious fraction = 0.900  
Time of concentration = 19.33 min.  
Rainfall intensity = 1.951(In/Hr) for a 100.0 year storm  
Subarea runoff = 33.934(CFS) for 20.000(Ac.)  
Total runoff = 108.662(CFS) Total area = 60.000(Ac.)

+++++  
Process from Point/Station 15.000 to Point/Station 16.000  
\*\*\*\* PIPEFLOW TRAVEL TIME (Program estimated size) \*\*\*\*

---

Upstream point/station elevation = 1472.630(Ft.)  
Downstream point/station elevation = 1472.340(Ft.)  
Pipe length = 95.00(Ft.) Manning's N = 0.013  
No. of pipes = 1 Required pipe flow = 108.662(CFS)  
Nearest computed pipe diameter = 54.00(In.)  
Calculated individual pipe flow = 108.662(CFS)  
Normal flow depth in pipe = 44.25(In.)  
Flow top width inside pipe = 41.54(In.)  
Critical Depth = 36.79(In.)  
Pipe flow velocity = 7.79(Ft/s)  
Travel time through pipe = 0.20 min.  
Time of concentration (TC) = 19.53 min.

+++++  
Process from Point/Station 15.000 to Point/Station 16.000  
\*\*\*\* SUBAREA FLOW ADDITION \*\*\*\*

---

COMMERCIAL subarea type  
Runoff Coefficient = 0.868  
Decimal fraction soil group A = 0.000  
Decimal fraction soil group B = 1.000  
Decimal fraction soil group C = 0.000  
Decimal fraction soil group D = 0.000  
RI index for soil(AMC 2) = 56.00  
Pervious area fraction = 0.100; Impervious fraction = 0.900  
Time of concentration = 19.53 min.  
Rainfall intensity = 1.941(In/Hr) for a 100.0 year storm  
Subarea runoff = 22.589(CFS) for 13.400(Ac.)  
Total runoff = 131.251(CFS) Total area = 73.400(Ac.)

+++++  
Process from Point/Station 16.000 to Point/Station 17.000  
\*\*\*\* PIPEFLOW TRAVEL TIME (Program estimated size) \*\*\*\*

---


Upstream point/station elevation = 1472.340(Ft.)  
Downstream point/station elevation = 1470.770(Ft.)  
Pipe length = 524.00(Ft.) Manning's N = 0.013  
No. of pipes = 1 Required pipe flow = 131.251(CFS)  
Nearest computed pipe diameter = 57.00(In.)  
Calculated individual pipe flow = 131.251(CFS)  
Normal flow depth in pipe = 50.25(In.)  
Flow top width inside pipe = 36.83(In.)  
Critical Depth = 39.94(In.)  
Pipe flow velocity = 7.93(Ft/s)  
Travel time through pipe = 1.10 min.  
Time of concentration (TC) = 20.63 min.

+++++  
Process from Point/Station 16.000 to Point/Station 17.000  
\*\*\*\* SUBAREA FLOW ADDITION \*\*\*\*

---

COMMERCIAL subarea type  
Runoff Coefficient = 0.868  
Decimal fraction soil group A = 0.000  
Decimal fraction soil group B = 1.000  
Decimal fraction soil group C = 0.000  
Decimal fraction soil group D = 0.000  
RI index for soil(AMC 2) = 56.00  
Pervious area fraction = 0.100; Impervious fraction = 0.900  
Time of concentration = 20.63 min.  
Rainfall intensity = 1.890(In/Hr) for a 100.0 year storm  
Subarea runoff = 9.840(CFS) for 6.000(Ac.)  
Total runoff = 141.090(CFS) Total area = 79.400(Ac.)  
End of computations, total study area = 79.40 (Ac.)  
The following figures may  
be used for a unit hydrograph study of the same area.

Area averaged pervious area fraction( $A_p$ ) = 0.100  
Area averaged RI index number = 56.3

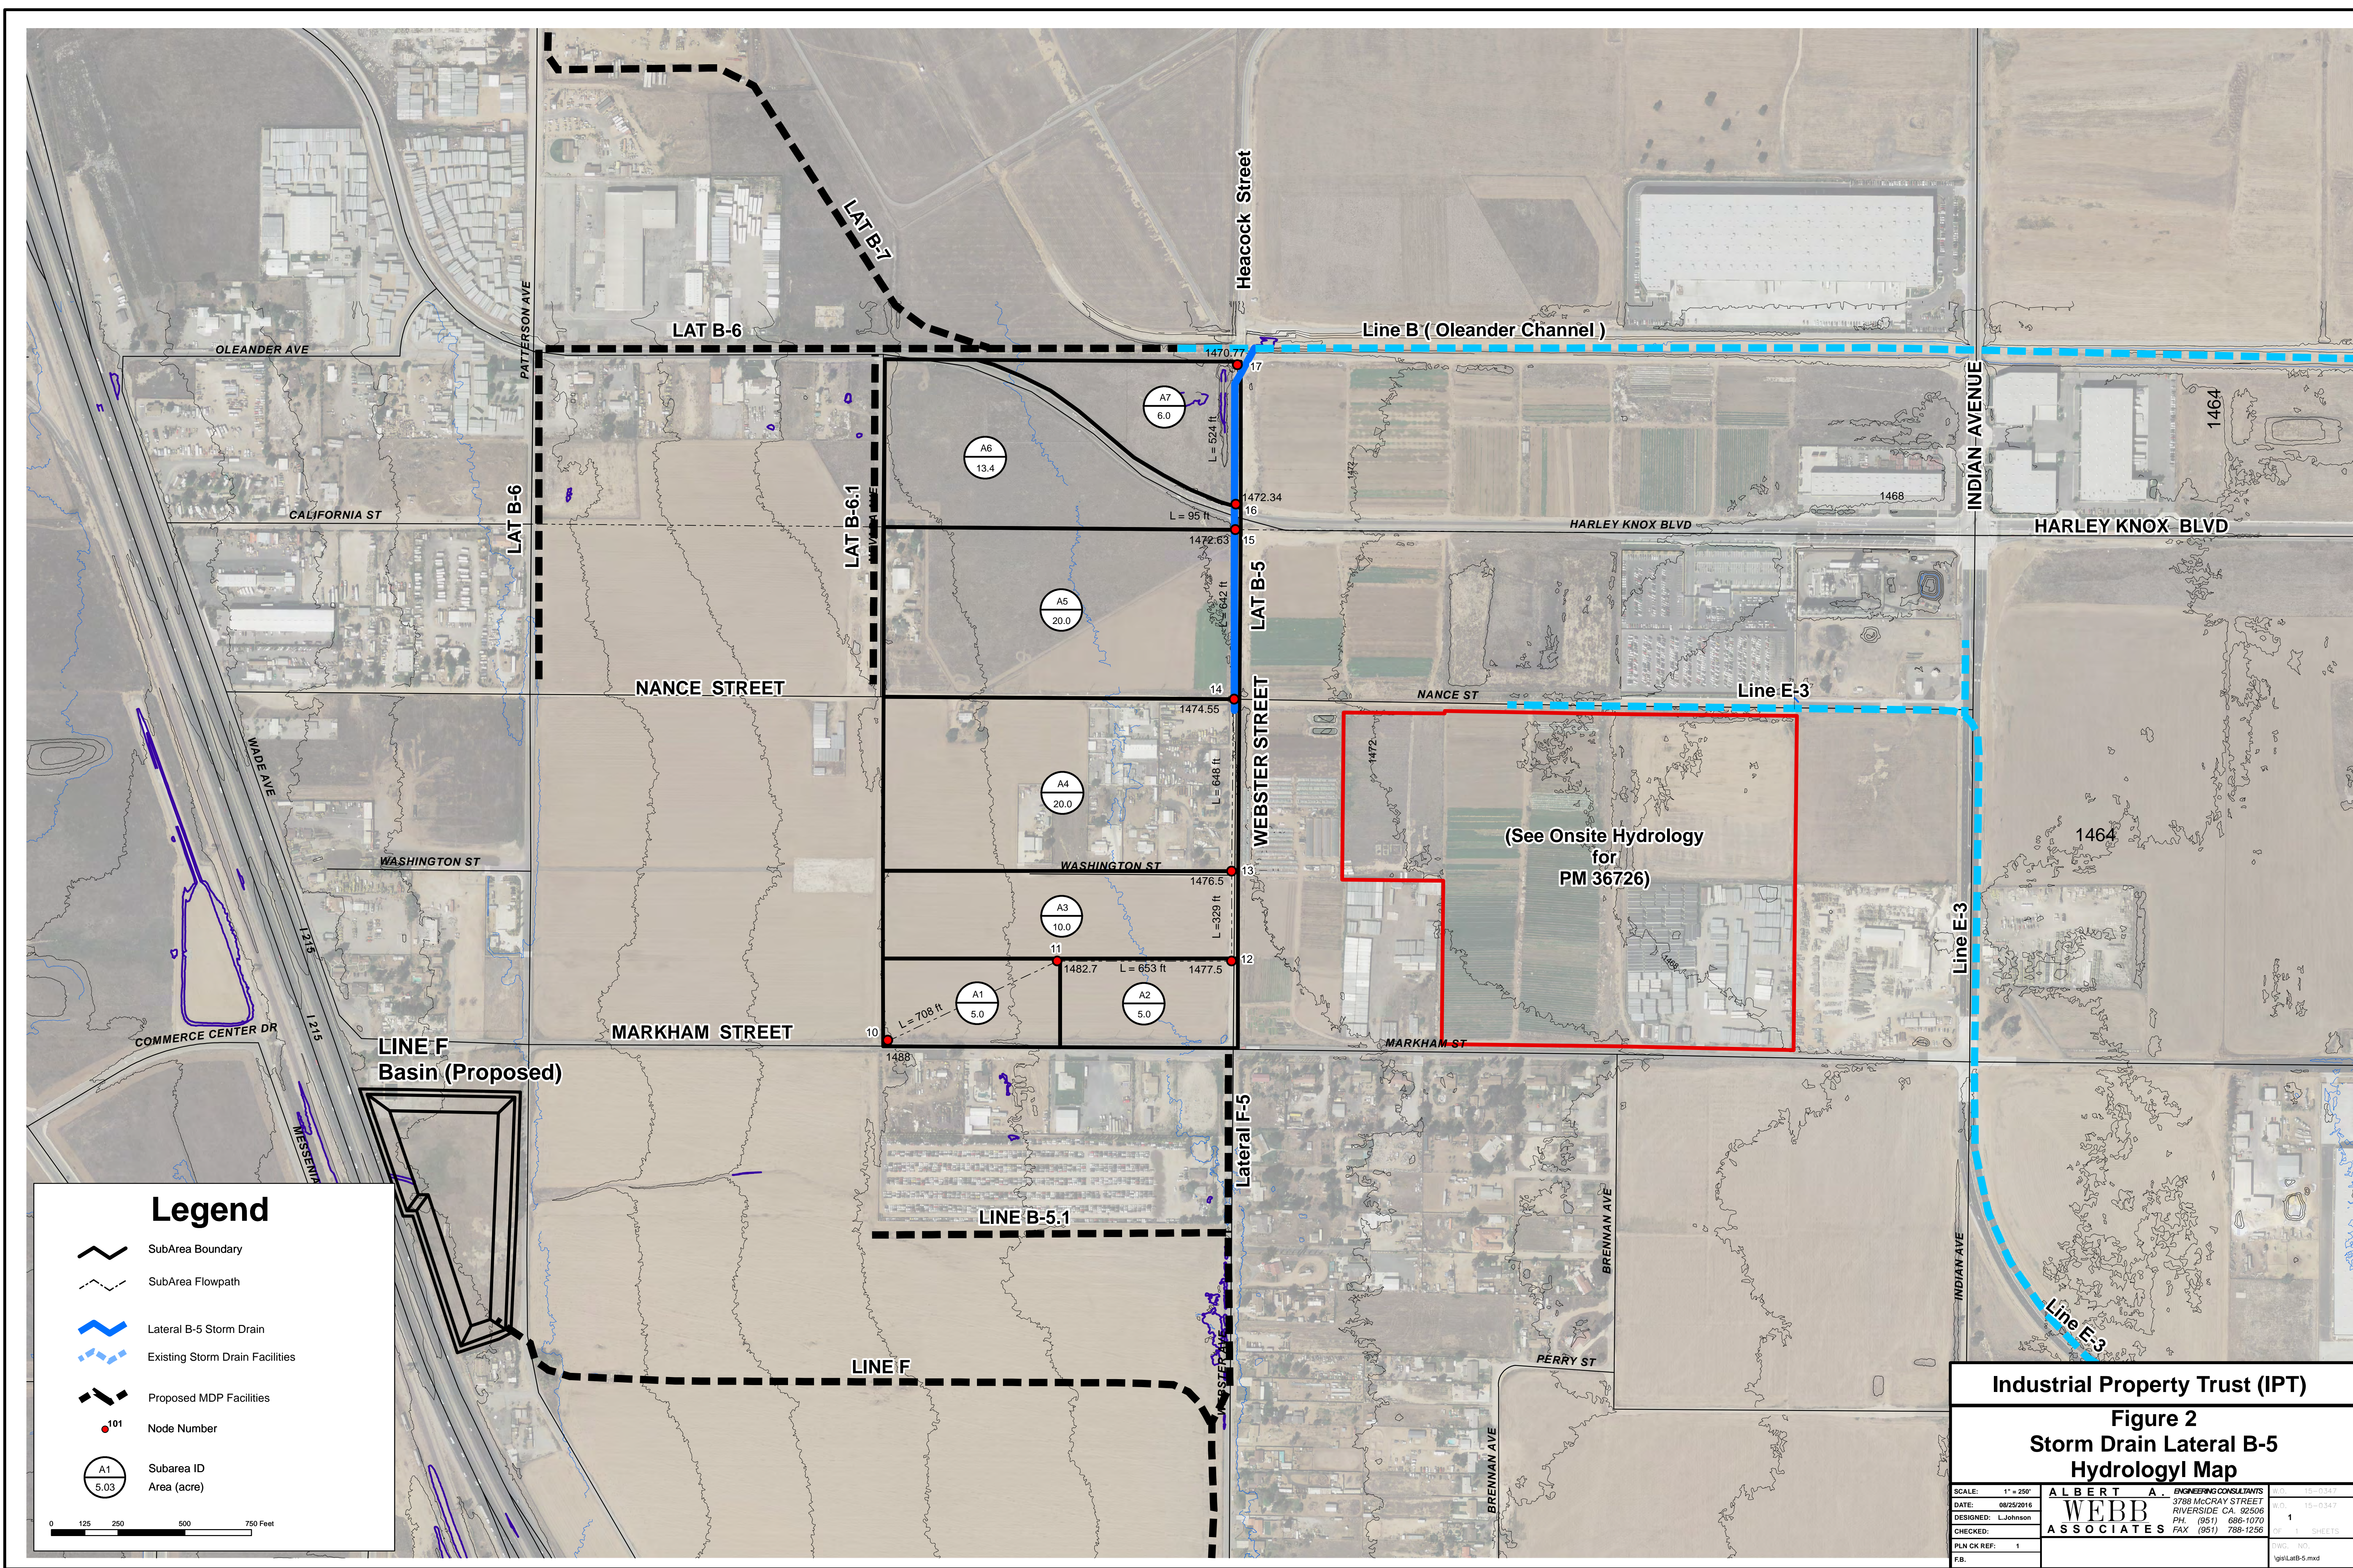

### Legend

- SubArea Boundary
- SubArea Flowpath
- Lateral B-5 Storm Drain
- Existing Storm Drain Facilities
- Proposed MDP Facilities
- Node Number
- Subarea ID  
Area (acre)

0 125 250 500 750 Feet

**Industrial Property Trust (IPT)**

**Figure 2**  
**Storm Drain Lateral B-5**  
**Hydrology Map**

SCALE: 1" = 250'	ALBERT A. ENGINEERING CONSULTANTS 3788 McCRAY STREET RIVERSIDE CA 92506 PH (951) 686-1070	S.C. 15-0347 S.C. 15-0347 1 OF 1 SHEETS
DATE: 08/25/2016	DESIGNED: L.Johnson	SHEET NO. 1
CHECKED:	PLN CR REF: 1	SHEET TITLE: IPT
F.B.	F.B.	F.B.

**NOTES TO USERS**

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where Base Flood Elevations (BFEs) and/or floodways have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations (BFEs) shown on this map apply only landward of 0.7 North American Vertical Datum of 1988 (NAVD 88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the floodways were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by flood control structures. Refer to Section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The projection used in the preparation of this map was Universal Transverse Mercator (UTM) zone 11. The horizontal datum was NAD83, GRS1980 spheroid. Differences in datum, spheroid, projection or State Plane zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the North American Vertical Datum of 1988. These flood elevations must be compared to structure and ground elevations referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services  
NOAA, NUNCS 12  
National Geodetic Survey  
SSMC-3, #6202  
1315 East-West Highway  
Silver Spring, Maryland 20910-3282  
(301) 713-3242

To obtain current elevation, description, and/or location information for bench marks shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base map information shown on this FIRM was derived from multiple sources including the Riverside County, CA effective database, and the National Geodetic Survey. Base map imagery for Riverside County, CA is a mosaic of the NAIP 2009 images, 1 meter resolution.

The "profile base lines" depicted on this map represent the hydraulic modeling baselines that match the flood profiles in the FIS report. As a result of improved topographic data, the "profile base line", in some cases, may deviate significantly from the channel centerline or appear outside the SFHA.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed Map Index for an overview map of the county showing the layout of map panels, community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.


For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products or the National Flood Insurance Program in general, please call the FEMA MAP Information eXchange at 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA Map Service Center website at <http://mssc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report and/or digital versions of this map. Many of these products can be ordered obtained directly from the website. Users may determine the current map data for each FIRM panel by visiting the FEMA Map Service Center website or by using the FEMA Map Information eXchange.

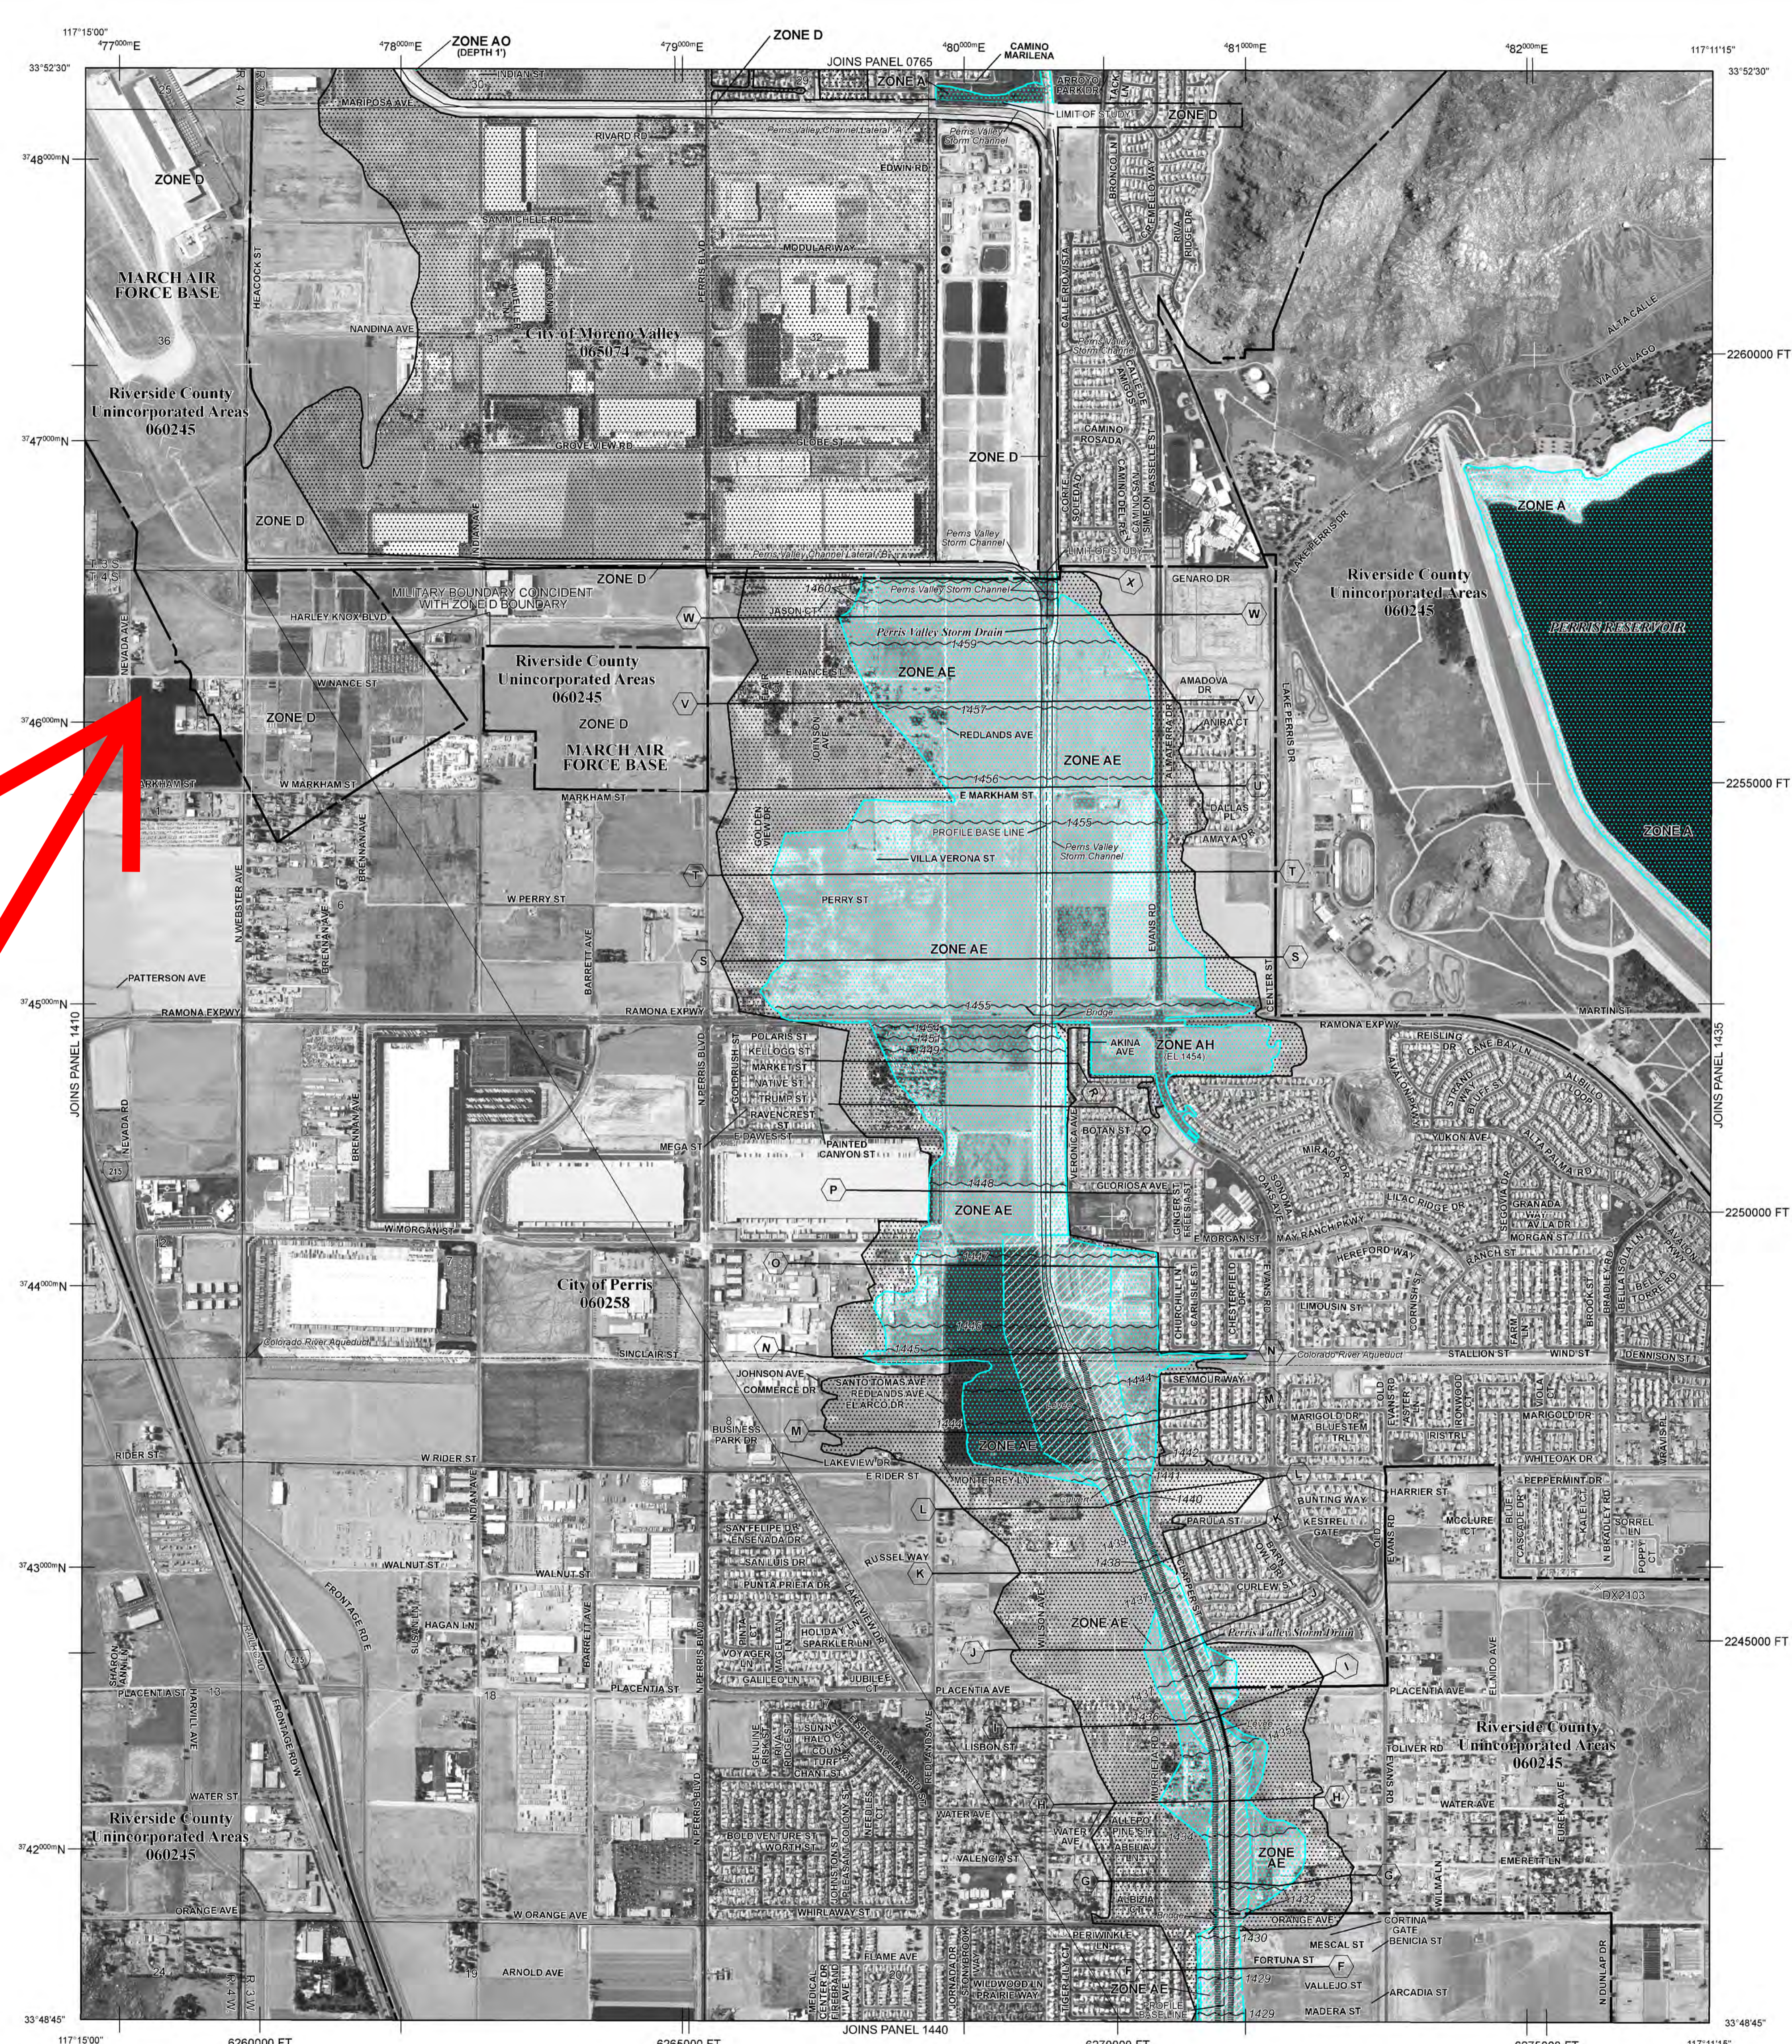

**LEGEND**

**SPECIAL FLOOD HAZARD AREAS SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD**

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equaled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

- ZONE A** No Base Flood Elevations determined.
- ZONE AE** Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR** Special Flood Hazard Area formerly protected from the 1% annual chance flood by a flood control system that was subsequently decertified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE A99** Areas to be protected from 1% annual chance flood event by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

**FLOODWAY AREAS IN ZONE AE**

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

**OTHER FLOOD AREAS**

- ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

**OTHER AREAS**

- ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.
- ZONE D** Areas in which flood hazards are undetermined, but possible.

**COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS**

**OTHERWISE PROTECTED AREAS (OPAs)**

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

- 1% annual chance floodplain boundary
- 0.2% annual chance floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary dividing Special Flood Hazard Area Zones and boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths, or flood velocities
- Base Flood Elevation line and value; elevation in feet\*
- Base Flood Elevation value where uniform within zone; elevation in feet\*

\* Referenced to the North American Vertical Datum of 1988

**Cross section line**

**Transect line**

Geographic coordinates referenced to the North American Datum of 1983 (NAD 83), Western Hemisphere

3000-meter Universal Transverse Mercator grid ticks, zone 11

5000-foot grid values; California State Plane coordinate system, Zone VI (FIPSZONE = 406), Lambert projection

Bench mark (see explanation in Notes to Users section of this FIRM panel)

**MAP REPOSITORIES**

Refer to Map Repositories List on Map Index

**EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP**


August 28, 2008

**EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL**

August 18, 2014; for a description of revisions, see Notice to Users page in the Flood Insurance Study report.

For community map revision history prior to countywide mapping, refer to the Community Map History table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.



**NATIONAL FLOOD INSURANCE PROGRAM**

**PANEL 1430H**

**FIRM**

**FLOOD INSURANCE RATE MAP**

**RIVERSIDE COUNTY, CALIFORNIA**

**AND INCORPORATED AREAS**

**PANEL 1430 OF 3805**

(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

**CONTAINS:**


COMMUNITY	NUMBER	PANEL	SUFFIX
MORENO VALLEY, CITY OF	065074	1430	H
PERRIS, CITY OF	060258	1430	H
RIVERSIDE COUNTY, UNINCORPORATED AREAS	060245	1430	H

Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.

**MAP NUMBER 06065C1430H**

**MAP REVISED AUGUST 18, 2014**

**Federal Emergency Management Agency**

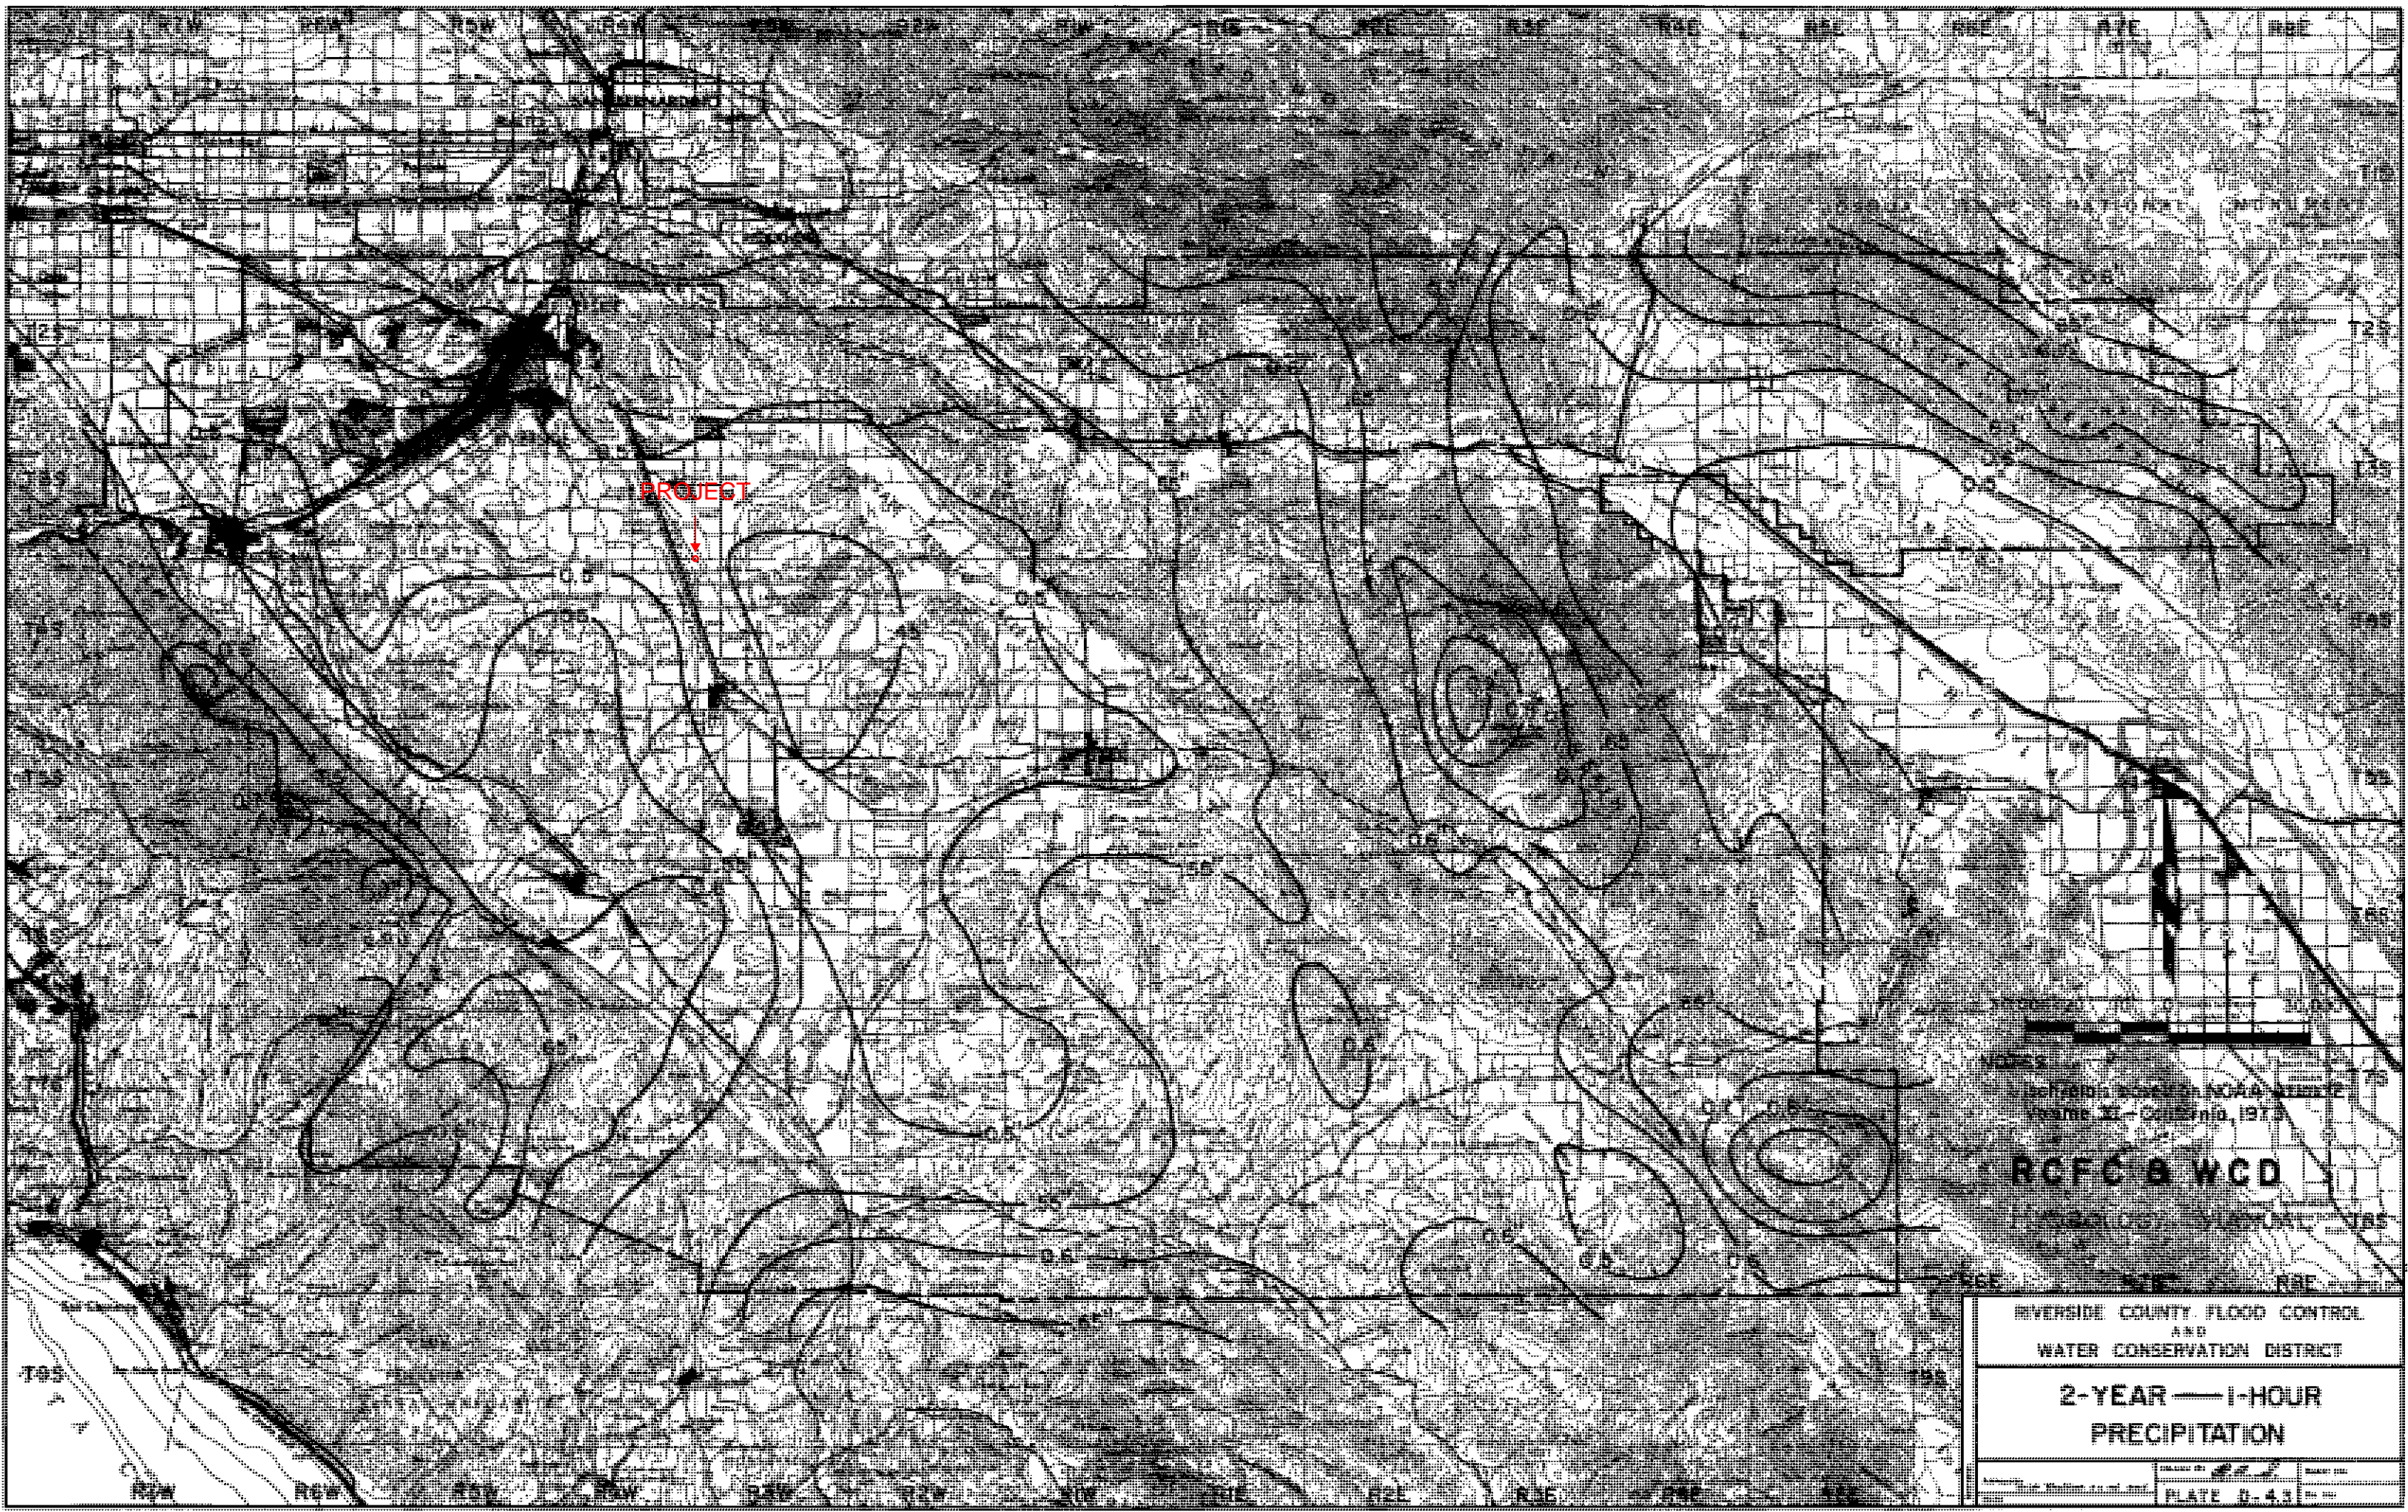

PROJECT



NOTES:  
1. Contour interval 100 feet  
2. Contour lines are shown in black  
3. Contour lines are based on U.S.G.S. 7.5 minute topographic maps, 1974


**RCFC & WCD**

RIVERSIDE COUNTY FLOOD CONTROL AND WATER CONSERVATION DISTRICT

RIVERSIDE COUNTY FLOOD CONTROL AND WATER CONSERVATION DISTRICT

**2-YEAR — 1-HOUR  
PRECIPITATION**

PLATE D-43

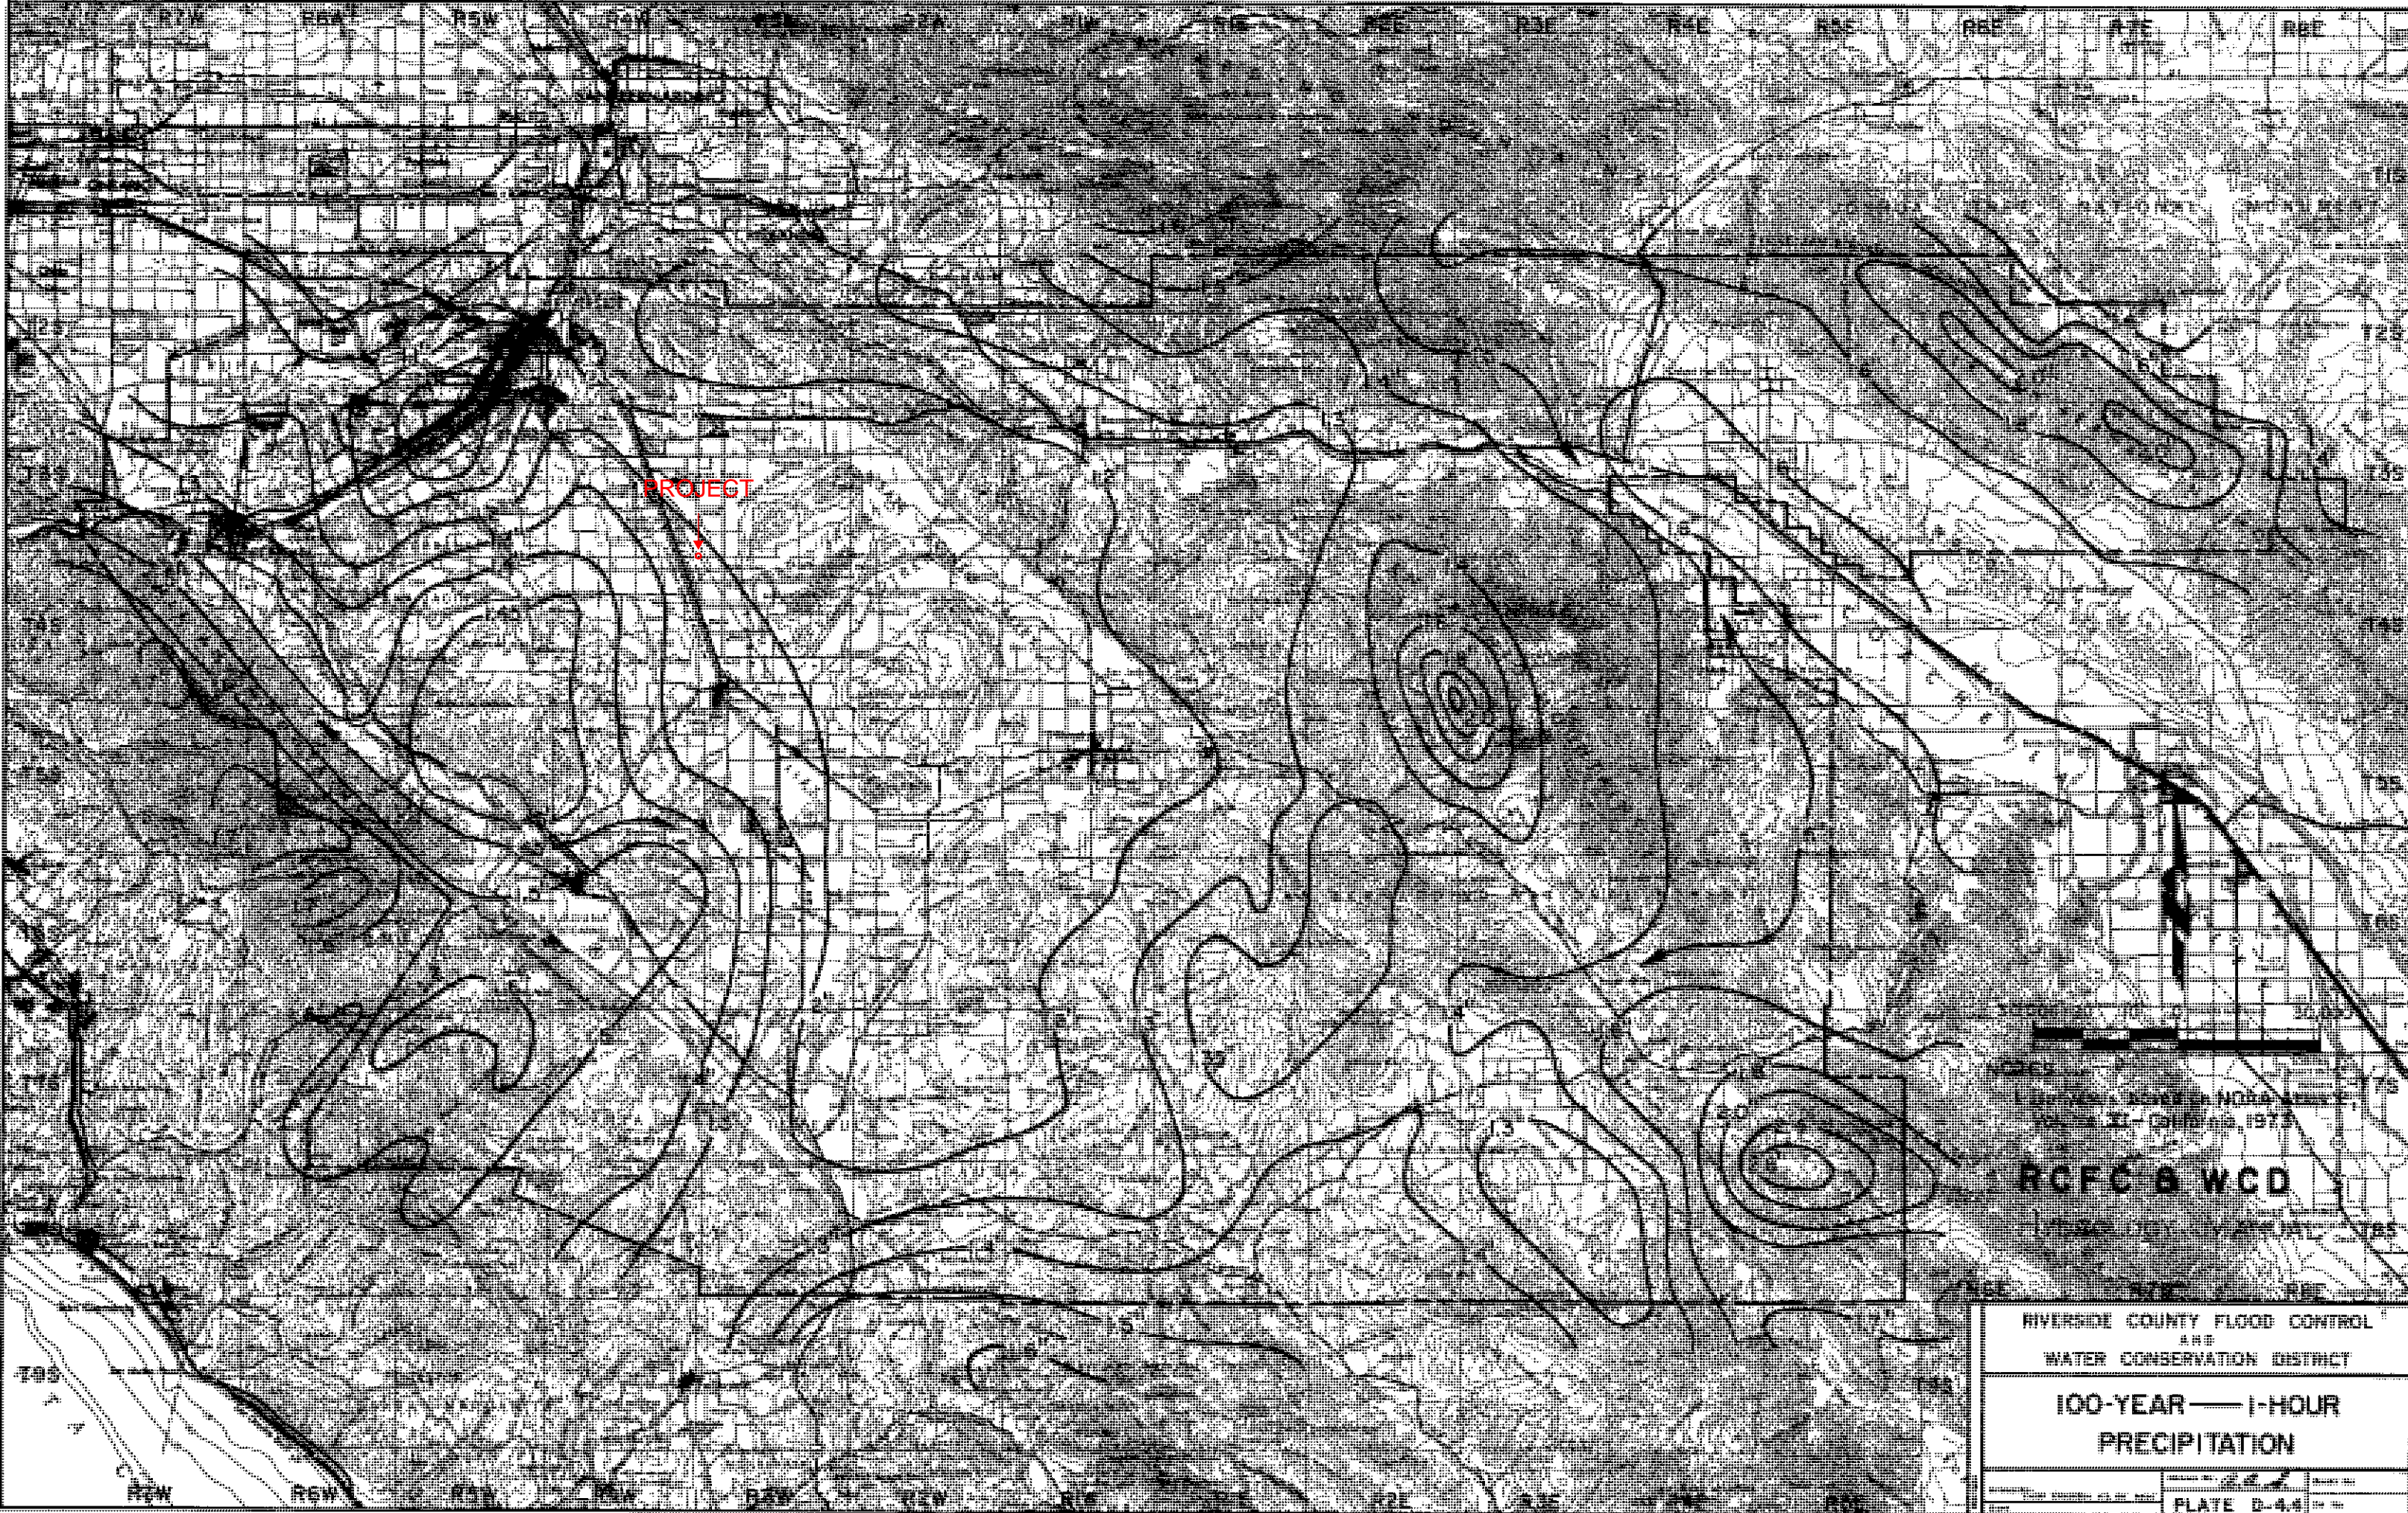

PROJECT



REVISIONS AND NOTES  
NO. 11 - 08/19/75

RCFC & WCD


100-YEAR - 1-HOUR PRECIPITATION

RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

100-YEAR - 1-HOUR  
PRECIPITATION

PLATE D-4.4



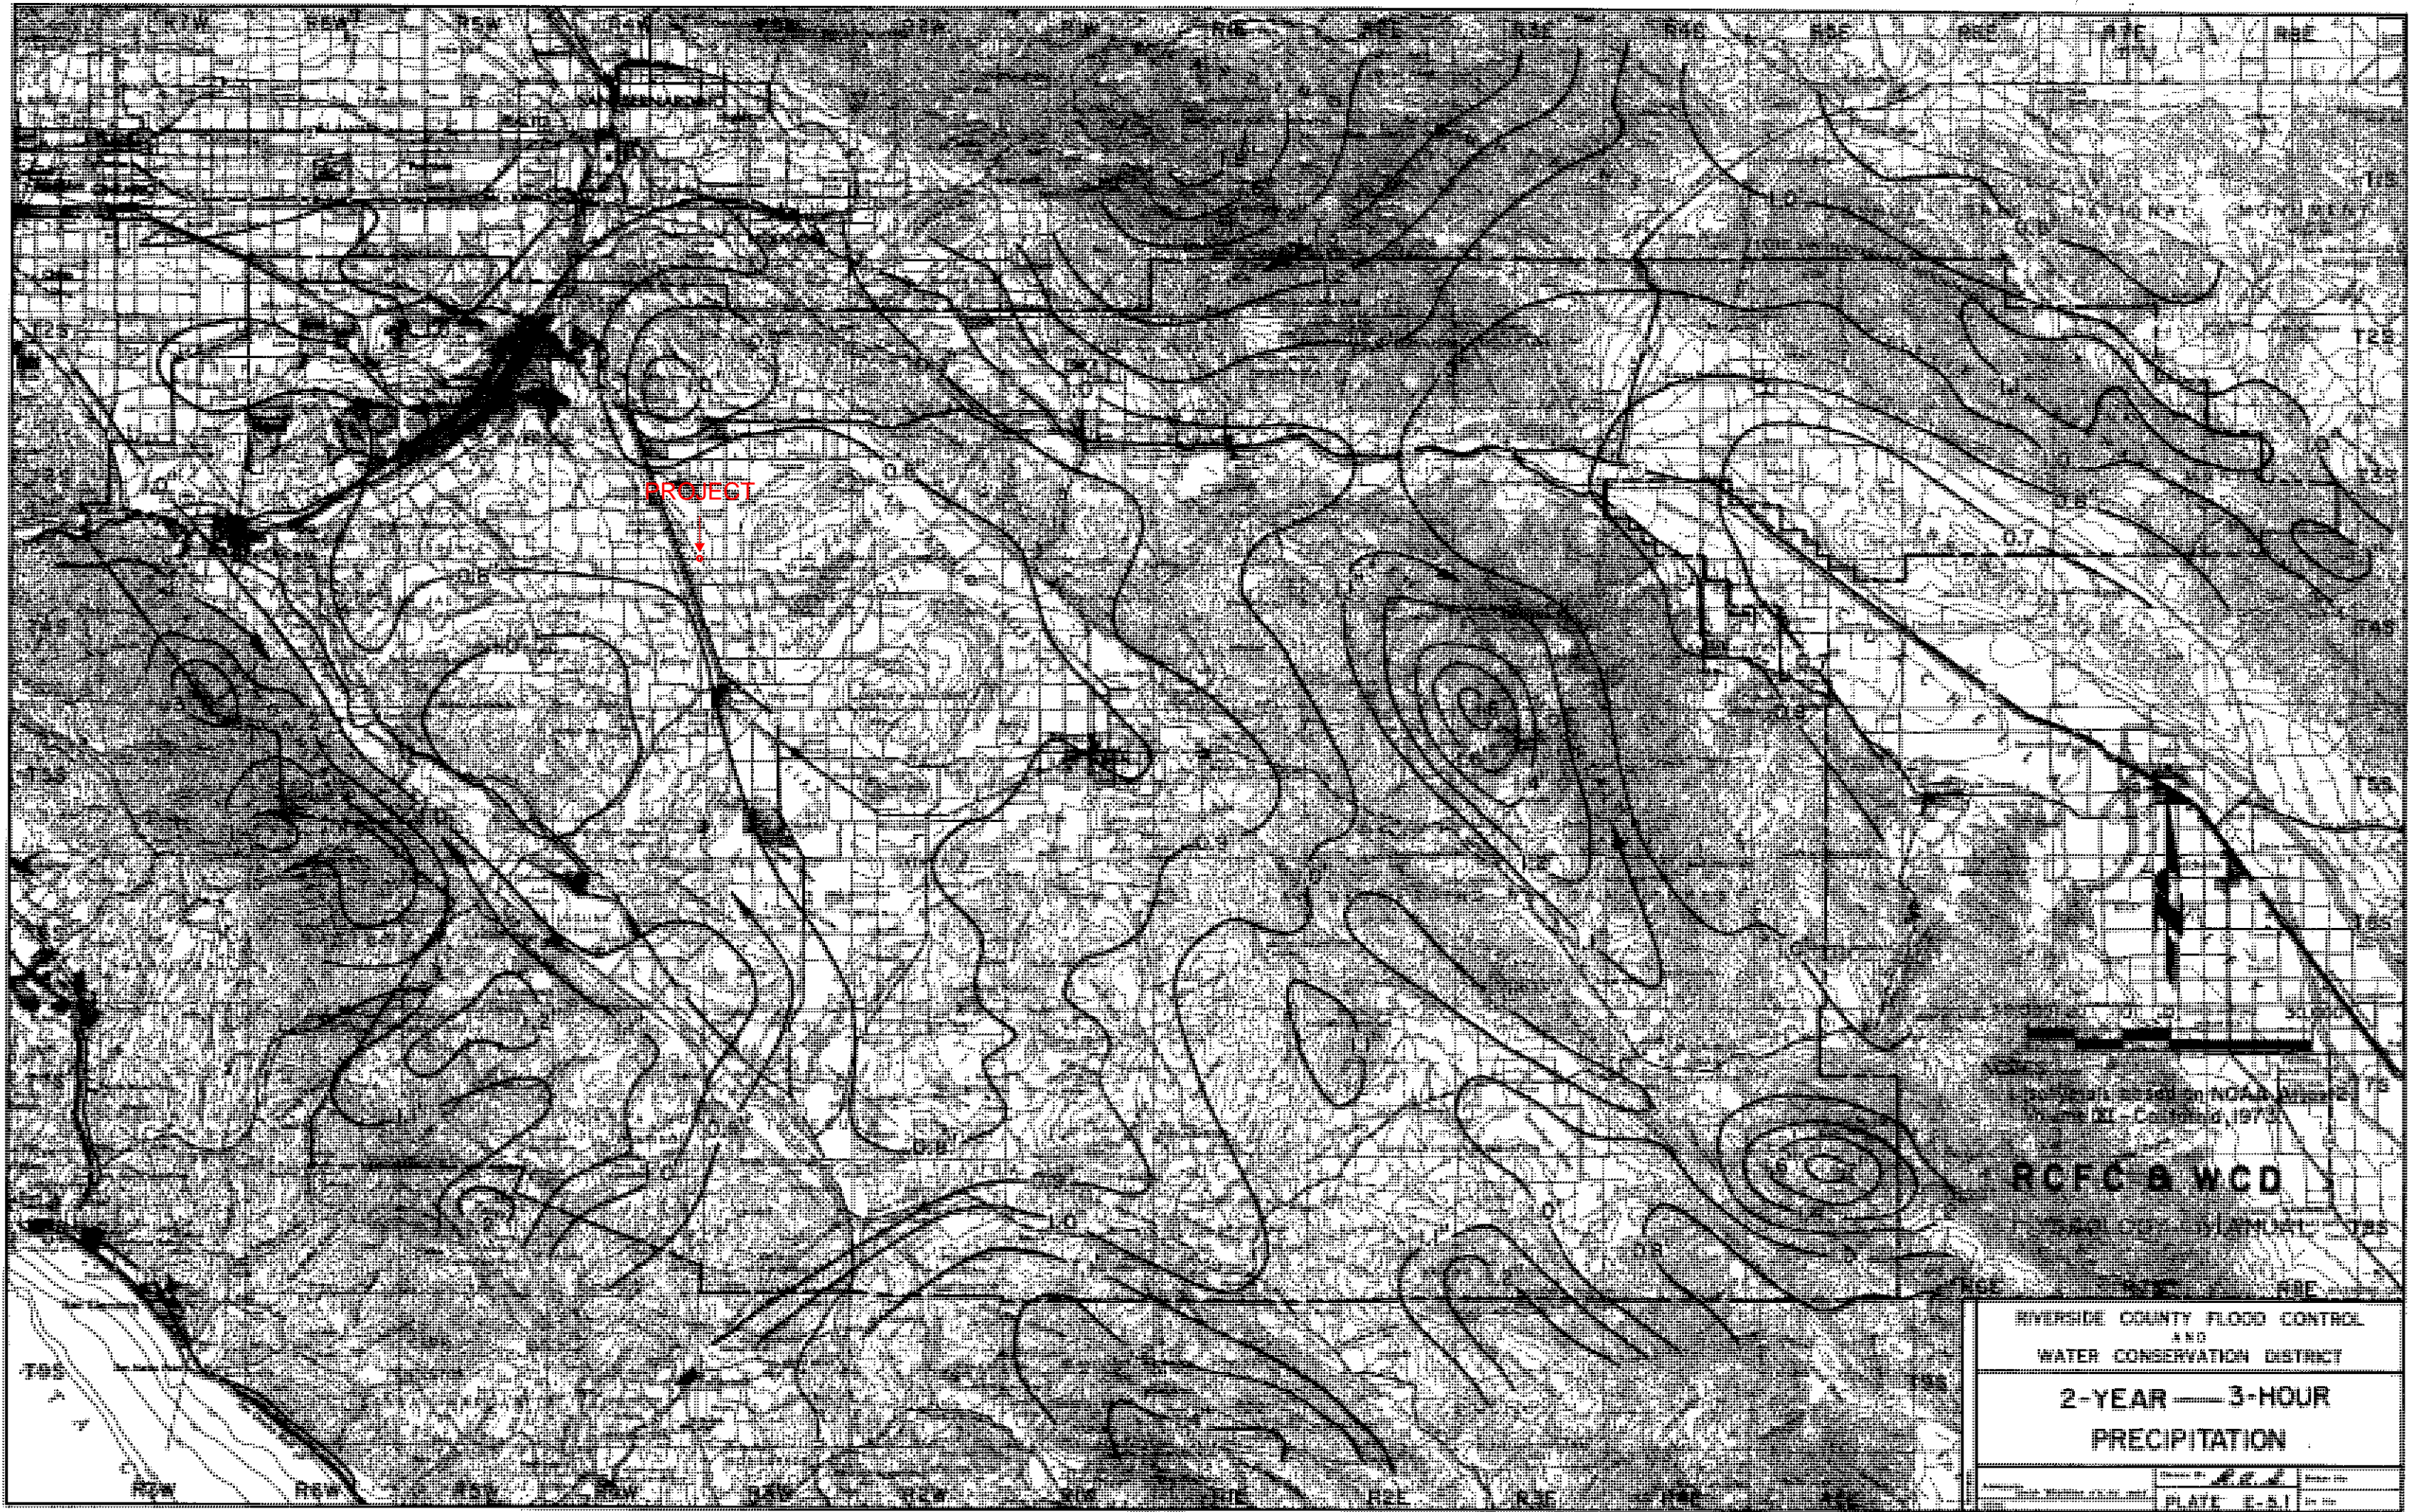

PROJECT




Topographic map based on NOAA Aerial Photographs  
and USGS Contours, 1970.

RCFC & WCD  
RIVERSIDE COUNTY FLOOD CONTROL  
AND WATER CONSERVATION DISTRICT

RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

2-YEAR — 3-HOUR  
PRECIPITATION

PLATE E-51

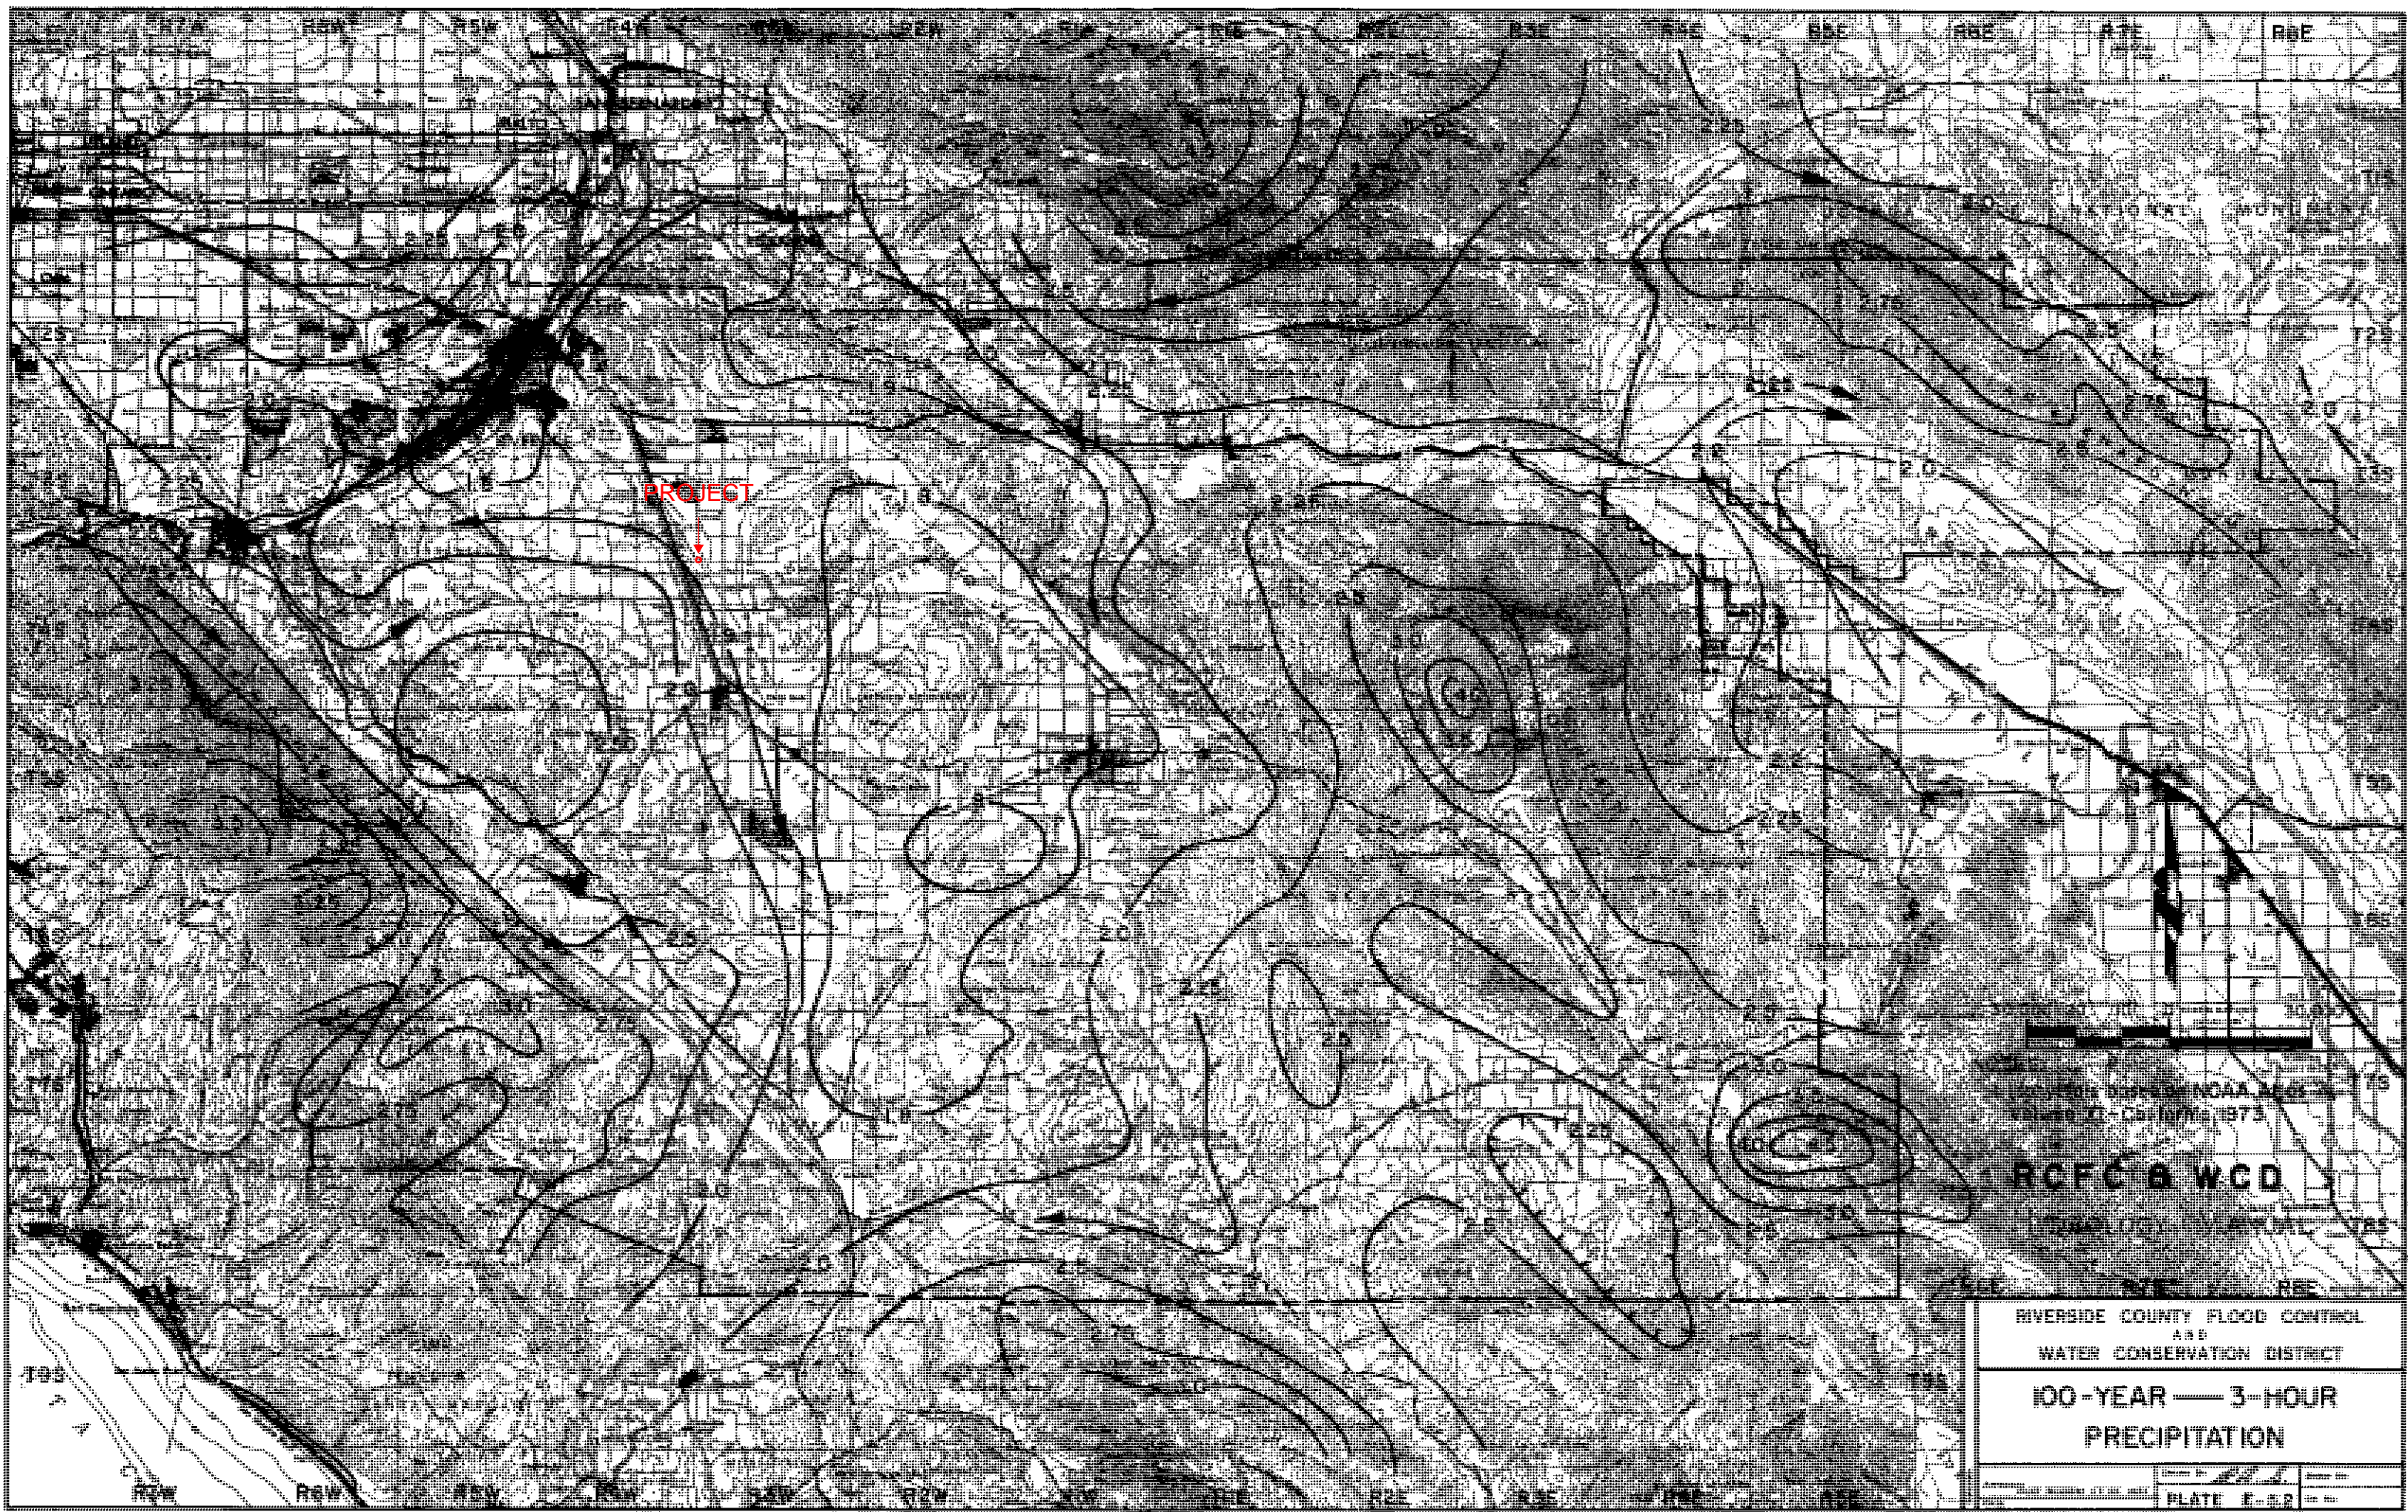

PROJECT




U.S. GEOLOGICAL SURVEY  
NATIONAL CENTER FOR  
HYDROLOGIC INFORMATION  
1225 NORTH FIRST STREET  
FEDERAL CENTER BUILDING  
DENVER, COLORADO 80202

RCFC & WCD

RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

100-YEAR — 3-HOUR  
PRECIPITATION

PLATE E-02

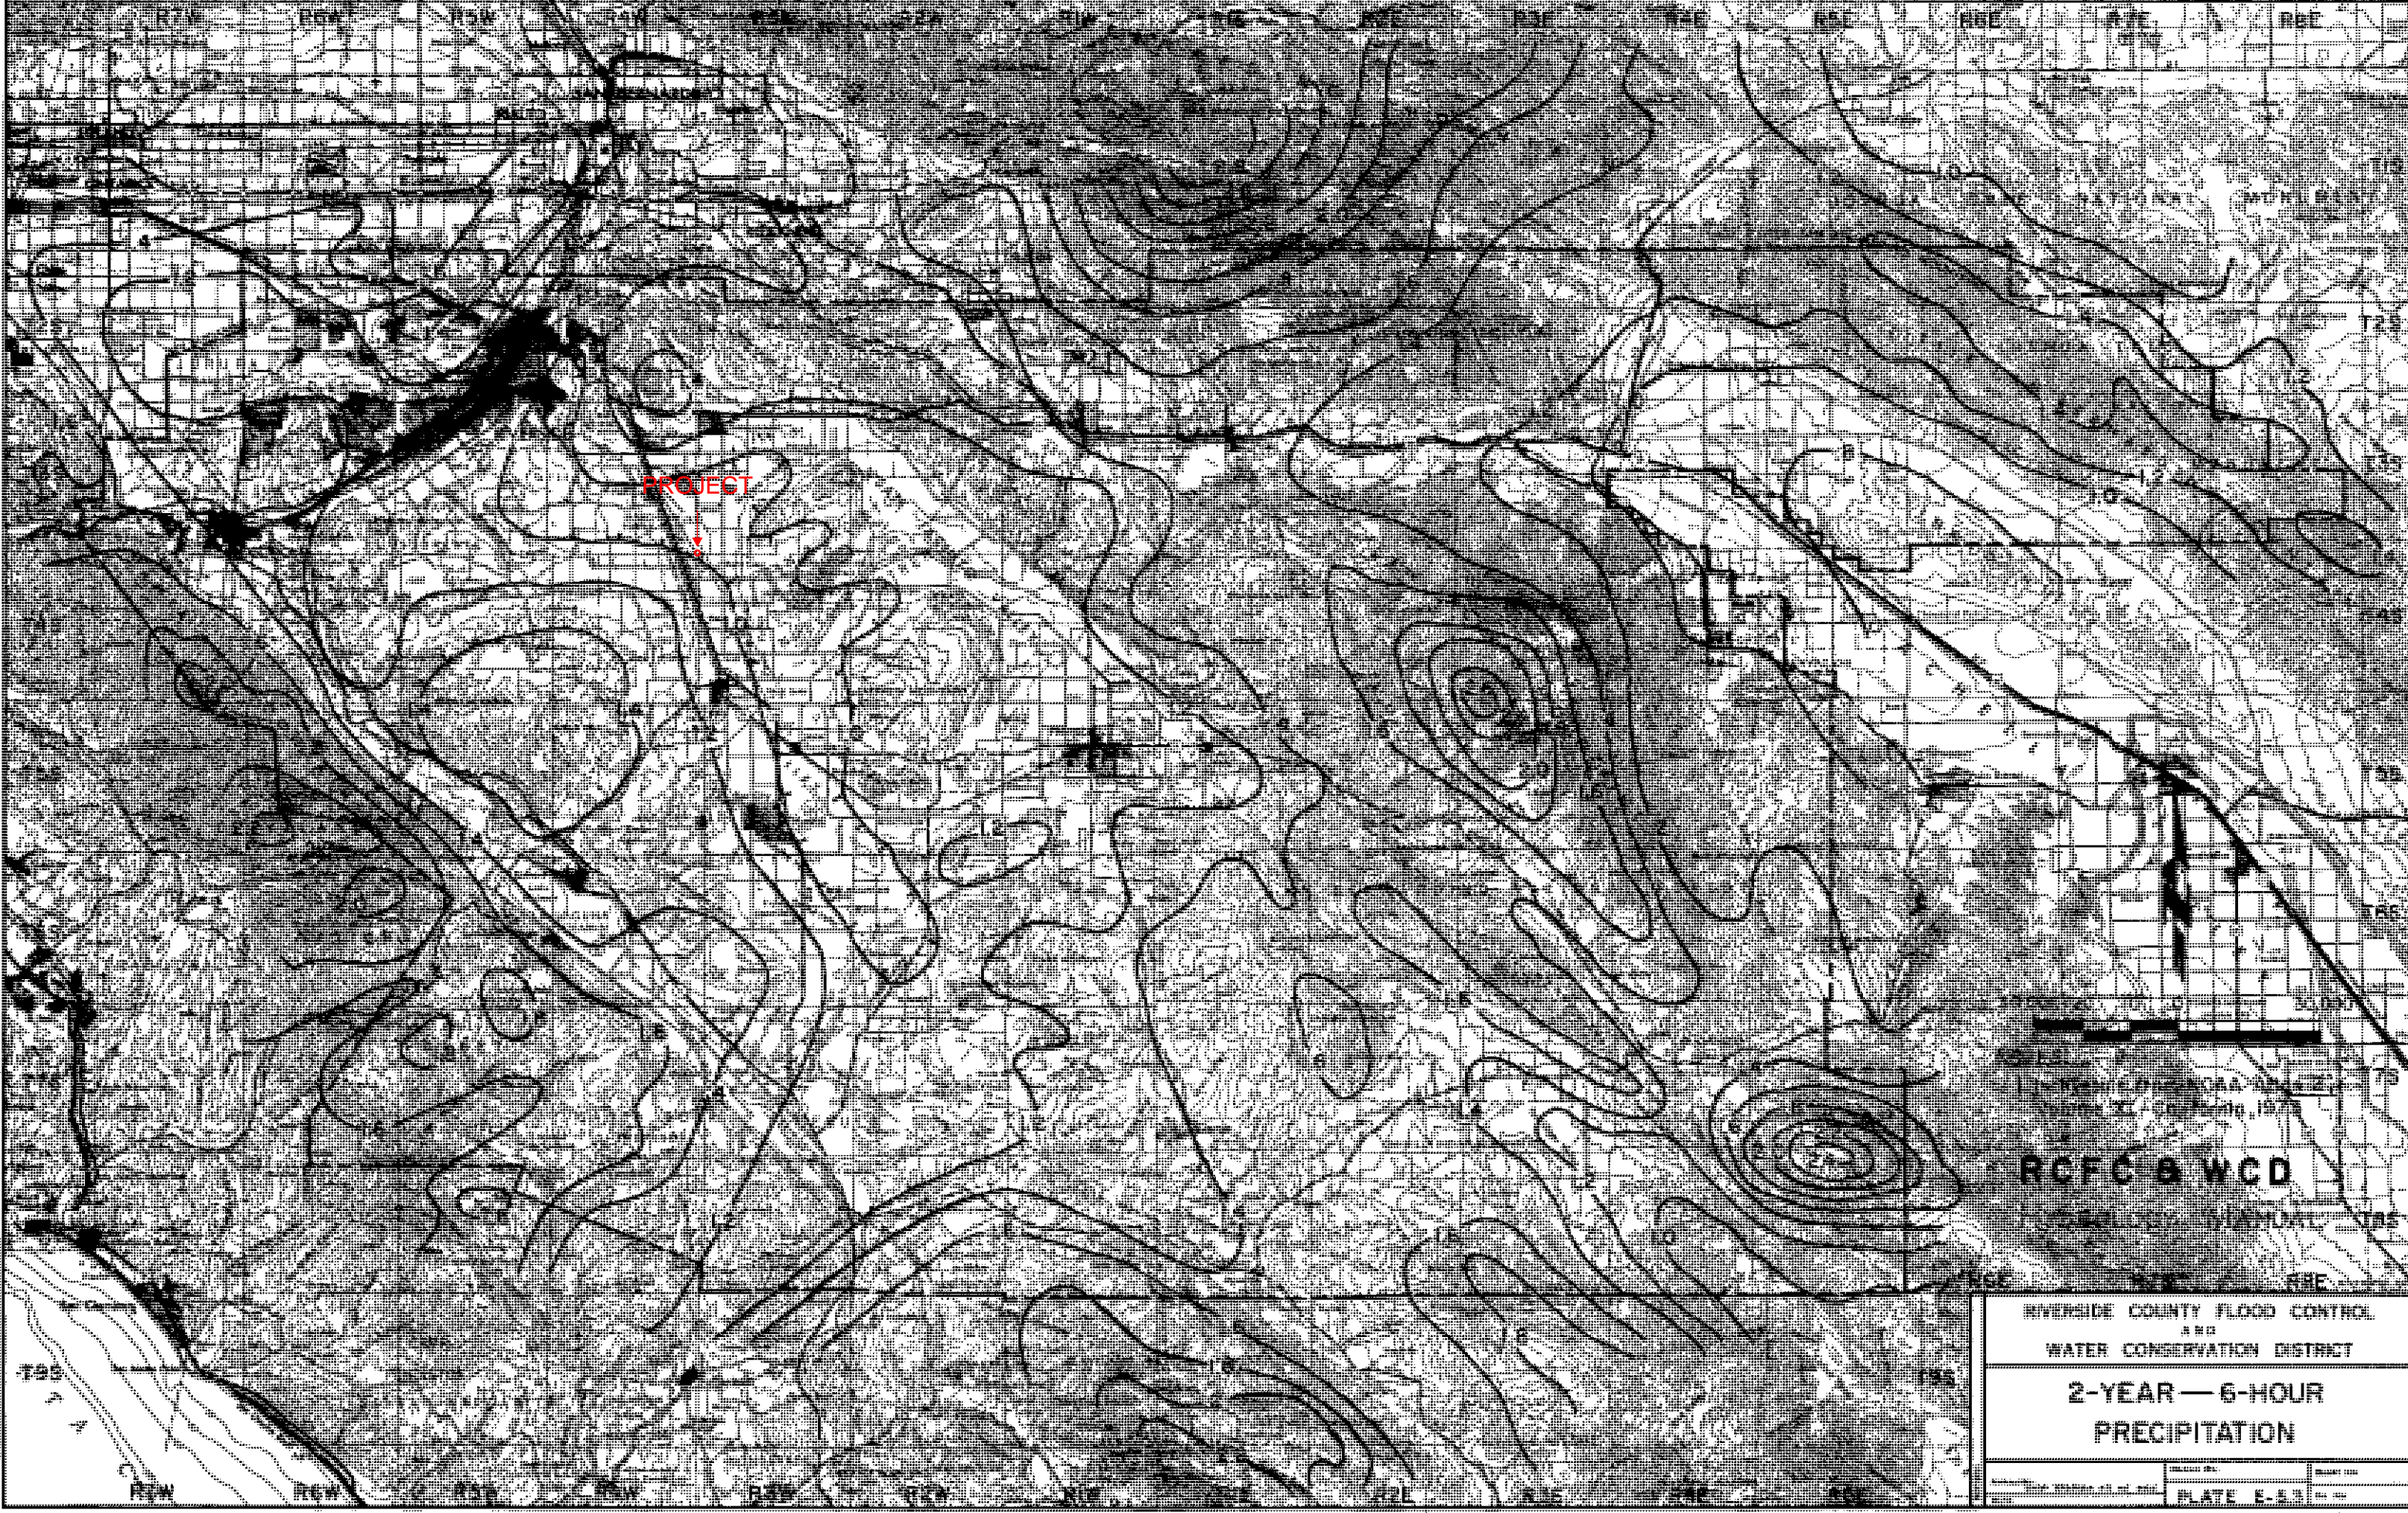


PROJECT

RCFC & WCD

RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

2-YEAR — 6-HOUR  
PRECIPITATION

PLATE E-53

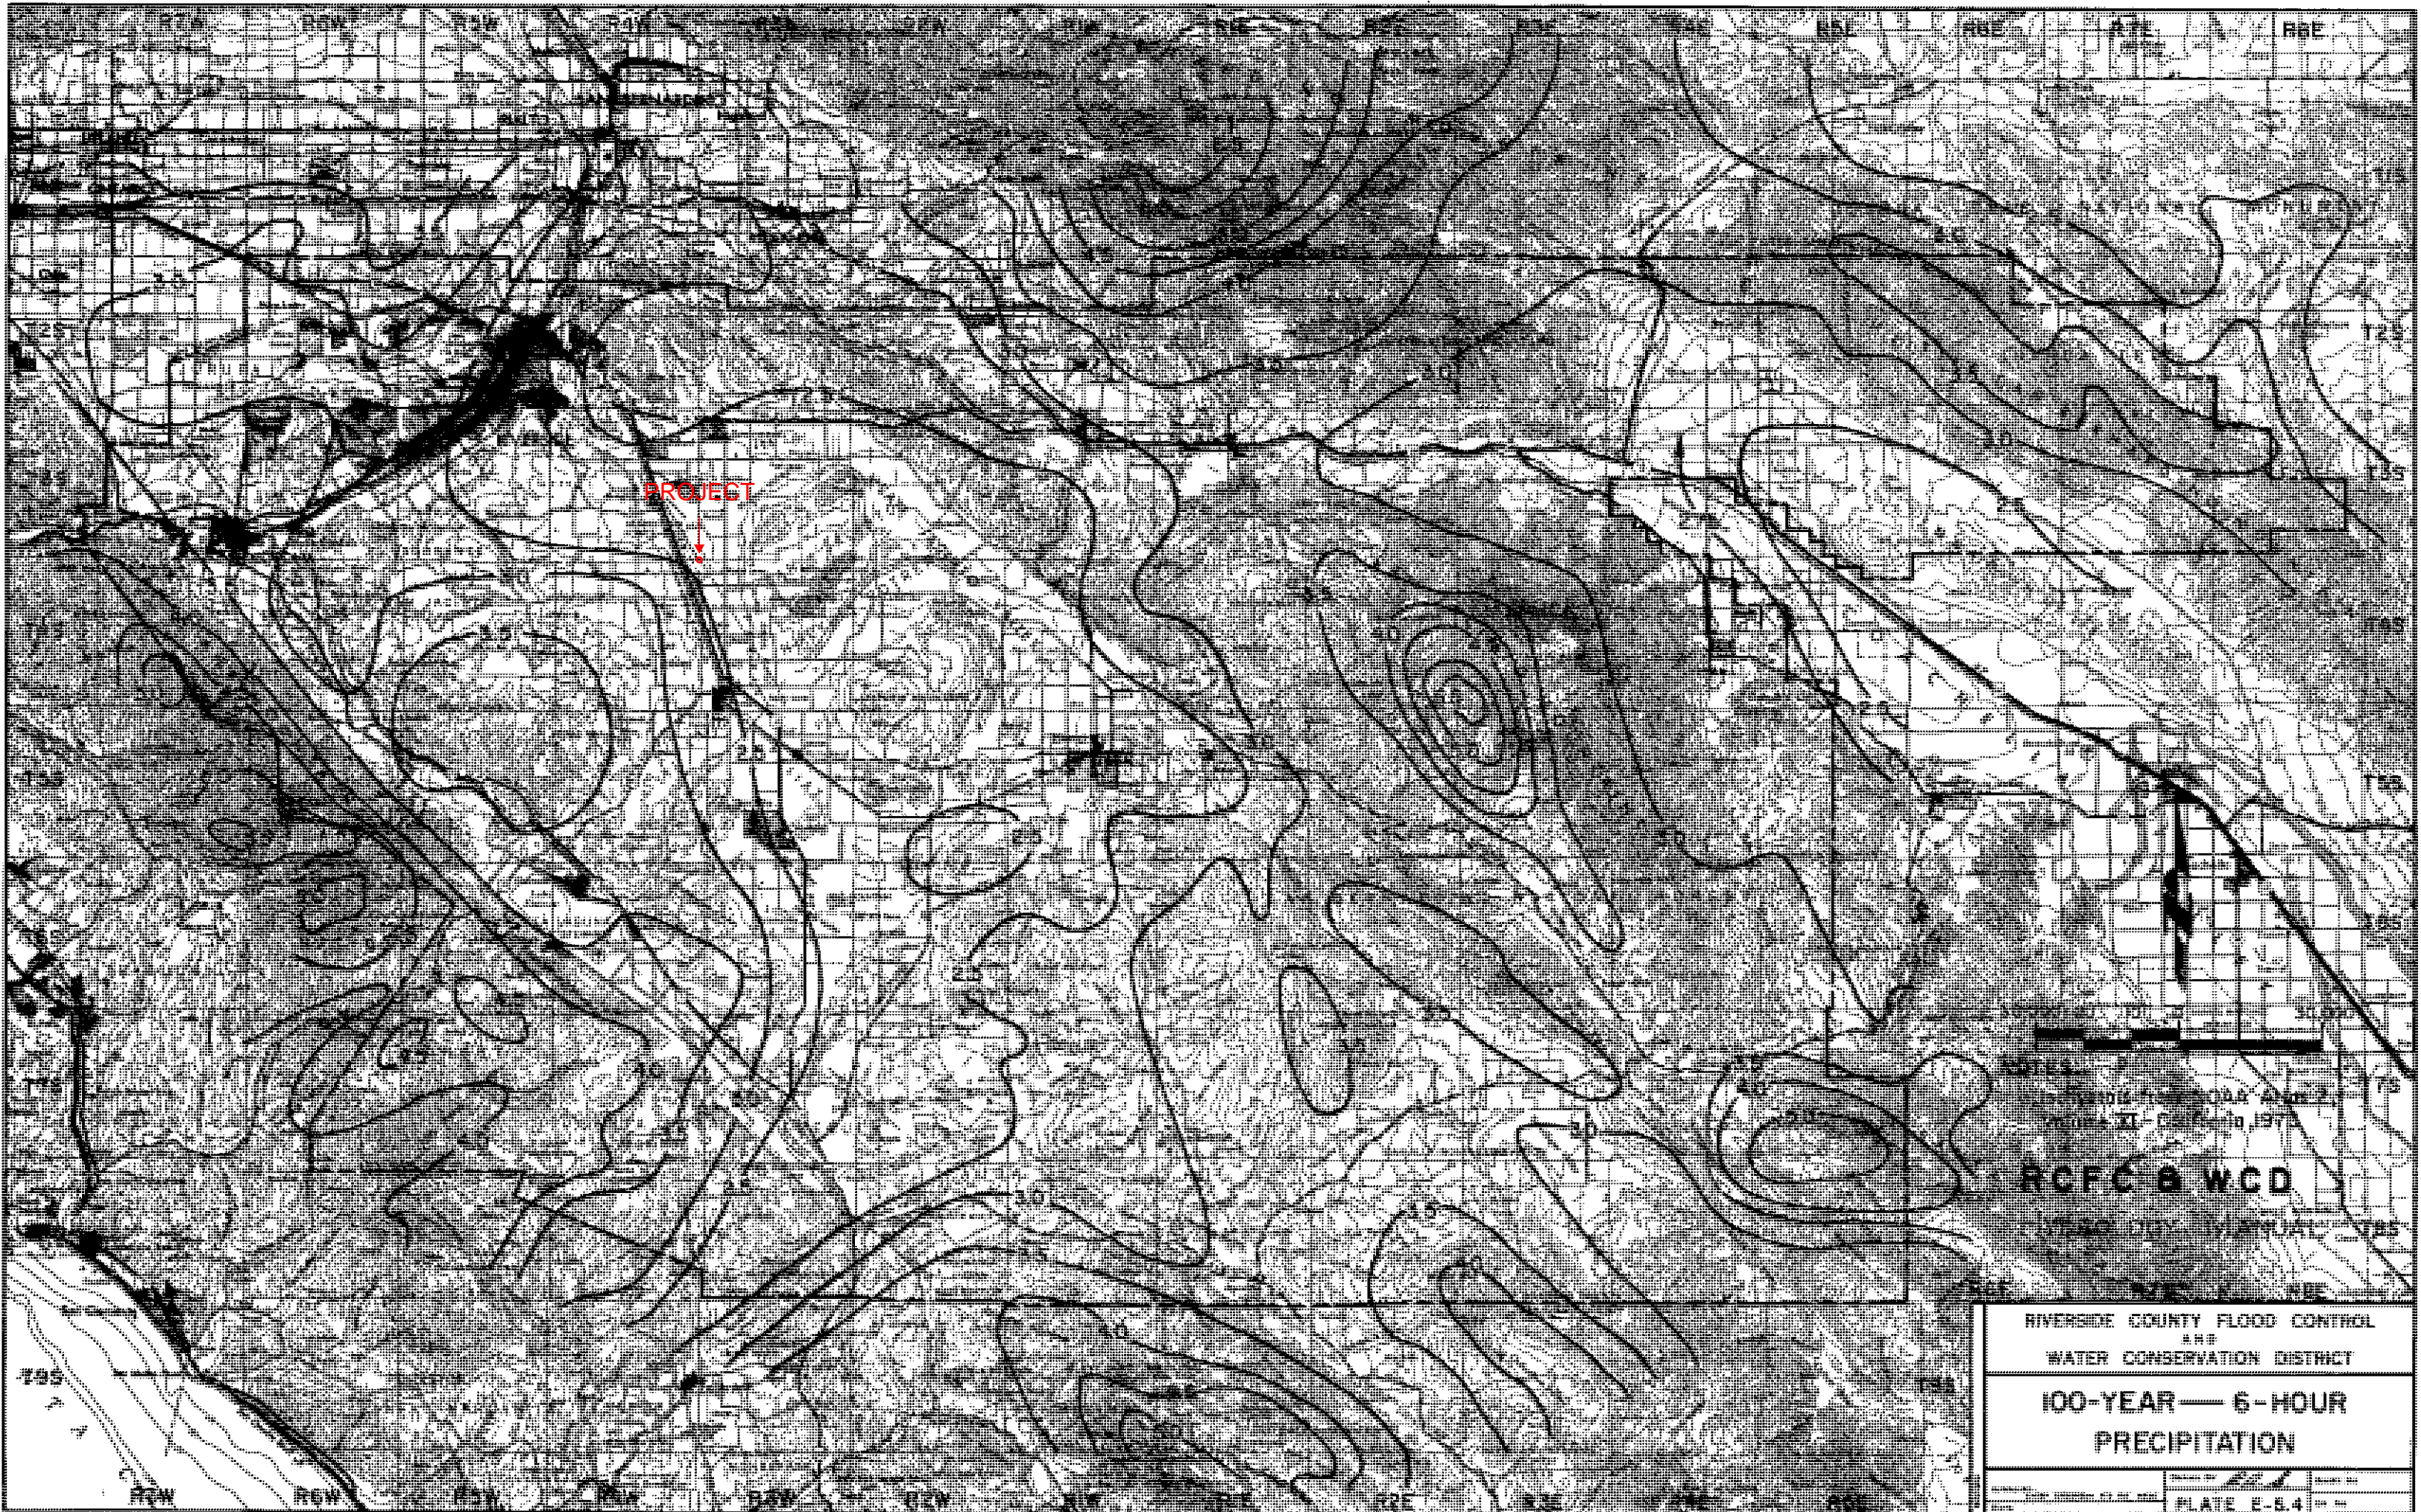

PROJECT




SCALE  
1" = 1000'  
1971

RCFC & WCD

100-YEAR 6-HOUR PRECIPITATION

RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

100-YEAR — 6-HOUR  
PRECIPITATION

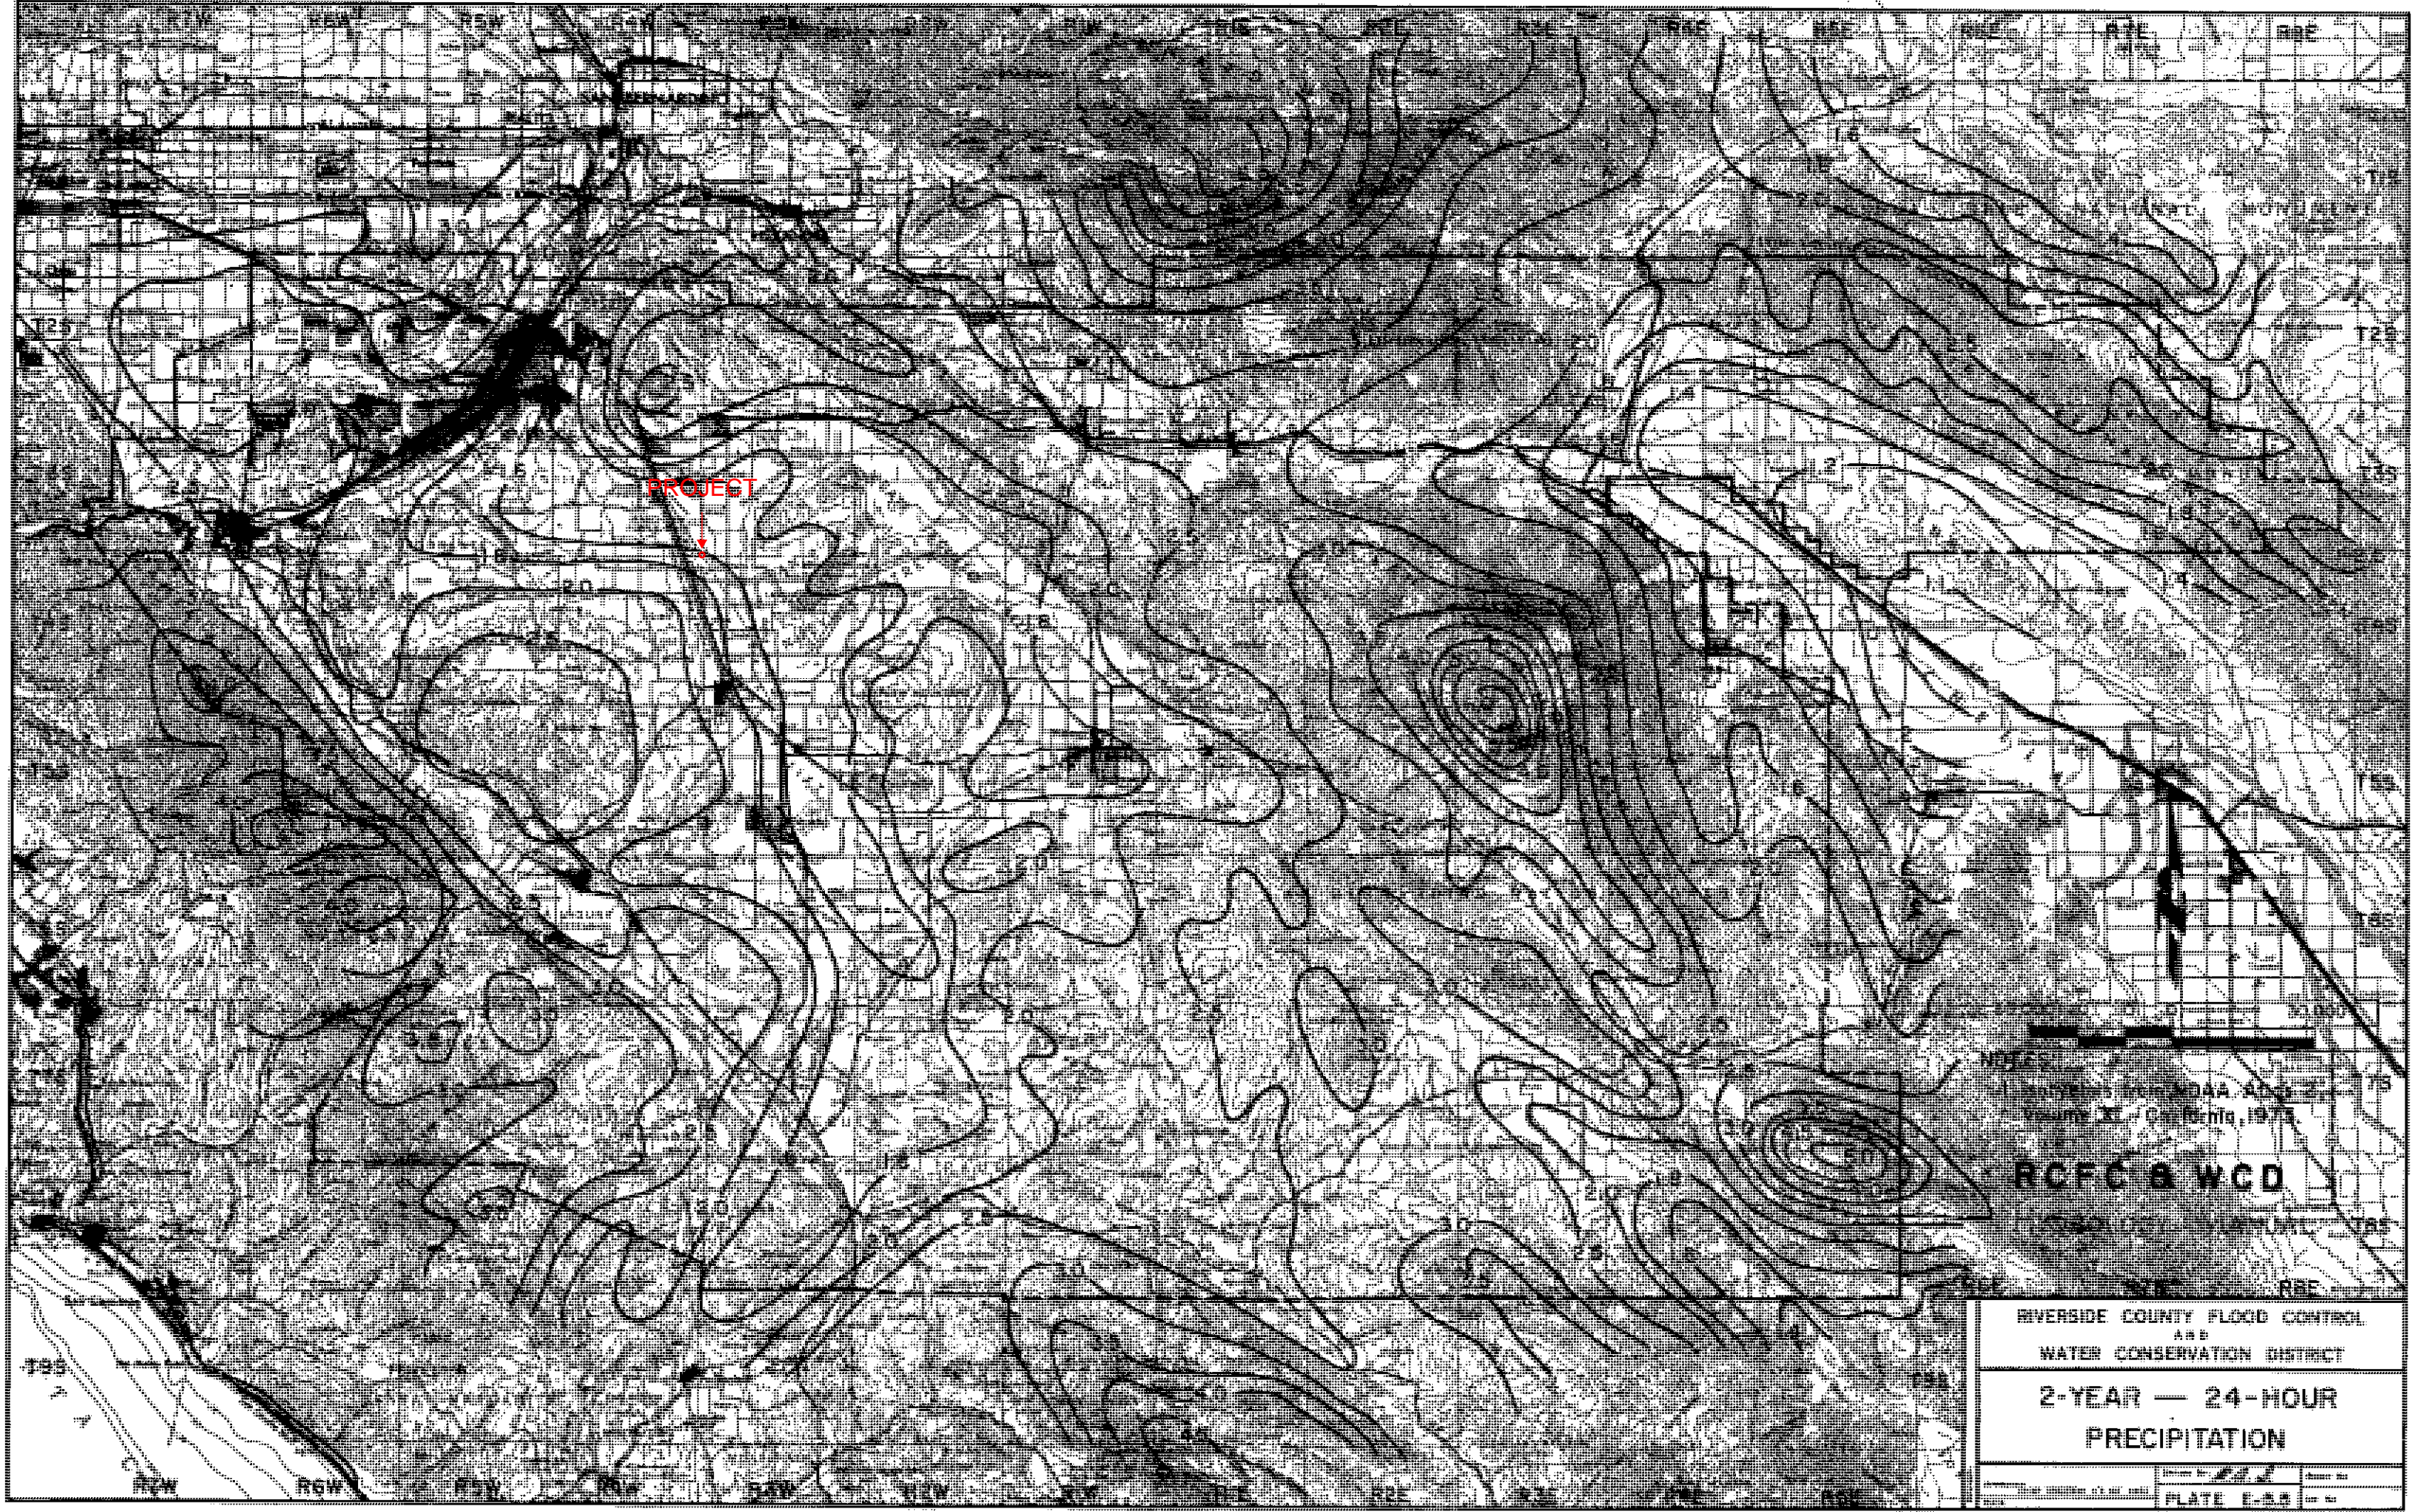

PROJECT


NOTES:  
1. Contours are based on data from the  
United States Geological Survey,  
Volume 10, California, 1971.

RCFC & WCD

RIVERSIDE COUNTY FLOOD CONTROL  
&  
WATER CONSERVATION DISTRICT

2-YEAR — 24-HOUR  
PRECIPITATION

PLATE E-55

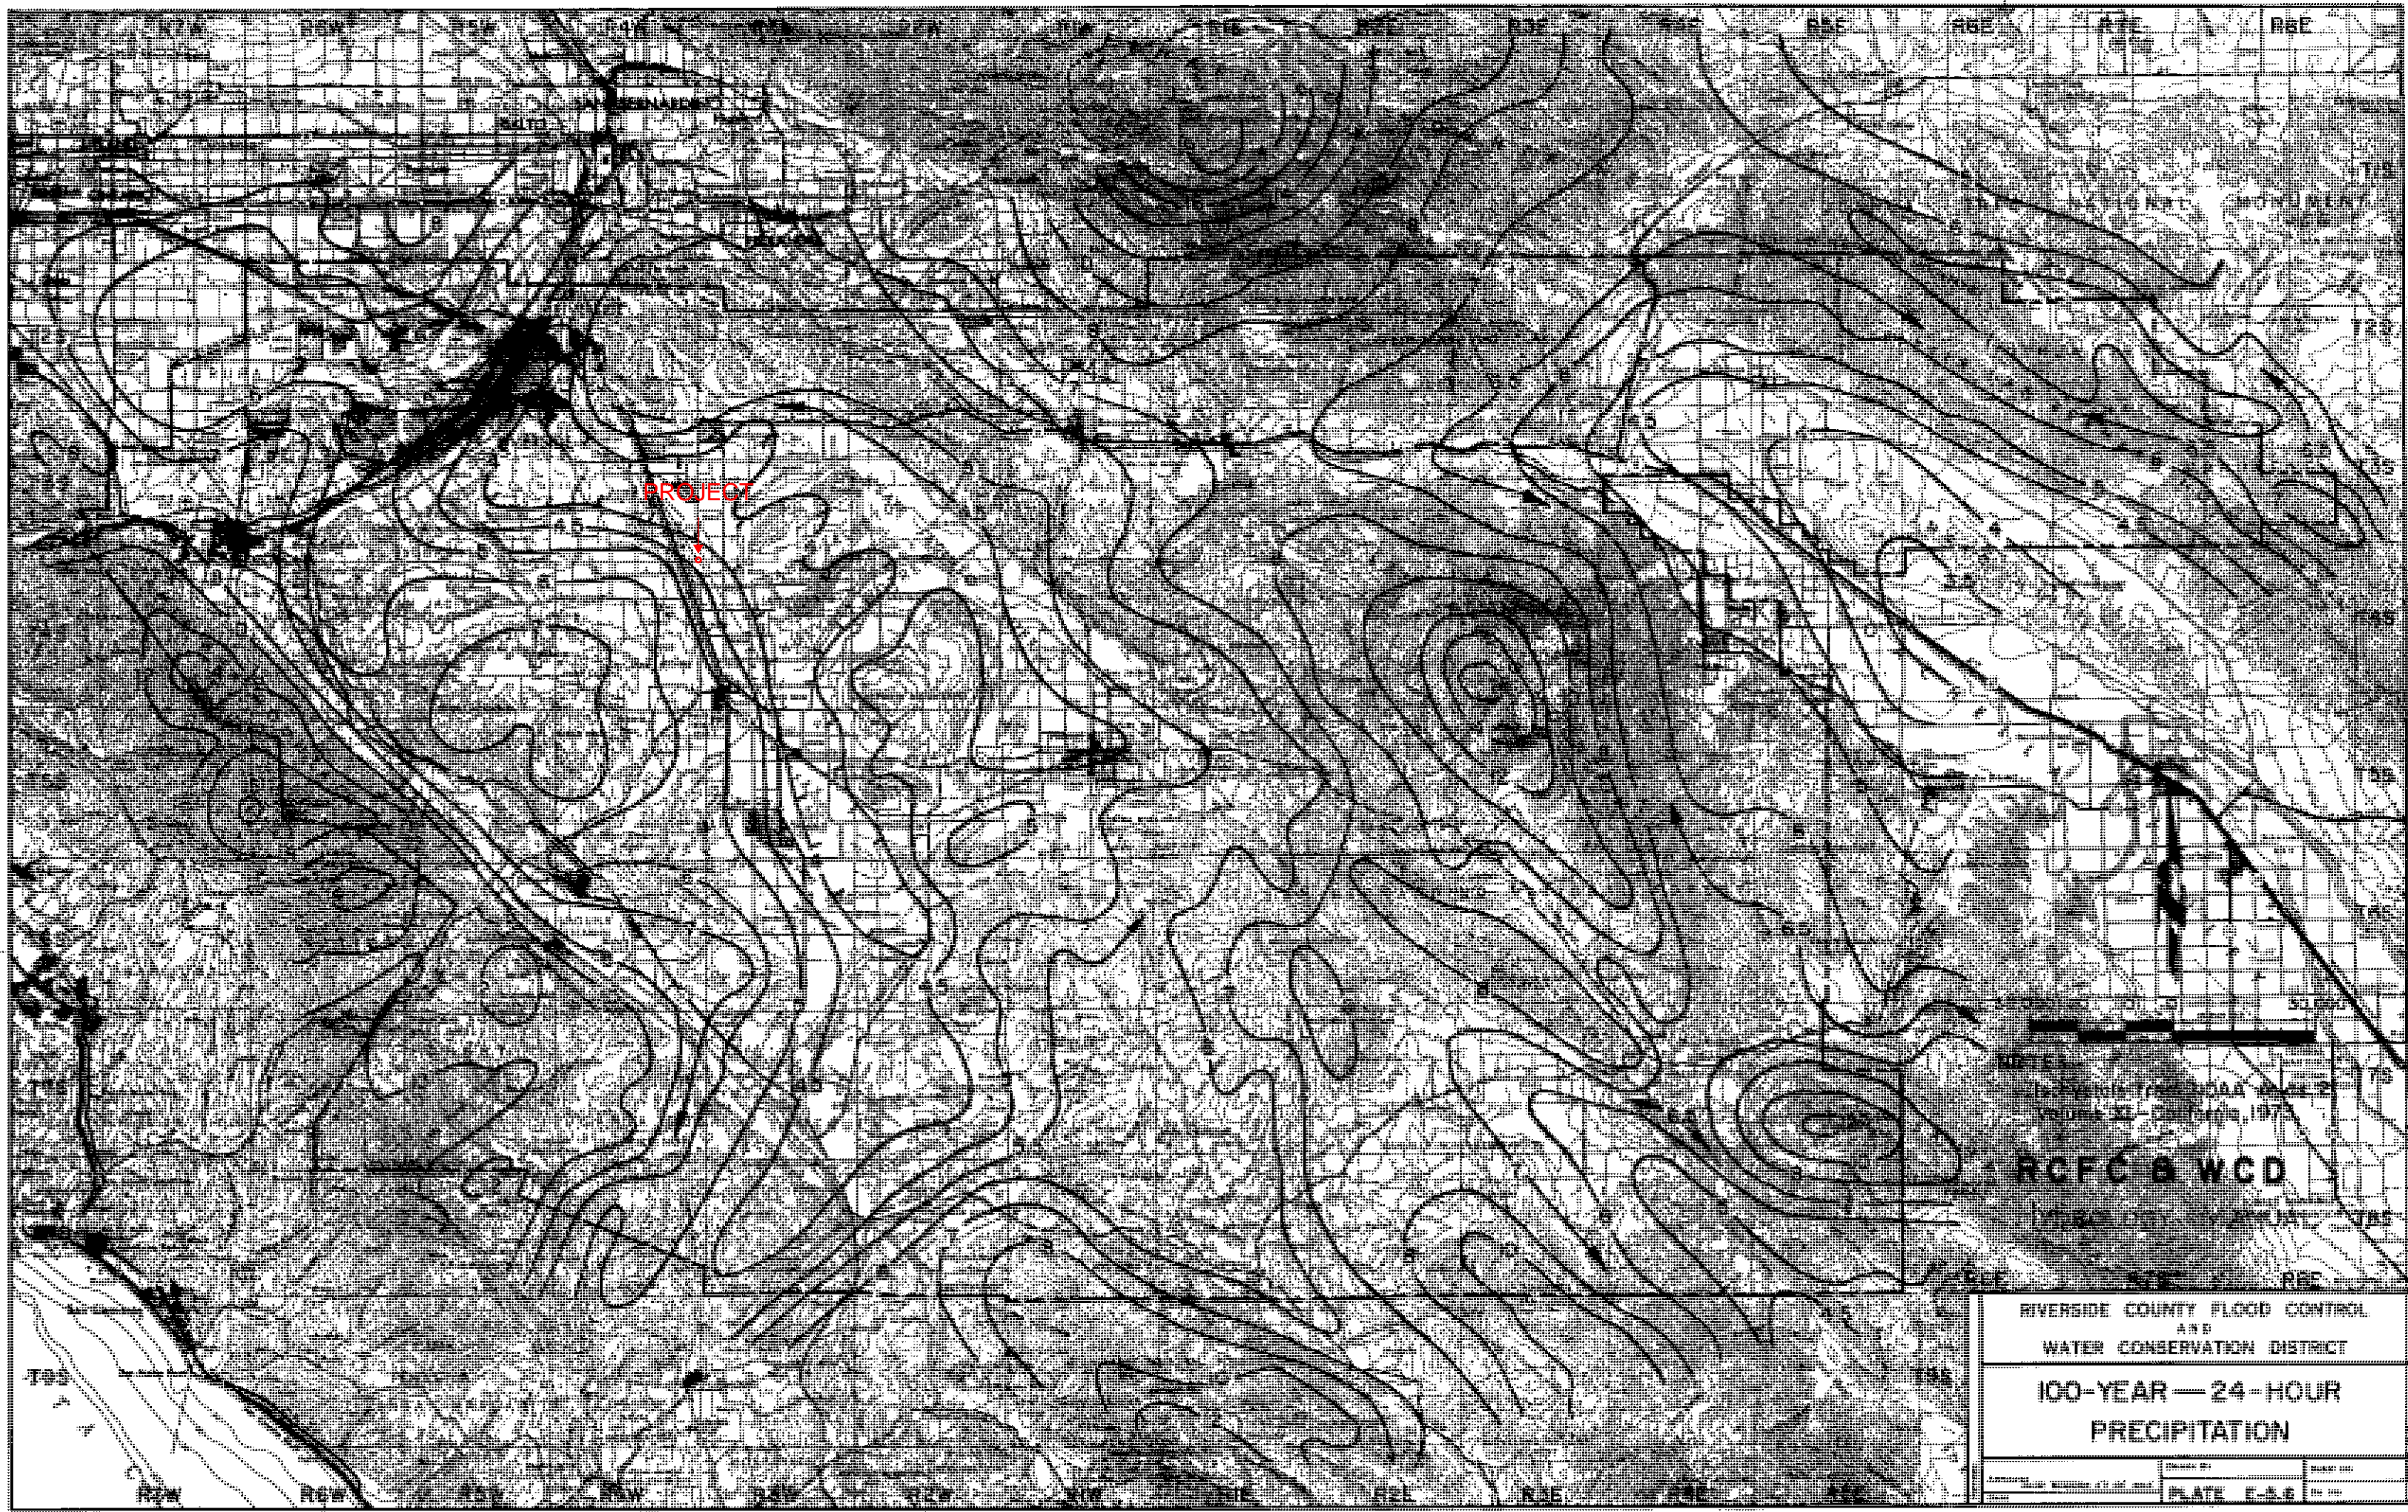

PROJECT


DATE: 10/15/1964  
BY: [illegible]  
SCALE: 1" = 100'

RCFC & WCD

RIVERSIDE COUNTY FLOOD CONTROL  
AND  
WATER CONSERVATION DISTRICT

100-YEAR — 24-HOUR  
PRECIPITATION

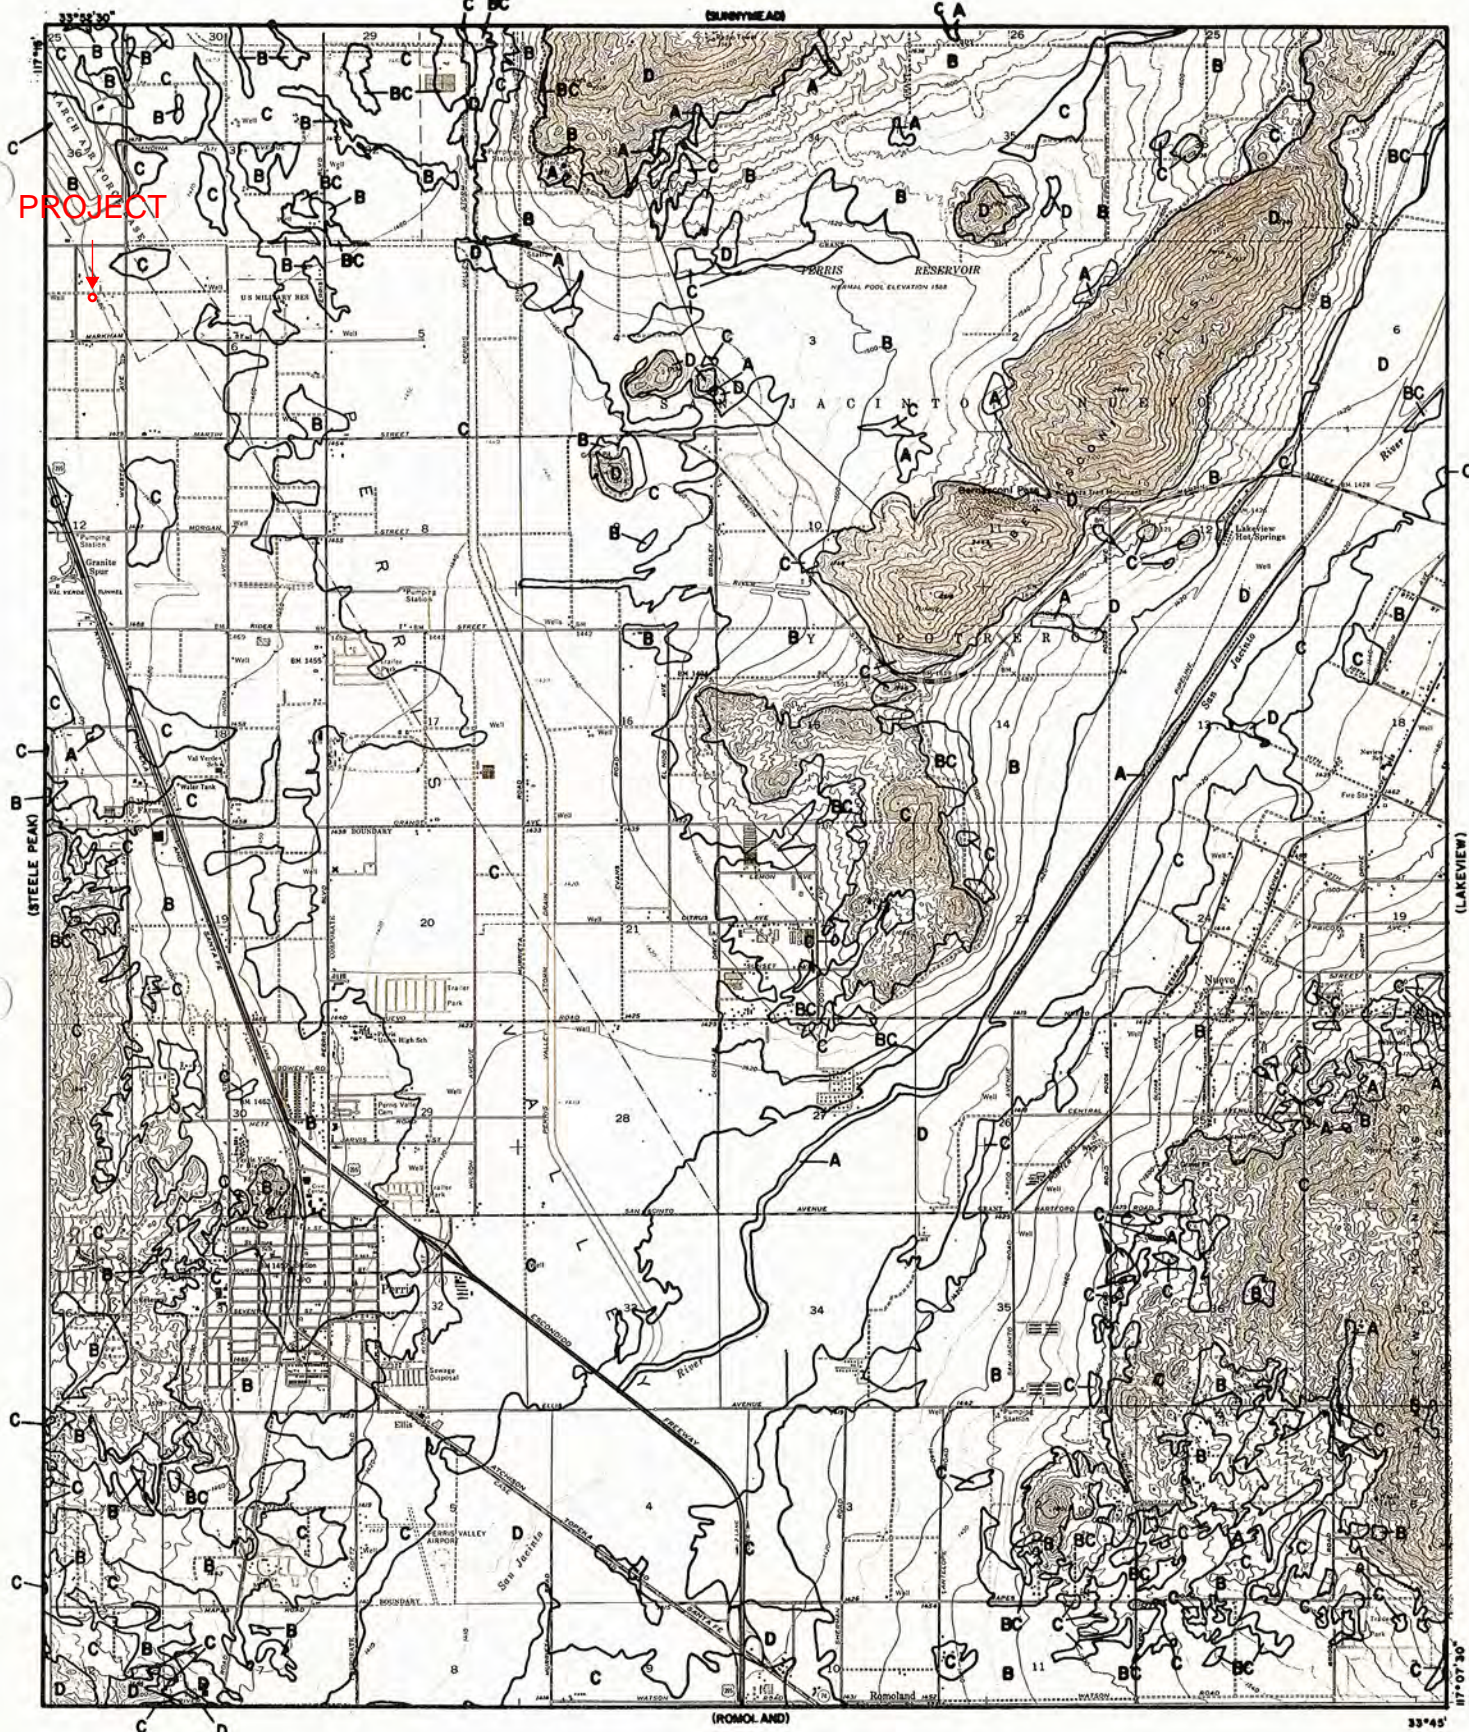

PLATE E-88



**LEGEND**

— SOILS GROUP BOUNDARY  
 A SOILS GROUP DESIGNATION

**RCFC & WCD**  
 HYDROLOGY MANUAL

  
  
 0 FEET 5000

**HYDROLOGIC SOILS GROUP MAP  
 FOR  
 PERRIS**

## **APPENDIX B**

# **HYDROLOGY CALCULATIONS**

OFFSITE

\*\*\*\*\*  
**RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM BASED ON**  
**RIVERSIDE COUNTY FLOOD CONTROL & WATER CONSERVATION DISTRICT**  
**(RCFC&WCD) 1978 HYDROLOGY MANUAL**  
 (c) Copyright 1982-2016 Advanced Engineering Software (aes)  
 (Rational Tabling Version 23.0)  
 Release Date: 07/01/2016 License ID 1435

Analysis prepared by:

\*\*\*\*\* DESCRIPTION OF STUDY \*\*\*\*\*  
 \* SOUTH NANCE TRAILER YARD - PERRIS \*  
 \* OFFSITE - NANCE STREET - NODES 0-2 \*  
 \* HYDROLOGIC ANALYSIS - 100-YEAR \*  
 \*\*\*\*\*

FILE NAME: 41300FNC.DAT  
 TIME/DATE OF STUDY: 16:00 01/23/2023

-----  
 USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:  
 -----

USER SPECIFIED STORM EVENT(YEAR) = 100.00  
 SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00  
 SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.95  
 2-YEAR, 1-HOUR PRECIPITATION(INCH) = 0.470  
 100-YEAR, 1-HOUR PRECIPITATION(INCH) = 1.230  
 COMPUTED RAINFALL INTENSITY DATA:  
 STORM EVENT = 100.00 1-HOUR INTENSITY(INCH/HOUR) = 1.230  
 SLOPE OF INTENSITY DURATION CURVE = 0.5000  
 RCFC&WCD HYDROLOGY MANUAL "C"-VALUES USED FOR RATIONAL METHOD  
 NOTE: CONSIDER ALL CONFLUENCE STREAM COMBINATIONS

FOR ALL DOWNSTREAM ANALYSES  
 \*USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL\*

NO.	HALF-CROWN TO		STREET-CROSSFALL:			CURB GUTTER-GEOMETRIES:			MANNING	
	WIDTH	CROSSFALL	IN-	OUT-/PARK-	HEIGHT	WIDTH	LIP HIKE	FACTOR		
	(FT)	(FT)	SIDE /	SIDE/	WAY	(FT)	(FT)	(FT)	(n)	
1	30.0	20.0	0.018/0.018/0.020			0.67	2.00	0.0313	0.167	0.0150

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:  
 1. Relative Flow-Depth = 0.00 FEET  
 as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)  
 2. (Depth)\*(Velocity) Constraint = 6.0 (FT\*FT/S)  
 \*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN  
 OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.\*

\*\*\*\*\*  
 FLOW PROCESS FROM NODE 0.00 TO NODE 1.00 IS CODE = 21  
 -----

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

=====

ASSUMED INITIAL SUBAREA UNIFORM  
 DEVELOPMENT IS: UNDEVELOPED WITH POOR COVER  
 $TC = K * [(LENGTH^{**3}) / (ELEVATION CHANGE)]^{** .2}$   
 INITIAL SUBAREA FLOW-LENGTH(FEET) = 689.00  
 UPSTREAM ELEVATION(FEET) = 1499.50  
 DOWNSTREAM ELEVATION(FEET) = 1492.50  
 ELEVATION DIFFERENCE(FEET) = 7.00  
 $TC = 0.533 * [(689.00^{**3}) / (7.00)]^{** .2} = 18.210$   
 100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 2.233  
 UNDEVELOPED WATERSHED RUNOFF COEFFICIENT = .6126  
 SOIL CLASSIFICATION IS "B"  
 SUBAREA RUNOFF(CFS) = 2.19  
 TOTAL AREA(ACRES) = 1.60 TOTAL RUNOFF(CFS) = 2.19

\*\*\*\*\*

FLOW PROCESS FROM NODE 1.00 TO NODE 2.00 IS CODE = 52

>>>>COMPUTE NATURAL VALLEY CHANNEL FLOW<<<<<  
>>>>TRAVELTIME THRU SUBAREA<<<<<

ELEVATION DATA: UPSTREAM(FEET) = 1492.50 DOWNSTREAM(FEET) = 1485.00  
CHANNEL LENGTH THRU SUBAREA(FEET) = 907.00 CHANNEL SLOPE = 0.0083  
CHANNEL FLOW THRU SUBAREA(CFS) = 2.19  
FLOW VELOCITY(FEET/SEC) = 1.59 (PER LACFCD/RCFC&WCD HYDROLOGY MANUAL)  
TRAVEL TIME(MIN.) = 9.48 Tc(MIN.) = 27.69  
LONGEST FLOWPATH FROM NODE 0.00 TO NODE 2.00 = 1596.00 FEET.

\*\*\*\*\*

FLOW PROCESS FROM NODE 2.00 TO NODE 2.00 IS CODE = 81

>>>>ADDITION OF SUBAREA TO MAINLINE PEAK FLOW<<<<<

100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 1.811  
UNDEVELOPED WATERSHED RUNOFF COEFFICIENT = .5701  
SOIL CLASSIFICATION IS "B"  
SUBAREA AREA(ACRES) = 0.39 SUBAREA RUNOFF(CFS) = 0.40  
TOTAL AREA(ACRES) = 2.0 TOTAL RUNOFF(CFS) = 2.59  
TC(MIN.) = 27.69

END OF STUDY SUMMARY:  
TOTAL AREA(ACRES) = 2.0 TC(MIN.) = 27.69  
PEAK FLOW RATE(CFS) = 2.59

END OF RATIONAL METHOD ANALYSIS

\*\*\*\*\*

RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM BASED ON  
RIVERSIDE COUNTY FLOOD CONTROL & WATER CONSERVATION DISTRICT  
(RCFC&WCD) 1978 HYDROLOGY MANUAL  
(c) Copyright 1982-2016 Advanced Engineering Software (aes)  
(Rational Tabling Version 23.0)  
Release Date: 07/01/2016 License ID 1435

Analysis prepared by:

\*\*\*\*\* DESCRIPTION OF STUDY \*\*\*\*\*  
\* SOUTH NANCE TRAILER YARD - PERRIS \*  
\* OFFSITE - WEST - NODES 10-12 \*  
\* HYDROLOGIC ANALYSIS - 100-YEAR \*  
\*\*\*\*\*

FILE NAME: 41300FWC.DAT  
TIME/DATE OF STUDY: 16:00 01/23/2023

-----  
USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:  
-----

USER SPECIFIED STORM EVENT(YEAR) = 100.00  
SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00  
SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.95  
2-YEAR, 1-HOUR PRECIPITATION(INCH) = 0.470  
100-YEAR, 1-HOUR PRECIPITATION(INCH) = 1.230  
COMPUTED RAINFALL INTENSITY DATA:  
STORM EVENT = 100.00 1-HOUR INTENSITY(INCH/HOUR) = 1.230  
DURATION OF INTENSITY DURATION CURVE = 0.5000  
RCFC&WCD HYDROLOGY MANUAL "C"-VALUES USED FOR RATIONAL METHOD  
NOTE: CONSIDER ALL CONFLUENCE STREAM COMBINATIONS

FOR ALL DOWNSTREAM ANALYSES  
\*USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL\*

NO.	HALF-WIDTH (FT)	CROWN TO CROSSFALL (FT)	STREET-CROSSFALL: IN-SIDE / OUT-SIDE / PARK-WAY	CURB HEIGHT (FT)	GUTTER WIDTH (FT)	GUTTER GEOMETRIES: LIP (FT)	HIKE (FT)	MANNING FACTOR (n)
1	30.0	20.0	0.018/0.018/0.020	0.67	2.00	0.0313	0.167	0.0150

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:  
1. Relative Flow-Depth = 0.00 FEET  
as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)  
2. (Depth)\*(Velocity) Constraint = 6.0 (FT\*FT/S)  
\*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN  
OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.\*

\*\*\*\*\*  
FLOW PROCESS FROM NODE 10.00 TO NODE 11.00 IS CODE = 21  
-----

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<

=====

ASSUMED INITIAL SUBAREA UNIFORM  
DEVELOPMENT IS: UNDEVELOPED WITH POOR COVER  
TC =  $K * [(LENGTH^{**3}) / (ELEVATION CHANGE)]^{** .2}$   
INITIAL SUBAREA FLOW-LENGTH(FEET) = 962.00  
UPSTREAM ELEVATION(FEET) = 1497.90  
DOWNSTREAM ELEVATION(FEET) = 1488.00  
ELEVATION DIFFERENCE(FEET) = 9.90  
TC =  $0.533 * [(962.00^{**3}) / (9.90)]^{** .2} = 20.758$   
100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 2.091  
UNDEVELOPED WATERSHED RUNOFF COEFFICIENT = .5996  
SOIL CLASSIFICATION IS "B"  
SUBAREA RUNOFF(CFS) = 2.78  
TOTAL AREA(ACRES) = 2.22 TOTAL RUNOFF(CFS) = 2.78

\*\*\*\*\*

FLOW PROCESS FROM NODE 11.00 TO NODE 12.00 IS CODE = 52

>>>>COMPUTE NATURAL VALLEY CHANNEL FLOW<<<<<  
>>>>TRAVELTIME THRU SUBAREA<<<<<

ELEVATION DATA: UPSTREAM(FEET) = 1488.00 DOWNSTREAM(FEET) = 1484.90  
CHANNEL LENGTH THRU SUBAREA(FEET) = 378.00 CHANNEL SLOPE = 0.0082  
CHANNEL FLOW THRU SUBAREA(CFS) = 2.78  
FLOW VELOCITY(FEET/SEC) = 1.67 (PER LACFCD/RCFC&WCD HYDROLOGY MANUAL)  
TRAVEL TIME(MIN.) = 3.77 Tc(MIN.) = 24.52  
LONGEST FLOWPATH FROM NODE 10.00 TO NODE 12.00 = 1340.00 FEET.

\*\*\*\*\*

FLOW PROCESS FROM NODE 12.00 TO NODE 12.00 IS CODE = 81

>>>>ADDITION OF SUBAREA TO MAINLINE PEAK FLOW<<<<<

100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 1.924  
UNDEVELOPED WATERSHED RUNOFF COEFFICIENT = .5827  
SOIL CLASSIFICATION IS "B"  
SUBAREA AREA(ACRES) = 5.64 SUBAREA RUNOFF(CFS) = 6.32  
TOTAL AREA(ACRES) = 7.9 TOTAL RUNOFF(CFS) = 9.11  
TC(MIN.) = 24.52

END OF STUDY SUMMARY:  
TOTAL AREA(ACRES) = 7.9 TC(MIN.) = 24.52  
PEAK FLOW RATE(CFS) = 9.11

END OF RATIONAL METHOD ANALYSIS

EXISTING CONDITION

\*\*\*\*\*

RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM BASED ON
RIVERSIDE COUNTY FLOOD CONTROL & WATER CONSERVATION DISTRICT
(RCFC&WCD) 1978 HYDROLOGY MANUAL
(c) Copyright 1982-2016 Advanced Engineering Software (aes)
(Rational Tabling Version 23.0)
Release Date: 07/01/2016 License ID 1435

Analysis prepared by:

\*\*\*\*\* DESCRIPTION OF STUDY \*\*\*\*\*
\* SOUTH NANCE TRAILER YARD - PERRIS \*
\* EXISTING CONDITION - WEST - NODES 100-101 \*
\* HYDROLOGIC ANALYSIS - 100-YEAR \*

FILE NAME: 4130EXWC.DAT
TIME/DATE OF STUDY: 16:00 01/23/2023

-----
USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:
-----

USER SPECIFIED STORM EVENT(YEAR) = 100.00
SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00
SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.95
2-YEAR, 1-HOUR PRECIPITATION(INCH) = 0.470
100-YEAR, 1-HOUR PRECIPITATION(INCH) = 1.230
COMPUTED RAINFALL INTENSITY DATA:
STORM EVENT = 100.00 1-HOUR INTENSITY(INCH/HOUR) = 1.230
DURATION OF INTENSITY DURATION CURVE = 0.5000
RCFC&WCD HYDROLOGY MANUAL "C"-VALUES USED FOR RATIONAL METHOD
NOTE: CONSIDER ALL CONFLUENCE STREAM COMBINATIONS

FOR ALL DOWNSTREAM ANALYSES
\*USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL\*
Table with 10 columns: NO., WIDTH (FT), CROWN TO CROSSFALL (FT), STREET- CROSSFALL: IN- / OUT- / PARK- SIDE / SIDE/ WAY, CURB HEIGHT (FT), GUTTER WIDTH (FT), GUTTER GEOMETRIES: LIP (FT), HIKE (FT), MANNING FACTOR (n)

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:
1. Relative Flow-Depth = 0.00 FEET
as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)
2. (Depth)\*(Velocity) Constraint = 6.0 (FT\*FT/S)
\*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN
OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.\*

\*\*\*\*\*
FLOW PROCESS FROM NODE 100.00 TO NODE 101.00 IS CODE = 21
-----

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<

=====
ASSUMED INITIAL SUBAREA UNIFORM
DEVELOPMENT IS: UNDEVELOPED WITH POOR COVER
TC = K\*[(LENGTH\*\*3)/(ELEVATION CHANGE)]\*\*.2
INITIAL SUBAREA FLOW-LENGTH(FEET) = 393.00
UPSTREAM ELEVATION(FEET) = 1485.30
DOWNSTREAM ELEVATION(FEET) = 1482.30
ELEVATION DIFFERENCE(FEET) = 3.00
TC = 0.533\*[( 393.00\*\*3)/( 3.00)]\*\*.2 = 15.403
100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 2.428
UNDEVELOPED WATERSHED RUNOFF COEFFICIENT = .6287
SOIL CLASSIFICATION IS "B"
SUBAREA RUNOFF(CFS) = 2.78
TOTAL AREA(ACRES) = 1.82 TOTAL RUNOFF(CFS) = 2.78
=====

END OF STUDY SUMMARY:

TOTAL AREA(ACRES) = 1.8 TC(MIN.) = 15.40  
PEAK FLOW RATE(CFS) = 2.78

=====  
=====  
END OF RATIONAL METHOD ANALYSIS

## PROPOSED CONDITION

\*\*\*\*\*

RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM BASED ON  
RIVERSIDE COUNTY FLOOD CONTROL & WATER CONSERVATION DISTRICT  
(RCFC&WCD) 1978 HYDROLOGY MANUAL  
(c) Copyright 1982-2016 Advanced Engineering Software (aes)  
(Rational Tabling Version 23.0)  
Release Date: 07/01/2016 License ID 1435

Analysis prepared by:

\*\*\*\*\* DESCRIPTION OF STUDY \*\*\*\*\*  
\* SOUTH NANCE TRAILER YARD - PERRIS \*  
\* PROPOSED CONDITION - WEST - NODES 100-123 \*  
\* HYDROLOGIC ANALYSIS - 100-YEAR \*  
\*\*\*\*\*

FILE NAME: 4130PRWC.DAT  
TIME/DATE OF STUDY: 10:00 01/26/2023

-----  
USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:  
-----

USER SPECIFIED STORM EVENT(YEAR) = 100.00  
SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00  
SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.95  
2-YEAR, 1-HOUR PRECIPITATION(INCH) = 0.470  
100-YEAR, 1-HOUR PRECIPITATION(INCH) = 1.230  
COMPUTED RAINFALL INTENSITY DATA:  
STORM EVENT = 100.00 1-HOUR INTENSITY(INCH/HOUR) = 1.230  
DURATION OF INTENSITY DURATION CURVE = 0.5000  
RCFC&WCD HYDROLOGY MANUAL "C"-VALUES USED FOR RATIONAL METHOD  
NOTE: CONSIDER ALL CONFLUENCE STREAM COMBINATIONS

FOR ALL DOWNSTREAM ANALYSES  
\*USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL\*

NO.	HALF- WIDTH (FT)	CROWN TO CROSSFALL (FT)	STREET- CROSSFALL: IN- / OUT-/ SIDE / SIDE/ WAY	CURB HEIGHT (FT)	GUTTER- WIDTH (FT)	GEOMETRIES: LIP (FT)	HIKE (FT)	MANNING FACTOR (n)
1	30.0	20.0	0.018/0.018/0.020	0.67	2.00	0.0313	0.167	0.0150

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:  
1. Relative Flow-Depth = 0.00 FEET  
as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)  
2. (Depth)\*(Velocity) Constraint = 6.0 (FT\*FT/S)  
\*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN  
OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.\*

\*\*\*\*\*  
FLOW PROCESS FROM NODE 100.00 TO NODE 101.00 IS CODE = 21  
-----

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

=====

ASSUMED INITIAL SUBAREA UNIFORM  
DEVELOPMENT IS COMMERCIAL  
TC =  $K * [(LENGTH^{**3}) / (ELEVATION CHANGE)]^{** .2}$   
INITIAL SUBAREA FLOW-LENGTH(FEET) = 79.00  
UPSTREAM ELEVATION(FEET) = 1485.07  
DOWNSTREAM ELEVATION(FEET) = 1483.23  
ELEVATION DIFFERENCE(FEET) = 1.84  
TC =  $0.303 * [(79.00^{**3}) / (1.84)]^{** .2} = 3.691$   
COMPUTED TIME OF CONCENTRATION INCREASED TO 5 MIN.  
100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 4.261  
COMMERCIAL DEVELOPMENT RUNOFF COEFFICIENT = .8822  
SOIL CLASSIFICATION IS "B"  
SUBAREA RUNOFF(CFS) = 0.53  
TOTAL AREA(ACRES) = 0.14 TOTAL RUNOFF(CFS) = 0.53

\*\*\*\*\*

FLOW PROCESS FROM NODE 101.00 TO NODE 111.00 IS CODE = 31

>>>>COMPUTE PIPE-FLOW TRAVEL TIME THRU SUBAREA<<<<<
>>>>USING COMPUTER-ESTIMATED PIPESIZE (NON-PRESSURE FLOW) <<<<<

ELEVATION DATA: UPSTREAM(FEET) = 1479.23 DOWNSTREAM(FEET) = 1478.97
FLOW LENGTH(FEET) = 230.00 MANNING' S N = 0.012
ESTIMATED PIPE DIAMETER(INCH) INCREASED TO 12.000
DEPTH OF FLOW IN 12.0 INCH PIPE IS 5.4 INCHES
PIPE-FLOW VELOCITY(FEET/SEC.) = 1.54
ESTIMATED PIPE DIAMETER(INCH) = 12.00 NUMBER OF PIPES = 1
PIPE-FLOW(CFS) = 0.53
PIPE TRAVEL TIME(MIN.) = 2.49 Tc(MIN.) = 7.49
LONGEST FLOWPATH FROM NODE 100.00 TO NODE 111.00 = 309.00 FEET.

\*\*\*\*\*

FLOW PROCESS FROM NODE 111.00 TO NODE 111.00 IS CODE = 1

>>>>DESIGNATE INDEPENDENT STREAM FOR CONFLUENCE<<<<<

TOTAL NUMBER OF STREAMS = 2
CONFLUENCE VALUES USED FOR INDEPENDENT STREAM 1 ARE:
TIME OF CONCENTRATION(MIN.) = 7.49
RAINFALL INTENSITY(INCH/HR) = 3.48
TOTAL STREAM AREA(ACRES) = 0.14
PEAK FLOW RATE(CFS) AT CONFLUENCE = 0.53

\*\*\*\*\*

FLOW PROCESS FROM NODE 110.00 TO NODE 111.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

ASSUMED INITIAL SUBAREA UNIFORM DEVELOPMENT IS COMMERCIAL
TC = K\*[(LENGTH\*\*3)/(ELEVATION CHANGE)]\*\*.2
INITIAL SUBAREA FLOW-LENGTH(FEET) = 139.00
UPSTREAM ELEVATION(FEET) = 1484.61
DOWNSTREAM ELEVATION(FEET) = 1482.97
ELEVATION DIFFERENCE(FEET) = 1.64
TC = 0.303\*[(139.00\*\*3)/(1.64)]\*\*.2 = 5.302
100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 4.138
COMMERCIAL DEVELOPMENT RUNOFF COEFFICIENT = .8818
SOIL CLASSIFICATION IS "B"
SUBAREA RUNOFF(CFS) = 5.22
TOTAL AREA(ACRES) = 1.43 TOTAL RUNOFF(CFS) = 5.22

\*\*\*\*\*

FLOW PROCESS FROM NODE 111.00 TO NODE 111.00 IS CODE = 1

>>>>DESIGNATE INDEPENDENT STREAM FOR CONFLUENCE<<<<<
>>>>AND COMPUTE VARIOUS CONFLUENCED STREAM VALUES<<<<<

TOTAL NUMBER OF STREAMS = 2
CONFLUENCE VALUES USED FOR INDEPENDENT STREAM 2 ARE:
TIME OF CONCENTRATION(MIN.) = 5.30
RAINFALL INTENSITY(INCH/HR) = 4.14
TOTAL STREAM AREA(ACRES) = 1.43
PEAK FLOW RATE(CFS) AT CONFLUENCE = 5.22

\*\* CONFLUENCE DATA \*\*

Table with 5 columns: STREAM NUMBER, RUNOFF (CFS), Tc (MIN.), INTENSITY (INCH/HOUR), AREA (ACRE). Rows for stream 1 and 2.

RAINFALL INTENSITY AND TIME OF CONCENTRATION RATIO CONFLUENCE FORMULA USED FOR 2 STREAMS.

\*\* PEAK FLOW RATE TABLE \*\*

Table with 4 columns: STREAM NUMBER, RUNOFF (CFS), Tc (MIN.), INTENSITY (INCH/HOUR).

1 5.59 5.30 4.138  
2 4.92 7.49 3.482

COMPUTED CONFLUENCE ESTIMATES ARE AS FOLLOWS:

PEAK FLOW RATE(CFS) = 5.59 Tc(MIN.) = 5.30  
TOTAL AREA(ACRES) = 1.6  
LONGEST FLOWPATH FROM NODE 100.00 TO NODE 111.00 = 309.00 FEET.

\*\*\*\*\*  
FLOW PROCESS FROM NODE 111.00 TO NODE 122.00 IS CODE = 31  
-----

>>>>COMPUTE PIPE-FLOW TRAVEL TIME THRU SUBAREA<<<<<  
>>>>USING COMPUTER-ESTIMATED PIPESIZE (NON-PRESSURE FLOW) <<<<<

=====

ELEVATION DATA: UPSTREAM(FEET) = 1478.97 DOWNSTREAM(FEET) = 1478.29  
FLOW LENGTH(FEET) = 299.00 MANNING'S N = 0.012  
DEPTH OF FLOW IN 21.0 INCH PIPE IS 13.0 INCHES  
PIPE-FLOW VELOCITY(FEET/SEC.) = 3.59  
ESTIMATED PIPE DIAMETER(INCH) = 21.00 NUMBER OF PIPES = 1  
PIPE-FLOW(CFS) = 5.59  
PIPE TRAVEL TIME(MIN.) = 1.39 Tc(MIN.) = 6.69  
LONGEST FLOWPATH FROM NODE 100.00 TO NODE 122.00 = 608.00 FEET.

\*\*\*\*\*  
FLOW PROCESS FROM NODE 122.00 TO NODE 122.00 IS CODE = 1  
-----

>>>>DESIGNATE INDEPENDENT STREAM FOR CONFLUENCE<<<<<

=====

TOTAL NUMBER OF STREAMS = 2  
CONFLUENCE VALUES USED FOR INDEPENDENT STREAM 1 ARE:  
TIME OF CONCENTRATION(MIN.) = 6.69  
RAINFALL INTENSITY(INCH/HR) = 3.68  
TOTAL STREAM AREA(ACRES) = 1.57  
PEAK FLOW RATE(CFS) AT CONFLUENCE = 5.59

\*\*\*\*\*  
FLOW PROCESS FROM NODE 120.00 TO NODE 121.00 IS CODE = 21  
-----

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

=====

ASSUMED INITIAL SUBAREA UNIFORM  
DEVELOPMENT IS COMMERCIAL  
TC = K\*[(LENGTH\*\*3)/(ELEVATION CHANGE)]\*\*.2  
INITIAL SUBAREA FLOW-LENGTH(FEET) = 113.00  
UPSTREAM ELEVATION(FEET) = 1483.17  
DOWNSTREAM ELEVATION(FEET) = 1482.35  
ELEVATION DIFFERENCE(FEET) = 0.82  
TC = 0.303\*[(113.00\*\*3)/(0.82)]\*\*.2 = 5.379  
100 YEAR RAINFALL INTENSITY(INCH/HOUR) = 4.108  
COMMERCIAL DEVELOPMENT RUNOFF COEFFICIENT = .8817  
SOIL CLASSIFICATION IS "B"  
SUBAREA RUNOFF(CFS) = 0.54  
TOTAL AREA(ACRES) = 0.15 TOTAL RUNOFF(CFS) = 0.54

\*\*\*\*\*  
FLOW PROCESS FROM NODE 121.00 TO NODE 122.00 IS CODE = 31  
-----

>>>>COMPUTE PIPE-FLOW TRAVEL TIME THRU SUBAREA<<<<<  
>>>>USING COMPUTER-ESTIMATED PIPESIZE (NON-PRESSURE FLOW) <<<<<

=====

ELEVATION DATA: UPSTREAM(FEET) = 1478.35 DOWNSTREAM(FEET) = 1478.29  
FLOW LENGTH(FEET) = 12.00 MANNING'S N = 0.012  
ESTIMATED PIPE DIAMETER(INCH) INCREASED TO 12.000  
DEPTH OF FLOW IN 12.0 INCH PIPE IS 3.7 INCHES  
PIPE-FLOW VELOCITY(FEET/SEC.) = 2.65  
ESTIMATED PIPE DIAMETER(INCH) = 12.00 NUMBER OF PIPES = 1  
PIPE-FLOW(CFS) = 0.54  
PIPE TRAVEL TIME(MIN.) = 0.08 Tc(MIN.) = 5.45  
LONGEST FLOWPATH FROM NODE 120.00 TO NODE 122.00 = 125.00 FEET.

\*\*\*\*\*  
FLOW PROCESS FROM NODE 122.00 TO NODE 122.00 IS CODE = 1  
-----

-----  
>>>>DESIGNATE INDEPENDENT STREAM FOR CONFLUENCE<<<<<<  
>>>>AND COMPUTE VARIOUS CONFLUENCED STREAM VALUES<<<<<<  
=====

TOTAL NUMBER OF STREAMS = 2  
CONFLUENCE VALUES USED FOR INDEPENDENT STREAM 2 ARE:  
TIME OF CONCENTRATION(MIN.) = 5.45  
RAINFALL INTENSITY(INCH/HR) = 4.08  
TOTAL STREAM AREA(ACRES) = 0.15  
PEAK FLOW RATE(CFS) AT CONFLUENCE = 0.54

\*\* CONFLUENCE DATA \*\*

STREAM NUMBER	RUNOFF (CFS)	Tc (MIN.)	INTENSITY (INCH/HOUR)	AREA (ACRE)
1	5.59	6.69	3.684	1.57
1	4.92	8.95	3.184	1.57
2	0.54	5.45	4.080	0.15

RAINFALL INTENSITY AND TIME OF CONCENTRATION RATIO  
CONFLUENCE FORMULA USED FOR 2 STREAMS.

\*\* PEAK FLOW RATE TABLE \*\*

STREAM NUMBER	RUNOFF (CFS)	Tc (MIN.)	INTENSITY (INCH/HOUR)
1	5.10	5.45	4.080
2	6.08	6.69	3.684
3	5.34	8.95	3.184

COMPUTED CONFLUENCE ESTIMATES ARE AS FOLLOWS:

PEAK FLOW RATE(CFS) = 6.08 Tc(MIN.) = 6.69  
TOTAL AREA(ACRES) = 1.7  
LONGEST FLOWPATH FROM NODE 100.00 TO NODE 122.00 = 608.00 FEET.

\*\*\*\*\*  
FLOW PROCESS FROM NODE 122.00 TO NODE 123.00 IS CODE = 31  
-----

>>>>COMPUTE PIPE- FLOW TRAVEL TIME THRU SUBAREA<<<<<<  
>>>>USING COMPUTER- ESTIMATED PIPESIZE (NON- PRESSURE FLOW) <<<<<<  
=====

ELEVATION DATA: UPSTREAM(FEET) = 1478.29 DOWNSTREAM(FEET) = 1478.19  
FLOW LENGTH(FEET) = 19.00 MANNING' S N = 0.012  
DEPTH OF FLOW IN 18.0 INCH PIPE IS 11.7 INCHES  
PIPE- FLOW VELOCITY(FEET/SEC.) = 5.01  
ESTIMATED PIPE DIAMETER(INCH) = 18.00 NUMBER OF PIPES = 1  
PIPE- FLOW(CFS) = 6.08  
PIPE TRAVEL TIME(MIN.) = 0.06 Tc(MIN.) = 6.75  
LONGEST FLOWPATH FROM NODE 100.00 TO NODE 123.00 = 627.00 FEET.

-----  
END OF STUDY SUMMARY:

TOTAL AREA(ACRES) = 1.7 TC(MIN.) = 6.75  
PEAK FLOW RATE(CFS) = 6.08

\*\*\* PEAK FLOW RATE TABLE \*\*\*

	Q(CFS)	Tc(MIN.)
1	5.10	5.52
2	6.08	6.75
3	5.34	9.02

-----  
END OF RATIONAL METHOD ANALYSIS  
-----

# **APPENDIX C**

## **DETENTION CALCULATIONS**

WESTERLY TRUCK STORAGE  
Truck yard Volume

Elevation	Depth (feet)	Area (sq. ft.)	Volume (c.f.)	$\Sigma$ Volume (c.f.)	$\Sigma$ Volume (ac-ft)
1483.00	0.00	18	17	17	0.00
1483.10	0.10	315	65	81	0.00
1483.20	0.20	978	149	231	0.01
1483.30	0.30	2007	271	501	0.01
1483.40	0.40	3403	428	929	0.02
1483.50	0.50	5165	623	1552	0.04
1483.60	0.60	7293	854	2406	0.06
1483.70	0.70	9787	1122	3528	0.08
1483.80	0.80	12647	1426	4954	0.11
1483.90	0.90	15874	1767	6721	0.15
1484.00	1.00	19467	2144	8865	0.20
1484.10	1.10	23417	2547	11413	0.26
1484.20	1.20	27528	2976	14389	0.33
1484.30	1.30	31995			

EXISTING CONDITION

Unit Hydrograph Analysis

Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2014, Version 9.0  
Study date 01/23/23 File: 4130EW102410.out

+++++

Riverside County Synthetic Unit Hydrology Method  
RCFC & WCD Manual date - April 1978

Program License Serial Number 6400

English (in-lb) Input Units Used  
English Rainfall Data (Inches) Input Values Used

English Units used in output format

SOUTH NANCE TRAILER YARD - PERRIS  
EXISTING CONDITION - WEST  
HYDROLOGIC ANALYSIS - 10-YEAR

Drainage Area = 1.82(Ac.) = 0.003 Sq. Mi.  
Drainage Area for Depth-Area Areal Adj. = 1.82(Ac.) = 0.003 Sq. Mi.  
USER Entry of lag time in hours  
Lag time = 0.000 Hr.  
Lag time = 0.00 Min.  
25% of lag time = 0.00 Min.  
40% of lag time = 0.00 Min.  
Unit time = 5.00 Min.  
Duration of storm = 24 Hour(s)  
User Entered Base Flow = 0.00(CFS)

2 YEAR Area rainfall data:

Area(Ac.) [1]	Rainfall (In) [2]	Weighting[1*2]
1.82	1.62	2.95

100 YEAR Area rainfall data:

Area(Ac.) [1]	Rainfall (In) [2]	Weighting[1*2]
1.82	4.40	8.01

STORM EVENT (YEAR) = 10.00  
Area Averaged 2-Year Rainfall = 1.620(In)  
Area Averaged 100-Year Rainfall = 4.400(In)

Point rain (area averaged) = 2.764(In)  
Areal adjustment factor = 100.00 %  
Adjusted average point rain = 2.764(In)

Sub-Area Data:

Area(Ac.)	Runoff Index	Impervious %
1.820	76.00	0.000
Total Area Entered = 1.82(Ac.)		

RI	RI	Infil. Rate	Impervious	Adj. Infil. Rate	Area%	F
AMC2	AMC-2	(In/Hr)	(Dec. %)	(In/Hr)	(Dec.)	(In/Hr)
76.0	76.0	0.291	0.000	0.291	1.000	0.291

Sum (F) = 0.291

Area averaged mean soil loss (F) (In/Hr) = 0.291

Minimum soil loss rate ((In/Hr)) = 0.146

(for 24 hour storm duration)

Soil loss rate (decimal) = 0.900

Unit Hydrograph  
VALLEY S-Curve

Unit Hydrograph Data

Unit time period (hrs)	Time % of lag	Distribution Graph %	Unit Hydrograph (CFS)
1 0.083	1. #I0	100.000	1.834
	Sum =	100.000	Sum= 1.834

The following loss rate calculations reflect use of the minimum calculated loss rate subtracted from the Storm Rain to produce the maximum Effective Rain value

Unit	Time (Hr.)	Pattern Percent	Storm Rain (In/Hr)	Loss rate(In./Hr)		Effective (In/Hr)
				Max	Low	
1	0.08	0.07	0.022	( 0.516)	0.020	0.002
2	0.17	0.07	0.022	( 0.514)	0.020	0.002
3	0.25	0.07	0.022	( 0.512)	0.020	0.002
4	0.33	0.10	0.033	( 0.510)	0.030	0.003
5	0.42	0.10	0.033	( 0.508)	0.030	0.003
6	0.50	0.10	0.033	( 0.506)	0.030	0.003
7	0.58	0.10	0.033	( 0.504)	0.030	0.003
8	0.67	0.10	0.033	( 0.502)	0.030	0.003
9	0.75	0.10	0.033	( 0.500)	0.030	0.003
10	0.83	0.13	0.044	( 0.498)	0.040	0.004
11	0.92	0.13	0.044	( 0.496)	0.040	0.004
12	1.00	0.13	0.044	( 0.494)	0.040	0.004
13	1.08	0.10	0.033	( 0.493)	0.030	0.003
14	1.17	0.10	0.033	( 0.491)	0.030	0.003
15	1.25	0.10	0.033	( 0.489)	0.030	0.003
16	1.33	0.10	0.033	( 0.487)	0.030	0.003
17	1.42	0.10	0.033	( 0.485)	0.030	0.003
18	1.50	0.10	0.033	( 0.483)	0.030	0.003
19	1.58	0.10	0.033	( 0.481)	0.030	0.003
20	1.67	0.10	0.033	( 0.479)	0.030	0.003
21	1.75	0.10	0.033	( 0.477)	0.030	0.003
22	1.83	0.13	0.044	( 0.475)	0.040	0.004
23	1.92	0.13	0.044	( 0.473)	0.040	0.004
24	2.00	0.13	0.044	( 0.471)	0.040	0.004
25	2.08	0.13	0.044	( 0.469)	0.040	0.004
26	2.17	0.13	0.044	( 0.467)	0.040	0.004
27	2.25	0.13	0.044	( 0.466)	0.040	0.004
28	2.33	0.13	0.044	( 0.464)	0.040	0.004
29	2.42	0.13	0.044	( 0.462)	0.040	0.004
30	2.50	0.13	0.044	( 0.460)	0.040	0.004
31	2.58	0.17	0.055	( 0.458)	0.050	0.006
32	2.67	0.17	0.055	( 0.456)	0.050	0.006
33	2.75	0.17	0.055	( 0.454)	0.050	0.006
34	2.83	0.17	0.055	( 0.452)	0.050	0.006
35	2.92	0.17	0.055	( 0.451)	0.050	0.006
36	3.00	0.17	0.055	( 0.449)	0.050	0.006
37	3.08	0.17	0.055	( 0.447)	0.050	0.006
38	3.17	0.17	0.055	( 0.445)	0.050	0.006
39	3.25	0.17	0.055	( 0.443)	0.050	0.006
40	3.33	0.17	0.055	( 0.441)	0.050	0.006
41	3.42	0.17	0.055	( 0.439)	0.050	0.006
42	3.50	0.17	0.055	( 0.438)	0.050	0.006
43	3.58	0.17	0.055	( 0.436)	0.050	0.006
44	3.67	0.17	0.055	( 0.434)	0.050	0.006
45	3.75	0.17	0.055	( 0.432)	0.050	0.006

46	3.83	0.20	0.066	( 0.430)	0.060	0.007
47	3.92	0.20	0.066	( 0.428)	0.060	0.007
48	4.00	0.20	0.066	( 0.427)	0.060	0.007
49	4.08	0.20	0.066	( 0.425)	0.060	0.007
50	4.17	0.20	0.066	( 0.423)	0.060	0.007
51	4.25	0.20	0.066	( 0.421)	0.060	0.007
52	4.33	0.23	0.077	( 0.419)	0.070	0.008
53	4.42	0.23	0.077	( 0.418)	0.070	0.008
54	4.50	0.23	0.077	( 0.416)	0.070	0.008
55	4.58	0.23	0.077	( 0.414)	0.070	0.008
56	4.67	0.23	0.077	( 0.412)	0.070	0.008
57	4.75	0.23	0.077	( 0.411)	0.070	0.008
58	4.83	0.27	0.088	( 0.409)	0.080	0.009
59	4.92	0.27	0.088	( 0.407)	0.080	0.009
60	5.00	0.27	0.088	( 0.405)	0.080	0.009
61	5.08	0.20	0.066	( 0.403)	0.060	0.007
62	5.17	0.20	0.066	( 0.402)	0.060	0.007
63	5.25	0.20	0.066	( 0.400)	0.060	0.007
64	5.33	0.23	0.077	( 0.398)	0.070	0.008
65	5.42	0.23	0.077	( 0.396)	0.070	0.008
66	5.50	0.23	0.077	( 0.395)	0.070	0.008
67	5.58	0.27	0.088	( 0.393)	0.080	0.009
68	5.67	0.27	0.088	( 0.391)	0.080	0.009
69	5.75	0.27	0.088	( 0.390)	0.080	0.009
70	5.83	0.27	0.088	( 0.388)	0.080	0.009
71	5.92	0.27	0.088	( 0.386)	0.080	0.009
72	6.00	0.27	0.088	( 0.384)	0.080	0.009
73	6.08	0.30	0.099	( 0.383)	0.090	0.010
74	6.17	0.30	0.099	( 0.381)	0.090	0.010
75	6.25	0.30	0.099	( 0.379)	0.090	0.010
76	6.33	0.30	0.099	( 0.378)	0.090	0.010
77	6.42	0.30	0.099	( 0.376)	0.090	0.010
78	6.50	0.30	0.099	( 0.374)	0.090	0.010
79	6.58	0.33	0.111	( 0.373)	0.099	0.011
80	6.67	0.33	0.111	( 0.371)	0.099	0.011
81	6.75	0.33	0.111	( 0.369)	0.099	0.011
82	6.83	0.33	0.111	( 0.368)	0.099	0.011
83	6.92	0.33	0.111	( 0.366)	0.099	0.011
84	7.00	0.33	0.111	( 0.364)	0.099	0.011
85	7.08	0.33	0.111	( 0.363)	0.099	0.011
86	7.17	0.33	0.111	( 0.361)	0.099	0.011
87	7.25	0.33	0.111	( 0.359)	0.099	0.011
88	7.33	0.37	0.122	( 0.358)	0.109	0.012
89	7.42	0.37	0.122	( 0.356)	0.109	0.012
90	7.50	0.37	0.122	( 0.354)	0.109	0.012
91	7.58	0.40	0.133	( 0.353)	0.119	0.013
92	7.67	0.40	0.133	( 0.351)	0.119	0.013
93	7.75	0.40	0.133	( 0.349)	0.119	0.013
94	7.83	0.43	0.144	( 0.348)	0.129	0.014
95	7.92	0.43	0.144	( 0.346)	0.129	0.014
96	8.00	0.43	0.144	( 0.345)	0.129	0.014
97	8.08	0.50	0.166	( 0.343)	0.149	0.017
98	8.17	0.50	0.166	( 0.341)	0.149	0.017
99	8.25	0.50	0.166	( 0.340)	0.149	0.017
100	8.33	0.50	0.166	( 0.338)	0.149	0.017
101	8.42	0.50	0.166	( 0.337)	0.149	0.017
102	8.50	0.50	0.166	( 0.335)	0.149	0.017
103	8.58	0.53	0.177	( 0.334)	0.159	0.018
104	8.67	0.53	0.177	( 0.332)	0.159	0.018
105	8.75	0.53	0.177	( 0.330)	0.159	0.018
106	8.83	0.57	0.188	( 0.329)	0.169	0.019
107	8.92	0.57	0.188	( 0.327)	0.169	0.019
108	9.00	0.57	0.188	( 0.326)	0.169	0.019
109	9.08	0.63	0.210	( 0.324)	0.189	0.021
110	9.17	0.63	0.210	( 0.323)	0.189	0.021
111	9.25	0.63	0.210	( 0.321)	0.189	0.021
112	9.33	0.67	0.221	( 0.320)	0.199	0.022
113	9.42	0.67	0.221	( 0.318)	0.199	0.022
114	9.50	0.67	0.221	( 0.317)	0.199	0.022
115	9.58	0.70	0.232	( 0.315)	0.209	0.023
116	9.67	0.70	0.232	( 0.314)	0.209	0.023
117	9.75	0.70	0.232	( 0.312)	0.209	0.023

118	9. 83	0. 73	0. 243	( 0. 310)	0. 219	0. 024
119	9. 92	0. 73	0. 243	( 0. 309)	0. 219	0. 024
120	10. 00	0. 73	0. 243	( 0. 308)	0. 219	0. 024
121	10. 08	0. 50	0. 166	( 0. 306)	0. 149	0. 017
122	10. 17	0. 50	0. 166	( 0. 305)	0. 149	0. 017
123	10. 25	0. 50	0. 166	( 0. 303)	0. 149	0. 017
124	10. 33	0. 50	0. 166	( 0. 302)	0. 149	0. 017
125	10. 42	0. 50	0. 166	( 0. 300)	0. 149	0. 017
126	10. 50	0. 50	0. 166	( 0. 299)	0. 149	0. 017
127	10. 58	0. 67	0. 221	( 0. 297)	0. 199	0. 022
128	10. 67	0. 67	0. 221	( 0. 296)	0. 199	0. 022
129	10. 75	0. 67	0. 221	( 0. 294)	0. 199	0. 022
130	10. 83	0. 67	0. 221	( 0. 293)	0. 199	0. 022
131	10. 92	0. 67	0. 221	( 0. 291)	0. 199	0. 022
132	11. 00	0. 67	0. 221	( 0. 290)	0. 199	0. 022
133	11. 08	0. 63	0. 210	( 0. 289)	0. 189	0. 021
134	11. 17	0. 63	0. 210	( 0. 287)	0. 189	0. 021
135	11. 25	0. 63	0. 210	( 0. 286)	0. 189	0. 021
136	11. 33	0. 63	0. 210	( 0. 284)	0. 189	0. 021
137	11. 42	0. 63	0. 210	( 0. 283)	0. 189	0. 021
138	11. 50	0. 63	0. 210	( 0. 281)	0. 189	0. 021
139	11. 58	0. 57	0. 188	( 0. 280)	0. 169	0. 019
140	11. 67	0. 57	0. 188	( 0. 279)	0. 169	0. 019
141	11. 75	0. 57	0. 188	( 0. 277)	0. 169	0. 019
142	11. 83	0. 60	0. 199	( 0. 276)	0. 179	0. 020
143	11. 92	0. 60	0. 199	( 0. 275)	0. 179	0. 020
144	12. 00	0. 60	0. 199	( 0. 273)	0. 179	0. 020
145	12. 08	0. 83	0. 276	( 0. 272)	0. 249	0. 028
146	12. 17	0. 83	0. 276	( 0. 270)	0. 249	0. 028
147	12. 25	0. 83	0. 276	( 0. 269)	0. 249	0. 028
148	12. 33	0. 87	0. 287	( 0. 268)	0. 259	0. 029
149	12. 42	0. 87	0. 287	( 0. 266)	0. 259	0. 029
150	12. 50	0. 87	0. 287	( 0. 265)	0. 259	0. 029
151	12. 58	0. 93	0. 310	0. 264 ( 0. 279)		0. 046
152	12. 67	0. 93	0. 310	0. 262 ( 0. 279)		0. 047
153	12. 75	0. 93	0. 310	0. 261 ( 0. 279)		0. 048
154	12. 83	0. 97	0. 321	0. 260 ( 0. 289)		0. 061
155	12. 92	0. 97	0. 321	0. 258 ( 0. 289)		0. 062
156	13. 00	0. 97	0. 321	0. 257 ( 0. 289)		0. 063
157	13. 08	1. 13	0. 376	0. 256 ( 0. 338)		0. 120
158	13. 17	1. 13	0. 376	0. 255 ( 0. 338)		0. 121
159	13. 25	1. 13	0. 376	0. 253 ( 0. 338)		0. 123
160	13. 33	1. 13	0. 376	0. 252 ( 0. 338)		0. 124
161	13. 42	1. 13	0. 376	0. 251 ( 0. 338)		0. 125
162	13. 50	1. 13	0. 376	0. 249 ( 0. 338)		0. 126
163	13. 58	0. 77	0. 254	( 0. 248)	0. 229	0. 025
164	13. 67	0. 77	0. 254	( 0. 247)	0. 229	0. 025
165	13. 75	0. 77	0. 254	( 0. 246)	0. 229	0. 025
166	13. 83	0. 77	0. 254	( 0. 244)	0. 229	0. 025
167	13. 92	0. 77	0. 254	( 0. 243)	0. 229	0. 025
168	14. 00	0. 77	0. 254	( 0. 242)	0. 229	0. 025
169	14. 08	0. 90	0. 298	0. 241 ( 0. 269)		0. 058
170	14. 17	0. 90	0. 298	0. 239 ( 0. 269)		0. 059
171	14. 25	0. 90	0. 298	0. 238 ( 0. 269)		0. 060
172	14. 33	0. 87	0. 287	0. 237 ( 0. 259)		0. 050
173	14. 42	0. 87	0. 287	0. 236 ( 0. 259)		0. 052
174	14. 50	0. 87	0. 287	0. 235 ( 0. 259)		0. 053
175	14. 58	0. 87	0. 287	0. 233 ( 0. 259)		0. 054
176	14. 67	0. 87	0. 287	0. 232 ( 0. 259)		0. 055
177	14. 75	0. 87	0. 287	0. 231 ( 0. 259)		0. 056
178	14. 83	0. 83	0. 276	0. 230 ( 0. 249)		0. 047
179	14. 92	0. 83	0. 276	0. 229 ( 0. 249)		0. 048
180	15. 00	0. 83	0. 276	0. 227 ( 0. 249)		0. 049
181	15. 08	0. 80	0. 265	0. 226 ( 0. 239)		0. 039
182	15. 17	0. 80	0. 265	0. 225 ( 0. 239)		0. 040
183	15. 25	0. 80	0. 265	0. 224 ( 0. 239)		0. 041
184	15. 33	0. 77	0. 254	0. 223 ( 0. 229)		0. 031
185	15. 42	0. 77	0. 254	0. 222 ( 0. 229)		0. 033
186	15. 50	0. 77	0. 254	0. 221 ( 0. 229)		0. 034
187	15. 58	0. 63	0. 210	( 0. 219)	0. 189	0. 021
188	15. 67	0. 63	0. 210	( 0. 218)	0. 189	0. 021
189	15. 75	0. 63	0. 210	( 0. 217)	0. 189	0. 021

190	15.83	0.63	0.210	(	0.216)	0.189	0.021
191	15.92	0.63	0.210	(	0.215)	0.189	0.021
192	16.00	0.63	0.210	(	0.214)	0.189	0.021
193	16.08	0.13	0.044	(	0.213)	0.040	0.004
194	16.17	0.13	0.044	(	0.212)	0.040	0.004
195	16.25	0.13	0.044	(	0.211)	0.040	0.004
196	16.33	0.13	0.044	(	0.210)	0.040	0.004
197	16.42	0.13	0.044	(	0.208)	0.040	0.004
198	16.50	0.13	0.044	(	0.207)	0.040	0.004
199	16.58	0.10	0.033	(	0.206)	0.030	0.003
200	16.67	0.10	0.033	(	0.205)	0.030	0.003
201	16.75	0.10	0.033	(	0.204)	0.030	0.003
202	16.83	0.10	0.033	(	0.203)	0.030	0.003
203	16.92	0.10	0.033	(	0.202)	0.030	0.003
204	17.00	0.10	0.033	(	0.201)	0.030	0.003
205	17.08	0.17	0.055	(	0.200)	0.050	0.006
206	17.17	0.17	0.055	(	0.199)	0.050	0.006
207	17.25	0.17	0.055	(	0.198)	0.050	0.006
208	17.33	0.17	0.055	(	0.197)	0.050	0.006
209	17.42	0.17	0.055	(	0.196)	0.050	0.006
210	17.50	0.17	0.055	(	0.195)	0.050	0.006
211	17.58	0.17	0.055	(	0.194)	0.050	0.006
212	17.67	0.17	0.055	(	0.193)	0.050	0.006
213	17.75	0.17	0.055	(	0.192)	0.050	0.006
214	17.83	0.13	0.044	(	0.191)	0.040	0.004
215	17.92	0.13	0.044	(	0.190)	0.040	0.004
216	18.00	0.13	0.044	(	0.189)	0.040	0.004
217	18.08	0.13	0.044	(	0.188)	0.040	0.004
218	18.17	0.13	0.044	(	0.188)	0.040	0.004
219	18.25	0.13	0.044	(	0.187)	0.040	0.004
220	18.33	0.13	0.044	(	0.186)	0.040	0.004
221	18.42	0.13	0.044	(	0.185)	0.040	0.004
222	18.50	0.13	0.044	(	0.184)	0.040	0.004
223	18.58	0.10	0.033	(	0.183)	0.030	0.003
224	18.67	0.10	0.033	(	0.182)	0.030	0.003
225	18.75	0.10	0.033	(	0.181)	0.030	0.003
226	18.83	0.07	0.022	(	0.180)	0.020	0.002
227	18.92	0.07	0.022	(	0.180)	0.020	0.002
228	19.00	0.07	0.022	(	0.179)	0.020	0.002
229	19.08	0.10	0.033	(	0.178)	0.030	0.003
230	19.17	0.10	0.033	(	0.177)	0.030	0.003
231	19.25	0.10	0.033	(	0.176)	0.030	0.003
232	19.33	0.13	0.044	(	0.175)	0.040	0.004
233	19.42	0.13	0.044	(	0.175)	0.040	0.004
234	19.50	0.13	0.044	(	0.174)	0.040	0.004
235	19.58	0.10	0.033	(	0.173)	0.030	0.003
236	19.67	0.10	0.033	(	0.172)	0.030	0.003
237	19.75	0.10	0.033	(	0.171)	0.030	0.003
238	19.83	0.07	0.022	(	0.171)	0.020	0.002
239	19.92	0.07	0.022	(	0.170)	0.020	0.002
240	20.00	0.07	0.022	(	0.169)	0.020	0.002
241	20.08	0.10	0.033	(	0.168)	0.030	0.003
242	20.17	0.10	0.033	(	0.168)	0.030	0.003
243	20.25	0.10	0.033	(	0.167)	0.030	0.003
244	20.33	0.10	0.033	(	0.166)	0.030	0.003
245	20.42	0.10	0.033	(	0.165)	0.030	0.003
246	20.50	0.10	0.033	(	0.165)	0.030	0.003
247	20.58	0.10	0.033	(	0.164)	0.030	0.003
248	20.67	0.10	0.033	(	0.163)	0.030	0.003
249	20.75	0.10	0.033	(	0.163)	0.030	0.003
250	20.83	0.07	0.022	(	0.162)	0.020	0.002
251	20.92	0.07	0.022	(	0.161)	0.020	0.002
252	21.00	0.07	0.022	(	0.161)	0.020	0.002
253	21.08	0.10	0.033	(	0.160)	0.030	0.003
254	21.17	0.10	0.033	(	0.159)	0.030	0.003
255	21.25	0.10	0.033	(	0.159)	0.030	0.003
256	21.33	0.07	0.022	(	0.158)	0.020	0.002
257	21.42	0.07	0.022	(	0.158)	0.020	0.002
258	21.50	0.07	0.022	(	0.157)	0.020	0.002
259	21.58	0.10	0.033	(	0.156)	0.030	0.003
260	21.67	0.10	0.033	(	0.156)	0.030	0.003
261	21.75	0.10	0.033	(	0.155)	0.030	0.003



2+ 5	0. 0011	0. 01	Q
2+10	0. 0012	0. 01	Q
2+15	0. 0012	0. 01	Q
2+20	0. 0013	0. 01	Q
2+25	0. 0013	0. 01	Q
2+30	0. 0014	0. 01	QV
2+35	0. 0015	0. 01	QV
2+40	0. 0015	0. 01	QV
2+45	0. 0016	0. 01	QV
2+50	0. 0017	0. 01	QV
2+55	0. 0017	0. 01	QV
3+ 0	0. 0018	0. 01	QV
3+ 5	0. 0019	0. 01	QV
3+10	0. 0019	0. 01	QV
3+15	0. 0020	0. 01	QV
3+20	0. 0021	0. 01	QV
3+25	0. 0022	0. 01	QV
3+30	0. 0022	0. 01	QV
3+35	0. 0023	0. 01	QV
3+40	0. 0024	0. 01	QV
3+45	0. 0024	0. 01	QV
3+50	0. 0025	0. 01	QV
3+55	0. 0026	0. 01	QV
4+ 0	0. 0027	0. 01	QV
4+ 5	0. 0028	0. 01	Q V
4+10	0. 0029	0. 01	Q V
4+15	0. 0029	0. 01	Q V
4+20	0. 0030	0. 01	Q V
4+25	0. 0031	0. 01	Q V
4+30	0. 0032	0. 01	Q V
4+35	0. 0033	0. 01	Q V
4+40	0. 0034	0. 01	Q V
4+45	0. 0035	0. 01	Q V
4+50	0. 0036	0. 02	Q V
4+55	0. 0037	0. 02	Q V
5+ 0	0. 0039	0. 02	Q V
5+ 5	0. 0039	0. 01	Q V
5+10	0. 0040	0. 01	Q V
5+15	0. 0041	0. 01	Q V
5+20	0. 0042	0. 01	Q V
5+25	0. 0043	0. 01	Q V
5+30	0. 0044	0. 01	Q V
5+35	0. 0045	0. 02	Q V
5+40	0. 0046	0. 02	Q V
5+45	0. 0047	0. 02	Q V
5+50	0. 0048	0. 02	Q V
5+55	0. 0050	0. 02	Q V
6+ 0	0. 0051	0. 02	Q V
6+ 5	0. 0052	0. 02	Q V
6+10	0. 0053	0. 02	Q V
6+15	0. 0054	0. 02	Q V
6+20	0. 0056	0. 02	Q V
6+25	0. 0057	0. 02	Q V
6+30	0. 0058	0. 02	Q V
6+35	0. 0060	0. 02	Q V
6+40	0. 0061	0. 02	Q V
6+45	0. 0062	0. 02	Q V
6+50	0. 0064	0. 02	Q V
6+55	0. 0065	0. 02	Q V
7+ 0	0. 0067	0. 02	Q V
7+ 5	0. 0068	0. 02	Q V
7+10	0. 0069	0. 02	Q V
7+15	0. 0071	0. 02	Q V
7+20	0. 0072	0. 02	Q V
7+25	0. 0074	0. 02	Q V
7+30	0. 0075	0. 02	Q V
7+35	0. 0077	0. 02	Q V
7+40	0. 0079	0. 02	Q V
7+45	0. 0080	0. 02	Q V
7+50	0. 0082	0. 03	Q V
7+55	0. 0084	0. 03	Q V
8+ 0	0. 0086	0. 03	Q V

8+ 5	0. 0088	0. 03	Q	V			
8+10	0. 0090	0. 03	Q	V			
8+15	0. 0092	0. 03	Q	V			
8+20	0. 0094	0. 03	Q	V			
8+25	0. 0096	0. 03	Q	V			
8+30	0. 0099	0. 03	Q	V			
8+35	0. 0101	0. 03	Q	V			
8+40	0. 0103	0. 03	Q	V			
8+45	0. 0105	0. 03	Q	V			
8+50	0. 0108	0. 03	Q	V			
8+55	0. 0110	0. 03	Q	V			
9+ 0	0. 0112	0. 03	Q	V			
9+ 5	0. 0115	0. 04	Q	V			
9+10	0. 0118	0. 04	Q	V			
9+15	0. 0120	0. 04	Q	V			
9+20	0. 0123	0. 04	Q	V			
9+25	0. 0126	0. 04	Q	V			
9+30	0. 0129	0. 04	Q	V			
9+35	0. 0132	0. 04	Q	V			
9+40	0. 0135	0. 04	Q	V			
9+45	0. 0137	0. 04	Q	V			
9+50	0. 0141	0. 04	Q	V			
9+55	0. 0144	0. 04	Q	V			
10+ 0	0. 0147	0. 04	Q	V			
10+ 5	0. 0149	0. 03	Q	V			
10+10	0. 0151	0. 03	Q	V			
10+15	0. 0153	0. 03	Q	V			
10+20	0. 0155	0. 03	Q	V			
10+25	0. 0157	0. 03	Q	V			
10+30	0. 0159	0. 03	Q	V			
10+35	0. 0162	0. 04	Q	V			
10+40	0. 0165	0. 04	Q	V			
10+45	0. 0168	0. 04	Q	V			
10+50	0. 0170	0. 04	Q	V			
10+55	0. 0173	0. 04	Q	V			
11+ 0	0. 0176	0. 04	Q	V			
11+ 5	0. 0179	0. 04	Q	V			
11+10	0. 0181	0. 04	Q	V			
11+15	0. 0184	0. 04	Q	V			
11+20	0. 0187	0. 04	Q	V			
11+25	0. 0189	0. 04	Q	V			
11+30	0. 0192	0. 04	Q	V			
11+35	0. 0194	0. 03	Q	V			
11+40	0. 0197	0. 03	Q	V			
11+45	0. 0199	0. 03	Q	V			
11+50	0. 0202	0. 04	Q	V			
11+55	0. 0204	0. 04	Q	V			
12+ 0	0. 0207	0. 04	Q	V			
12+ 5	0. 0210	0. 05	Q	V			
12+10	0. 0214	0. 05	Q	V			
12+15	0. 0217	0. 05	Q	V			
12+20	0. 0221	0. 05	Q	V			
12+25	0. 0224	0. 05	Q	V			
12+30	0. 0228	0. 05	Q	V			
12+35	0. 0234	0. 08	Q	V			
12+40	0. 0240	0. 09	Q	V			
12+45	0. 0246	0. 09	Q	V			
12+50	0. 0254	0. 11	Q	V			
12+55	0. 0261	0. 11	Q	V			
13+ 0	0. 0269	0. 12	Q	V			
13+ 5	0. 0285	0. 22	Q	V			
13+10	0. 0300	0. 22	Q	V			
13+15	0. 0315	0. 22	Q	V			
13+20	0. 0331	0. 23	Q	V			
13+25	0. 0347	0. 23	Q	V			
13+30	0. 0363	0. 23	Q	V			
13+35	0. 0366	0. 05	Q	V			
13+40	0. 0369	0. 05	Q	V			
13+45	0. 0373	0. 05	Q	V			
13+50	0. 0376	0. 05	Q	V			
13+55	0. 0379	0. 05	Q	V			
14+ 0	0. 0382	0. 05	Q	V			



20+ 5	0.0531	0.01	Q				V
20+10	0.0532	0.01	Q				V
20+15	0.0532	0.01	Q				V
20+20	0.0533	0.01	Q				V
20+25	0.0533	0.01	Q				V
20+30	0.0534	0.01	Q				V
20+35	0.0534	0.01	Q				V
20+40	0.0534	0.01	Q				V
20+45	0.0535	0.01	Q				V
20+50	0.0535	0.00	Q				V
20+55	0.0535	0.00	Q				V
21+ 0	0.0536	0.00	Q				V
21+ 5	0.0536	0.01	Q				V
21+10	0.0537	0.01	Q				V
21+15	0.0537	0.01	Q				V
21+20	0.0537	0.00	Q				V
21+25	0.0537	0.00	Q				V
21+30	0.0538	0.00	Q				V
21+35	0.0538	0.01	Q				V
21+40	0.0539	0.01	Q				V
21+45	0.0539	0.01	Q				V
21+50	0.0539	0.00	Q				V
21+55	0.0540	0.00	Q				V
22+ 0	0.0540	0.00	Q				V
22+ 5	0.0540	0.01	Q				V
22+10	0.0541	0.01	Q				V
22+15	0.0541	0.01	Q				V
22+20	0.0541	0.00	Q				V
22+25	0.0542	0.00	Q				V
22+30	0.0542	0.00	Q				V
22+35	0.0542	0.00	Q				V
22+40	0.0543	0.00	Q				V
22+45	0.0543	0.00	Q				V
22+50	0.0543	0.00	Q				V
22+55	0.0543	0.00	Q				V
23+ 0	0.0544	0.00	Q				V
23+ 5	0.0544	0.00	Q				V
23+10	0.0544	0.00	Q				V
23+15	0.0544	0.00	Q				V
23+20	0.0545	0.00	Q				V
23+25	0.0545	0.00	Q				V
23+30	0.0545	0.00	Q				V
23+35	0.0546	0.00	Q				V
23+40	0.0546	0.00	Q				V
23+45	0.0546	0.00	Q				V
23+50	0.0546	0.00	Q				V
23+55	0.0547	0.00	Q				V
24+ 0	0.0547	0.00	Q				V

## PROPOSED CONDITION

Unit Hydrograph Analysis

Copyright (c) CIVILCADD/CIVILDESIGN, 1989 - 2014, Version 9.0  
Study date 01/23/23 File: 4130PW102410.out

+++++

Riverside County Synthetic Unit Hydrology Method  
RCFC & WCD Manual date - April 1978

Program License Serial Number 6400

English (in-lb) Input Units Used  
English Rainfall Data (Inches) Input Values Used

English Units used in output format

SOUTH NANCE TRAILER YARD - PERRIS  
PROPOSED CONDITION - WEST  
HYDROLOGIC ANALYSIS - 10-YEAR

Drainage Area = 1.82(Ac.) = 0.003 Sq. Mi.  
Drainage Area for Depth-Area Areal Adj. = 1.82(Ac.) = 0.003 Sq. Mi.  
USER Entry of lag time in hours  
Lag time = 0.000 Hr.  
Lag time = 0.00 Min.  
25% of lag time = 0.00 Min.  
40% of lag time = 0.00 Min.  
Unit time = 5.00 Min.  
Duration of storm = 24 Hour(s)  
User Entered Base Flow = 0.00(CFS)

2 YEAR Area rainfall data:

Area(Ac.) [1]	Rainfall (In) [2]	Weighting[1*2]
1.82	1.62	2.95

100 YEAR Area rainfall data:

Area(Ac.) [1]	Rainfall (In) [2]	Weighting[1*2]
1.82	4.40	8.01

STORM EVENT (YEAR) = 10.00  
Area Averaged 2-Year Rainfall = 1.620(In)  
Area Averaged 100-Year Rainfall = 4.400(In)

Point rain (area averaged) = 2.764(In)  
Areal adjustment factor = 100.00 %  
Adjusted average point rain = 2.764(In)

Sub-Area Data:

Area(Ac.)	Runoff Index	Impervious %
1.820	56.00	0.900
Total Area Entered = 1.82(Ac.)		

RI	RI	Infil. Rate	Impervious	Adj. Infil. Rate	Area%	F
AMC2	AMC-2	(In/Hr)	(Dec. %)	(In/Hr)	(Dec.)	(In/Hr)
56.0	56.0	0.511	0.900	0.097	1.000	0.097

Sum (F) = 0.097

Area averaged mean soil loss (F) (In/Hr) = 0.097  
 Minimum soil loss rate ((In/Hr)) = 0.049  
 (for 24 hour storm duration)  
 Soil loss rate (decimal) = 0.180

Unit Hydrograph  
VALLEY S-Curve

Unit Hydrograph Data

Unit time period (hrs)	Time % of lag	Distribution Graph %	Unit Hydrograph (CFS)
1	0.083	1. #I0	1.834
		Sum = 100.000	Sum= 1.834

The following loss rate calculations reflect use of the minimum calculated loss rate subtracted from the Storm Rain to produce the maximum Effective Rain value

Unit	Time (Hr.)	Pattern Percent	Storm Rain (In/Hr)	Loss rate(In. /Hr)		Effective (In/Hr)
				Max	Low	
1	0.08	0.07	0.022	( 0.172)	0.004	0.018
2	0.17	0.07	0.022	( 0.171)	0.004	0.018
3	0.25	0.07	0.022	( 0.171)	0.004	0.018
4	0.33	0.10	0.033	( 0.170)	0.006	0.027
5	0.42	0.10	0.033	( 0.169)	0.006	0.027
6	0.50	0.10	0.033	( 0.169)	0.006	0.027
7	0.58	0.10	0.033	( 0.168)	0.006	0.027
8	0.67	0.10	0.033	( 0.167)	0.006	0.027
9	0.75	0.10	0.033	( 0.167)	0.006	0.027
10	0.83	0.13	0.044	( 0.166)	0.008	0.036
11	0.92	0.13	0.044	( 0.165)	0.008	0.036
12	1.00	0.13	0.044	( 0.165)	0.008	0.036
13	1.08	0.10	0.033	( 0.164)	0.006	0.027
14	1.17	0.10	0.033	( 0.163)	0.006	0.027
15	1.25	0.10	0.033	( 0.163)	0.006	0.027
16	1.33	0.10	0.033	( 0.162)	0.006	0.027
17	1.42	0.10	0.033	( 0.162)	0.006	0.027
18	1.50	0.10	0.033	( 0.161)	0.006	0.027
19	1.58	0.10	0.033	( 0.160)	0.006	0.027
20	1.67	0.10	0.033	( 0.160)	0.006	0.027
21	1.75	0.10	0.033	( 0.159)	0.006	0.027
22	1.83	0.13	0.044	( 0.158)	0.008	0.036
23	1.92	0.13	0.044	( 0.158)	0.008	0.036
24	2.00	0.13	0.044	( 0.157)	0.008	0.036
25	2.08	0.13	0.044	( 0.156)	0.008	0.036
26	2.17	0.13	0.044	( 0.156)	0.008	0.036
27	2.25	0.13	0.044	( 0.155)	0.008	0.036
28	2.33	0.13	0.044	( 0.155)	0.008	0.036
29	2.42	0.13	0.044	( 0.154)	0.008	0.036
30	2.50	0.13	0.044	( 0.153)	0.008	0.036
31	2.58	0.17	0.055	( 0.153)	0.010	0.045
32	2.67	0.17	0.055	( 0.152)	0.010	0.045
33	2.75	0.17	0.055	( 0.151)	0.010	0.045
34	2.83	0.17	0.055	( 0.151)	0.010	0.045
35	2.92	0.17	0.055	( 0.150)	0.010	0.045
36	3.00	0.17	0.055	( 0.150)	0.010	0.045
37	3.08	0.17	0.055	( 0.149)	0.010	0.045
38	3.17	0.17	0.055	( 0.148)	0.010	0.045
39	3.25	0.17	0.055	( 0.148)	0.010	0.045
40	3.33	0.17	0.055	( 0.147)	0.010	0.045
41	3.42	0.17	0.055	( 0.146)	0.010	0.045
42	3.50	0.17	0.055	( 0.146)	0.010	0.045
43	3.58	0.17	0.055	( 0.145)	0.010	0.045
44	3.67	0.17	0.055	( 0.145)	0.010	0.045
45	3.75	0.17	0.055	( 0.144)	0.010	0.045

46	3.83	0.20	0.066	( 0.143)	0.012	0.054
47	3.92	0.20	0.066	( 0.143)	0.012	0.054
48	4.00	0.20	0.066	( 0.142)	0.012	0.054
49	4.08	0.20	0.066	( 0.142)	0.012	0.054
50	4.17	0.20	0.066	( 0.141)	0.012	0.054
51	4.25	0.20	0.066	( 0.140)	0.012	0.054
52	4.33	0.23	0.077	( 0.140)	0.014	0.063
53	4.42	0.23	0.077	( 0.139)	0.014	0.063
54	4.50	0.23	0.077	( 0.139)	0.014	0.063
55	4.58	0.23	0.077	( 0.138)	0.014	0.063
56	4.67	0.23	0.077	( 0.137)	0.014	0.063
57	4.75	0.23	0.077	( 0.137)	0.014	0.063
58	4.83	0.27	0.088	( 0.136)	0.016	0.073
59	4.92	0.27	0.088	( 0.136)	0.016	0.073
60	5.00	0.27	0.088	( 0.135)	0.016	0.073
61	5.08	0.20	0.066	( 0.134)	0.012	0.054
62	5.17	0.20	0.066	( 0.134)	0.012	0.054
63	5.25	0.20	0.066	( 0.133)	0.012	0.054
64	5.33	0.23	0.077	( 0.133)	0.014	0.063
65	5.42	0.23	0.077	( 0.132)	0.014	0.063
66	5.50	0.23	0.077	( 0.132)	0.014	0.063
67	5.58	0.27	0.088	( 0.131)	0.016	0.073
68	5.67	0.27	0.088	( 0.130)	0.016	0.073
69	5.75	0.27	0.088	( 0.130)	0.016	0.073
70	5.83	0.27	0.088	( 0.129)	0.016	0.073
71	5.92	0.27	0.088	( 0.129)	0.016	0.073
72	6.00	0.27	0.088	( 0.128)	0.016	0.073
73	6.08	0.30	0.099	( 0.128)	0.018	0.082
74	6.17	0.30	0.099	( 0.127)	0.018	0.082
75	6.25	0.30	0.099	( 0.126)	0.018	0.082
76	6.33	0.30	0.099	( 0.126)	0.018	0.082
77	6.42	0.30	0.099	( 0.125)	0.018	0.082
78	6.50	0.30	0.099	( 0.125)	0.018	0.082
79	6.58	0.33	0.111	( 0.124)	0.020	0.091
80	6.67	0.33	0.111	( 0.124)	0.020	0.091
81	6.75	0.33	0.111	( 0.123)	0.020	0.091
82	6.83	0.33	0.111	( 0.122)	0.020	0.091
83	6.92	0.33	0.111	( 0.122)	0.020	0.091
84	7.00	0.33	0.111	( 0.121)	0.020	0.091
85	7.08	0.33	0.111	( 0.121)	0.020	0.091
86	7.17	0.33	0.111	( 0.120)	0.020	0.091
87	7.25	0.33	0.111	( 0.120)	0.020	0.091
88	7.33	0.37	0.122	( 0.119)	0.022	0.100
89	7.42	0.37	0.122	( 0.119)	0.022	0.100
90	7.50	0.37	0.122	( 0.118)	0.022	0.100
91	7.58	0.40	0.133	( 0.118)	0.024	0.109
92	7.67	0.40	0.133	( 0.117)	0.024	0.109
93	7.75	0.40	0.133	( 0.116)	0.024	0.109
94	7.83	0.43	0.144	( 0.116)	0.026	0.118
95	7.92	0.43	0.144	( 0.115)	0.026	0.118
96	8.00	0.43	0.144	( 0.115)	0.026	0.118
97	8.08	0.50	0.166	( 0.114)	0.030	0.136
98	8.17	0.50	0.166	( 0.114)	0.030	0.136
99	8.25	0.50	0.166	( 0.113)	0.030	0.136
100	8.33	0.50	0.166	( 0.113)	0.030	0.136
101	8.42	0.50	0.166	( 0.112)	0.030	0.136
102	8.50	0.50	0.166	( 0.112)	0.030	0.136
103	8.58	0.53	0.177	( 0.111)	0.032	0.145
104	8.67	0.53	0.177	( 0.111)	0.032	0.145
105	8.75	0.53	0.177	( 0.110)	0.032	0.145
106	8.83	0.57	0.188	( 0.110)	0.034	0.154
107	8.92	0.57	0.188	( 0.109)	0.034	0.154
108	9.00	0.57	0.188	( 0.109)	0.034	0.154
109	9.08	0.63	0.210	( 0.108)	0.038	0.172
110	9.17	0.63	0.210	( 0.108)	0.038	0.172
111	9.25	0.63	0.210	( 0.107)	0.038	0.172
112	9.33	0.67	0.221	( 0.107)	0.040	0.181
113	9.42	0.67	0.221	( 0.106)	0.040	0.181
114	9.50	0.67	0.221	( 0.105)	0.040	0.181
115	9.58	0.70	0.232	( 0.105)	0.042	0.190
116	9.67	0.70	0.232	( 0.104)	0.042	0.190
117	9.75	0.70	0.232	( 0.104)	0.042	0.190

118	9. 83	0. 73	0. 243	( 0. 103)	0. 044	0. 199
119	9. 92	0. 73	0. 243	( 0. 103)	0. 044	0. 199
120	10. 00	0. 73	0. 243	( 0. 102)	0. 044	0. 199
121	10. 08	0. 50	0. 166	( 0. 102)	0. 030	0. 136
122	10. 17	0. 50	0. 166	( 0. 101)	0. 030	0. 136
123	10. 25	0. 50	0. 166	( 0. 101)	0. 030	0. 136
124	10. 33	0. 50	0. 166	( 0. 101)	0. 030	0. 136
125	10. 42	0. 50	0. 166	( 0. 100)	0. 030	0. 136
126	10. 50	0. 50	0. 166	( 0. 100)	0. 030	0. 136
127	10. 58	0. 67	0. 221	( 0. 099)	0. 040	0. 181
128	10. 67	0. 67	0. 221	( 0. 099)	0. 040	0. 181
129	10. 75	0. 67	0. 221	( 0. 098)	0. 040	0. 181
130	10. 83	0. 67	0. 221	( 0. 098)	0. 040	0. 181
131	10. 92	0. 67	0. 221	( 0. 097)	0. 040	0. 181
132	11. 00	0. 67	0. 221	( 0. 097)	0. 040	0. 181
133	11. 08	0. 63	0. 210	( 0. 096)	0. 038	0. 172
134	11. 17	0. 63	0. 210	( 0. 096)	0. 038	0. 172
135	11. 25	0. 63	0. 210	( 0. 095)	0. 038	0. 172
136	11. 33	0. 63	0. 210	( 0. 095)	0. 038	0. 172
137	11. 42	0. 63	0. 210	( 0. 094)	0. 038	0. 172
138	11. 50	0. 63	0. 210	( 0. 094)	0. 038	0. 172
139	11. 58	0. 57	0. 188	( 0. 093)	0. 034	0. 154
140	11. 67	0. 57	0. 188	( 0. 093)	0. 034	0. 154
141	11. 75	0. 57	0. 188	( 0. 092)	0. 034	0. 154
142	11. 83	0. 60	0. 199	( 0. 092)	0. 036	0. 163
143	11. 92	0. 60	0. 199	( 0. 092)	0. 036	0. 163
144	12. 00	0. 60	0. 199	( 0. 091)	0. 036	0. 163
145	12. 08	0. 83	0. 276	( 0. 091)	0. 050	0. 227
146	12. 17	0. 83	0. 276	( 0. 090)	0. 050	0. 227
147	12. 25	0. 83	0. 276	( 0. 090)	0. 050	0. 227
148	12. 33	0. 87	0. 287	( 0. 089)	0. 052	0. 236
149	12. 42	0. 87	0. 287	( 0. 089)	0. 052	0. 236
150	12. 50	0. 87	0. 287	( 0. 088)	0. 052	0. 236
151	12. 58	0. 93	0. 310	( 0. 088)	0. 056	0. 254
152	12. 67	0. 93	0. 310	( 0. 087)	0. 056	0. 254
153	12. 75	0. 93	0. 310	( 0. 087)	0. 056	0. 254
154	12. 83	0. 97	0. 321	( 0. 087)	0. 058	0. 263
155	12. 92	0. 97	0. 321	( 0. 086)	0. 058	0. 263
156	13. 00	0. 97	0. 321	( 0. 086)	0. 058	0. 263
157	13. 08	1. 13	0. 376	( 0. 085)	0. 068	0. 308
158	13. 17	1. 13	0. 376	( 0. 085)	0. 068	0. 308
159	13. 25	1. 13	0. 376	( 0. 084)	0. 068	0. 308
160	13. 33	1. 13	0. 376	( 0. 084)	0. 068	0. 308
161	13. 42	1. 13	0. 376	( 0. 084)	0. 068	0. 308
162	13. 50	1. 13	0. 376	( 0. 083)	0. 068	0. 308
163	13. 58	0. 77	0. 254	( 0. 083)	0. 046	0. 208
164	13. 67	0. 77	0. 254	( 0. 082)	0. 046	0. 208
165	13. 75	0. 77	0. 254	( 0. 082)	0. 046	0. 208
166	13. 83	0. 77	0. 254	( 0. 081)	0. 046	0. 208
167	13. 92	0. 77	0. 254	( 0. 081)	0. 046	0. 208
168	14. 00	0. 77	0. 254	( 0. 081)	0. 046	0. 208
169	14. 08	0. 90	0. 298	( 0. 080)	0. 054	0. 245
170	14. 17	0. 90	0. 298	( 0. 080)	0. 054	0. 245
171	14. 25	0. 90	0. 298	( 0. 079)	0. 054	0. 245
172	14. 33	0. 87	0. 287	( 0. 079)	0. 052	0. 236
173	14. 42	0. 87	0. 287	( 0. 079)	0. 052	0. 236
174	14. 50	0. 87	0. 287	( 0. 078)	0. 052	0. 236
175	14. 58	0. 87	0. 287	( 0. 078)	0. 052	0. 236
176	14. 67	0. 87	0. 287	( 0. 077)	0. 052	0. 236
177	14. 75	0. 87	0. 287	( 0. 077)	0. 052	0. 236
178	14. 83	0. 83	0. 276	( 0. 077)	0. 050	0. 227
179	14. 92	0. 83	0. 276	( 0. 076)	0. 050	0. 227
180	15. 00	0. 83	0. 276	( 0. 076)	0. 050	0. 227
181	15. 08	0. 80	0. 265	( 0. 075)	0. 048	0. 218
182	15. 17	0. 80	0. 265	( 0. 075)	0. 048	0. 218
183	15. 25	0. 80	0. 265	( 0. 075)	0. 048	0. 218
184	15. 33	0. 77	0. 254	( 0. 074)	0. 046	0. 208
185	15. 42	0. 77	0. 254	( 0. 074)	0. 046	0. 208
186	15. 50	0. 77	0. 254	( 0. 073)	0. 046	0. 208
187	15. 58	0. 63	0. 210	( 0. 073)	0. 038	0. 172
188	15. 67	0. 63	0. 210	( 0. 073)	0. 038	0. 172
189	15. 75	0. 63	0. 210	( 0. 072)	0. 038	0. 172

190	15.83	0.63	0.210	( 0.072)	0.038	0.172
191	15.92	0.63	0.210	( 0.072)	0.038	0.172
192	16.00	0.63	0.210	( 0.071)	0.038	0.172
193	16.08	0.13	0.044	( 0.071)	0.008	0.036
194	16.17	0.13	0.044	( 0.071)	0.008	0.036
195	16.25	0.13	0.044	( 0.070)	0.008	0.036
196	16.33	0.13	0.044	( 0.070)	0.008	0.036
197	16.42	0.13	0.044	( 0.069)	0.008	0.036
198	16.50	0.13	0.044	( 0.069)	0.008	0.036
199	16.58	0.10	0.033	( 0.069)	0.006	0.027
200	16.67	0.10	0.033	( 0.068)	0.006	0.027
201	16.75	0.10	0.033	( 0.068)	0.006	0.027
202	16.83	0.10	0.033	( 0.068)	0.006	0.027
203	16.92	0.10	0.033	( 0.067)	0.006	0.027
204	17.00	0.10	0.033	( 0.067)	0.006	0.027
205	17.08	0.17	0.055	( 0.067)	0.010	0.045
206	17.17	0.17	0.055	( 0.066)	0.010	0.045
207	17.25	0.17	0.055	( 0.066)	0.010	0.045
208	17.33	0.17	0.055	( 0.066)	0.010	0.045
209	17.42	0.17	0.055	( 0.065)	0.010	0.045
210	17.50	0.17	0.055	( 0.065)	0.010	0.045
211	17.58	0.17	0.055	( 0.065)	0.010	0.045
212	17.67	0.17	0.055	( 0.064)	0.010	0.045
213	17.75	0.17	0.055	( 0.064)	0.010	0.045
214	17.83	0.13	0.044	( 0.064)	0.008	0.036
215	17.92	0.13	0.044	( 0.063)	0.008	0.036
216	18.00	0.13	0.044	( 0.063)	0.008	0.036
217	18.08	0.13	0.044	( 0.063)	0.008	0.036
218	18.17	0.13	0.044	( 0.063)	0.008	0.036
219	18.25	0.13	0.044	( 0.062)	0.008	0.036
220	18.33	0.13	0.044	( 0.062)	0.008	0.036
221	18.42	0.13	0.044	( 0.062)	0.008	0.036
222	18.50	0.13	0.044	( 0.061)	0.008	0.036
223	18.58	0.10	0.033	( 0.061)	0.006	0.027
224	18.67	0.10	0.033	( 0.061)	0.006	0.027
225	18.75	0.10	0.033	( 0.060)	0.006	0.027
226	18.83	0.07	0.022	( 0.060)	0.004	0.018
227	18.92	0.07	0.022	( 0.060)	0.004	0.018
228	19.00	0.07	0.022	( 0.060)	0.004	0.018
229	19.08	0.10	0.033	( 0.059)	0.006	0.027
230	19.17	0.10	0.033	( 0.059)	0.006	0.027
231	19.25	0.10	0.033	( 0.059)	0.006	0.027
232	19.33	0.13	0.044	( 0.058)	0.008	0.036
233	19.42	0.13	0.044	( 0.058)	0.008	0.036
234	19.50	0.13	0.044	( 0.058)	0.008	0.036
235	19.58	0.10	0.033	( 0.058)	0.006	0.027
236	19.67	0.10	0.033	( 0.057)	0.006	0.027
237	19.75	0.10	0.033	( 0.057)	0.006	0.027
238	19.83	0.07	0.022	( 0.057)	0.004	0.018
239	19.92	0.07	0.022	( 0.057)	0.004	0.018
240	20.00	0.07	0.022	( 0.056)	0.004	0.018
241	20.08	0.10	0.033	( 0.056)	0.006	0.027
242	20.17	0.10	0.033	( 0.056)	0.006	0.027
243	20.25	0.10	0.033	( 0.056)	0.006	0.027
244	20.33	0.10	0.033	( 0.055)	0.006	0.027
245	20.42	0.10	0.033	( 0.055)	0.006	0.027
246	20.50	0.10	0.033	( 0.055)	0.006	0.027
247	20.58	0.10	0.033	( 0.055)	0.006	0.027
248	20.67	0.10	0.033	( 0.054)	0.006	0.027
249	20.75	0.10	0.033	( 0.054)	0.006	0.027
250	20.83	0.07	0.022	( 0.054)	0.004	0.018
251	20.92	0.07	0.022	( 0.054)	0.004	0.018
252	21.00	0.07	0.022	( 0.054)	0.004	0.018
253	21.08	0.10	0.033	( 0.053)	0.006	0.027
254	21.17	0.10	0.033	( 0.053)	0.006	0.027
255	21.25	0.10	0.033	( 0.053)	0.006	0.027
256	21.33	0.07	0.022	( 0.053)	0.004	0.018
257	21.42	0.07	0.022	( 0.053)	0.004	0.018
258	21.50	0.07	0.022	( 0.052)	0.004	0.018
259	21.58	0.10	0.033	( 0.052)	0.006	0.027
260	21.67	0.10	0.033	( 0.052)	0.006	0.027
261	21.75	0.10	0.033	( 0.052)	0.006	0.027



2+ 5	0. 0091	0. 07	QV
2+10	0. 0095	0. 07	QV
2+15	0. 0100	0. 07	QV
2+20	0. 0104	0. 07	QV
2+25	0. 0109	0. 07	QV
2+30	0. 0113	0. 07	QV
2+35	0. 0119	0. 08	QV
2+40	0. 0125	0. 08	QV
2+45	0. 0131	0. 08	QV
2+50	0. 0136	0. 08	QV
2+55	0. 0142	0. 08	QV
3+ 0	0. 0148	0. 08	QV
3+ 5	0. 0154	0. 08	QV
3+10	0. 0159	0. 08	QV
3+15	0. 0165	0. 08	QV
3+20	0. 0171	0. 08	QV
3+25	0. 0176	0. 08	Q V
3+30	0. 0182	0. 08	Q V
3+35	0. 0188	0. 08	Q V
3+40	0. 0194	0. 08	Q V
3+45	0. 0199	0. 08	Q V
3+50	0. 0206	0. 10	Q V
3+55	0. 0213	0. 10	Q V
4+ 0	0. 0220	0. 10	Q V
4+ 5	0. 0227	0. 10	Q V
4+10	0. 0234	0. 10	Q V
4+15	0. 0241	0. 10	Q V
4+20	0. 0249	0. 12	Q V
4+25	0. 0257	0. 12	Q V
4+30	0. 0265	0. 12	Q V
4+35	0. 0273	0. 12	Q V
4+40	0. 0281	0. 12	Q V
4+45	0. 0289	0. 12	Q V
4+50	0. 0298	0. 13	Q V
4+55	0. 0307	0. 13	Q V
5+ 0	0. 0316	0. 13	Q V
5+ 5	0. 0323	0. 10	Q V
5+10	0. 0330	0. 10	Q V
5+15	0. 0337	0. 10	Q V
5+20	0. 0345	0. 12	Q V
5+25	0. 0353	0. 12	Q V
5+30	0. 0361	0. 12	Q V
5+35	0. 0370	0. 13	Q V
5+40	0. 0379	0. 13	Q V
5+45	0. 0388	0. 13	Q V
5+50	0. 0398	0. 13	Q V
5+55	0. 0407	0. 13	Q V
6+ 0	0. 0416	0. 13	Q V
6+ 5	0. 0426	0. 15	Q V
6+10	0. 0437	0. 15	Q V
6+15	0. 0447	0. 15	Q V
6+20	0. 0457	0. 15	Q V
6+25	0. 0467	0. 15	Q V
6+30	0. 0478	0. 15	Q V
6+35	0. 0489	0. 17	Q V
6+40	0. 0501	0. 17	Q V
6+45	0. 0512	0. 17	Q V
6+50	0. 0524	0. 17	Q V
6+55	0. 0535	0. 17	Q V
7+ 0	0. 0547	0. 17	Q V
7+ 5	0. 0558	0. 17	Q V
7+10	0. 0569	0. 17	Q V
7+15	0. 0581	0. 17	Q V
7+20	0. 0593	0. 18	Q V
7+25	0. 0606	0. 18	Q V
7+30	0. 0619	0. 18	Q V
7+35	0. 0632	0. 20	Q V
7+40	0. 0646	0. 20	Q V
7+45	0. 0660	0. 20	Q V
7+50	0. 0675	0. 22	Q V
7+55	0. 0690	0. 22	Q V
8+ 0	0. 0705	0. 22	Q V







20+ 5	0. 3310	0. 05	Q			V
20+10	0. 3313	0. 05	Q			V
20+15	0. 3317	0. 05	Q			V
20+20	0. 3320	0. 05	Q			V
20+25	0. 3324	0. 05	Q			V
20+30	0. 3327	0. 05	Q			V
20+35	0. 3331	0. 05	Q			V
20+40	0. 3334	0. 05	Q			V
20+45	0. 3337	0. 05	Q			V
20+50	0. 3340	0. 03	Q			V
20+55	0. 3342	0. 03	Q			V
21+ 0	0. 3344	0. 03	Q			V
21+ 5	0. 3348	0. 05	Q			V
21+10	0. 3351	0. 05	Q			V
21+15	0. 3355	0. 05	Q			V
21+20	0. 3357	0. 03	Q			V
21+25	0. 3359	0. 03	Q			V
21+30	0. 3362	0. 03	Q			V
21+35	0. 3365	0. 05	Q			V
21+40	0. 3368	0. 05	Q			V
21+45	0. 3372	0. 05	Q			V
21+50	0. 3374	0. 03	Q			V
21+55	0. 3376	0. 03	Q			V
22+ 0	0. 3379	0. 03	Q			V
22+ 5	0. 3382	0. 05	Q			V
22+10	0. 3386	0. 05	Q			V
22+15	0. 3389	0. 05	Q			V
22+20	0. 3391	0. 03	Q			V
22+25	0. 3394	0. 03	Q			V
22+30	0. 3396	0. 03	Q			V
22+35	0. 3398	0. 03	Q			V
22+40	0. 3400	0. 03	Q			V
22+45	0. 3403	0. 03	Q			V
22+50	0. 3405	0. 03	Q			V
22+55	0. 3407	0. 03	Q			V
23+ 0	0. 3410	0. 03	Q			V
23+ 5	0. 3412	0. 03	Q			V
23+10	0. 3414	0. 03	Q			V
23+15	0. 3417	0. 03	Q			V
23+20	0. 3419	0. 03	Q			V
23+25	0. 3421	0. 03	Q			V
23+30	0. 3423	0. 03	Q			V
23+35	0. 3426	0. 03	Q			V
23+40	0. 3428	0. 03	Q			V
23+45	0. 3430	0. 03	Q			V
23+50	0. 3433	0. 03	Q			V
23+55	0. 3435	0. 03	Q			V
24+ 0	0. 3437	0. 03	Q			V

# **APPENDIX D**

## **HYDROLOGY MAPS**

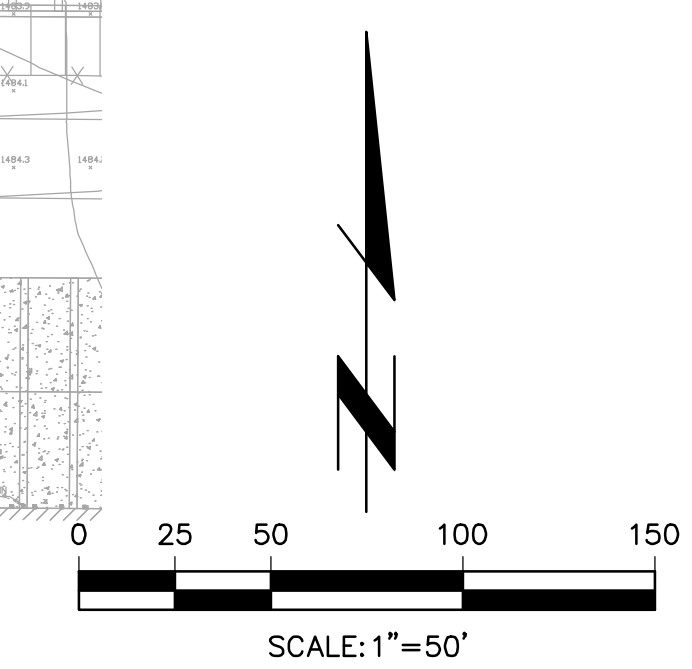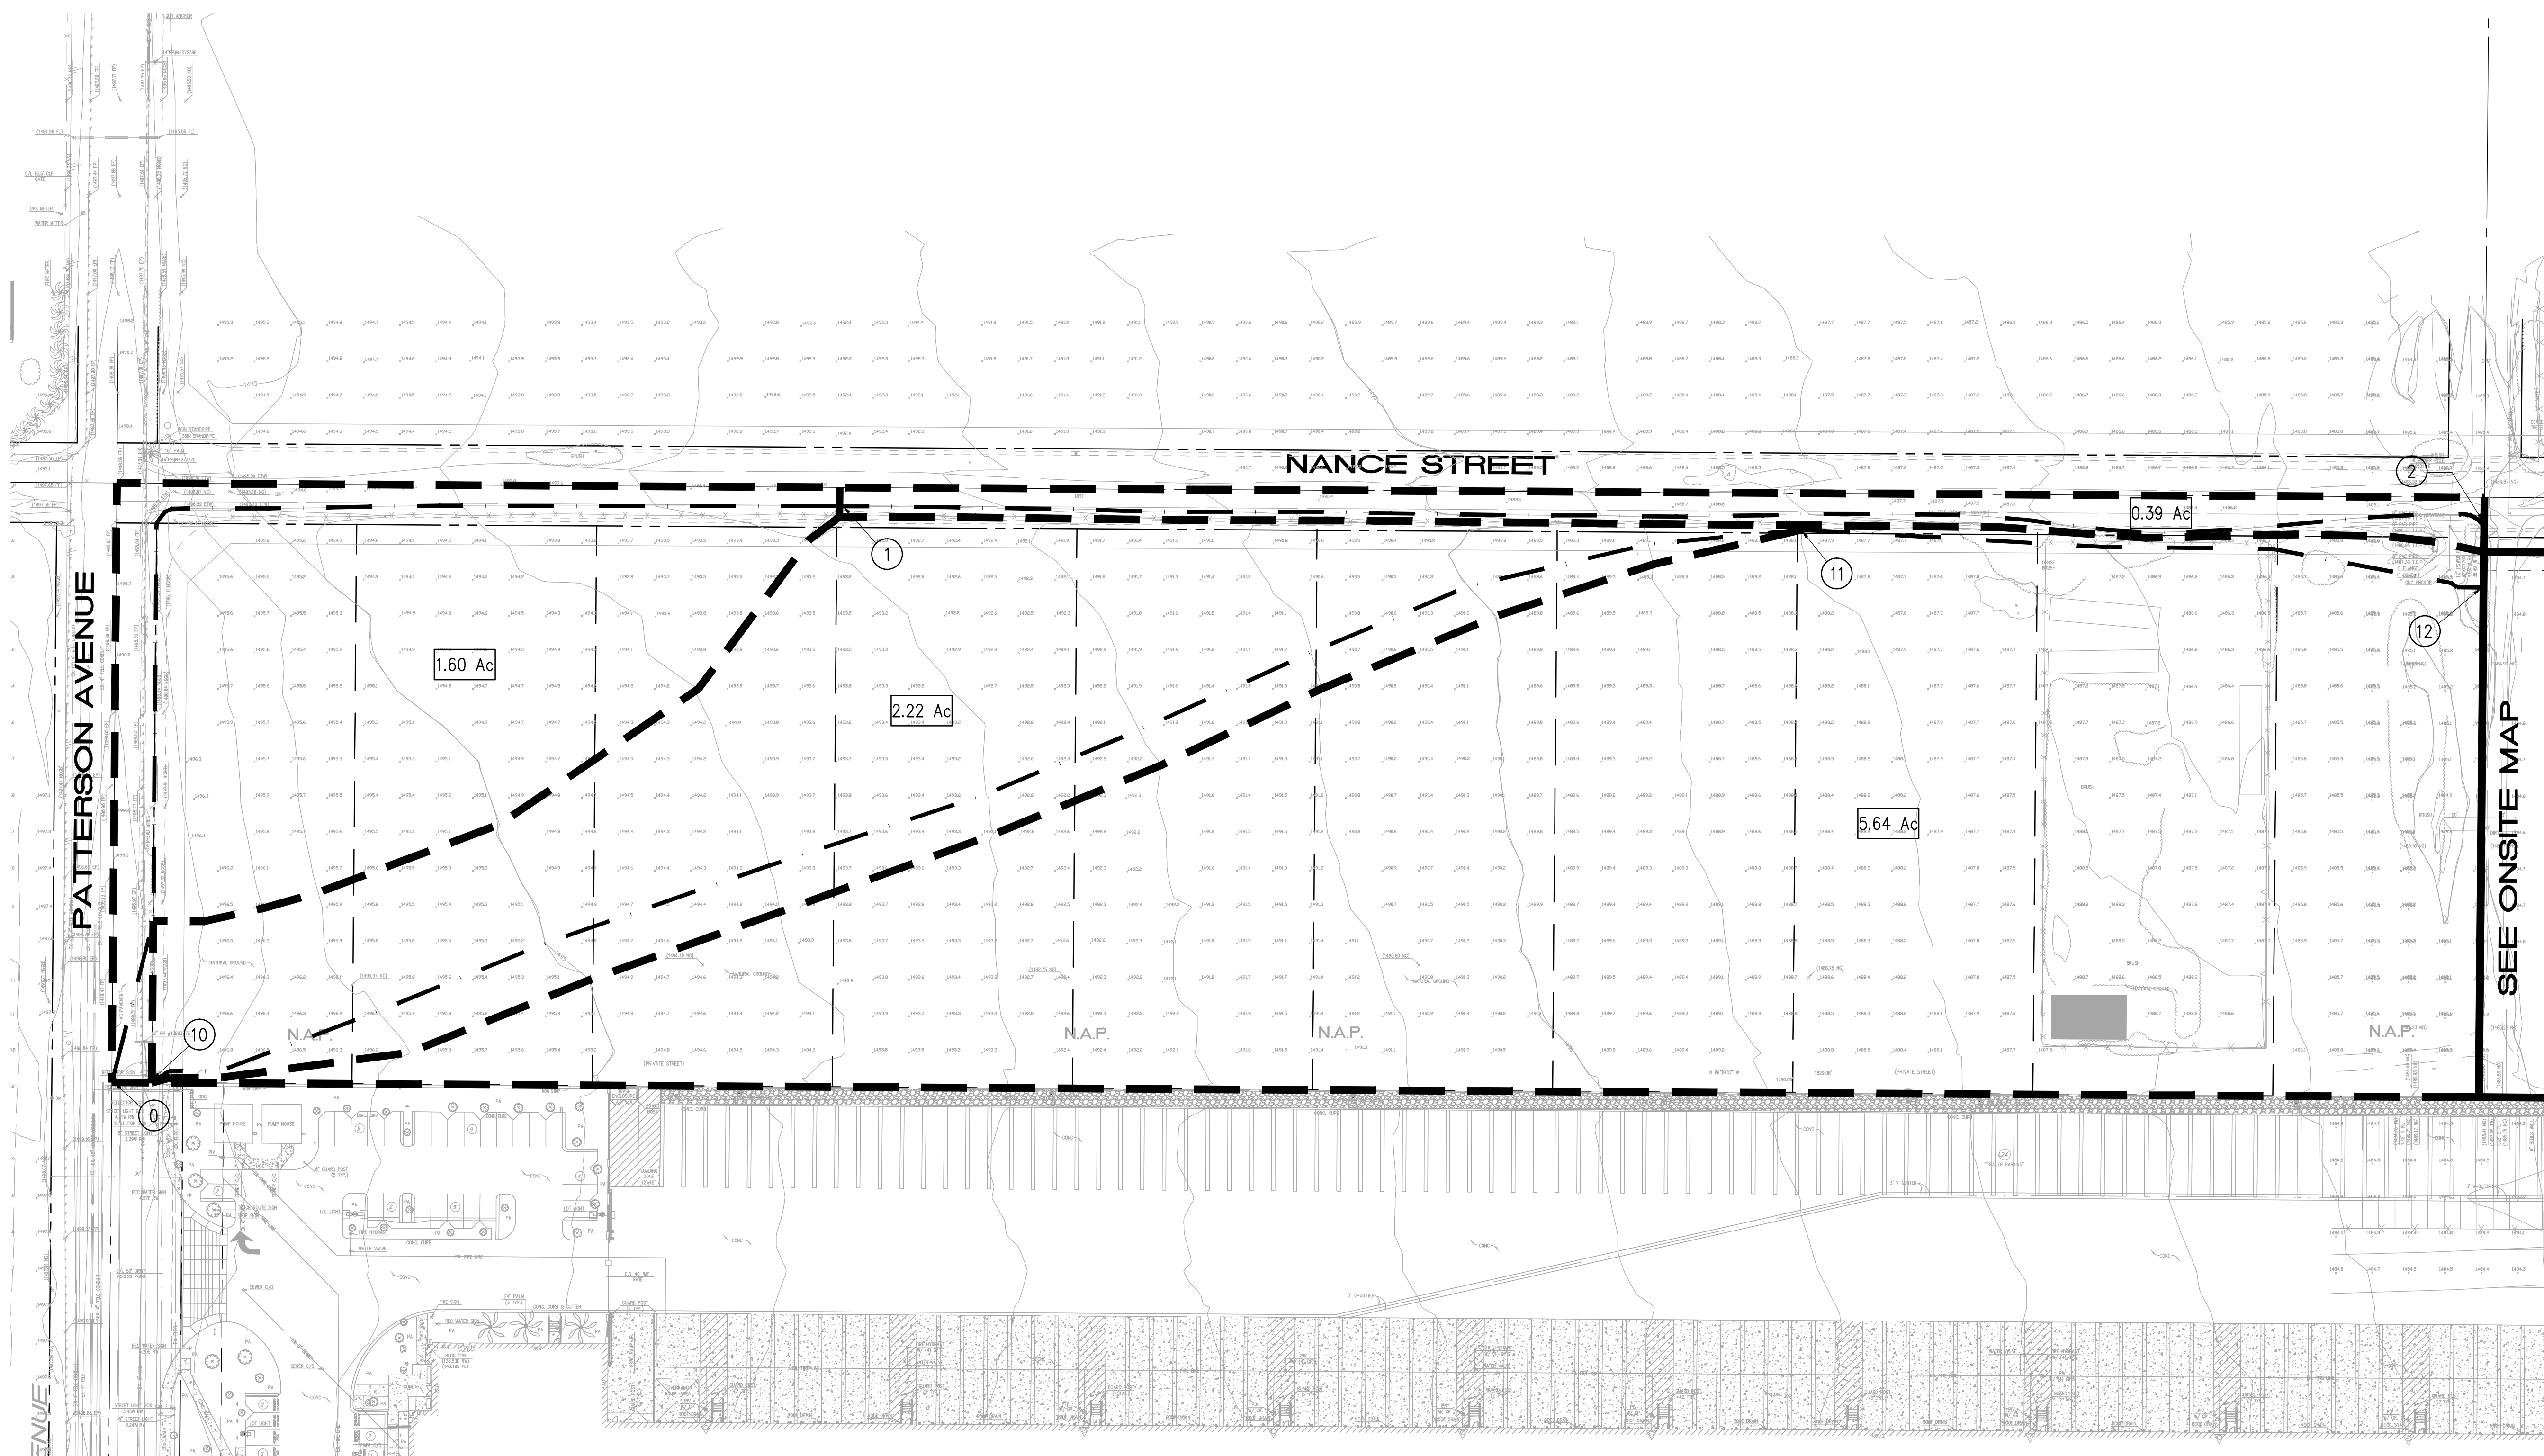


LEGEND	
	PROJECT BOUNDARY
	SUBAREA BOUNDARY
	FLOW PATH
	SUBAREA AREA
	NODE NUMBER


**PREPARED FOR:**  
 LAKE CREEK INDUSTRIAL, LLC  
 1302 BRITTANY CROSS RD.  
 SANTA ANA, CA. 92705  
 CONTACT: BOB KUBICHEK



<b>CITY OF PERRIS</b> PUBLIC WORKS DEPARTMENT	
<b>OFFSITE</b> <b>HYDROLOGY MAP</b> <b>FERRIS TRAILER YARD</b> <b>NANCE ST. AND NEVADA AVE.</b>	
Designed by _____ Date _____	Approved by _____ Date _____
Checked by _____ Date _____	Public Works Director _____ R.C.E. _____
Designed by _____ Date _____	
Checked by _____ Date _____	
Sheet <b>1</b> of <b>1</b> Sheets	JN: 4130

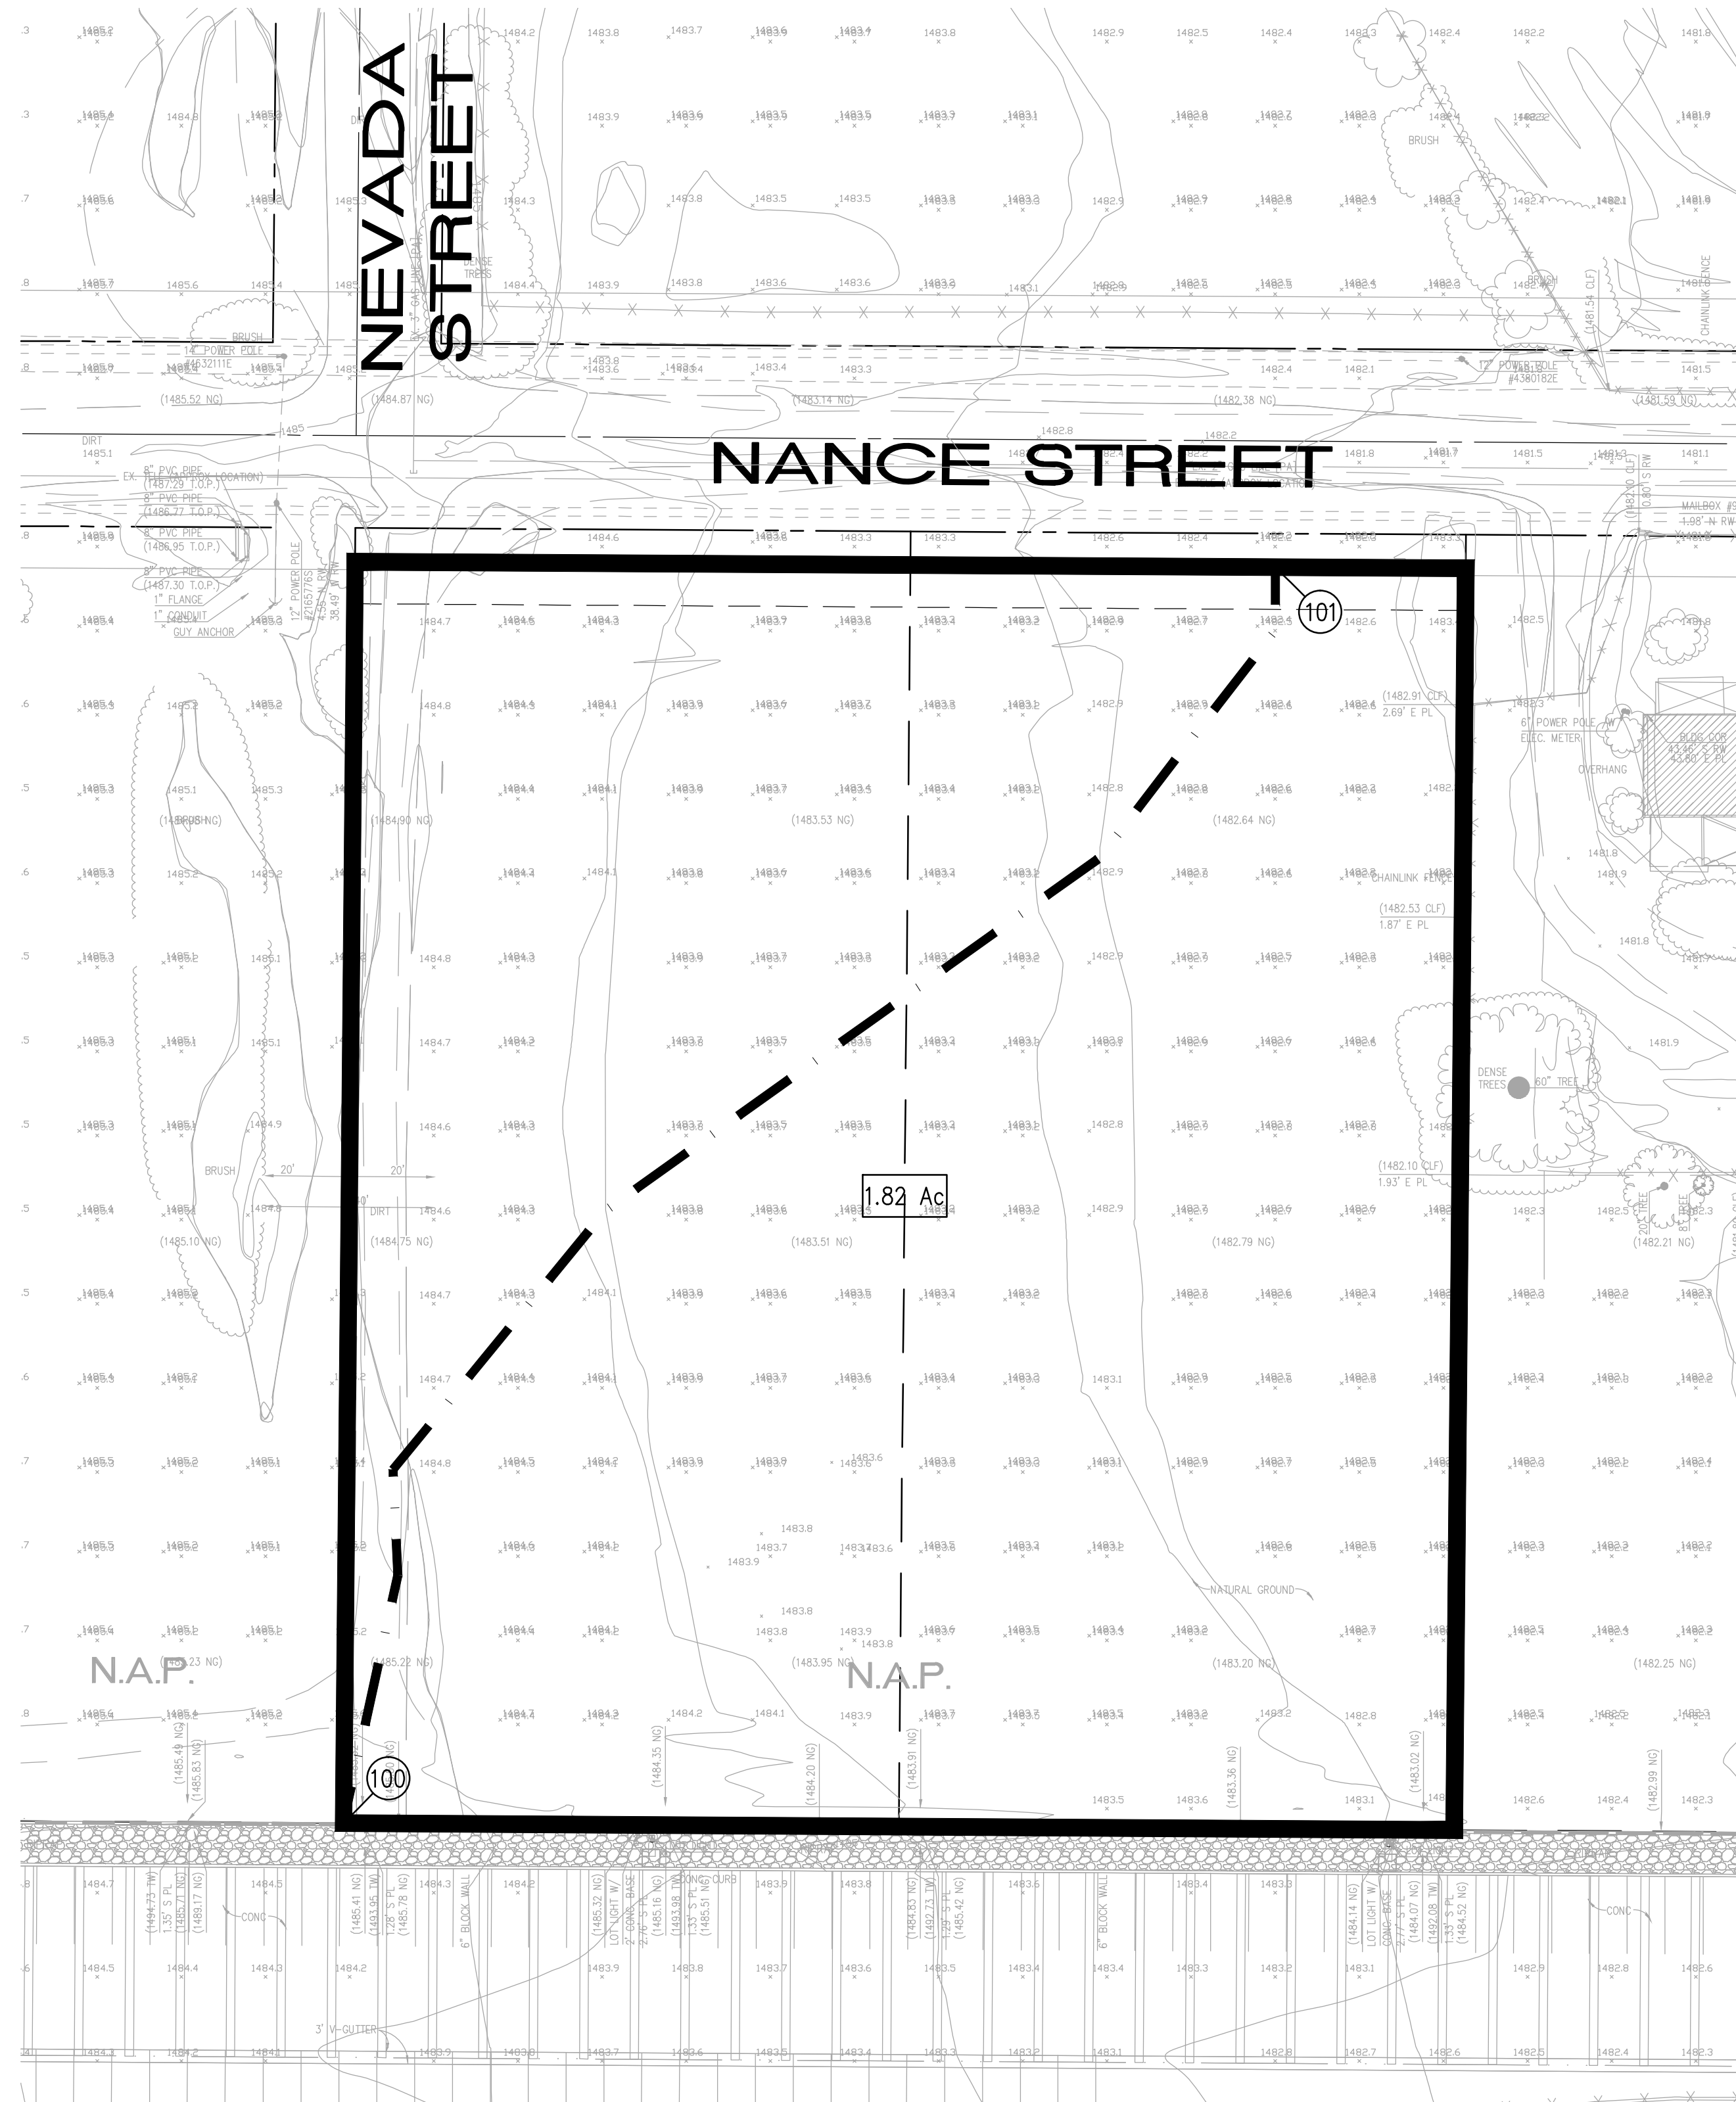

LEGEND	
	PROJECT BOUNDARY
	SUBAREA BOUNDARY
	FLOW PATH
	SUBAREA AREA
	NODE NUMBER

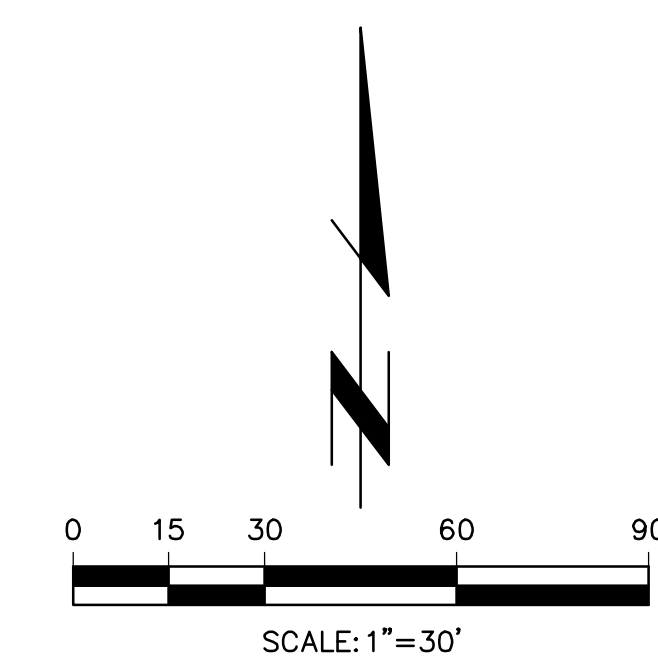


<b>CITY OF PERRIS</b> PUBLIC WORKS DEPARTMENT	
<b>EXISTING CONDITION HYDROLOGY MAP</b>	
<b>PERRIS TRAILER YARD</b>	
<b>NANCE ST. AND NEVADA AVE.</b>	
Designed by _____	Approved by _____ Date _____
Checked by _____	Public Works Director _____ R.C.E. _____
Designed by _____	Sheet <b>1</b> of <b>1</b> Sheets
Checked by _____	
Date _____	

**PREPARED FOR:**  
LAKE CREEK INDUSTRIAL, LLC  
1302 BRITTANY CROSS RD.  
SANTA ANA, CA. 92705  
CONTACT: BOB KUBICHEK






JN- 4130

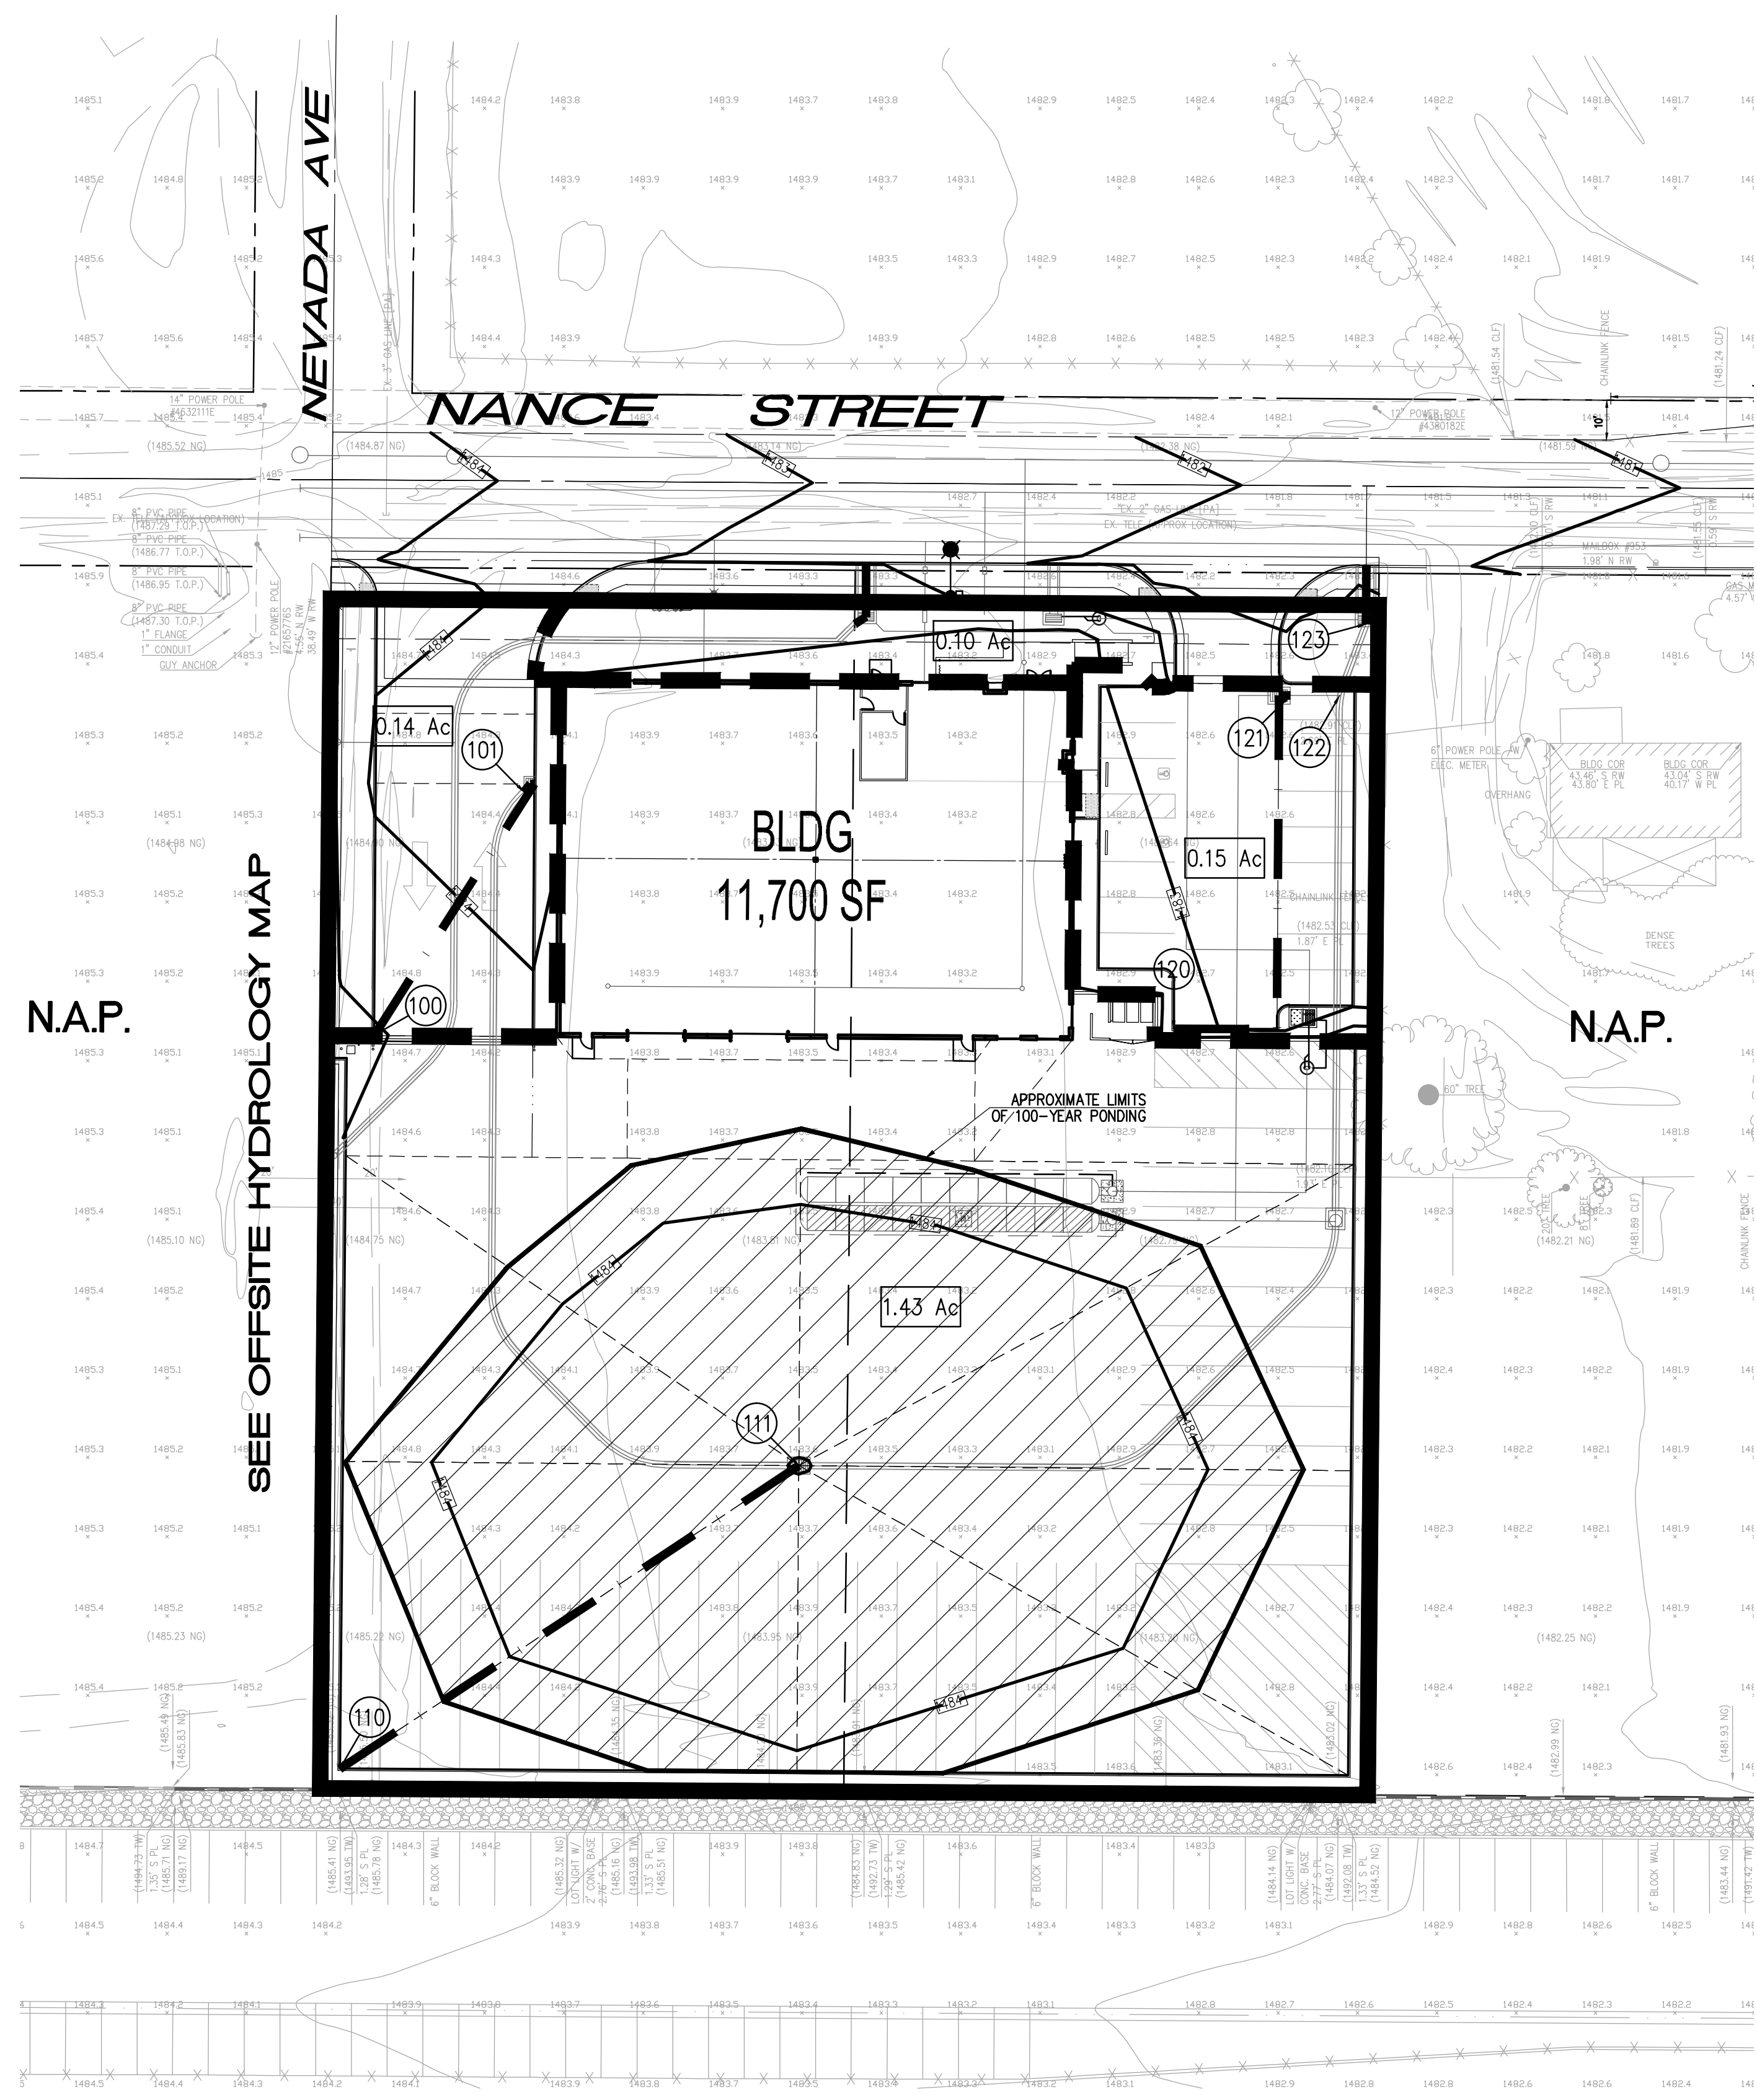

N.A.P.


N.A.P.

SEE OFFSITE HYDROLOGY MAP

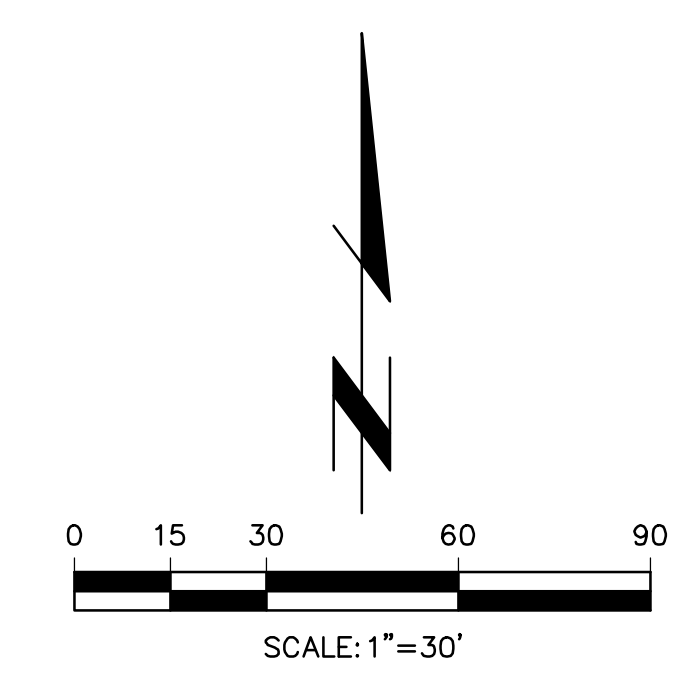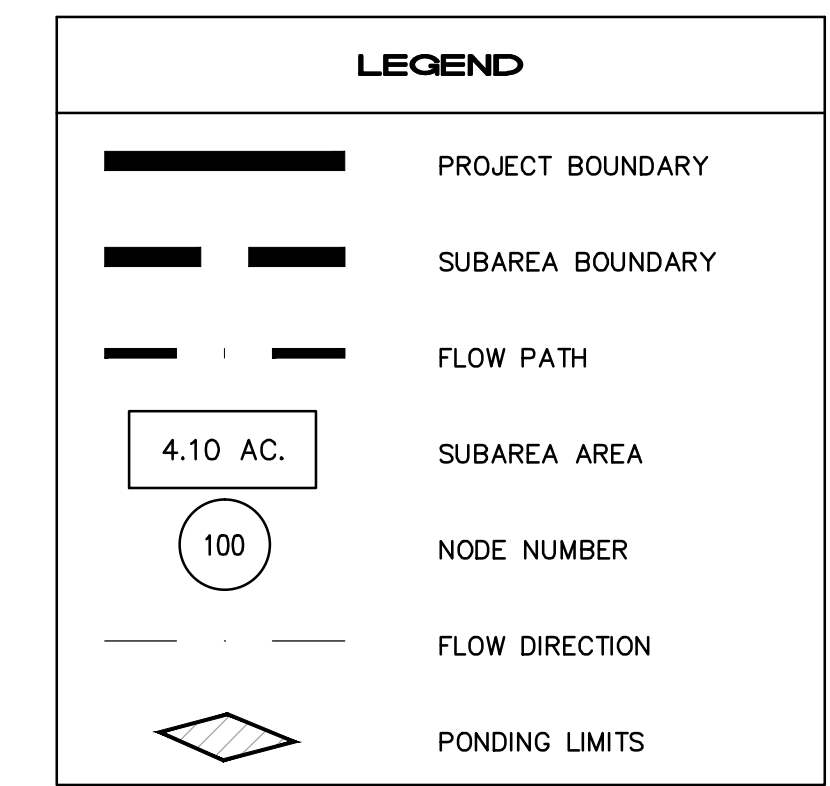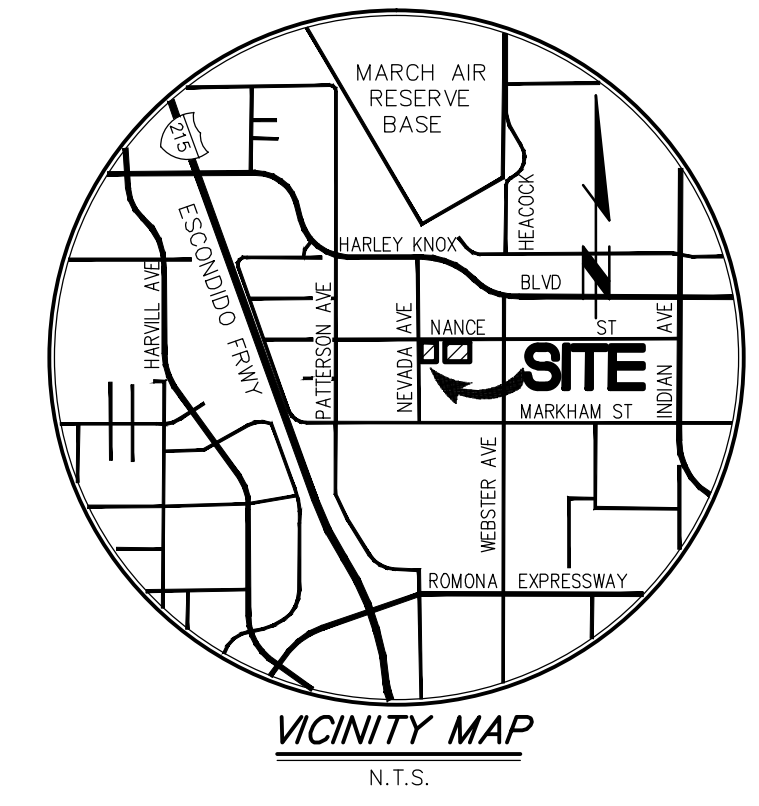

**CITY OF PERRIS**  
PUBLIC WORKS DEPARTMENT  
**PROPOSED CONDITION**  
**HYDROLOGY MAP**  
**PERRIS TRAILER YARD**  
**NANCE ST. AND NEVADA AVE.**

**PREPARED FOR**  
LAKE CREEK INDUSTRIAL, LLC  
1302 BRITTANY CROSS RD.  
SANTA ANA, CA. 92705  
CONTACT: BOB KUBICHEK

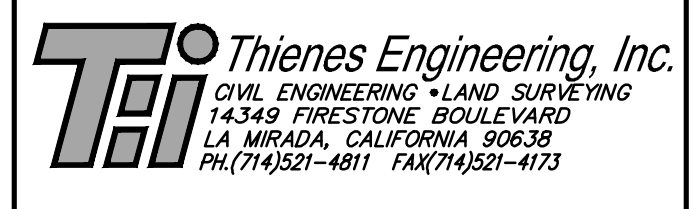

Designed by _____	Approved by _____	Date _____
Checked by _____	Public Works Director _____	R.C.E. XXXXX
Date _____		
Designed by _____		
Date _____		
Checked by _____		
Date _____		
Sheet <b>1</b> of <b>1</b> Sheets		

JN: 4130

DATE: 07/09/2023